DEPARTMENT OF Engineering Physics UNIVERSITY OF WISCONSIN–MADISON

UW–Madison WRCCS

MELCOR Analysis of a Scaled NGNP Reactor Cavity Cooling System Experiment

Troy C. Haskin

Michael Corradini
Jae Oh
Casy Tompkins

MELCOR Cooperative Assessment Program (MCAP)

September 17, 2015

Outline

DEPARTMENT OF
Engineering Physics
UNIVERSITY OF WISCONSIN–MADISON

Outline

Reactor Cavity Cooling System (RCCS)

DEPARTMENT OF Engineering Physics
UNIVERSITY OF WISCONSIN–MADISON

- Ultimate heat sink for reactor decay heat
- Most designed for passive cooling
- Two popular fluids: air and water

Table: List of RCCS designs from *Experimental Studies of NGNP Reactor Cavity Cooling System With Water* [pdf].

Reactor	Coolant	Mode	Country	Power [MW]
HTTR	Water	Forced	Japan	30
HTR-10	Water	Natural	China	10
PBMR	Water	Natural	South Africa	265
GT-MHR	Air	Natural	Russia	600
MHTGR	Air	Natural	USA	450

PBMR RCCS

Figure: From “PBMR Auxiliary Systems” [pdf], part of *Summary of Public Meeting with PBMR (PTY) LTD* [nrc.gov].

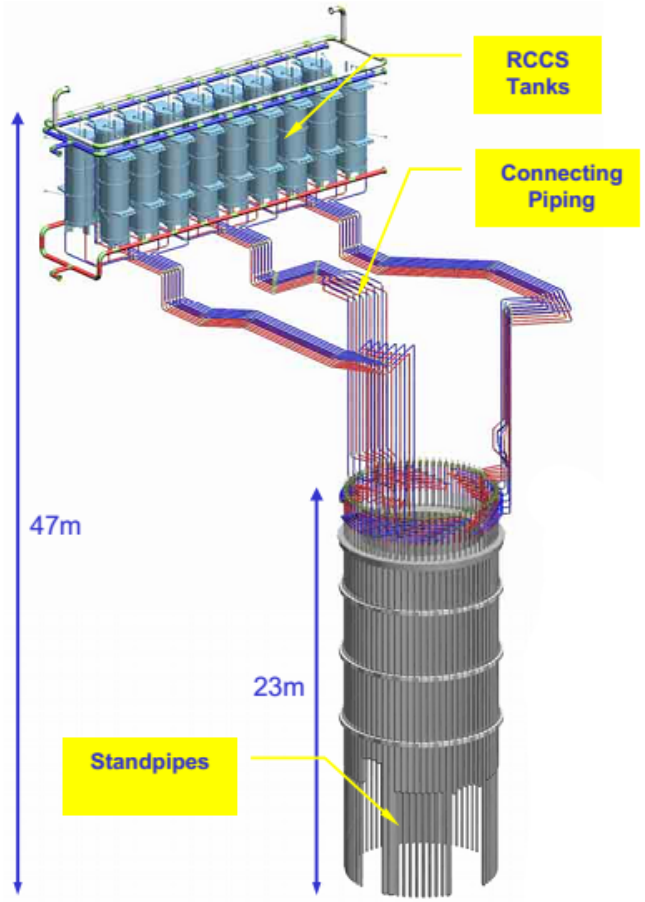

Outline

DEPARTMENT OF
Engineering Physics
UNIVERSITY OF WISCONSIN–MADISON

WRCCS Purpose

DEPARTMENT OF
Engineering Physics
UNIVERSITY OF WISCONSIN–MADISON

- Characterize both single and two-phase behavior of a scaled-version of the Reactor Cavity Cooling System (RCCS) with water coolant operating via natural circulation.

WRCCS Facility

DEPARTMENT OF
Engineering Physics
UNIVERSITY OF WISCONSIN–MADISON

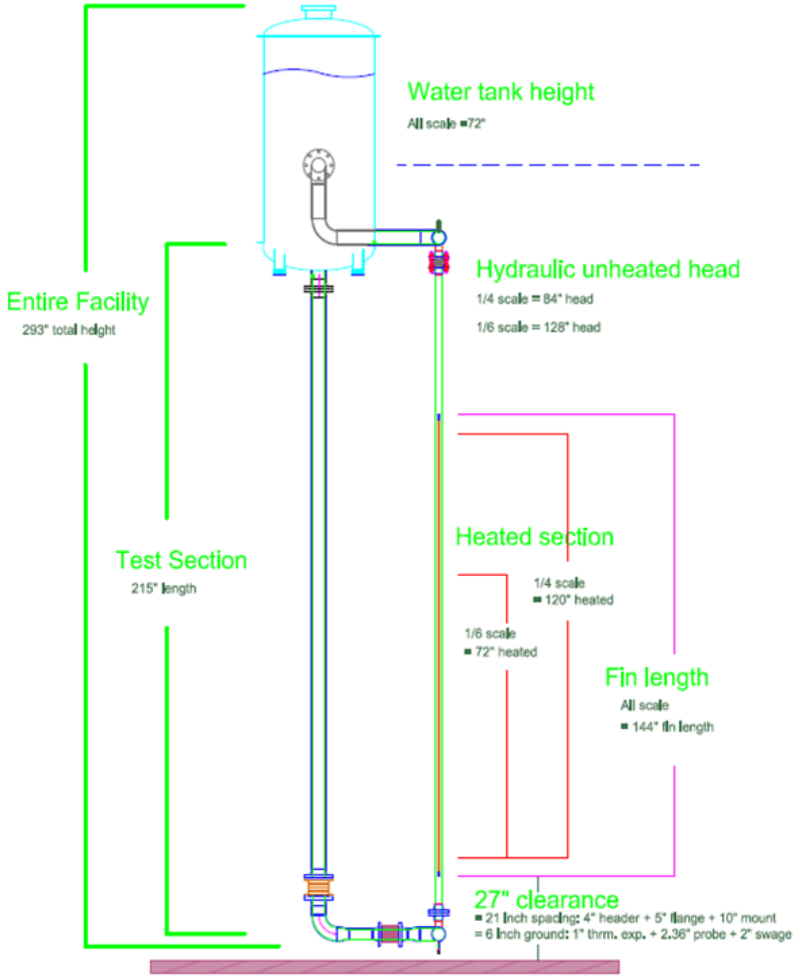

WRCCS Features

DEPARTMENT OF Engineering Physics UNIVERSITY OF WISCONSIN–MADISON

- ∼330 gallon tank, rated for 2 atm
- Heater Array
  - maximum ∼40 kW radiant power
  - 34 heaters, 17×2 array
- Instrumentation
  - Flow meter (total system flow rate)
  - Numerous thermocouples
  - Differential and absolute pressure

WRCCS Features

DEPARTMENT OF Engineering Physics
UNIVERSITY OF WISCONSIN–MADISON

- ~330 gallon tank, rated for 2 atm
- Heater Array
  - maximum ~40 kW radiant power
  - 34 heaters, 17×2 array (old)
  - 36 heaters, 9×4 array (new)
- Instrumentation
  - Flow meter (total system flow rate)
  - Numerous thermocouples
  - Differential and absolute pressure
  - Void mesh sensors (new)



Boiling Features

DEPARTMENT OF Engineering Physics
UNIVERSITY OF WISCONSIN–MADISON

A. Single-phase heat-up
B. Boiling incipience
C. Boiling oscillations
D. Continuous circulations
E. Geysering

Figure: Source: "Influences of boil-off on the behavior of a two-phase natural circulation loop", 2014., *Int. J. of Multiphase Flow*, 60, 135-148.

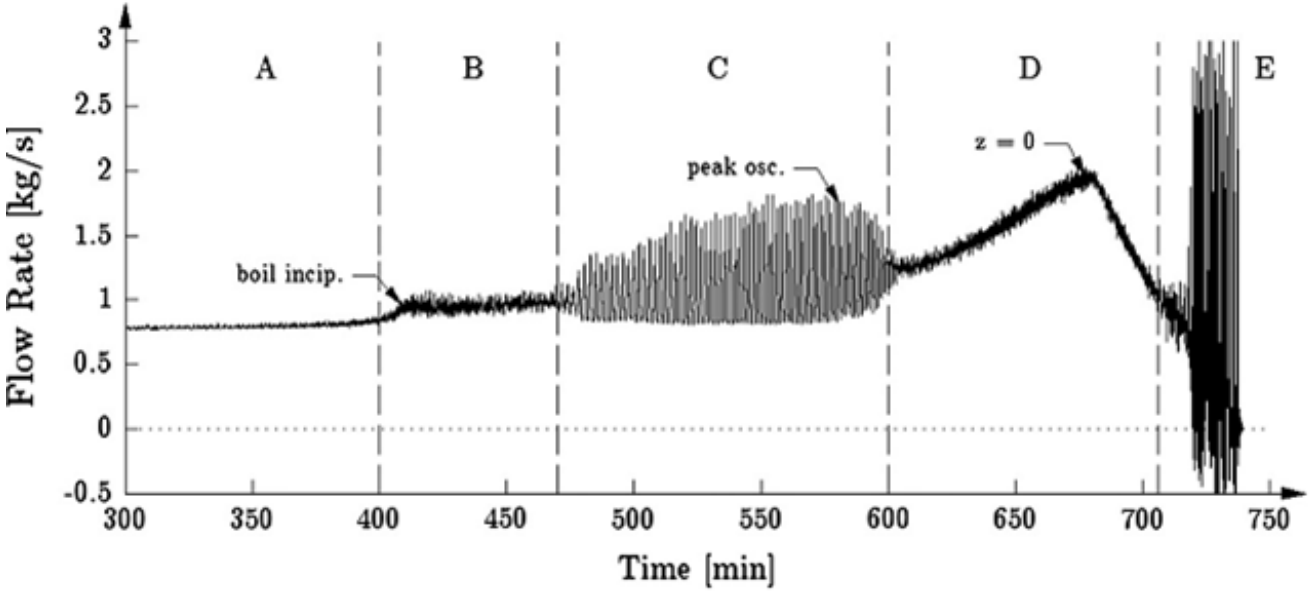

Benchmark Test

DEPARTMENT OF Engineering Physics
UNIVERSITY OF WISCONSIN–MADISON

- Chose the most mature test for benchmark modeling.
- Parameters
  - Initial tank fill: 60%
  - Power profile: Uniform
  - No active cooling

Figure: Energy balance and mass flow rate of benchmark

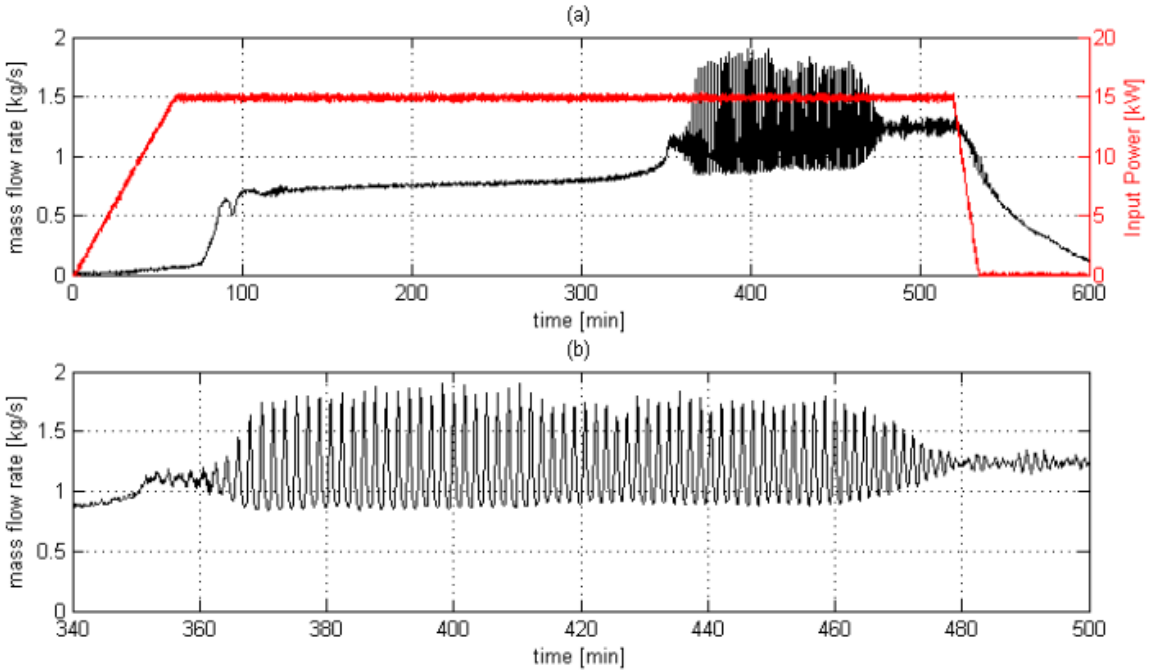

Outline

DEPARTMENT OF
Engineering Physics
UNIVERSITY OF WISCONSIN–MADISON

Development

DEPARTMENT OF
Engineering Physics
UNIVERSITY OF WISCONSIN–MADISON

- Started from simple adiabatic design
- Investigated several other variations:
  - Tank Nodalization
  - Heat losses
    - Reduced power
    - Heater box losses and air infiltration
    - Heat box and network piping losses
  - Interphase friction

Base Nodalization

DEPARTMENT OF Engineering Physics UNIVERSITY OF WISCONSIN–MADISON

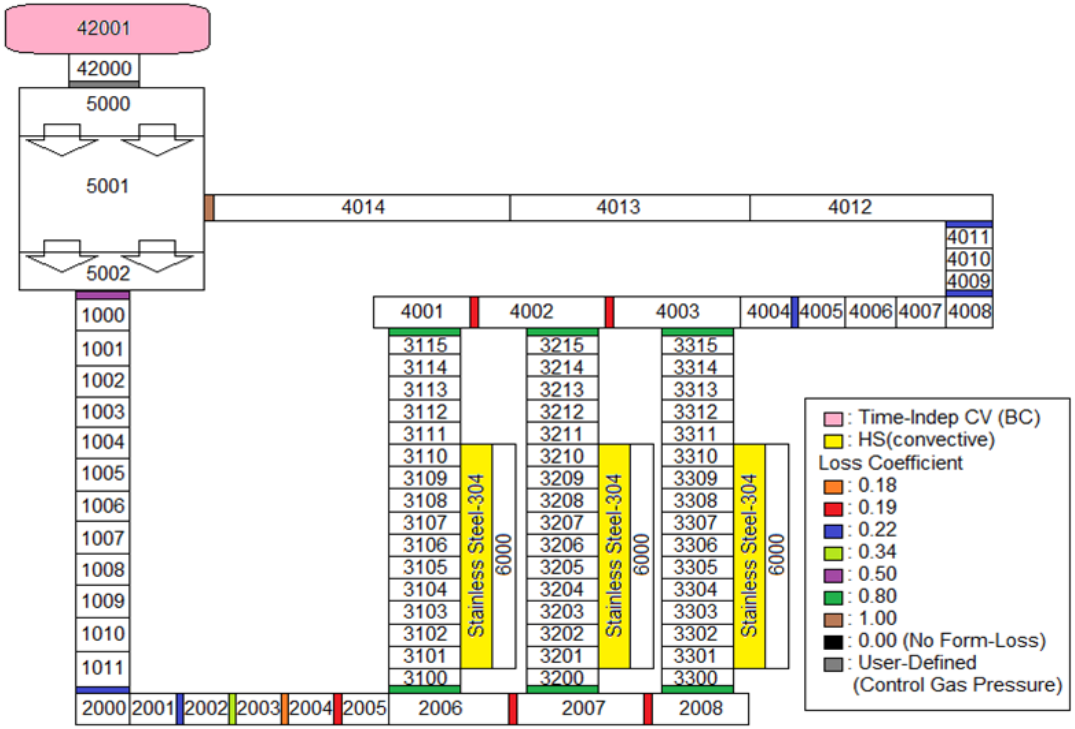



Side View



Top View

Not to-scale

Outline

DEPARTMENT OF Engineering Physics
UNIVERSITY OF WISCONSIN–MADISON

Variations

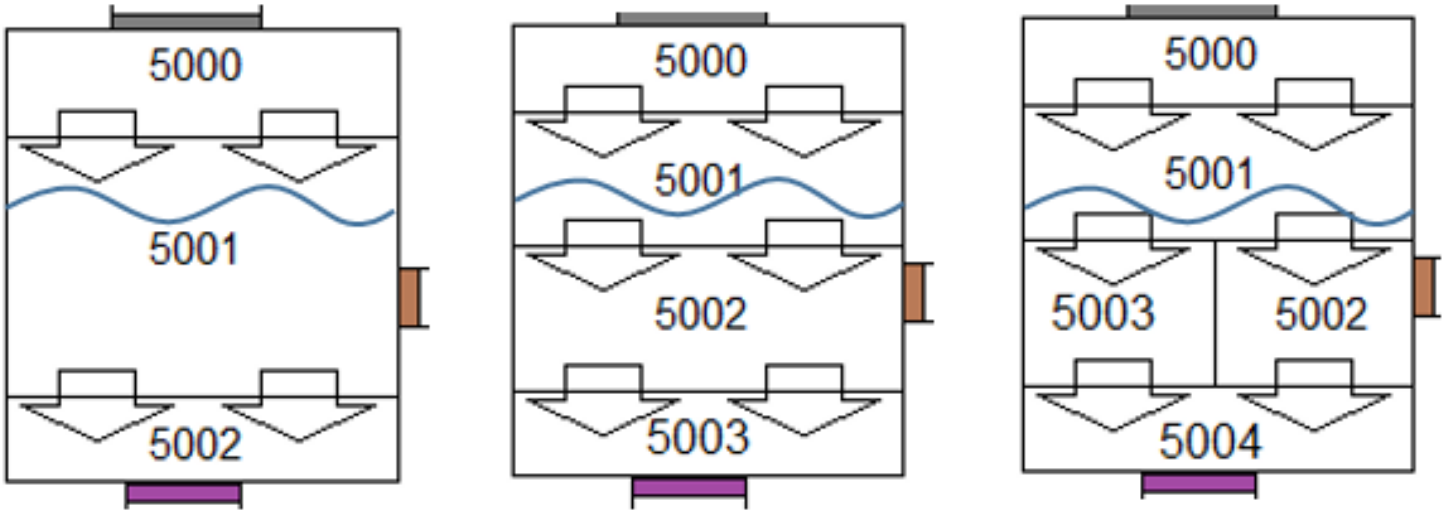

(a) (b) (c)

Comparison

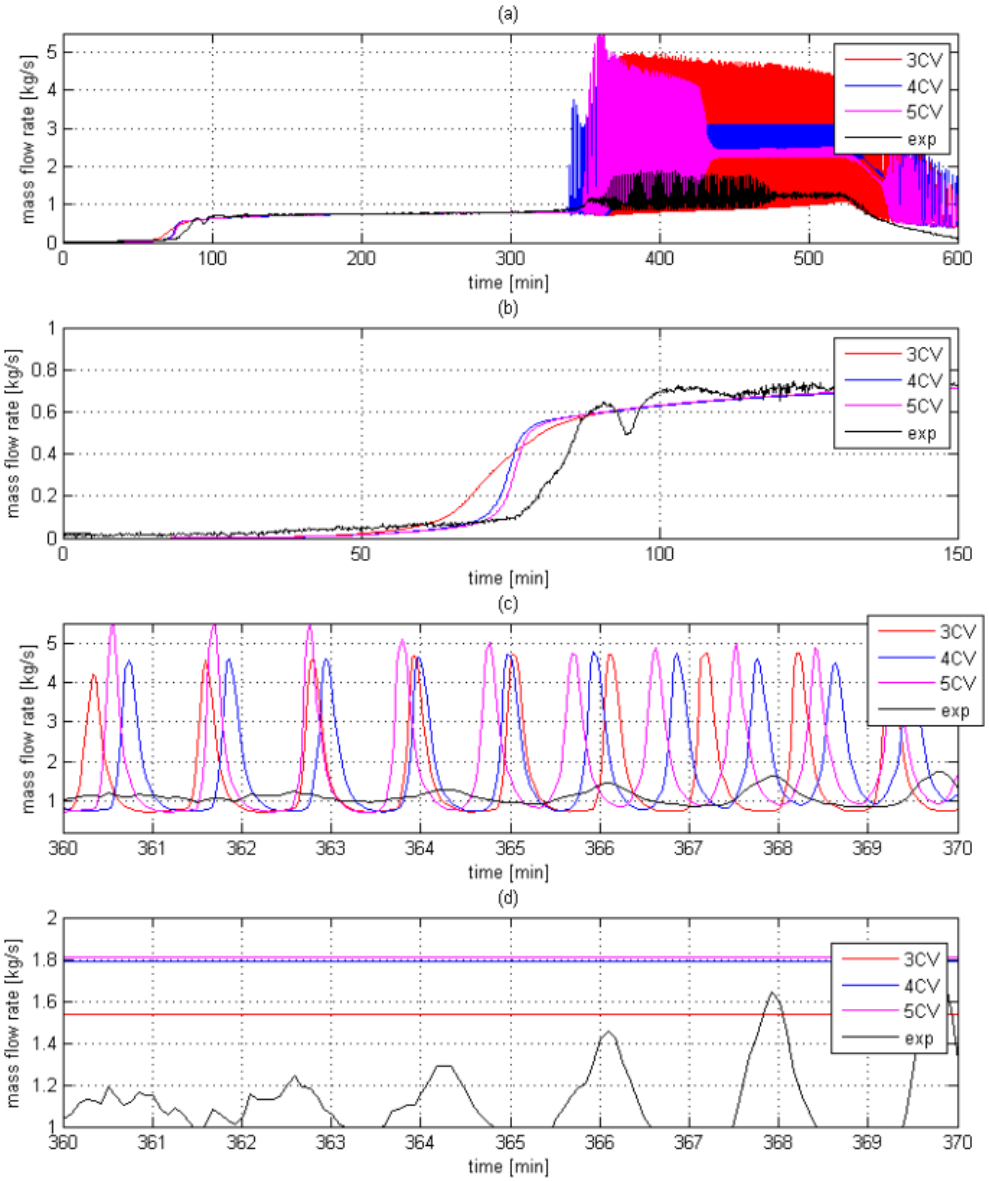
(a)
mass flow rate [kg/s]
time [min]
3CV
4CV
5CV
exp
(b)
mass flow rate [kg/s]
time [min]
3CV
4CV
5CV
exp
(c)
mass flow rate [kg/s]
time [min]
3CV
4CV
5CV
exp
(d)
mass flow rate [kg/s]
time [min]
3CV
4CV
5CV
exp

Outline

Adiabatic

DEPARTMENT OF Engineering Physics
UNIVERSITY OF WISCONSIN–MADISON

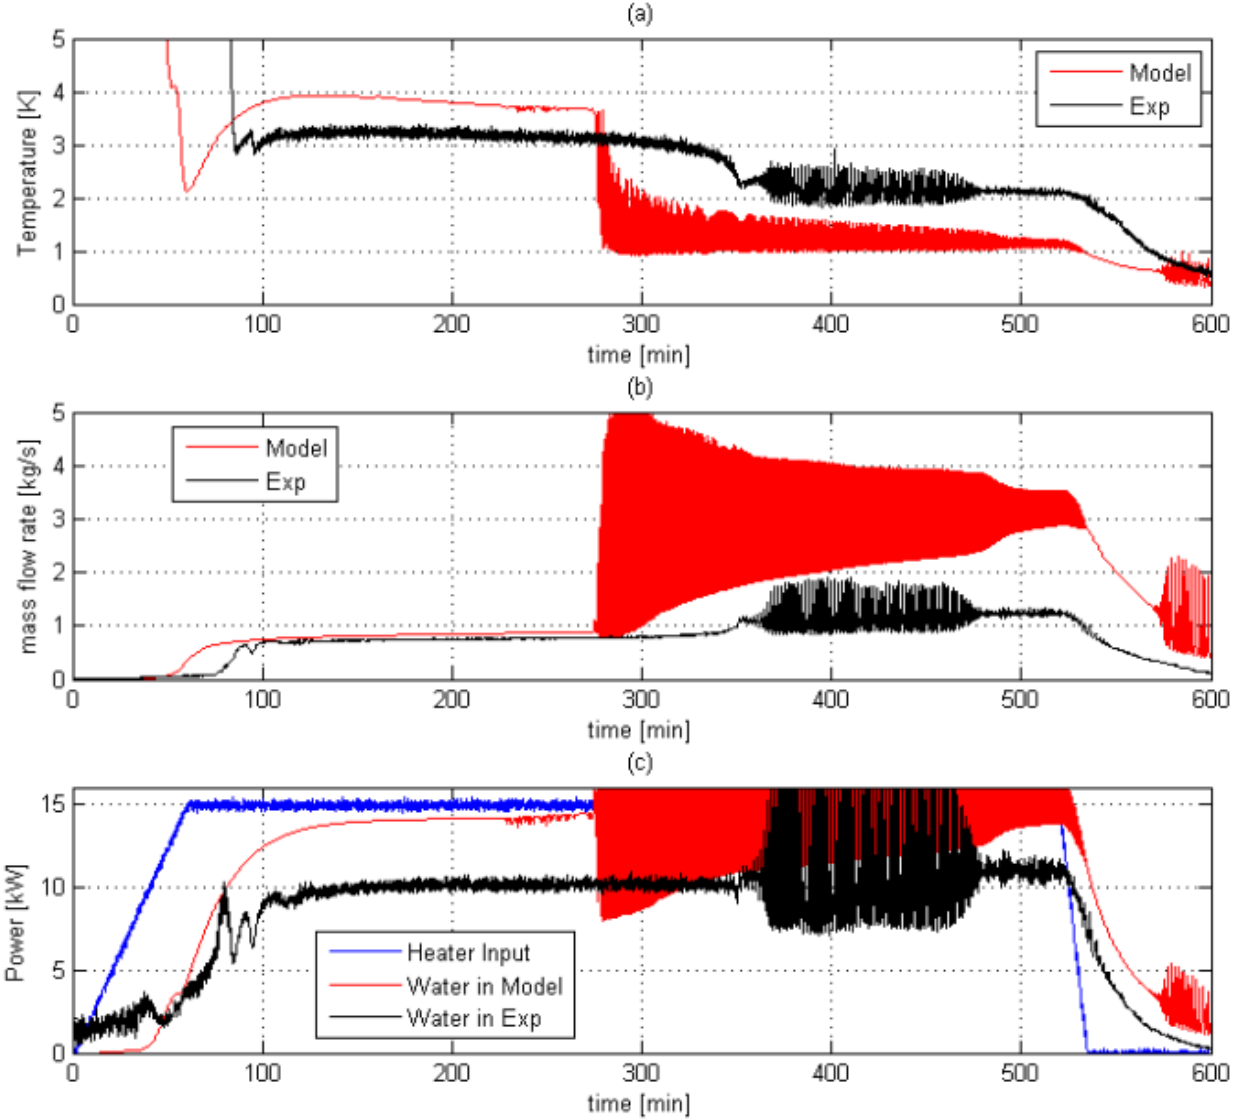

Energy losses

DEPARTMENT OF Engineering Physics
UNIVERSITY OF WISCONSIN–MADISON

- Experiment is not adiabatic: $\sim$ 4.5 kW lost in test section
- Two different paths were considered
  - Reduced power: artificially lower heater power
  - Heater box loss: add convective losses and air infiltration to heater box

Reduced Power (B)

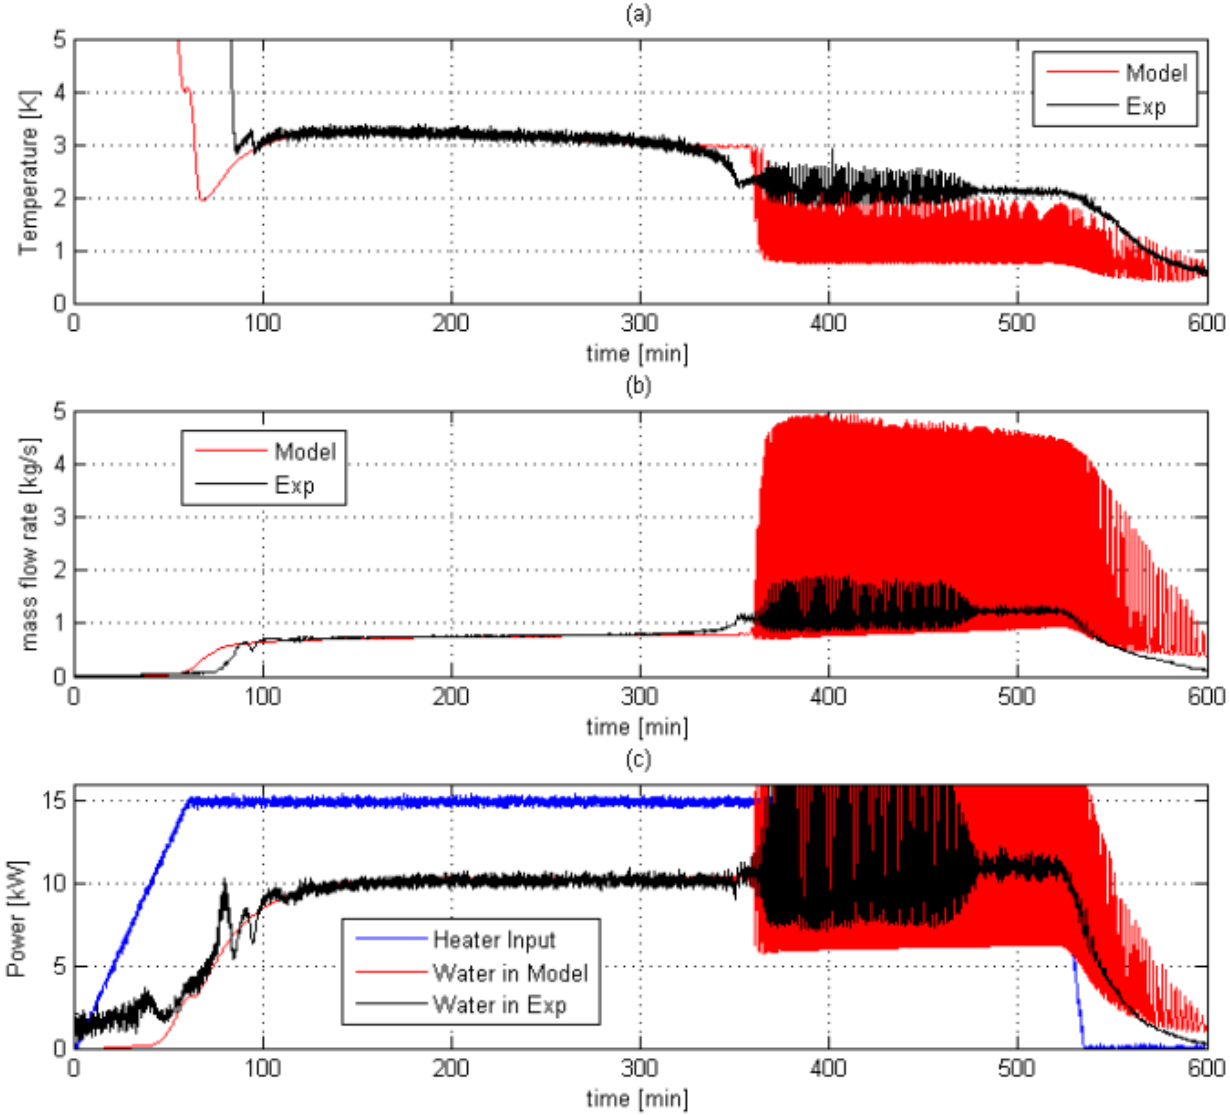

Heater Box Loss (C)

DEPARTMENT OF Engineering Physics
UNIVERSITY OF WISCONSIN–MADISON

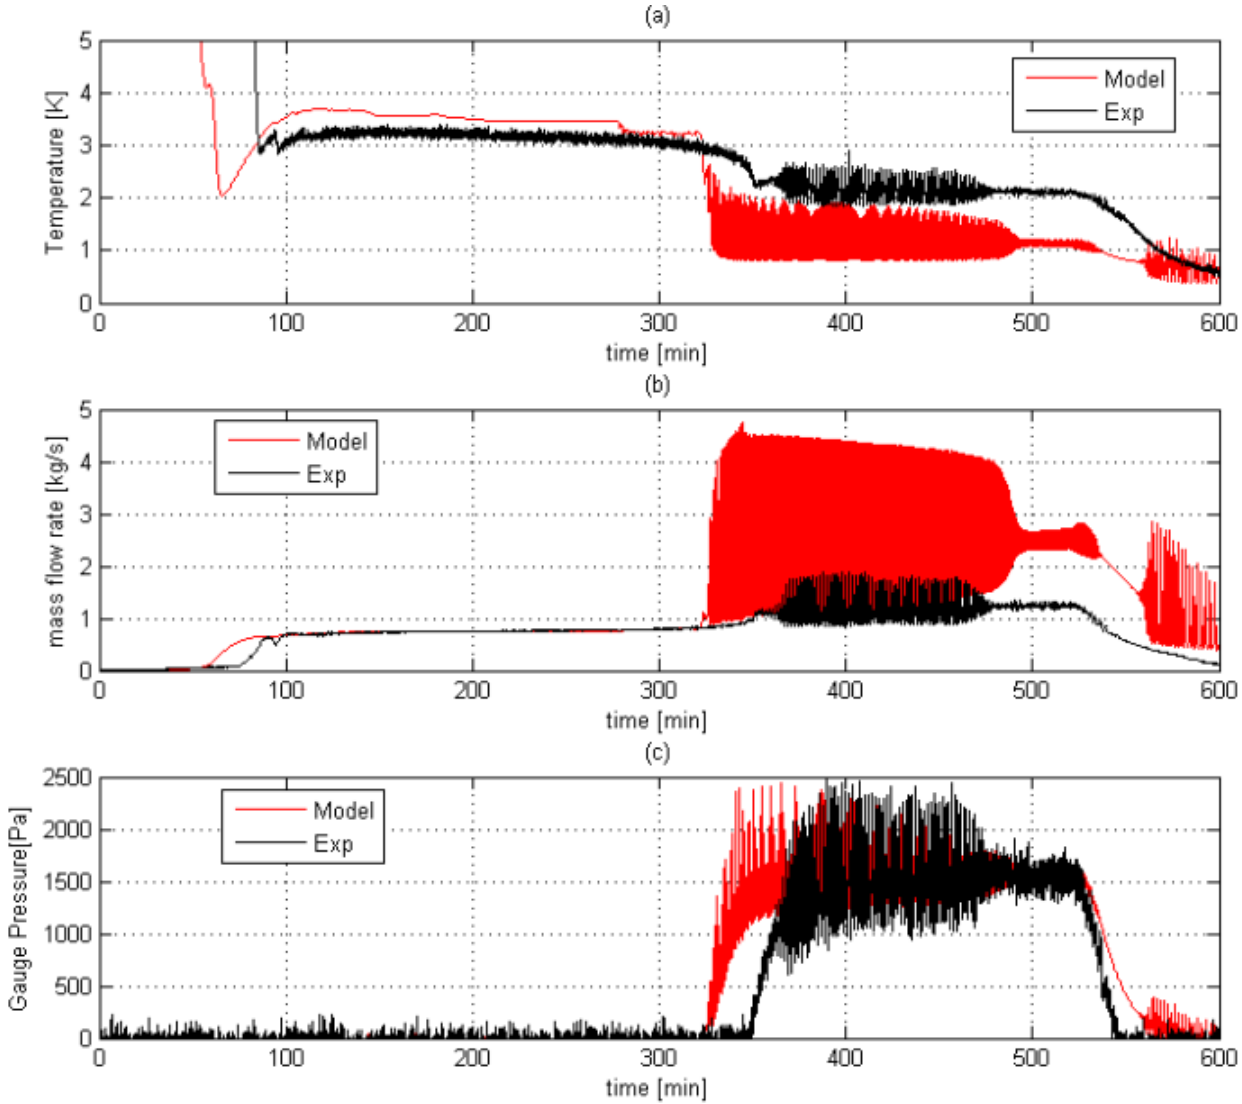

Reduced Power/Convective Losses (D)

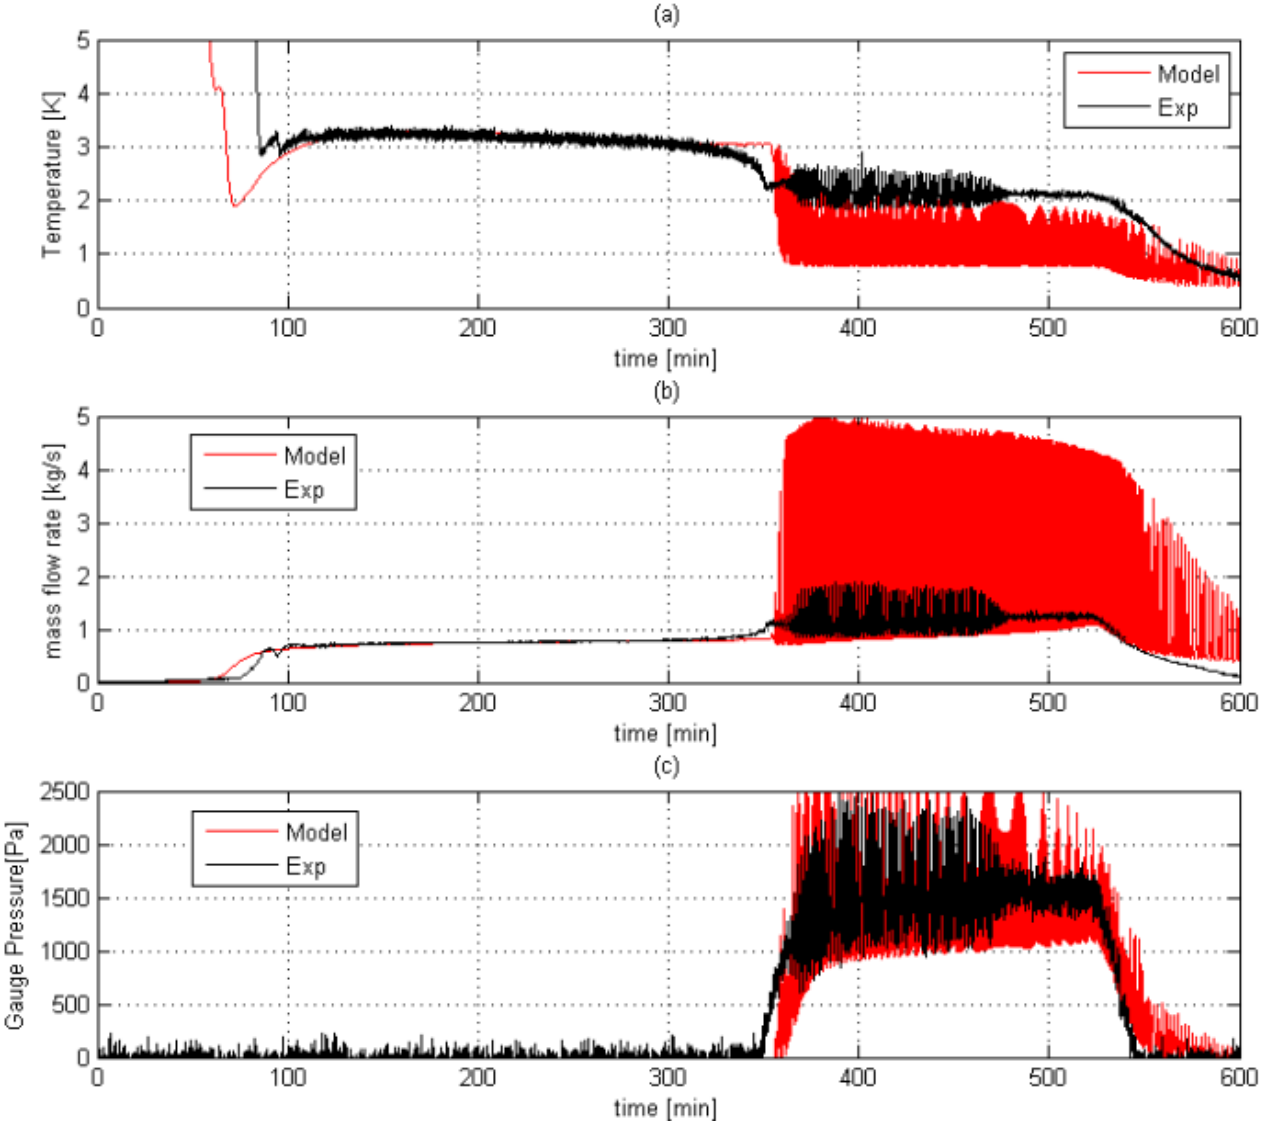

Piping Loss Comparison

DEPARTMENT OF Engineering Physics UNIVERSITY OF WISCONSIN–MADISON

- Additional network piping losses quantified: ~ 2 kW
- Doesn't affect temperature rise
- Does affect period and average mass flow rate

Piping Loss Comparison

DEPARTMENT OF Engineering Physics
UNIVERSITY OF WISCONSIN–MADISON

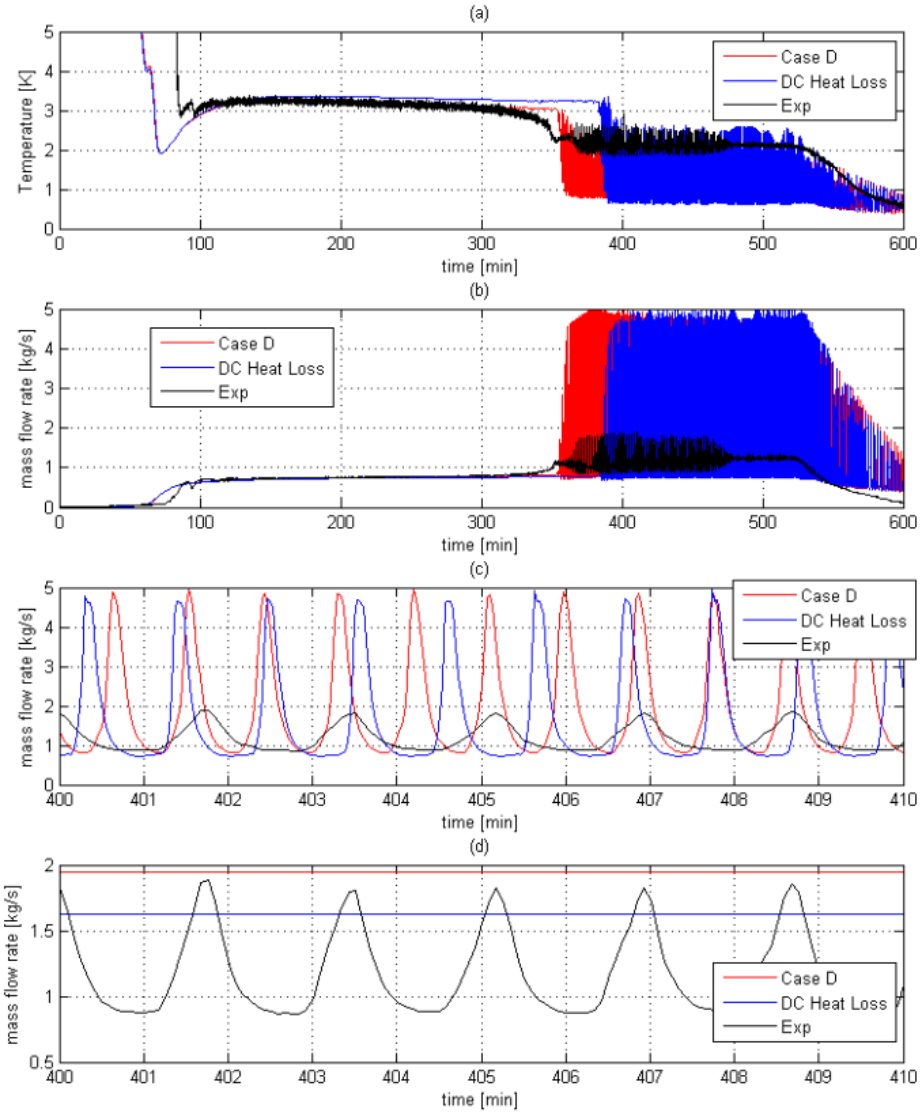

Outline

DEPARTMENT OF Engineering Physics
UNIVERSITY OF WISCONSIN–MADISON

Interphase friction

DEPARTMENT OF Engineering Physics
UNIVERSITY OF WISCONSIN–MADISON

MELCOR's interphase friction term was considered to account for period discrepancy.

Interphase friction

DEPARTMENT OF Engineering Physics UNIVERSITY OF WISCONSIN–MADISON

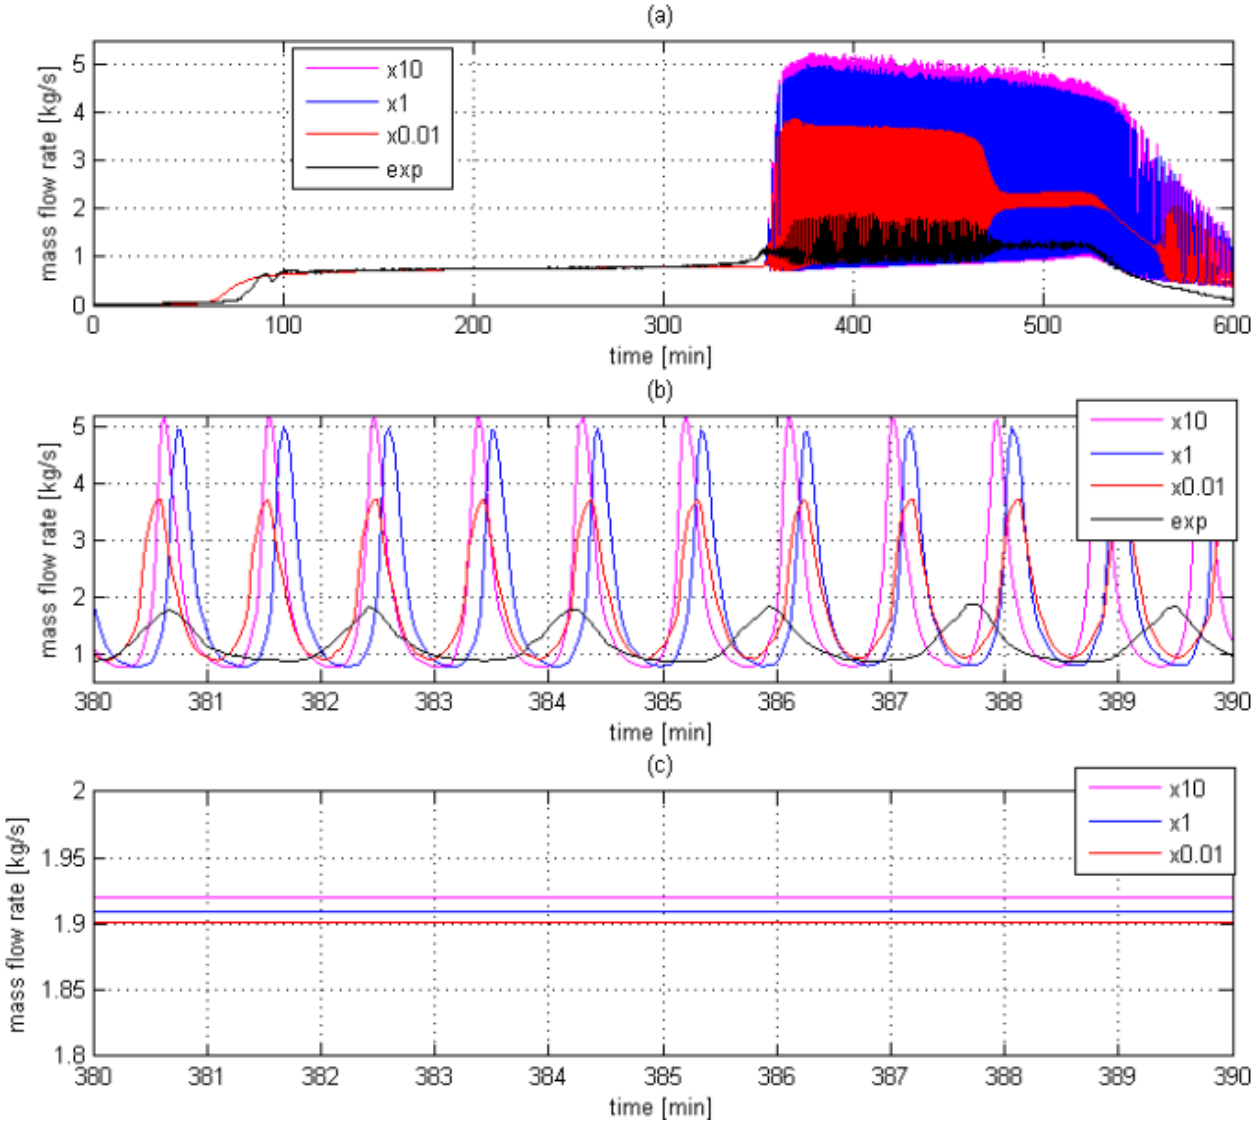

Outline

Conclusions

DEPARTMENT OF Engineering Physics UNIVERSITY OF WISCONSIN–MADISON

- MELCOR is able to qualitatively model the Heat-Up and Boiling Oscillation regimes
- Period/Amplitude discrepancy may imply some two-phase dissipation terms are missing

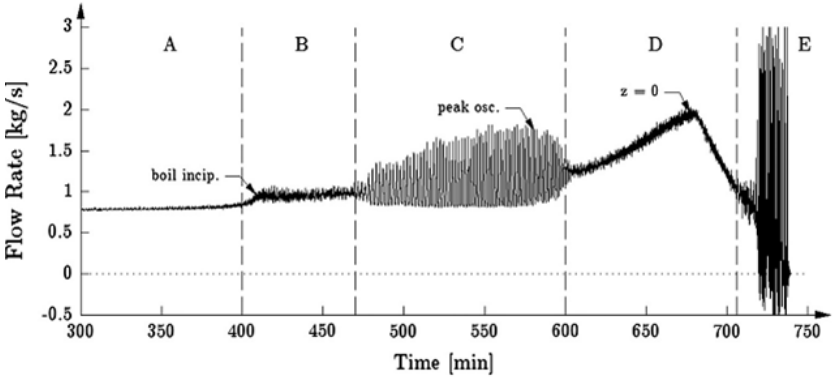

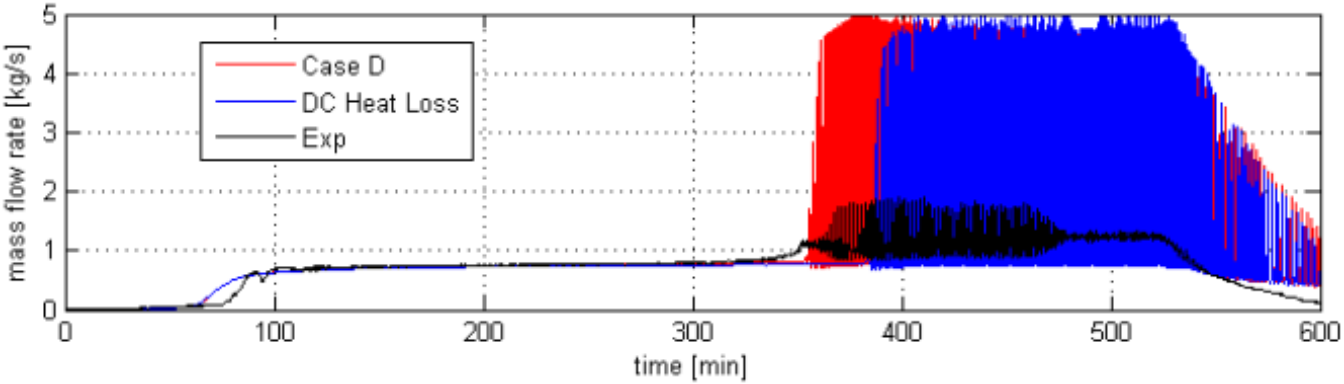

Current and Future Work

DEPARTMENT OF Engineering Physics
UNIVERSITY OF WISCONSIN–MADISON

- Installed Void Mesh Sensors in boiling region of experiment
- Use data to infer relationships among system variables (e.g., pressure losses, voiding, and mass flow rate).

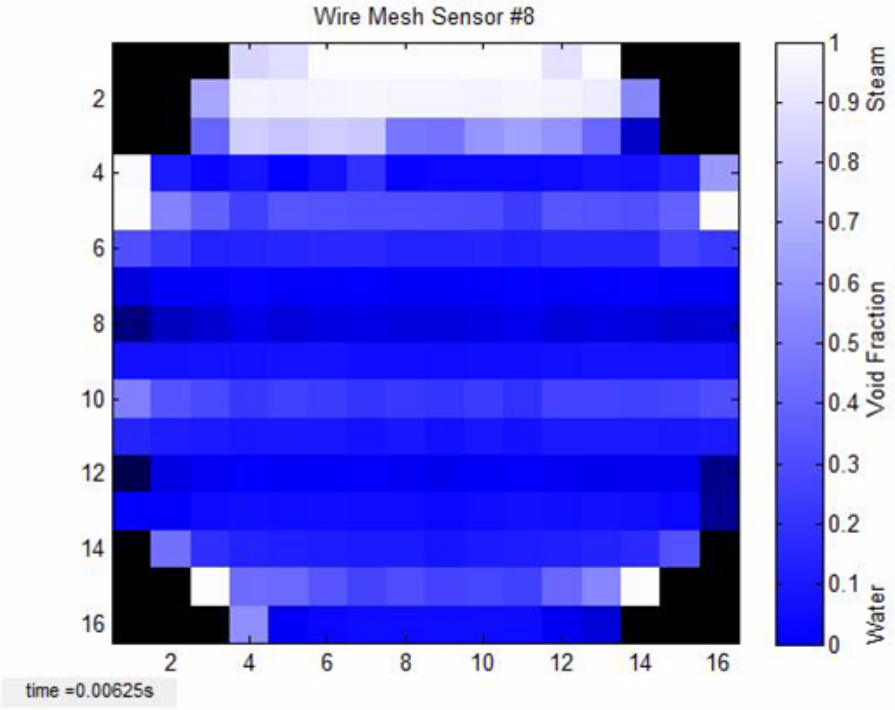

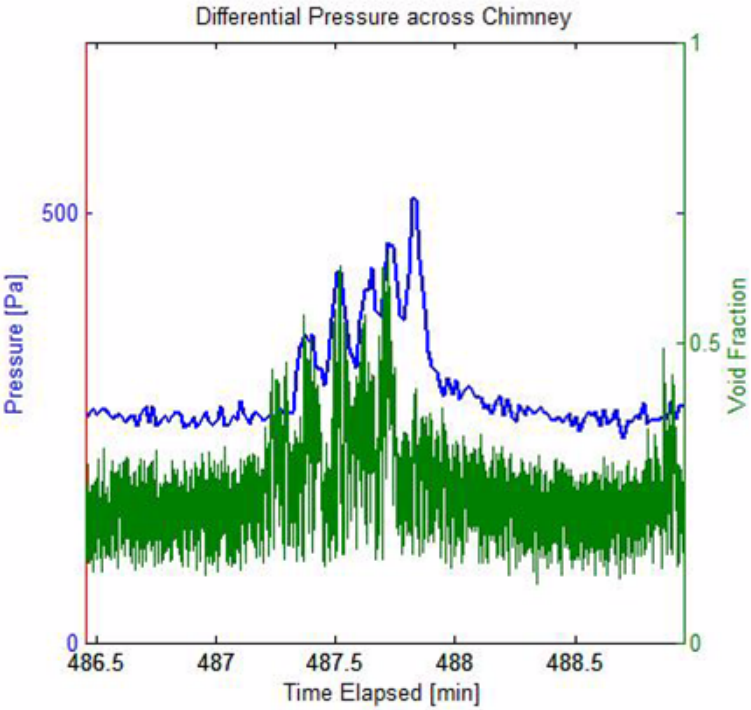

Questions