

- GENERAL GRADING PLAN NOTES:
1. ALL CONSTRUCTION WORK SHALL CONFORM TO THE COUNTY OF SAN LUIS OBISPO STANDARDS AND SPECIFICATIONS AND IN ACCORDANCE WITH C.R.C. ALL WORK SHALL BE SUBJECT TO THE APPROVAL OF THE CITY BUILDING DEPT.
 2. THE DEVELOPER SHALL BE RESPONSIBLE FOR SCHEDULING A PRE-CONSTRUCTION MEETING WITH THE COUNTY AND OTHER AFFECTED AGENCIES. THE CONTRACTOR SHALL NOTIFY THE COUNTY AT LEAST 24 HOURS PRIOR TO ANY WORK BEING PERFORMED AND ARRANGEMENT FOR INSPECTION.
 3. AN ENCROACHMENT PERMIT IS REQUIRED FOR ANY WORK IN THE COUNTY RIGHT OF WAY.
 4. A SOILS ENGINEER SHALL SUPERVISE THE GRADING AND CERTIFY THAT ALL GRADING HAS BEEN COMPLETED IN CONFORMANCE WITH THESE PLANS AND SPECIFICATIONS, SECTION 1803 OF THE C.R.C.
 5. ESTIMATED EARTH QUANTITIES: CUT: 303 CU. YDS. FILL: 91 CU. YDS. NOTE: EXACT SHRINKAGE, CONSOLIDATION, AND SUBSIDENCE FACTORS AND LOSSES DUE TO CLEARING OPERATIONS ARE NOT INCLUDED. ESTIMATED EARTHWORK QUANTITIES ARE BASED UPON THE DIFFERENCE BETWEEN EXISTING GROUND SURFACE AND PROPOSED FINISH GRADES, OR SUB-GRADES AS SHOWN ON THE PLAN, AND SHOULD VARY ACCORDING TO THESE FACTORS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR SITE INSPECTION AND QUANTITY TAKE OFF AND SHALL BID ACCORDINGLY.
 6. THE CONTRACTOR SHALL MAINTAIN DUST CONTROL AT ALL TIMES.
 7. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF ALL EXISTING SURVEY MARKERS DURING CONSTRUCTION. ALL SUCH MONUMENTS OR MARKERS SHALL BE RESET AT THE CONTRACTORS EXPENSE.
 8. ALL TOP SOIL SHALL BE STOCKPILED FOR LATER DISTRIBUTION OVER THE LOTS AND SLOPES. ALL CUT AND FILL SLOPES ARE TO BE PLANTED OR HYDRO-SEEDED AFTER COMPACTION TO PREVENT EROSION.
 9. ALL ROUGH GRADING SHALL BE COMPLETED AND APPROVED BY THE COUNTY BUILDING DEPT PRIOR TO ISSUANCE OF ANY BUILDING PERMITS.
 10. ANY OAK TREES ON SITE SHALL BE PROTECTED DURING CONSTRUCTION. IF THE DEVELOPER PROPOSES TO REMOVE AN OAK, AN APPLICATION SHALL BE FILED WITH THE COUNTY OF SAN LUIS OBISPO FOR APPROVAL.
 11. ALL CONTRACTORS AND SUB-CONTRACTORS WORKING WITH THE RIGHT OF WAY SHALL HAVE AN APPROPRIATE CONTRACTORS LICENSE, A LOCAL BUSINESS LICENSE, AND SHALL OBTAIN AN ENCROACHMENT PERMIT.
 12. SLOPES OF ALL CUT SURFACES TO BE NO LESS THAN 2 HORIZ. TO 1 VERT. ALL FILL SURFACES SHALL NOT EXCEED 3:1 SLOPE. ALL FILL SHALL HAVE 90% COMPACTION.
 13. GRADING SHALL COMPLY WITH THE RECOMMENDATION OF THE SOILS REPORT BY GEO-SOLUTIONS, JOB NO. SLO8060-2 DATED JULY 17, 2013 FILED WITH THE COUNTY OF SAN LUIS OBISPO.

UTILITY NOTES:

1. PROVIDE WATER PRESSURE REGULATOR FOR NEW CONSTRUCTION.
2. THE MINIMUM SIZE FOR RISERS SHALL BE 1" IN DIAMETER. MATERIALS TO BE USED MAY BE SCHEDULE 80 PVC OR TYPE L COPPER PIPE.
3. PROVIDE NEW SEWER LATERAL WITH CLEANOUT 2 FEET MIN. FROM BUILDING.
4. HOSE BIBS AND SPRINKLER SYSTEMS SHALL HAVE APPROVED BACKFLOW PREVENTION DEVICES.
5. WATER PRESSURE IN BUILDING SHALL BE LIMITED TO 80 PSI OR LESS. PRESSURE REGULATOR IS REQUIRED.
6. WHERE APPLICABLE, PROVIDE BACK WATER VALVE ON THE SEWER LATERAL WHEN THE PROPOSED BUILDING FIXTURES HAVE FLOOD RISKS LOCATED BELOW THE ELEVATION OF THE NEXT UPSTREAM MANHOLE COVER.
7. IF DRAIN LINES WITHIN THE BUILDING ARE LOWER THAN THE SEWER MAIN, AN EJECTOR PUMP PUMP MAY BE REQUIRED.
8. MINIMUM SIZE FOR SERVICE RISERS FOR STRUCTURES SHALL BE 1" DIA. MATERIALS SHALL BE SCHEDULE 80 PVC OR TYPE "L" COPPER, MIN.
9. ALL NEW UTILITY CONNECTIONS SHALL BE LACED UNDERGROUND.

SITE NOTES:

1. CONTOUR SHOWN DERIVED FROM APPROVED PLANS. IT IS RECOMMENDED THAT A LICENSED SURVEYOR ESTABLISH ACTUAL GRADES. THIS DRAWING SHALL NOT BE CONSTRUCTED AS A GRADING PLAN.
2. PROVIDE A MINIMUM SETBACKS PER CITY ORDINANCE.
3. ALL PROPERTY CORNERS SHALL BE ESTABLISHED AT TIME OF FOUNDATION INSPECTION WITH THE MARK OF A LICENSED LAND SURVEYOR.
4. DRIVEWAY APRON SHALL COMPLY WITH CITY STREET STANDARDS.
5. FINISH GRADE AROUND THE STRUCTURE SHALL SLOPE AWAY FROM THE STRUCTURE FOUND. A MIN. OF 5% FOR 10'-0" & DRAIN TOWARD A PUBLIC STREET OR ENGINEERED DRAINAGE STRUCTURE.

GENERAL NOTES:

1. CONSTRUCTION SHALL BE OF THE HIGHEST QUALITY WORKMANSHIP. ALL WALLS SHALL BE PLUMB AND TRUE. ALL CONNECTIONS SHALL BE MADE SECURE ACCORDING TO ACCEPTED CONSTRUCTION PROCEDURES OR AS SPECIFIED HEREIN OR AS PER THE 2019 EDITION OF THE CALIFORNIA BUILDING CODE.
2. THE DRAFTSMAN ASSUMES NO RESPONSIBILITY FOR ANY CHANGES, ERRORS, OMISSIONS OR DEVIATIONS BY THE OWNER OR CONTRACTOR, EITHER INTENTIONAL OR ACCIDENTAL.
3. THE OWNER IS ADVISED THAT THESE DRAWINGS AND ASSOCIATED CONSTRUCTION DOCUMENTS ARE THE ONLY MEDIUM AVAILABLE TO EXPRESS THE INTENT OF NRB AND CANNOT BE ASSUMED ALL-INCLUSIVE WITH REGARD TO SUCH.
4. IN ALL CASES, NOTED DIMENSIONS SHALL SUPERSEDE SCALED DIMENSIONS.

IRRIGATION NOTES:

1. AUTOMATIC IRRIGATION SYSTEM CONTROLLERS FOR LANDSCAPING PROVIDED BY THE BUILDER AND INSTALLED AT THE TIME OF FINAL INSPECTION SHALL COMPLY WITH CALIFORNIA GREEN BUILDING STANDARDS.
2. CONTROLLERS SHALL BE WEATHER-OR SOIL MOISTURE-BASED CONTROLLERS THAT AUTOMATICALLY ADJUST IRRIGATION IN RESPONSE TO CHANGES IN PLANTS' NEEDS AS WEATHER CONDITIONS CHANGE.
3. WEATHER-BASED CONTROLLERS WITHOUT INTEGRAL RAIN SENSORS OR COMMUNICATION SYSTEMS THAT ACCEPT OR LOCAL RAINFALL SHALL HAVE A SEPARATE WIRED OR WIRELESS RAIN SENSOR WHICH CONNECTS OR COMMUNICATES WITH THE CONTROLLER(S). SOIL MOISTURE-BASED CONTROLLERS ARE NOT REQUIRED TO HAVE RAIN SENSOR INPUT.

6.0 CONCLUSIONS AND RECOMMENDATIONS

The Site is suitable for the proposed development provided the recommendations presented in this report are incorporated into the project plans and specifications.

The primary geotechnical concerns at the Site are:

1. The presence of loose surface soils.
 2. The potential for differential settlement occurring between foundations supported on two soil materials having different settlement characteristics, such as native soil and engineered fill. Therefore, it is important that all of the foundations are founded in equally competent uniform material in accordance with this report.
- 6.1 Preparation of Building Pad
1. It is anticipated that a graded engineered fill pad will be developed for the proposed residence with footings founded in engineered fill.
 2. For the development of an engineered fill pad, the native material should be over-excavated at least 36 inches below existing grade, 24 inches below the bottom of the footings, to competent material, or to one-half the depth of the deepest fill, whichever is greatest. The limits of over-excavation should extend a minimum of 5 feet beyond the perimeter foundation. The exposed surface should be scarified to a depth of 12 inches; moisture conditioned to near optimum moisture content, and compacted to a minimum relative density of 90 percent (ASTM D1557-07). The over-excavated material should then be processed as engineered fill. Refer to Figure 4: Sub-Slab Detail for under-slab drainage material and Appendix C for more details on fill placement.

STATEMENT OF SPECIAL INSPECTIONS	
1. THIS STATEMENT OF SPECIAL INSPECTIONS IS SUBMITTED IN FULFILLMENT OF THE REQUIREMENTS OF CBC SECTIONS 1104 AND 1105.	
2. SCHEDULE OF SPECIAL INSPECTIONS AND TESTS APPLICABLE TO THIS PROJECT	
2.1. SPECIAL INSPECTIONS PER SECTIONS 1104 AND 1105	
2.2. SPECIAL INSPECTIONS FOR BUILDING PAD PREPARATION	
3. SPECIAL INSPECTIONS AND TESTS WILL BE PERFORMED IN ACCORDANCE WITH THE APPROVED PLANS AND SPECIFICATIONS, THIS STATEMENT AND CBC 1104.1	
4. THE OWNER WILL RETAIN AND DIRECTLY PAY FOR THE SPECIAL INSPECTIONS AS REQUIRED IN CBC SECTION 1104.1	
SCHEDULE OF INSPECTION, TESTING AGENCIES, AND INSPECTORS	
THE FOLLOWING ARE THE TESTING AGENCIES AND SPECIAL INSPECTORS THAT WILL BE RETAINED TO CONDUCT THE MAJORITY OF THE TESTS AND INSPECTION ON THIS PROJECT	
RESPONSIBILITY:	FIRM CONTACT INFORMATION:
1. GEOTECHNICAL INSPECTIONS	GEO-SOLUTIONS, INC. 220 HIGH STREET SAN LUIS OBISPO, CA 93401 (805) 543-0539
SCHEDULE OF SPECIAL INSPECTIONS	
NOTATION USED IN TABLE	
C INDICATES CONTINUOUS INSPECTION IS REQUIRED	
P INDICATES PERIODIC INSPECTIONS ARE REQUIRED	
THE NOTES AND/OR CONTRACT DOCUMENTS SHOULD CLARIFY	
TABLE 1104.1 - INSPECTION OF SOILS	C P
1. VERIFY MATERIALS BELOW FOOTINGS ARE ADEQUATE TO ACHIEVE THE DESIRED BEARING CAPACITY	X
2. VERIFY EXCAVATIONS ARE EXTENDED TO PROPER DEPTH AND HAVE REACHED PROPER MATERIAL	X
3. PERFORM CLASSIFICATION AND TESTING OF CONTROLLED FILL MATERIALS	X
4. VERIFY USE OF PROPER MATERIALS, DENSITIES AND LIFT THICKNESS DURING PLACEMENT AND COMPACTION OF CONTROLLED FILL	X
5. PRIOR TO PLACEMENT OF CONTROLLED FILL, OBSERVE SUBGRADE AND VERIFY THAT SITE HAS BEEN PREPARED PROPERLY	X

REFER TO SHEET SP FOR VARIOUS ENGINEERS SPECIAL INSPECTION STATEMENT AS REQUIRED. ALSO REFER TO SHEETS 1 & 2 OF CIVIL SHEETS FOR SEPTIC/GEOTECHNICAL INSPECTIONS AND SHEET S-2 FOR STRUCTURAL INSPECTIONS/OBSERVATIONS DURING CONSTRUCTION.


GRADING:

CUT: 303 CU YDS ±
FILL: 91 CU YDS ±
TOTAL: 394 CU YDS
MAX DEPTH OF CUT = 3'
MAX DEPTH OF FILL = 3'
PERCENT OF NATURAL GRADE: 6%
AREA OF DISTURBANCE: 7,705 SQ. FT.
IMPERIOUS AREA: 4,534 SQ. FT.

A SEPARATE PERMIT IS REQUIRED FOR:
FIRE SPRINKLERS
GRADING
SOLAR-2.45 kWDC

UTILITY LINE CONNECTIONS:

ELECTRICAL-4" DIA. SCHEDULE 40
WATER-2" DIA. SCHEDULE 40 PVC
GAS-1-1/2" DIA. YELLOW POLYLINE
SEWER-4" DIA. ABS (SDR)

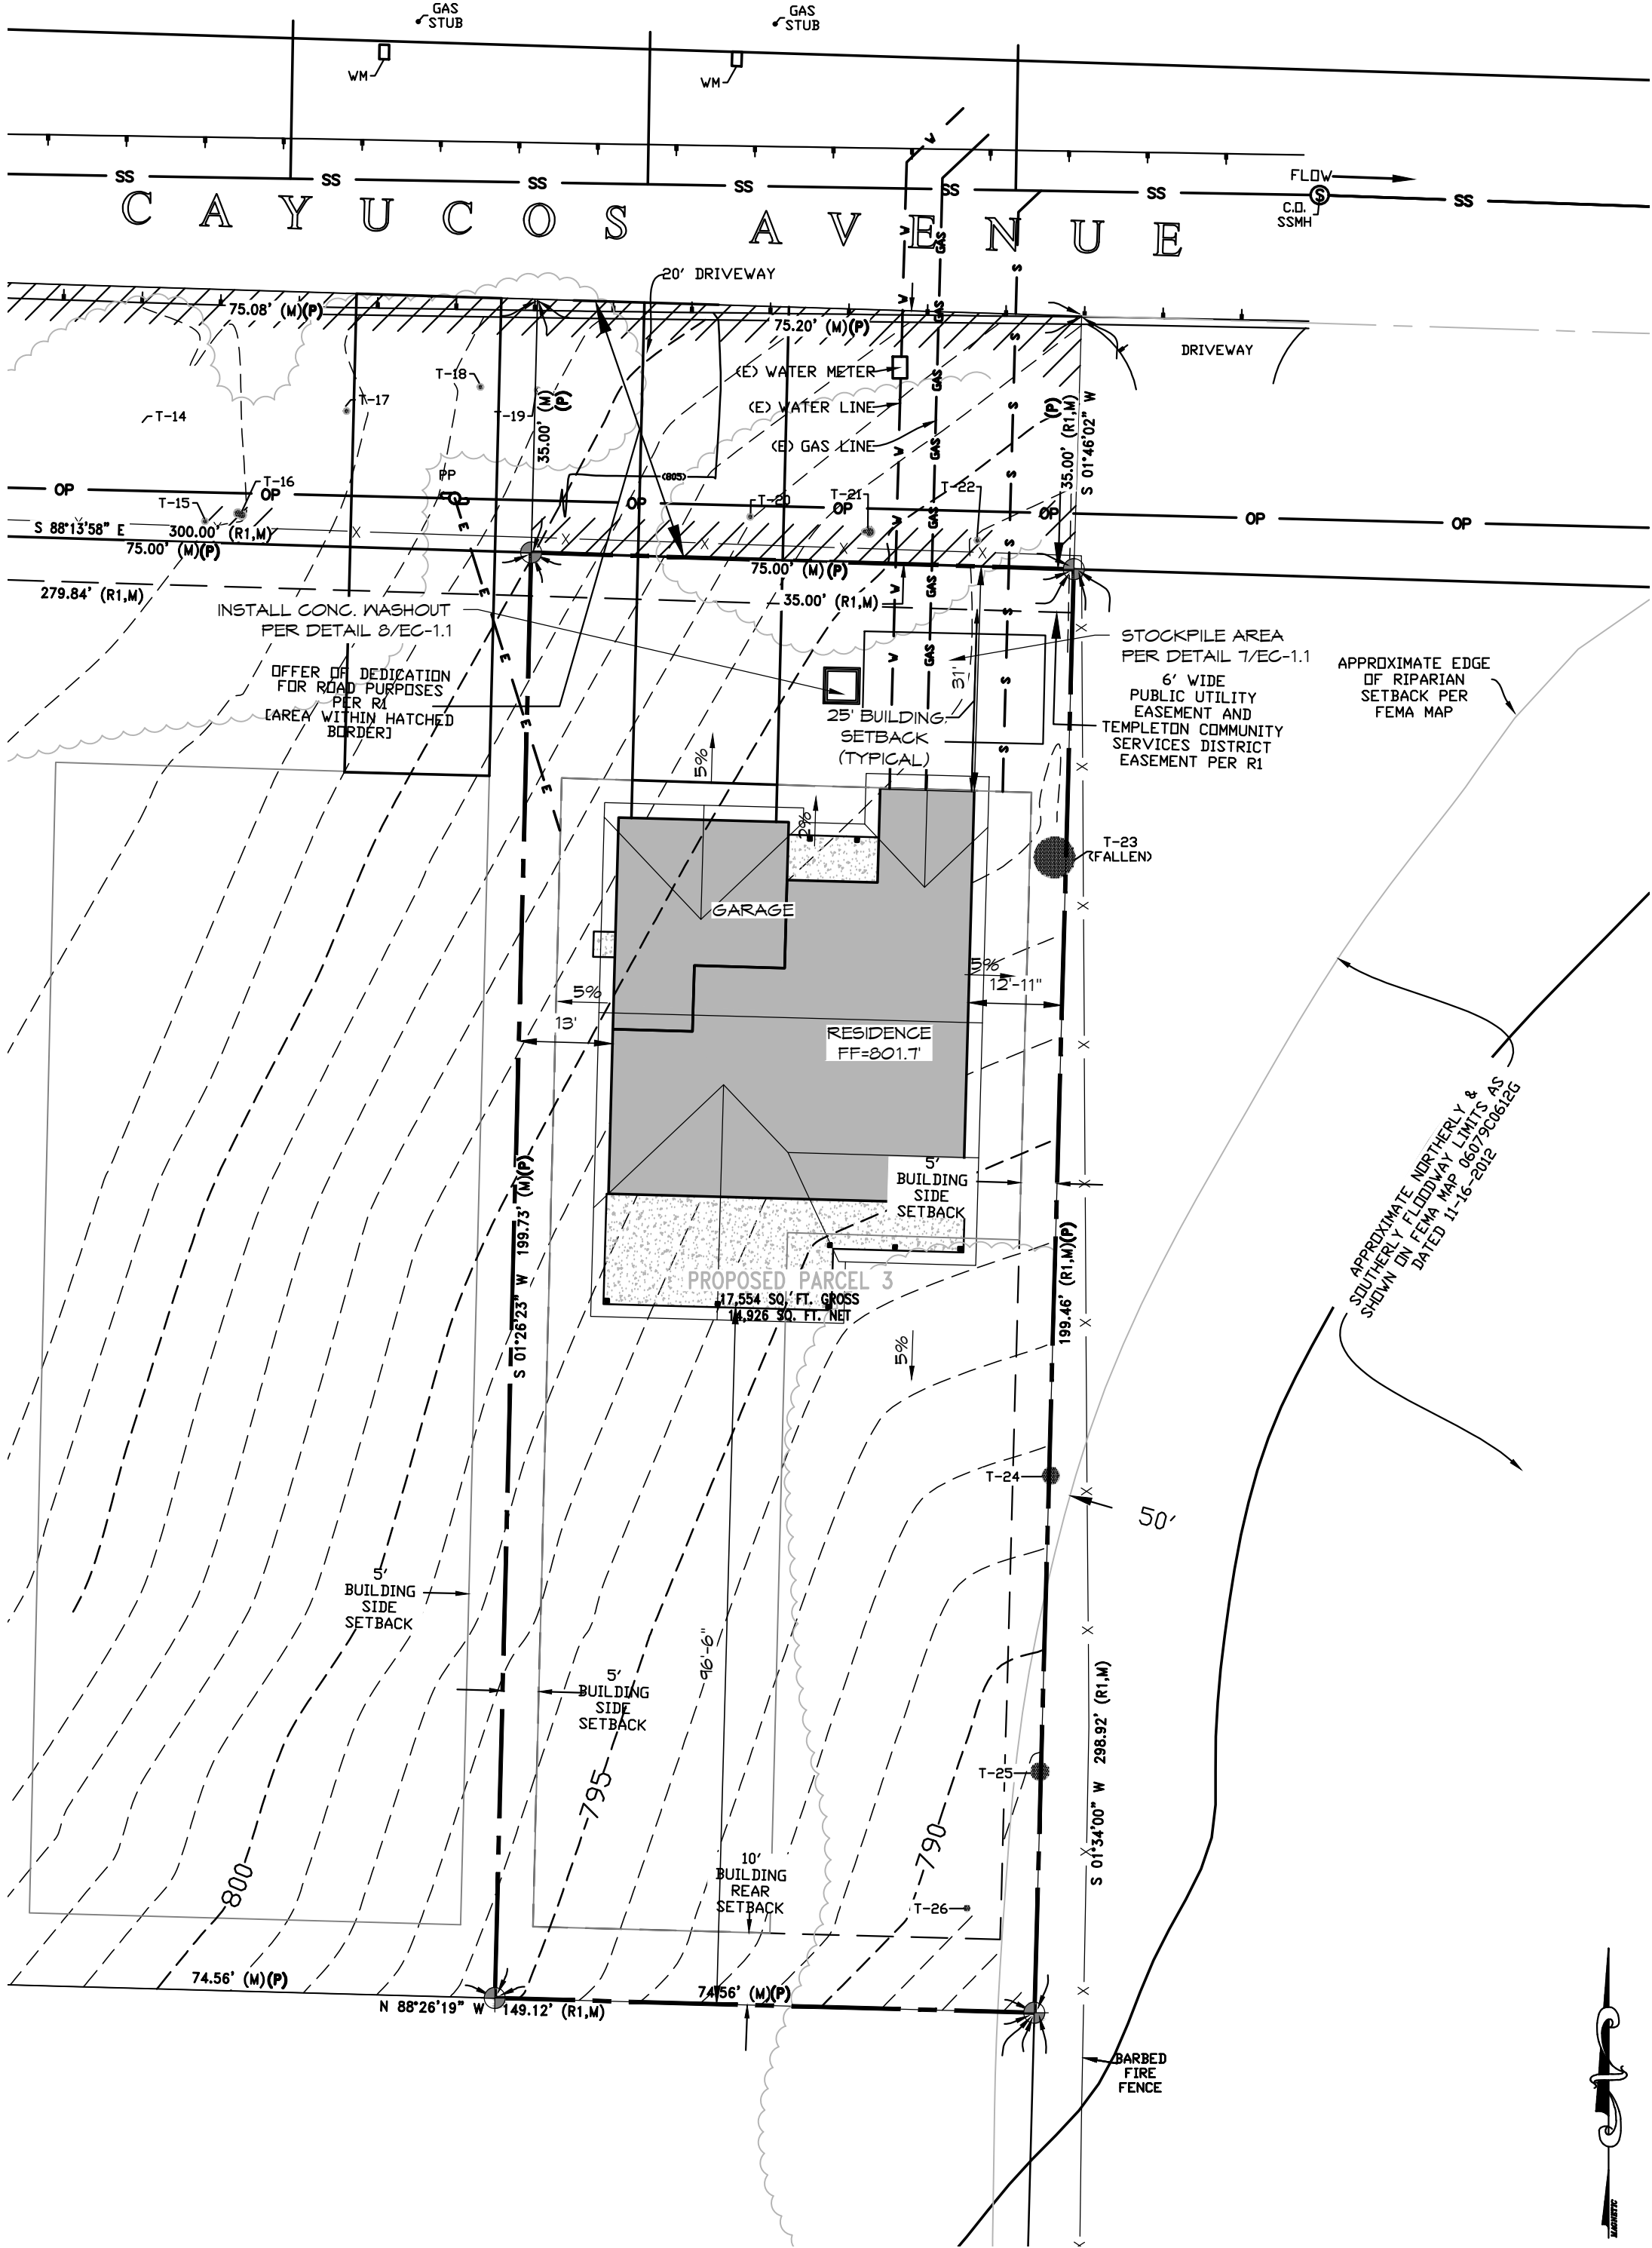

SITE PLAN

1" = 20'-0"

PROJECT TEAM

	SOLAR COMPANY	SOILS COMPANY	ENERGY FORMS	FIRE SPRINKLER	CIVIL ENGINEER	TRUSS COMPANY	ENGINEER	DRAFTSMAN	OWNER
	SUNCAL ELECTRIC 514 SPRING STREET PASO ROBLES, CA 93446 (805) 239-0111	GEO-SOLUTIONS, INC. 220 HUERA STREET SAN LUIS OBISPO, CA 93401 (805) 543-0539 JN: SLO8060-2	CARSTAIRS P.O. BOX 4156 SAN LUIS OBISPO, CA 93403 (805) 904-9048	SHAHER FIRE PROTECTION 4948 FLYTROT PASO ROBLES, CA 93446 (805) 610-9946	ROBERTS ENGINEERING 2015 VISTA DE LA VINA TEMPLETON, CA 93465 (805) 239-0664	TRUSPRO, INC. P.O. BOX 250 GUADALUPE, CA 93434 (800) 332-8187	JORDAN ENGINEERING 2190 MOOD DUCK LANE PASO ROBLES, CA 93446 (661) 246-5072	NRB DRAFTING, INC. 2121 PINE STREET, SUITE A PASO ROBLES, CA 93446 (805) 231-3146 (805) 231-1360 FAX	JON D. GLASS 616 FOREST AVE. TEMPLETON, CA 93465 (805) 459-0130

DESIGNER NOTE

PLANS PREPARED BY:

NELSON R. BERNAL
2121 PINE STREET, SUITE A
PASO ROBLES 231-3146 FX (805) 231-1360

NELSON R. BERNAL TAKES NO LIABILITY FOR INFORMATION PROVIDED BY THE OWNER IN THE PREPARATION OF THESE CONSTRUCTION DRAWINGS. THE OWNER HAS APPROVED THIS SET OF PLANS AND AGREED THAT THIS STRUCTURE IS BUILDABLE ON SAID LOT. THE DRAFTSMAN DOES NOT REPRESENT THAT THESE PLANS OR THE SPECIFICATIONS IN CONNECTION THEREWITH ARE SUITABLE, WHETHER OR NOT MODIFIED FOR ANY OTHER SITE THAN THE ONE FOR WHICH THEY WERE SPECIFICALLY PREPARED. THE CONTRACTOR SHALL VERIFY AND BE RESPONSIBLE FOR ALL DIMENSIONS AND CONDITIONS ON THE JOB AND THIS OFFICE MUST BE NOTIFIED IN LETTER OF ANY VARIATIONS FROM THE DIMENSIONS AND CONDITIONS SHOWN BY THESE DRAWINGS. THIS DRAWING IS NOT FINAL OR TO BE USED FOR CONSTRUCTION UNTIL SIGNED BY THE DRAFTSMAN. ALL DRAWING AND WRITTEN MATERIAL APPEARING HEREIN CONSTITUTE THE ORIGINAL AND UNPUBLISHED WORK OF THE DRAFTSMAN AND THE SAME MAY NOT BE DUPLICATED, USED OR DISCLOSED WITHOUT WRITTEN CONSENT OF THE DRAFTSMAN.

SHEET INDEX

CS	COVER SHEET/ SITE PLAN
SP	SPECIAL INSPECTION REQUIREMENTS
C-1/C-4	GRADING/EROSION CONTROL PLAN
LEG	LEGEND & ABBREVIATIONS
T-24	ENERGY COMPLIANCE FORMS
GC-1.1	GREEN CODE REQUIREMENTS
GC-1.2	GREEN CODE REQUIREMENTS
GC-1.3	GREEN CODE CHECKLIST
WF-1	WILD FIRE REQUIREMENTS
A-1	FLOOR PLAN
A-2	BUILDING SECTIONS
A-3.1	EXTERIOR ELEVATIONS
A-3.2	EXTERIOR ELEVATIONS
ELEC-4	ELECTRICAL PLAN
M-1	MECHANICAL PLAN
D-4	ARCHITECTURAL DETAILS
S-1	STRUCTURAL GENERAL NOTES
S-2	STANDARD TABLES & SPECIAL INSPECTIONS
S-3	FOUNDATION PLAN
S-4	ROOF FRAMING PLAN
D-1/D-4	STRUCTURAL DETAILS

AREA CALCS

FLOOR PLAN SQ. FOOTAGE	
LIVING:	1795 SQ. FT.
GARAGE:	504 SQ. FT.
COVERED PORCH:	575 SQ. FT.

BLDG CODE DATA

OCCUPANCY: R-3/U-1
TYPE OF CONSTRUCTION: VB
ALLOWABLE AREA: UNLIMITED
HEIGHT (MAX): 35'-0"
AUTOMATIC FIRE SPRINKLER: YES
STORIES: 1

CODE ANALYSIS

ALL CONSTRUCTION SHALL CONFORM TO THE:
2019 California Energy Code
2019 California Building Code
2019 California Electrical Code
2019 California Fire Code
2019 California Green Building Code
2019 California Mechanical Code
2019 California Plumbing Code
2019 California Residential Code
2019 California Reference Standards Code
AS WELL AS ALL COUNTY OF SAN LUIS OBISPO LAND AND BUILDING ORDINANCES AND GREEN BUILDING STANDARDS


PROJECT DATA

PARCEL 3, CO 15-0014 LOT SIZE: 0.34 AC
CAYUCOS AVE.
TOWN OF TEMPLETON
COUNTY OF SAN LUIS OBISPO
APN #: 041-075-011

SCOPE OF WORK

CONSTRUCT NEW 1-STORY SFD WITH ATTACHED GARAGE

VICINITY MAP

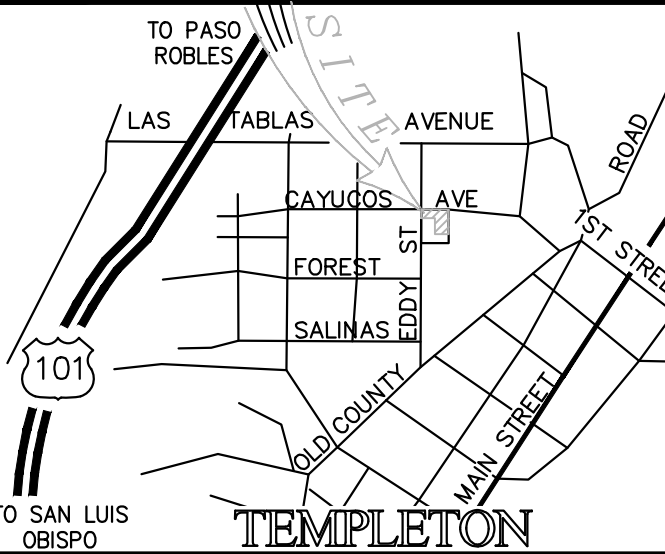

NUMBER OF ORIGINALS IN SETS 27

THESE RECORD DOCUMENTS HAVE BEEN PREPARED BASED UPON INFORMATION SUBMITTED. IN PART, BY OTHERS. WHILE THIS INFORMATION IS BELIEVED TO BE RELIABLE, NRB DRAFTING IS NOT RESPONSIBLE FOR THEIR ACCURACY, NOR FOR ERRORS OR OMISSIONS WHICH MAY HAVE BEEN INCORPORATED INTO THESE DOCUMENTS AS A RESULT.

NRB DRAFTING SERVICES, INC. NELSON R. BERNAL

2121 Pine St., SUITE A
Paso Robles, California 93446
Tel: 805.231.3146
Fax: 805.231.1360
Email: nelson@nrbdrafting.biz

ATTENTION: IF PLAN CHECK CORRECTION DATE DOES NOT APPEAR IN THE REVISION BLOCK BELOW, DO NOT LAYOUT / BUILD STRUCTURE FROM THIS COPY OF CONSTRUCTION DRAWINGS, UNLESS OTHERWISE INDICATED WITH "APPROVED" RED STAMP FROM LOCAL BUILDING AND PLANNING DEPARTMENT. COPIES WITHOUT CORRECTION DATE INDICATED ARE MOST LIKELY PRELIMINARY DOCUMENTS ONLY.

JON GLASS
APN: 041-075-011
CAYUCOS AVE.
TEMPLETON, CA 93465

20028

COVER SHEET


PMTR: 2020-0921

DESCRIPTION	DATE
CORRECTIONS	10-10-20

DRAWN	SCALE	DATE
9AB	1/4" = 1'-0"	04-10-20
JOB NO:	DWG NAME	CHECKED
202225		

SHEET

CS

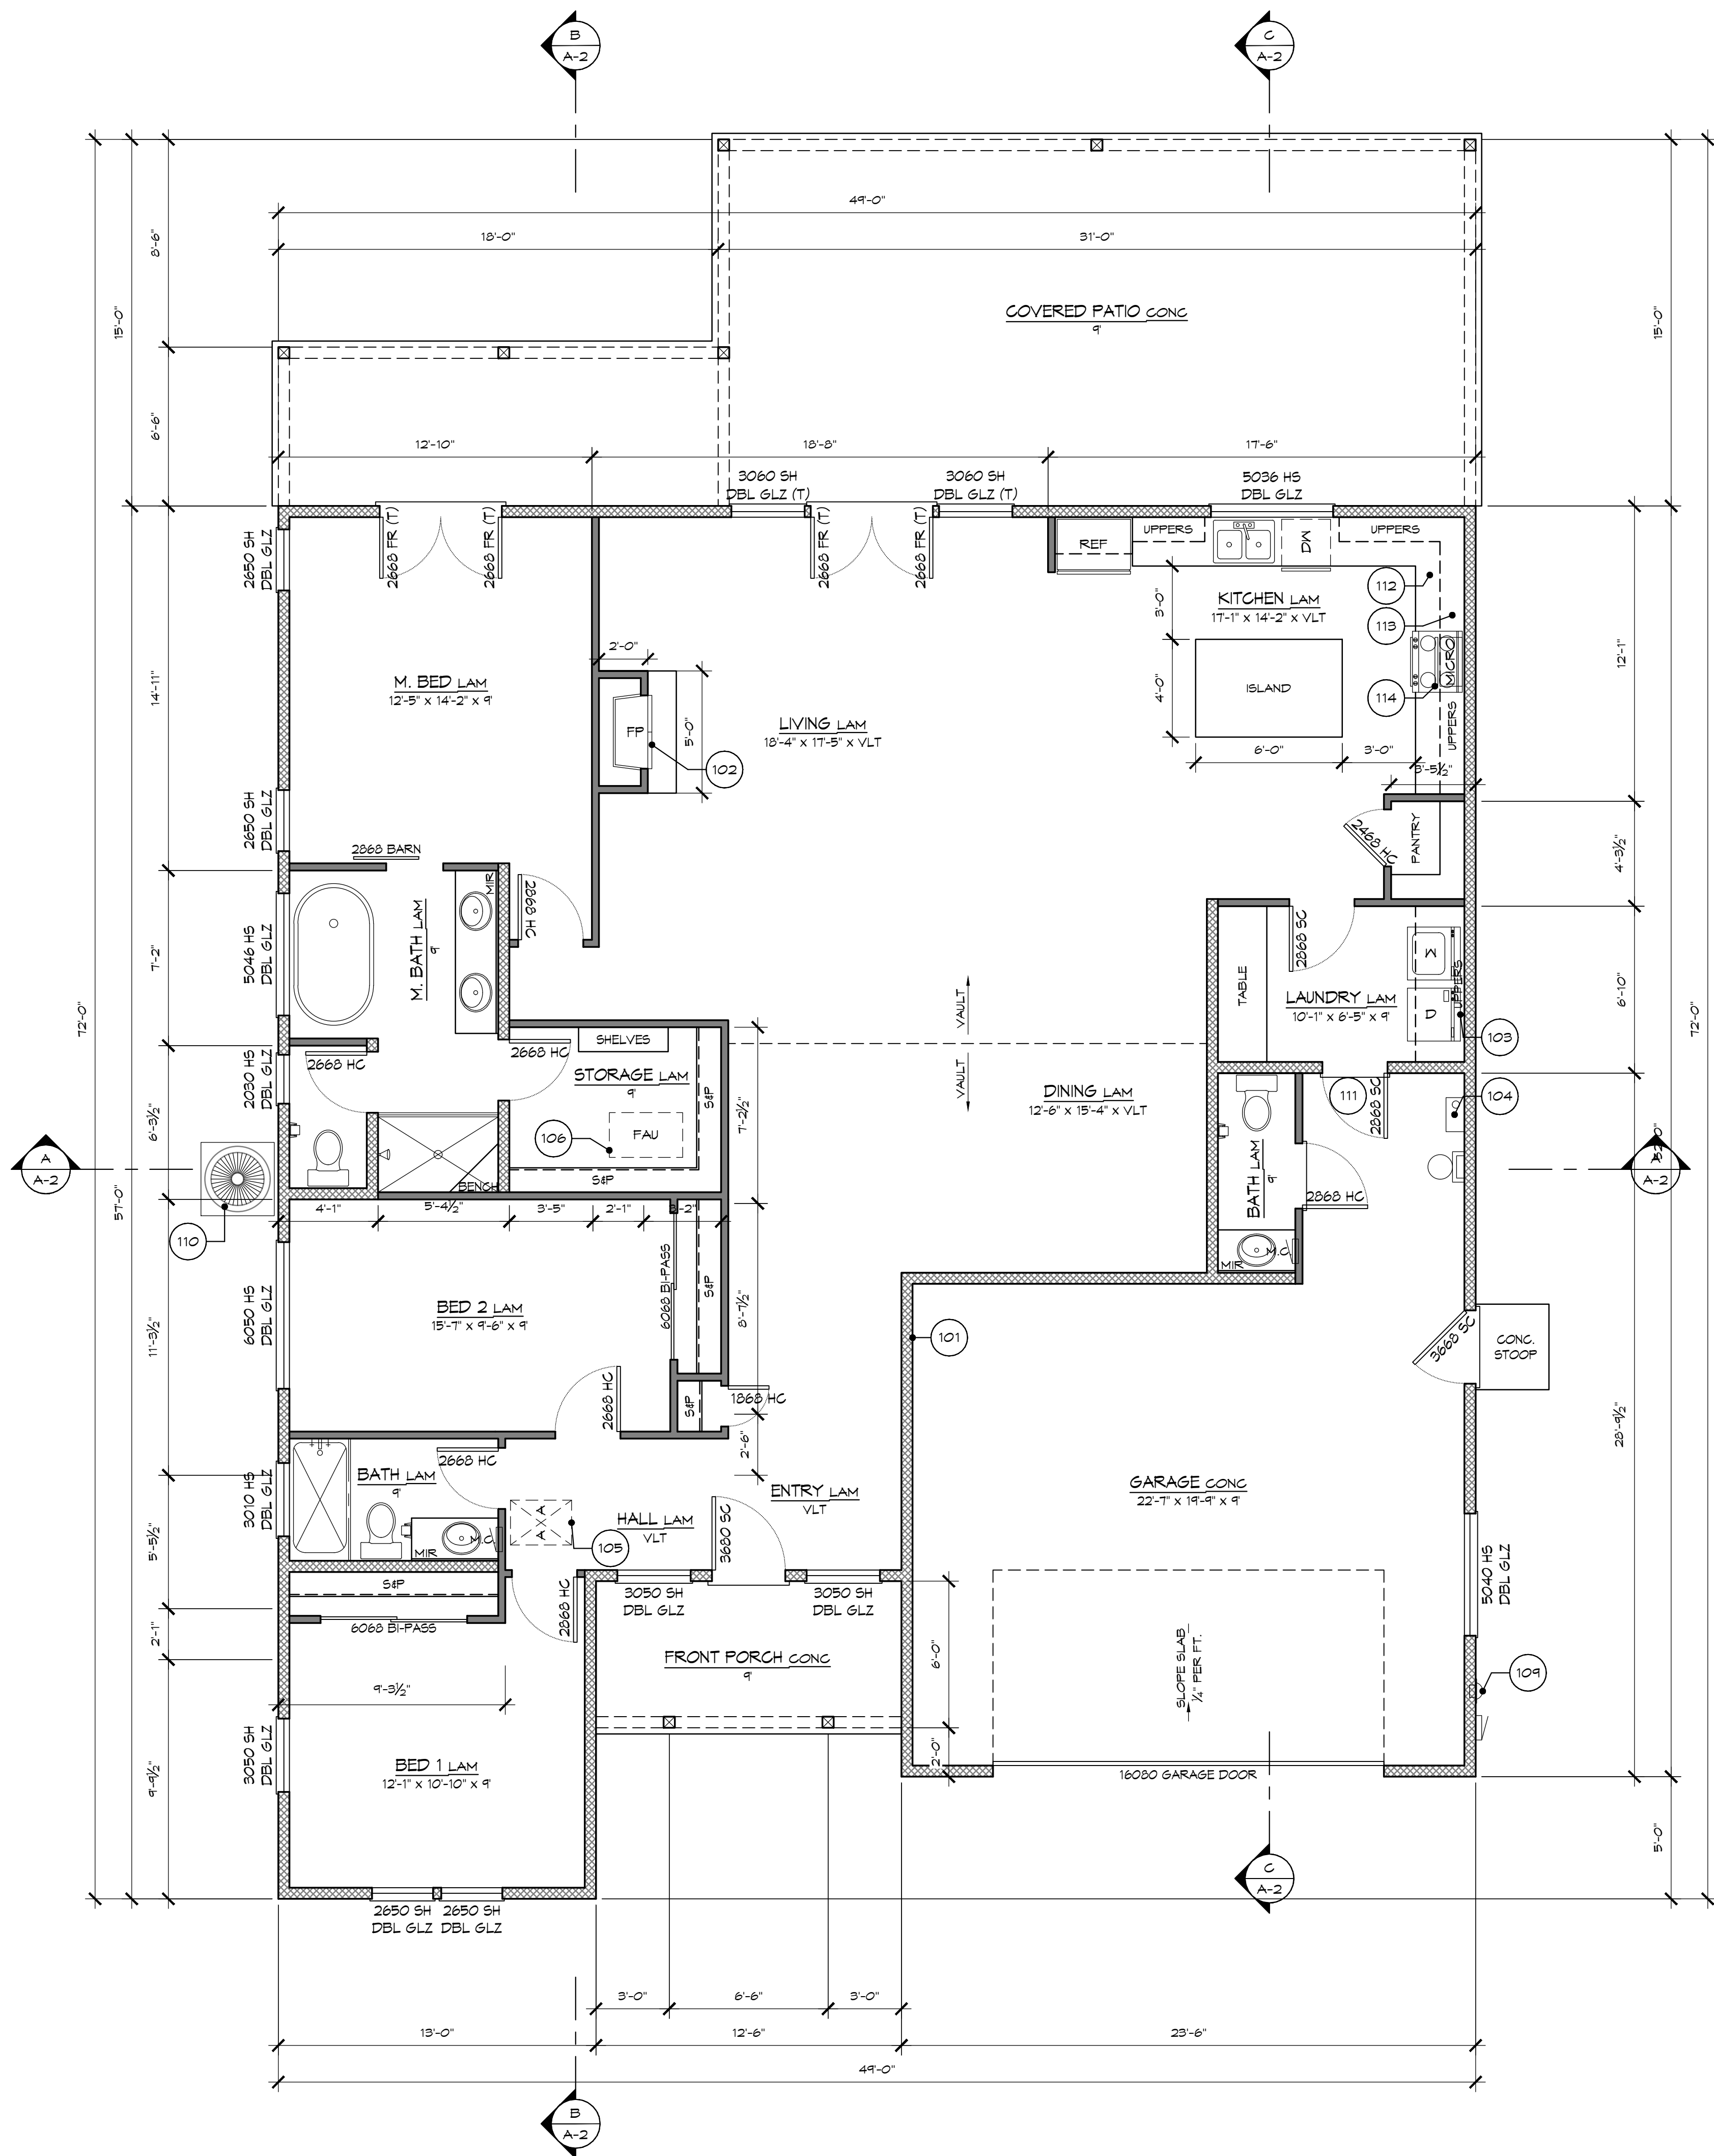

WALL LEGEND	
	2x4 STUDS @ 16" O.C.
	2x6 STUDS @ 16" O.C.
	1-HOUR FIRE WALL

KEYNOTES	
101	1/2" GYP BOARD ON COMMON WALLS WITH HOUSE FOUNDATION TO ROOF SHEATHING (REFER TO FLOOR PLAN NOTES)
102	SUPERIOR DRT 3035 (EPA PHASE II CERTIFIED & SLO COUNTY APCD RULE 504) AZ 22.15 14" HIGH HEARTH
103	VENT DRYER TO EXTERIOR, THROUGH ROOF IF NECESSARY
104	TANK-LESS WATER HEATER, INSTALL PER MANUFACTURES SPECIFICATIONS
105	22" x 30" ATTIC ACCESS
106	FAU IN ATTIC - SEE UTILITY PLAN FOR ADDITIONAL REQUIREMENTS
107	NOT USED
108	NOT USED
109	200 AMP ELECTRICAL PANEL
110	AIR-CONDENSER ON CONC. STOOOP
111	1 3/4" SOLID-CORE OR 20 MIN. RATED DOOR WITH SELF-CLOSER. MUST BE TIGHT FITTING TYPE
112	BUILT-IN CABINETS PER OWNER
113	UPPER CABINETS PER OWNER
114	RANGE WITH MICROWAVE ABOVE

FLOOR PLAN NOTES	
1.	ALL EXTERIOR HEADERS ABOVE OPENINGS SHALL BE 6 x 10 #1 DF UNLESS OTHERWISE NOTED. INTERIOR HEADER SHALL BE 4 x 8 #2 DF UNLESS NOTED.
2.	ALL INTERIOR PLUMBING WALLS RECOMMENDED TO BE 2 x 6 STUDS @ 16" O.C.
3.	PROVIDE FIRE STOPS IN CONCEALED SPACES OF STUD WALLS INCLUDING SPACES AT CEILINGS AND FLOORS AND IN OPENINGS AROUND DUCTS, PIPES, CHIMNEYS AND SIMILAR OPENINGS WHICH ALLOW PASSAGE OF FIRE.
4.	SHOWER AREA WALLS SHALL BE FINISHED WITH A SMOOTH NON-ABSORBENT, HARD SURFACE TO A HEIGHT OF 10' ABOVE DRAIN INLET.
5.	ALL FIREPLACES SHALL HAVE APPROVED COLLAPSIBLE METAL OR GLASS DOORS AND OUTSIDE COMBUSTION AIR. OUTSIDE COMBUSTION AIR IS NOT REQUIRED ON INTERIOR FIREPLACES INSTALLED OVER CONCRETE SLAB ON GRADE. MANUFACTURER'S INSTALLATION GUIDE TO BE ON-SITE FOR INSPECTION.
6.	ALL SOLID FUEL BURNING APPLIANCES (STOVES/FIREPLACES) FOR WHICH A CONSTRUCTION PERMIT APPLICATION IS SUBMITTED AFTER FEBRUARY 1,1994 MAY BE INSTALLED ONLY IF "EPA" CERTIFIED AS RECOGNIZED BY THE AIR POLLUTION CONTROL BOARD (COUNTY BOARD OF SUPERVISOR) APCD 504.
7.	FLUE DAMPER TO BE PERMANENTLY BLOCKED OPEN IF A GAS LOG LIGHTER IS PROPOSED. CMC
8.	FLOOR LEVEL CHANGE AT DOORS NOT TO EXCEED 1/2".
9.	METAL CHIMNEYS SHALL BE ANCHORED AT EACH FLOOR AND ROOF WITH TWO 1 1/2" x 1/8" METAL STRAPS LOOPED AROUND THE OUTSIDE OF THE CHIMNEY INSTALLATION AND NAILED WITH NOT LESS THAN (6) 8d NAILS PER STRAP AT EACH JOIST. CBC
10.	PROVIDE EMERGENCY EXIT DOOR OR WINDOW FROM SLEEPING ROOMS. NET CLEAR WINDOW OPENING SHALL NOT BE LESS THAN 5.0 SQ. FT. MIN. NET OPENING HEIGHT DIMENSION, 24" CLEAR. MIN. NET OPENING WIDTH DIMENSION, 20" CLEAR FINISHED SILL HEIGHT. MAX. 44" TO THE BOTTOM OF THE CLEAR OPENING.
11.	OCCUPANCY SEPARATION BETWEEN GARAGE AND HOUSE SHALL BE OF 1/2" GYPSUM BOARD CONSTRUCTION ON THE GARAGE SIDE. CBC A. FIREWALL IS REQUIRED TO EXTEND FROM FLOOR TO ROOF SHEATHING PROVIDED A COMPLETE SEPARATION BETWEEN THE GARAGE AND SPD OR THE CEILING AND ALL BEARING WALLS OF CEILING ARE REQUIRED TO BE COVERED WITH FIRE RATED DRYWALL. B. WHEN THE CEILING IN THE GARAGE IS REQUIRED TO BE ENTIRELY PROTECTED, THE WALLS, BEAMS OR POSTS SUPPORTING THE CEILING ARE TO BE PROTECTED WITH EQUIVALENT FIRE RESTRICTIVE CONSTRUCTION. CBC C. IF THE SEPARATION IS A FLOOR-CEILING ASSEMBLY, THE CEILING AND ALL SUPPORTING ELEMENTS AND POSTS MUST BE FIRE PROTECTED AND JACKETED FOR PROTECTION AGAINST MECHANICAL DAMAGE 104.2.5 AND 6.
12.	SKYLIGHTS SHALL BE TEMPERED GLASS.
13.	EXTERIOR WINDOWS, WINDOW WALLS, GLAZED DOORS, AND GLAZED DOORS SHALL BE DUAL-GLAZED UNITS WITH A MINIMUM OF ONE TEMPERED PANE OR SHALL BE GLASS BLOCK UNITS OR SHALL HAVE A FIRE-RESTRICTIVE RATING NOT LESS THAN 20 MINUTES. GLAZING FRAMES MADE OF VINYL SHALL HAVE WELDED CORNERS AND METAL REINFORCEMENT IN THE INTERLOCK AREA.
14.	EXTERIOR DOORS AND EXTERIOR GLAZING SHALL COMPLY WITH FIRE REQUIREMENTS PER SHEET MF-1.

PLAN LEGEND	
	REFRIGERATOR (N.I.C.)
	COOKTOP W/HOOD
	OPTIONAL TRASH COMPACTOR
	CONDENSER ON CONCRETE PAD
	DISHWASHER
	OVEN/MICROWAVE
	DOUBLE SINK W/ DISPOSAL
	LAVATORY
	WATER CLOSET
	SHOWER
	TUB ON PLATFORM
	TUB/SHOWER
	OPTIONAL SOAKING SINK
	DRYER (N.I.C.)
	WASHER (N.I.C.)
	MEDICINE CABINET
	TOILET PAPER DISPENSER @ 119"
	TOWEL BAR (PROVIDE SOLID BACKING)
	GAS METER
	ELEC. METER

AREAS:	
LIVING	1935 SQ. FT.
GARAGE	574 SQ. FT.
FRONT PORCH	75 SQ. FT.
COVERED PATIO	465 SQ. FT.

FLOOR PLAN

1/4" = 1'-0"

NRB
DRAFTING
SERVICES, INC.
NELSON R. BERNAL

2121 Pine St., SUITE A
Paso Robles, California 93446
Tel: 805.231.3146
Fax: 805.231.1866
Email: nelsonnrbdrafting.biz

ATTENTION: IF PLAN CHECK CORRECTION DATE DOES NOT APPEAR IN THE REVISION BLOCK BELOW, DO NOT LAYOUT / BUILD STRUCTURE FROM THIS COPY OF CONSTRUCTION DRAWINGS, UNLESS OTHERWISE INDICATED WITH "APPROVED" RED STAMP FROM LOCAL BUILDING AND PLANNING DEPARTMENT. COPIES WITHOUT CORRECTION DATE INDICATED ARE MOST LIKELY PRELIMINARY DOCUMENTS ONLY.

JON GLASS
APN: 041-075-011
CAYUCOS AVE.
TEMPLETON, CA 93465

20028


FLOOR PLAN

PMTR: 2020-00921

REVISIONS	
DESCRIPTION	DATE
CORRECTIONS	10-10-20


DRAWN	SCALE	DATE
SHB	1/4" = 1'-0"	04-10-20
JOB NO.	DWG NAME	CHECKED
20028		
SHEET		

A-1

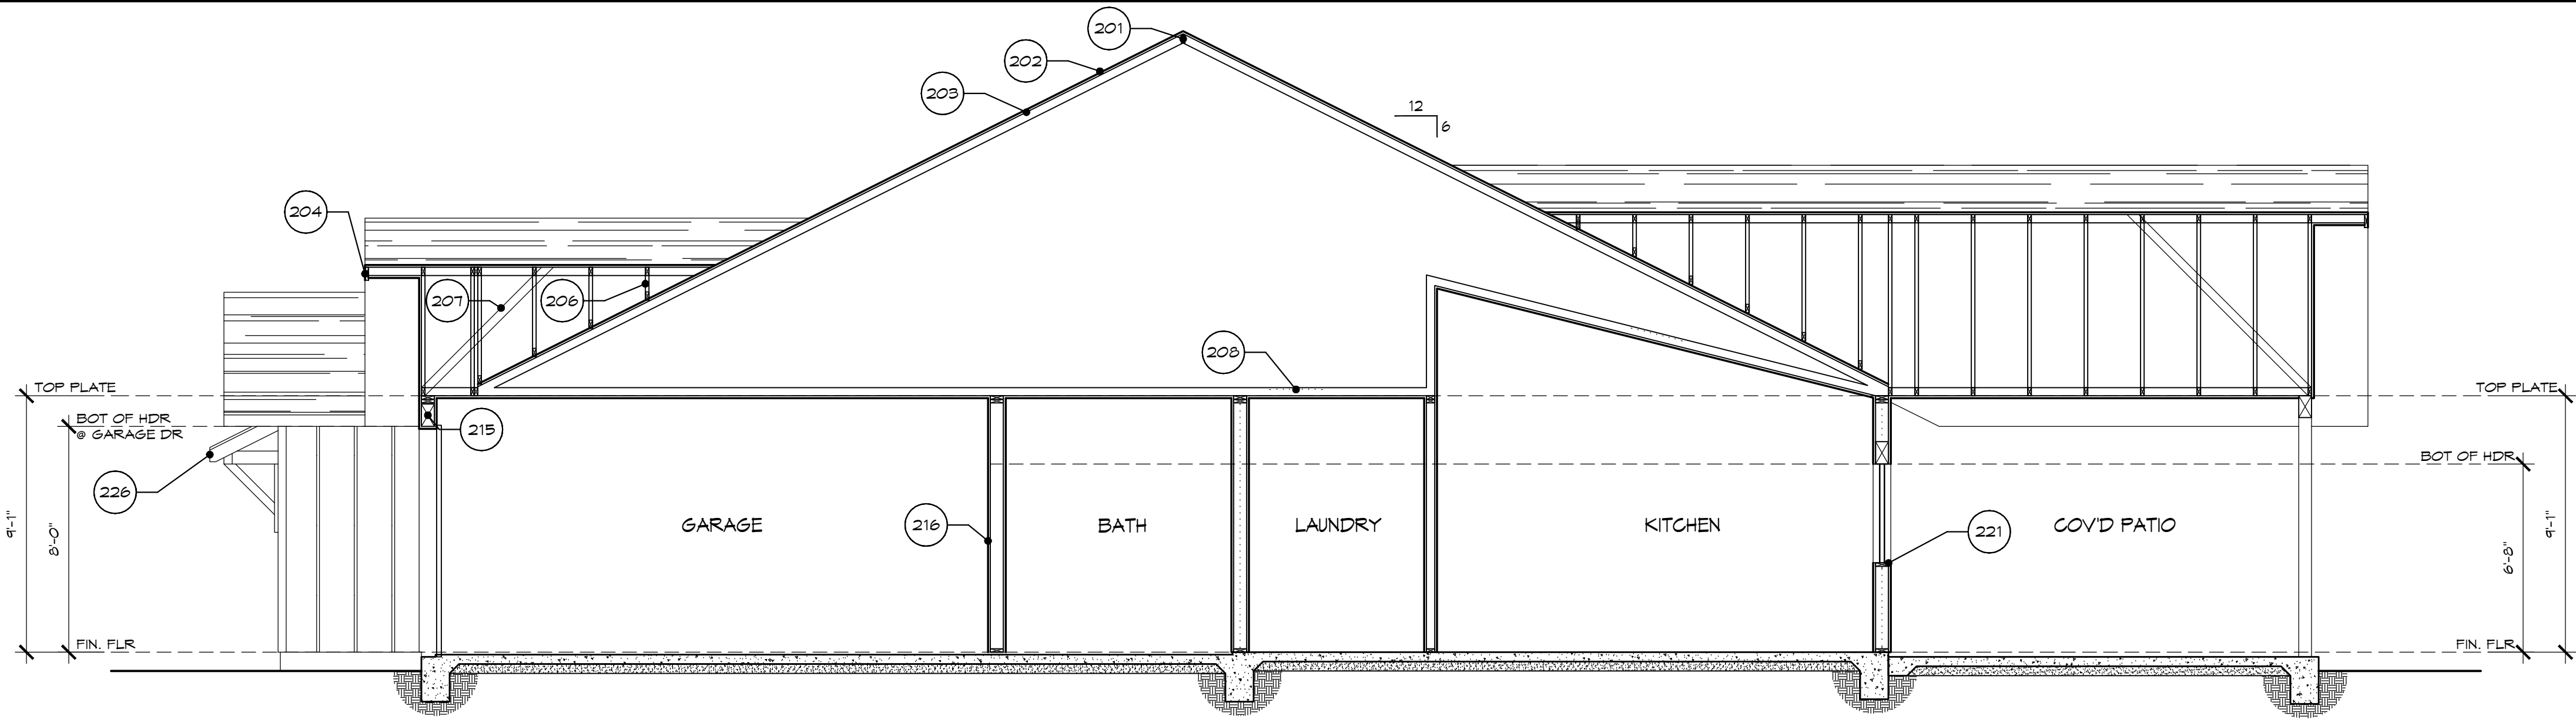


SECTION 'B'

1/4" = 1'-0"

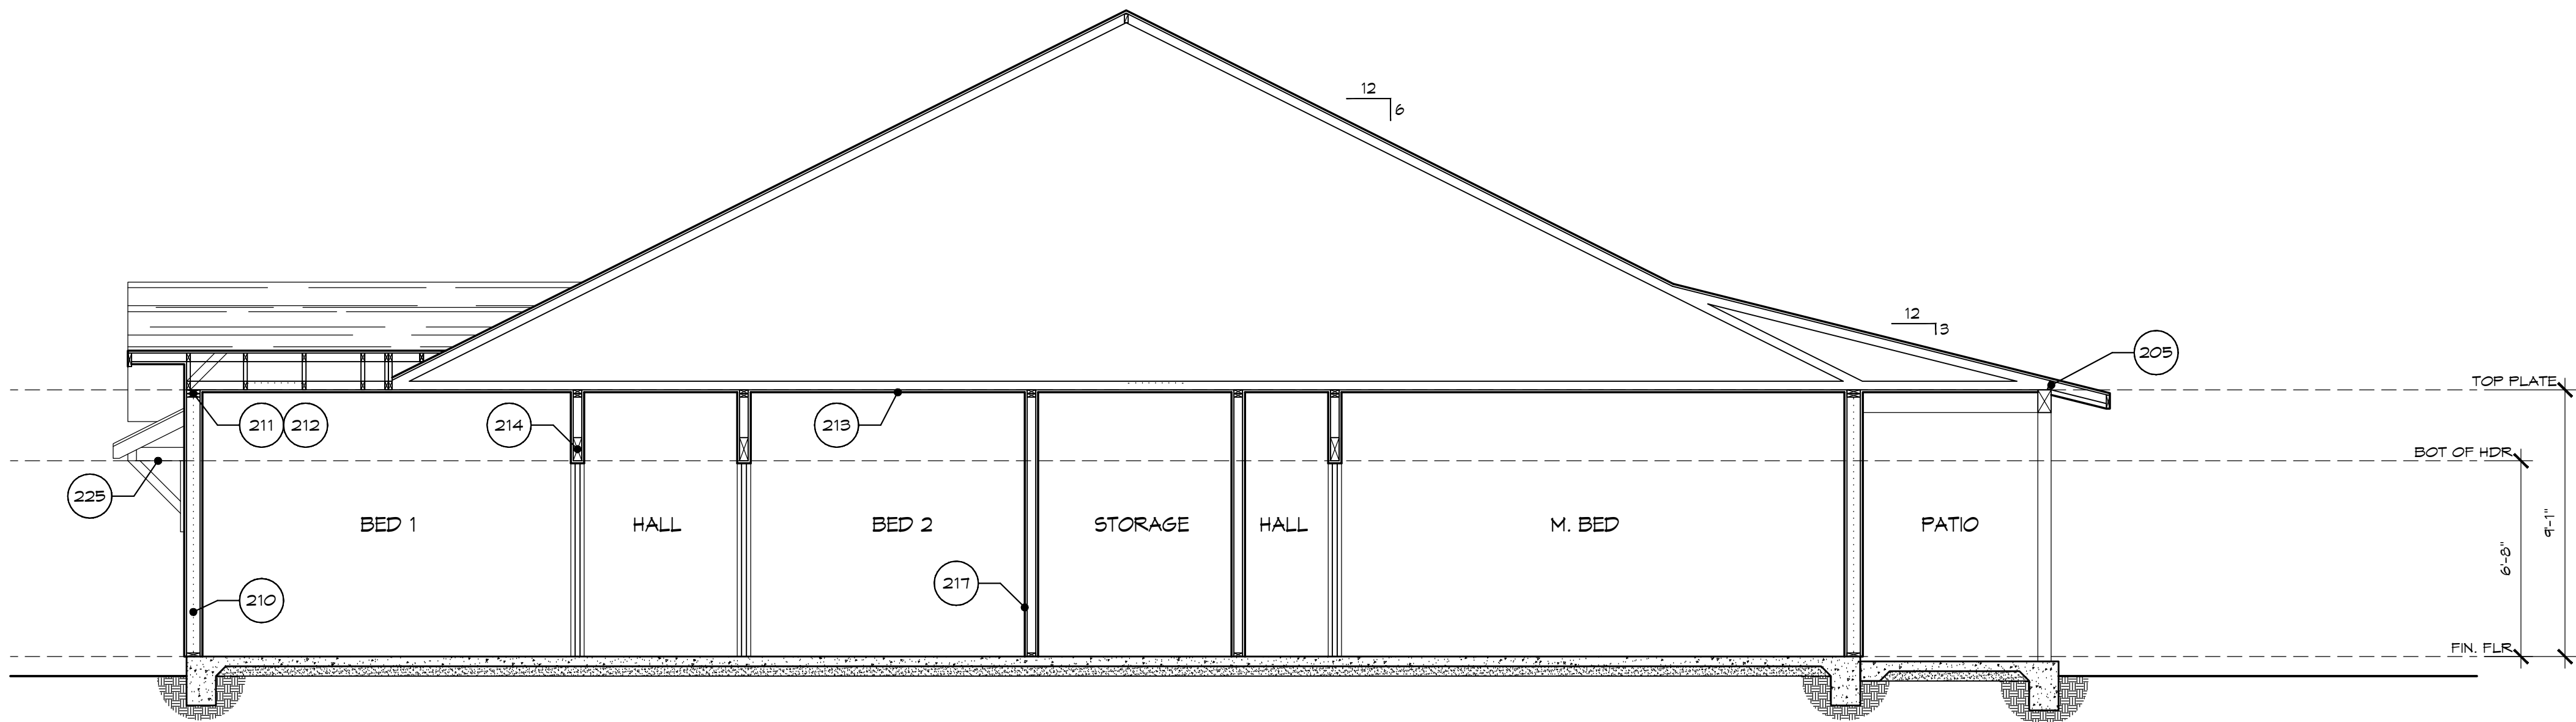

SECTION 'B'

1/4" = 1'-0"

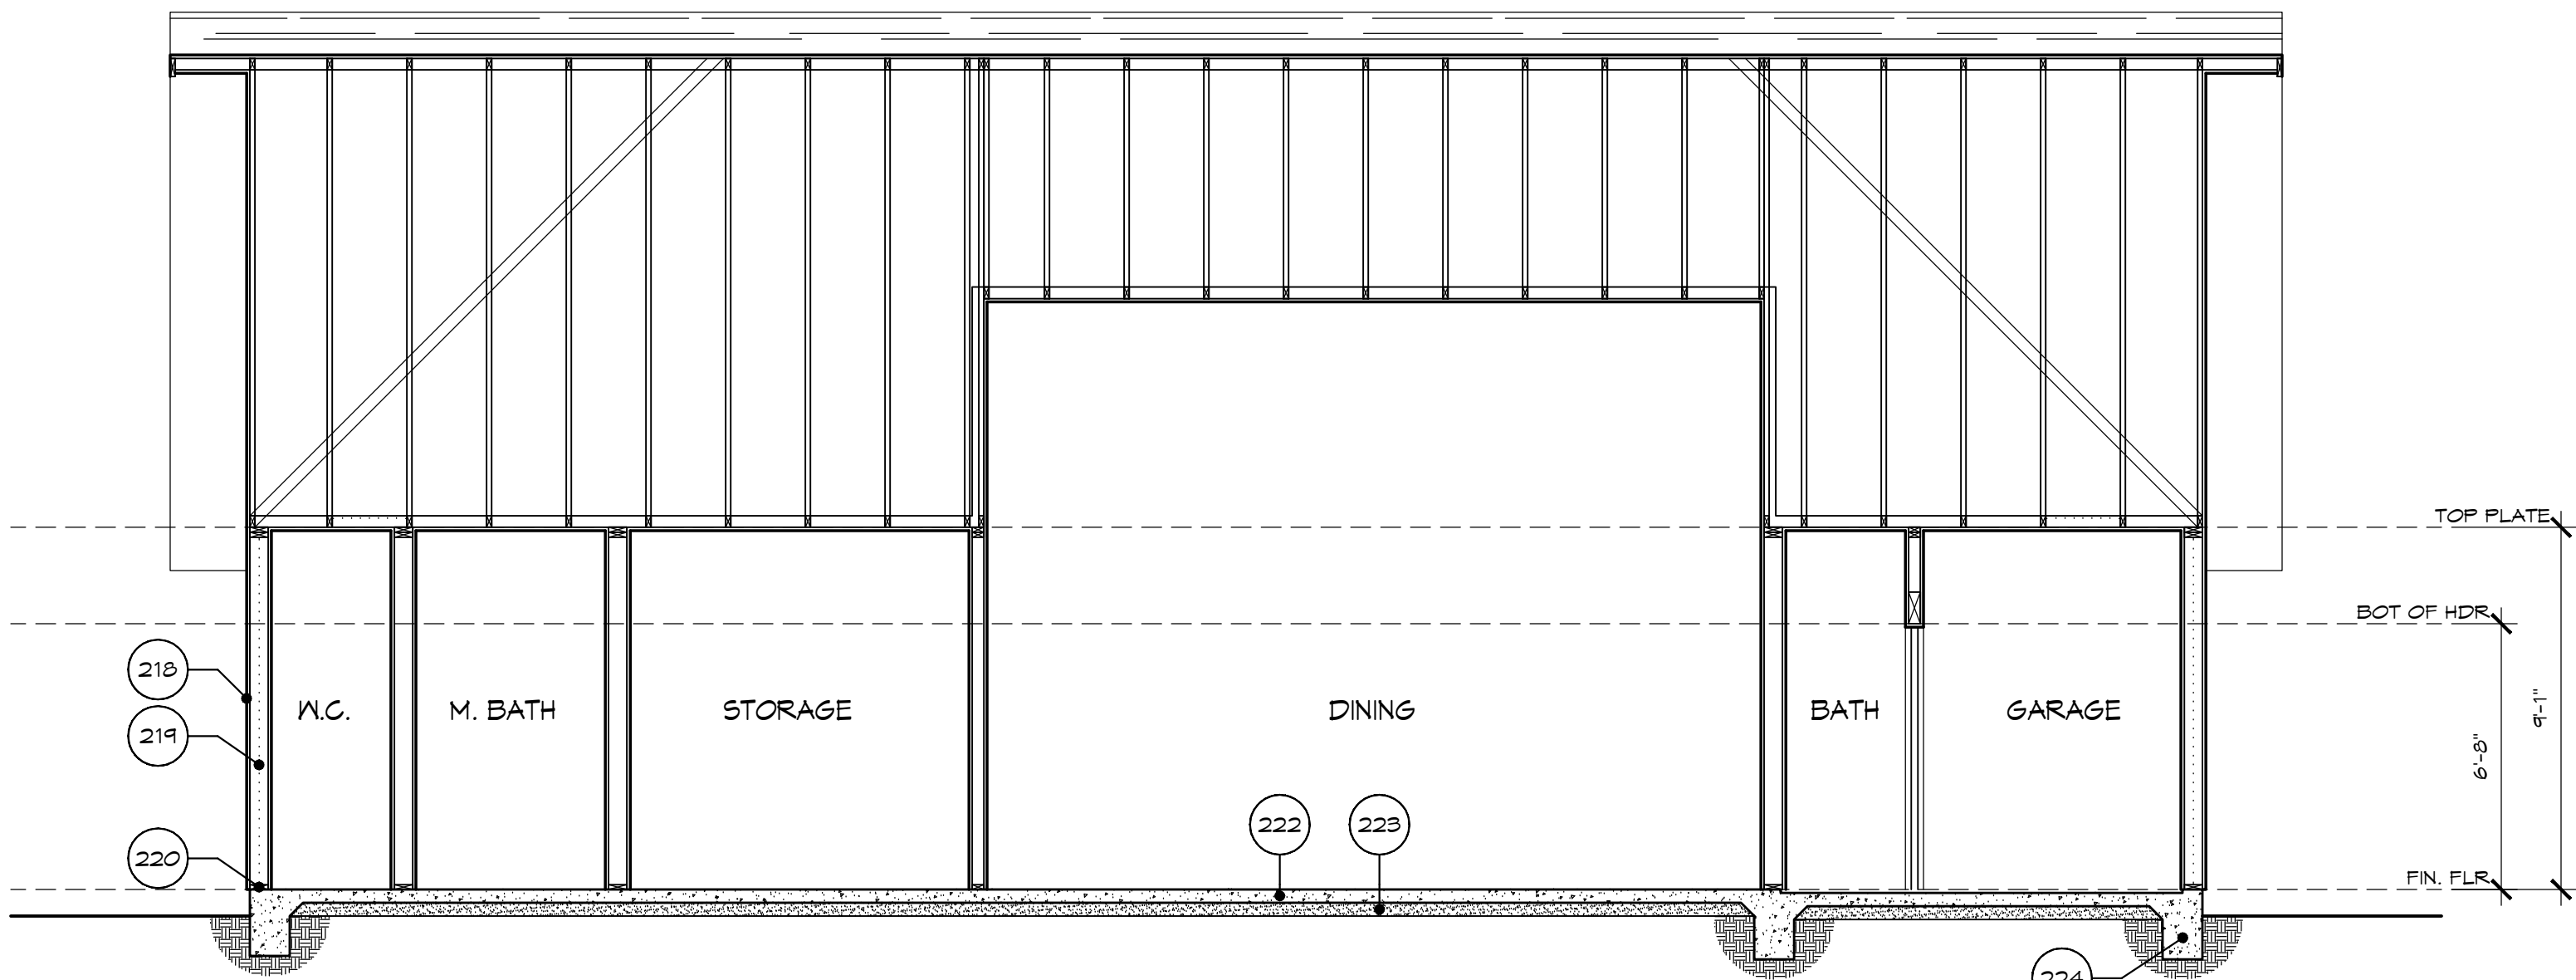

SECTION 'A'

1/4" = 1'-0"

KEYNOTES

- 201 SOLID BLK @ RIDGE
202 3/4" CDX ROOF PLY (RADIANT BARRIER) W/ Bd @ 6'-6" O.C.
203 CLASS-A COMP. SHINGLE ROOF O/ 15# BLDG FELT
204 2x6 HEM FIR FASCIA
205 SOLID BLKS W/ Bd @ 6" O.C.
206 PRE-MANUF. TRUSSES @ 24" O.C. MAX.
207 2x4 #2 DF ATTIC BRACES @ 48" O.C.
208 R-38 INSULATION IN ATTIC (TYP)
209 NOT USED
210 R-20 INSULATION IN WALLS (TYP)
211 USE H-1 OR A-35 CLIPS TRUSS TO T.P.
212 DBL TOP-PLATES W/ 48" MIN LAPS
213 5/8" GYP BOARD ON CEILING (TYP)
214 6 X10 #1 DF HEADERS (TYP)
215 GARAGE DOOR HDR PER PLAN
216 1/2" TYPE 'X' GYP BOARD ON COMMON WALL W/ HOUSE FLOOR TO ROOF SHEATHING
217 1/2" GYP BOARD ON WALLS
218 HORIZONTAL HARD-PLANK EXTERIOR SIDING O/ APPROVED BUILDING PAPER
219 2x6 EXTERIOR STUDS @ 16" O.C.
220 P.T. DF SILL PLATES W/ 5/8" # A.B. PER PLANS
221 1 X 4 TRIM AROUND ALL DOOR & WINDOW OPENINGS
222 4" THICK CONC. SLAB W/ #3 BARS @ 18" O.C.
223 4" COMP. SAND O/ 10ML VAPOR BARRIER
224 #5 BARS CONT. @ TOP & BOTTOM
225 HARDIE-SOFFIT UNDER ALL EXPOSED EAVES, SOFFITS, & LIDS OF COVERED PORCHES/PATIOS
226 ALUMINUM SEAMLESS GUTTERS W/ DOWNSPOUTS. PROVIDE MEANS TO PREVENT ACCUMULATION OF LEAVES AND DEBRIS



2121 Pine St., SUITE A
Paso Robles, California 93446
Tel: 805.231.5146
Fax: 805.231.1865
Email: nelsonnrbdrafting.biz

ATTENTION: IF PLAN CHECK CORRECTION DATE DOES NOT APPEAR IN THE REVISION BLOCK BELOW, DO NOT LAYOUT / BUILD STRUCTURE FROM THIS COPY OF CONSTRUCTION DRAWINGS, UNLESS OTHERWISE INDICATED WITH 'APPROVED' RED STAMP FROM LOCAL BUILDING AND PLANNING DEPARTMENT. COPIES WITHOUT CORRECTION DATE INDICATED ARE MOST LIKELY PRELIMINARY DOCUMENTS ONLY.

JON GLASS
APN: 041-075-011
CAYUCOS AVE.
TEMPLETON, CA 93465

20028

SECTIONS

PMTR: 2020-00921

REVISIONS	
DESCRIPTION	DATE
CORRECTIONS	10-10-20

DRAWN	SCALE	DATE
GAB	1/4" = 1'-0"	04-10-20
JOB NO.	DWG NAME	CHECKED
20028		
SHEET		

A-2

ATTIC VENT CALCS

LIVING AND PORCH ATTIC VENTILATION REQUIRED

ROOF SQ. FT. = 1955 / 300 PER CRC R806.2
6.51000 SQUARE FT. X 144 SQ.IN.
937.4 SQ. IN. FREE AREA REQ'D
375.0 TO 468.7 SQ. IN. (40% TO 50%) UPPER VENTILATION REQ'D
EAVE VENTS AT 41 SQ. IN.
GABLE VENTS AT 102 SQ. IN.
ROOF VENTS AT 105 SQ. IN.

UPPER VENTILATION

2 GABLE VENTS @ 102 SQ. INCHES = 204 SQ. INCHES
2 ROOF VENTS @ 105 SQ. INCHES = 210 SQ. INCHES
0 EAVE VENTS @ 41 SQ. INCHES = 0 SQ. INCHES
414 SQ. INCHES PROVIDED (44.2 % OF REQ'D)

LOWER VENTILATION

0 GABLE VENTS @ 102 SQ. INCHES = 0 SQ. INCHES
4 ROOF VENTS @ 105 SQ. INCHES = 420 SQ. INCHES
2 EAVE VENTS @ 41 SQ. INCHES = 82 SQ. INCHES
502 SQ. INCHES PROVIDED

916 TOTAL SQ. INCHES PROVIDED

- * GABLE VENTS TO BE APPROVED "VULCAN VENT" MODEL V61424FF
- * ROOF VENTS TO BE APPROVED "VULCAN VENT" MODEL V5B1212

NOTE: SECTION R806.2 REQUIRES A MINIMUM OF 40% AND NOT MORE THAN 50% OF THE REQUIRED VENTILATING AREA IN THE UPPER PORTION OF THE ATTIC.

GARAGE ATTIC VENTILATION REQUIRED

ROOF SQ. FT. = 509 / 300 PER CRC R806.2
1.7 SQUARE FT. X 144 SQ.IN.
244.3 SQ. IN. FREE AREA REQ'D
97.7 TO 122.2 SQ. IN. (40% TO 50%) UPPER VENTILATION REQ'D
EAVE VENTS AT 41 SQ. IN.
GABLE VENTS AT 102 SQ. IN.
ROOF VENTS AT 105 SQ. IN.

UPPER VENTILATION

1 GABLE VENTS @ 102 SQ. INCHES = 102 SQ. INCHES
0 ROOF VENTS @ 105 SQ. INCHES = 0 SQ. INCHES
2 EAVE VENTS @ 41 SQ. INCHES = 82 SQ. INCHES
184 SQ. INCHES PROVIDED (75.3 % OF REQ'D)



LOWER VENTILATION

0 GABLE VENTS @ 102 SQ. INCHES = 0 SQ. INCHES
2 ROOF VENTS @ 105 SQ. INCHES = 210 SQ. INCHES
0 EAVE VENTS @ 41 SQ. INCHES = 0 SQ. INCHES
210 SQ. INCHES PROVIDED

394 TOTAL SQ. INCHES PROVIDED


- * GABLE VENTS TO BE APPROVED "VULCAN VENT" MODEL V61424FF
- * ROOF VENTS TO BE APPROVED "VULCAN VENT" MODEL V5B1212

NOTE: SECTION R806.2 REQUIRES A MINIMUM OF 40% AND NOT MORE THAN 50% OF THE REQUIRED VENTILATING AREA IN THE UPPER PORTION OF THE ATTIC.

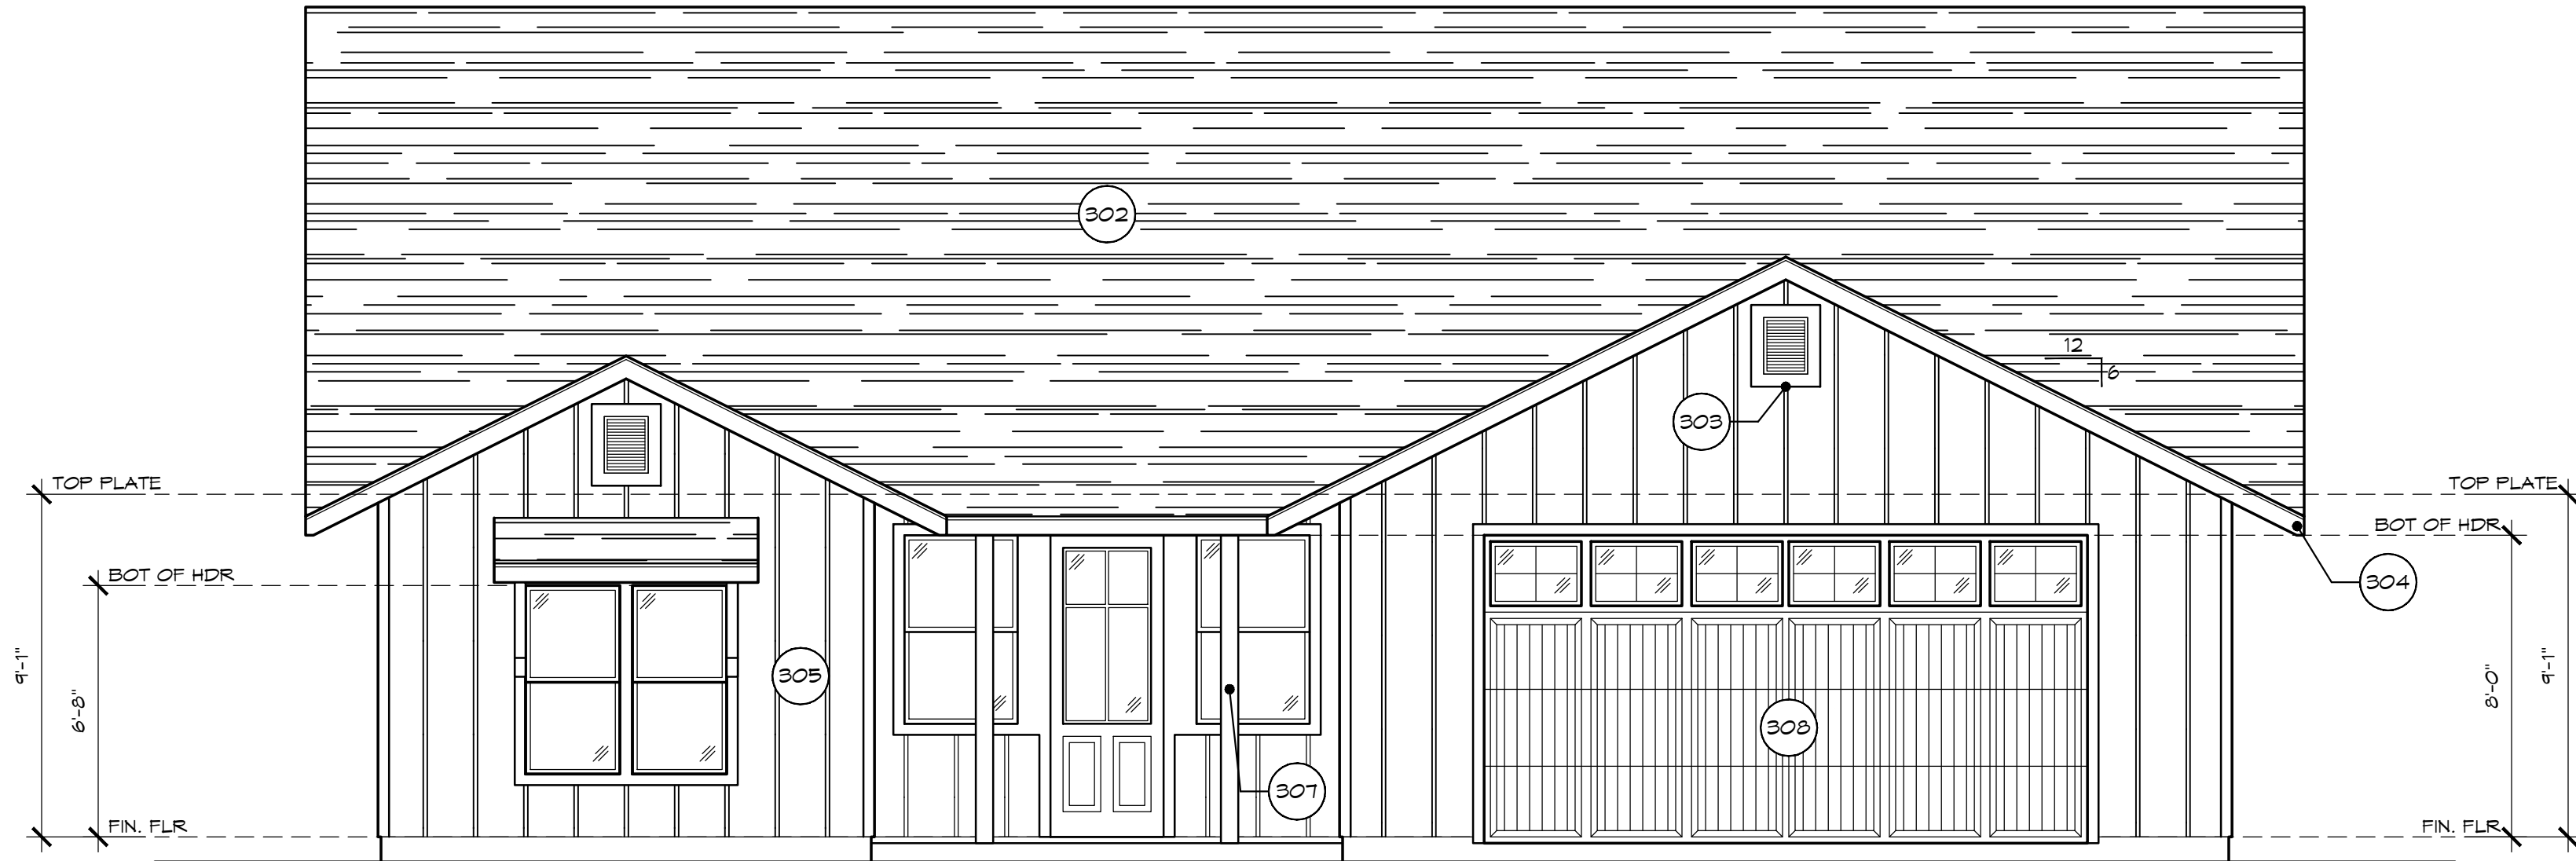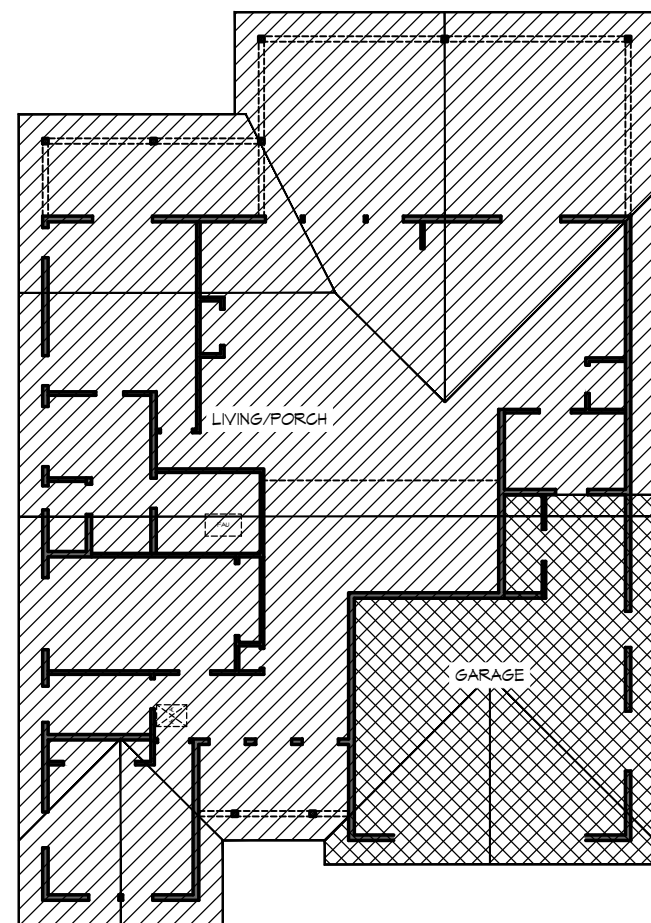

FRONT ELEVATION

1/4" = 1'-0"

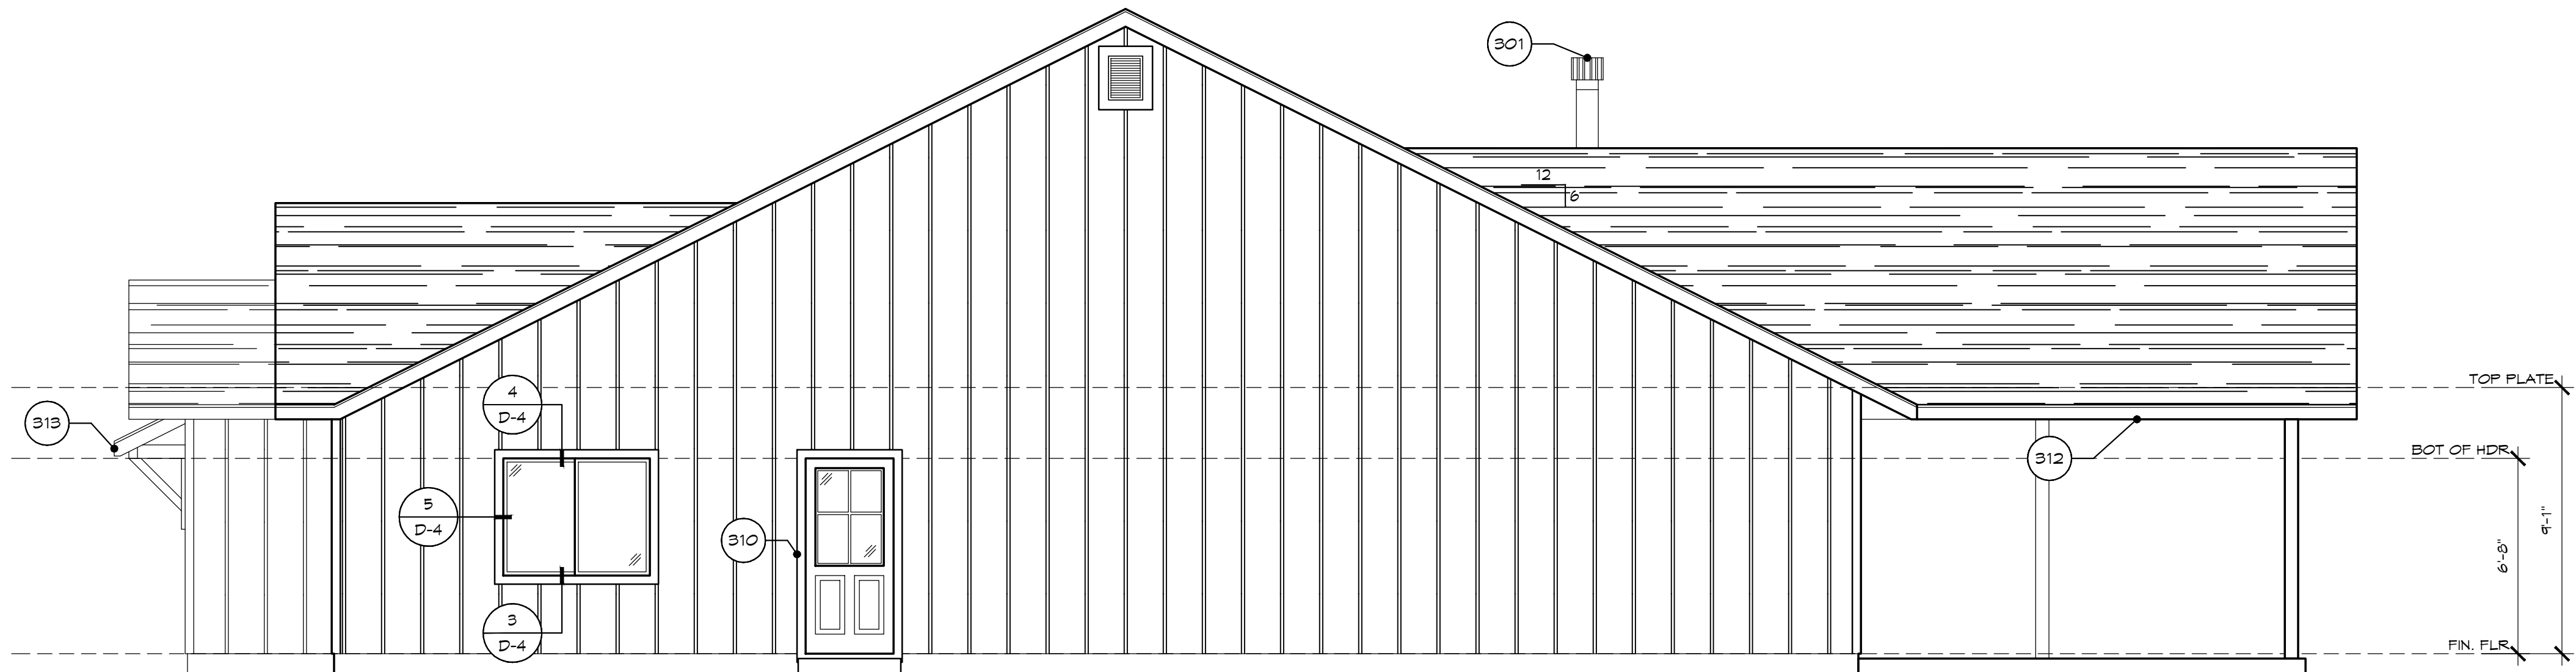

RIGHT ELEVATION

1/4" = 1'-0"

KEYNOTES

- 301 CHIMNEY CAP & SPARK ARRESTOR
- 302 GLASS-A COMP. SHINGLE ROOF PER OWNER
- 303 GABLE END VENTS PER ATTIC CALC.
- 304 2X6 HEM FIR FASCIA
- 305 VERTICAL HARDIE-PLANK EXTERIOR SIDING PER OWNER O/ APPROVED BUILDING PAPER
- 306 NOT USED
- 307 6 x 6 WOOD POSTS
- 308 METAL SECTIONAL ROLL-UP GARAGE DOOR
- 309 NOT USED
- 310 2 x 4 WOOD TRIM AROUND ALL WINDOWS AND DOORS ALL POSSIBLE CORNERS
- 311 APPROXIMATE SOLAR PANEL LOCATION, DO NOT PENETRATE ROOF
- 312 HARDI-SOFFIT UNDER ALL EXPOSED EAVES, SOFFITS & LIDS OF COVERED PORCHES/PATIOS
- 313 ALUMINUM SEAMLESS GUTTERS IV/ DOWNSPOUTS PROVIDE MEANS TO PREVENT ACCUMULATION OF LEAVES AND DEBRIS

ELEVATION NOTES

1. GLASS SKYLIGHTS SHALL BE TEMPERED AND COMPLY WITH CBC.
2. ALL ROOFING MATERIAL SHALL BE CLASS 'A', AND SHALL BE ICBO APPROVED.
3. ROOF VALLEY FLASHING SHALL BE PROVIDED OF NOT LESS THAN 26 GALV. SHEET CORROSION-RESISTANT METAL AND SHALL EXTEND AT LEAST 18" FROM THE CENTER LINE EACH WAY. SECTIONS OF FLASHING SHALL EXTEND AT LEAST 18" FROM THE CENTERLINE EACH WAY. SECTIONS OF FLASHING SHALL HAVE AN END LAP OF NOT LESS THAN 4". ALTERNATIVELY, THE VALLEY SHALL CONSIST OF INTERLOCKING ASPHALT SHINGLES APPLIED IN ACCORDANCE WITH THE MANUFACTURER'S PRINTED INSTRUCTIONS. R905.2.5.2.
4. ATTIC INSULATION SHALL BE CONFINED SO AS NOT TO BLOCK EAVE OR CORNICE (ONE INCH MIN. CLEARANCE REQUIRED)
5. ATTIC VENTS ARE TO BE PROTECTED WITH CORROSION-RESISTANT WIRE CLOTH SCREENING, HARDWARE CLOTH, OR SIMILAR MATERIAL WITH OPENINGS HAVING A LEAST DIMENSION OF MINIMUM 1/8" AND MAXIMUM 1/4". PER CRC R806.1
6. THE CHIMNEY SHALL BE EQUIPPED WITH A SPARK ARRESTOR. THE NET FREE AREA OF THE SPARK ARRESTOR SHALL NOT BE LESS THAN 4 TIMES THE NET FREE AREA OF THE OUTLET OF THE CHIMNEY. SPARK ARRESTOR SCREEN SHALL BE CORROSION RESISTANT AND SHALL HAVE OPENINGS LESS THAN 1/2" AND GREATER THAN 3/8" IN SIZE.
7. FACTORY BUILT CHIMNEYS SHALL EXTEND AT LEAST 2 FEET ABOVE ANY PART OF THE BUILDING WITHIN 10 FEET



2121 Pine St., SUITE A
Paso Robles, California 93446
Tel: 805.231.3746
Fax: 805.231.1866
Email: nelsonnrbdrafting.biz

ATTENTION: IF PLAN CHECK CORRECTION DATE DOES NOT APPEAR IN THE REVISION BLOCK BELOW, DO NOT LAYOUT / BUILD STRUCTURE FROM THIS COPY OF CONSTRUCTION DRAWINGS, UNLESS OTHERWISE INDICATED WITH "APPROVED" RED STAMP FROM LOCAL BUILDING AND PLANNING DEPARTMENT. COPIES WITHOUT CORRECTION DATE INDICATED ARE MOST LIKELY PRELIMINARY DOCUMENTS ONLY.

JON GLASS
APN: 041-075-011
CAYUCOS AVE.
TEMPLETON, CA 93465

20028


ELEVATIONS

FMTR: 2020-00921

REVISIONS	
DESCRIPTION	DATE
CORRECTIONS	10-10-20


DRAWN	SCALE	DATE
GAB	1/4" = 1'-0"	04-10-20
JOB NO:	DWG NAME	CHECKED
20028		
SHEET		

A-3.1

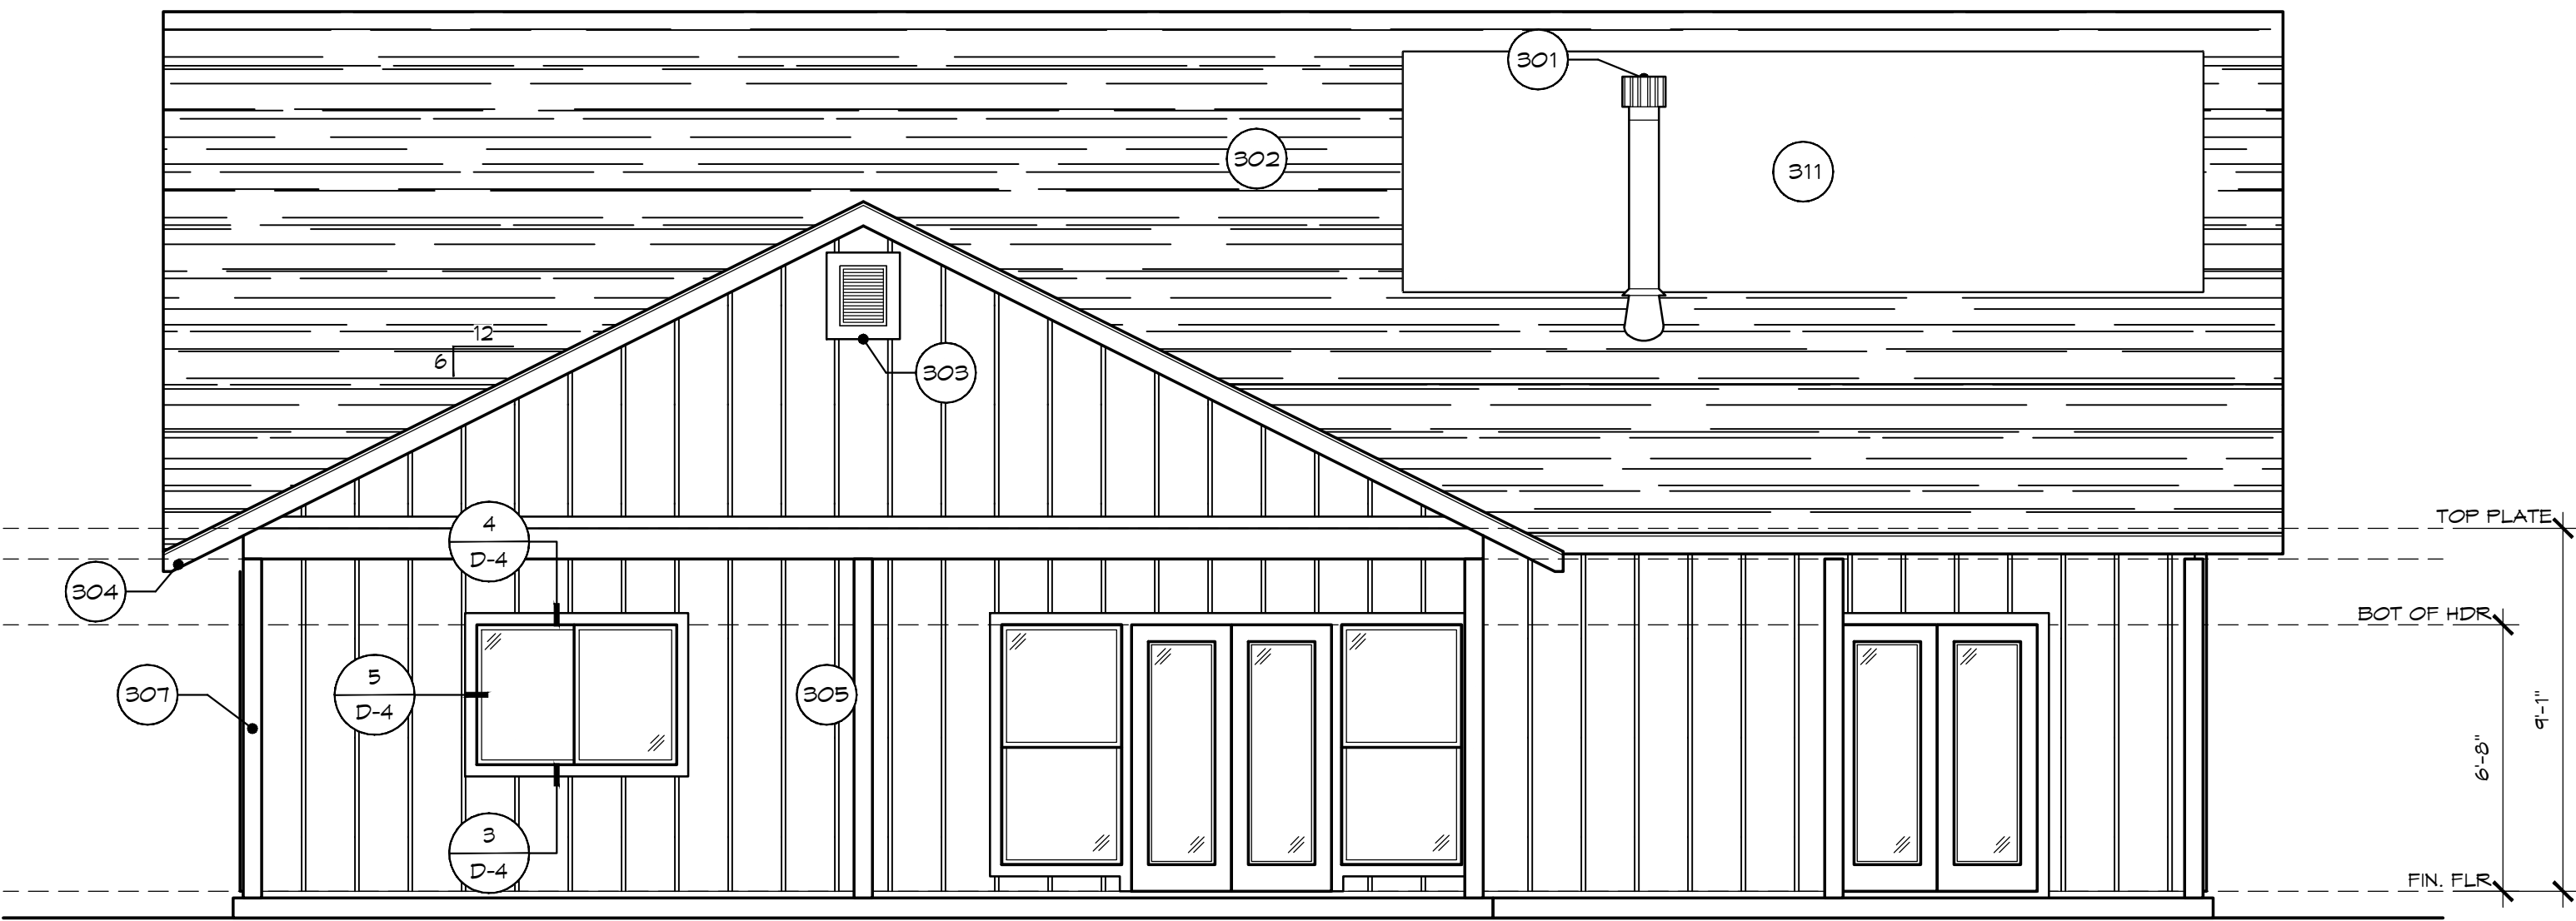

REAR ELEVATION

1/4" = 1'-0"

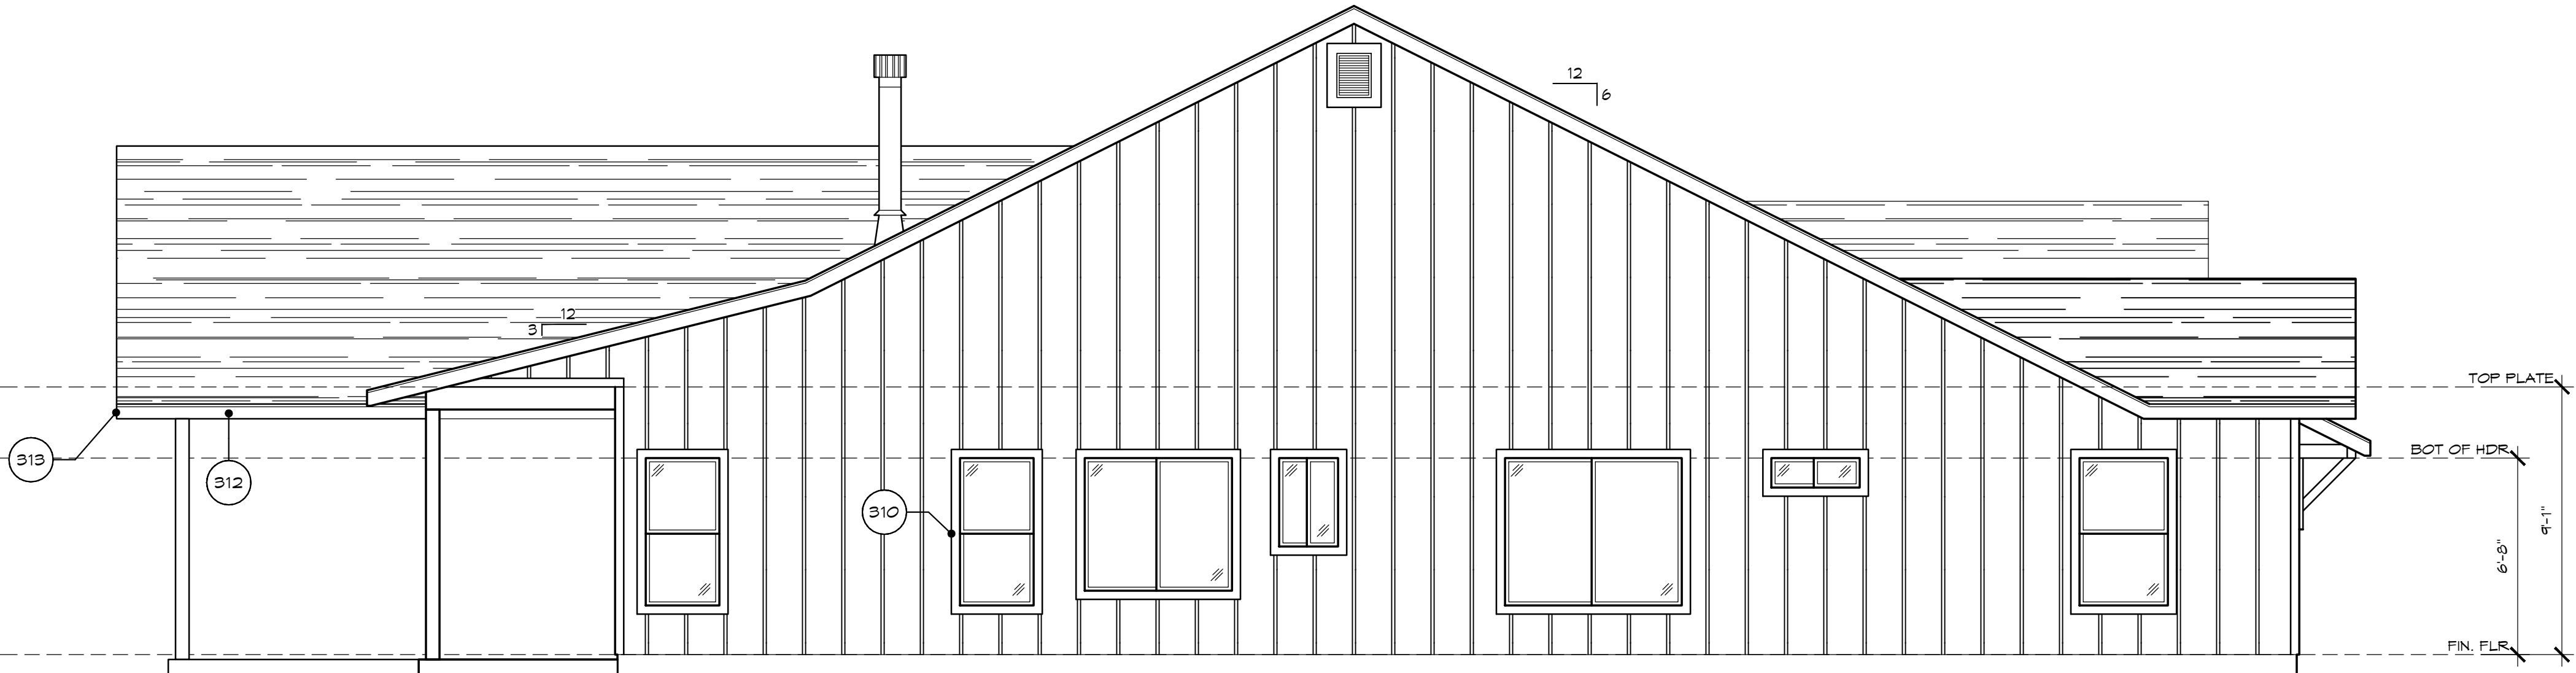

LEFT ELEVATION

1/4" = 1'-0"

KEYNOTES

- 301 CHIMNEY CAP & SPARK ARRESTOR
- 302 GLASS-A COMP. SHINGLE ROOF PER OWNER
- 303 GABLE END VENTS PER ATTIC CALC.
- 304 2X6 HEM FIR FASCIA
- 305 VERTICAL HARDIE-PLANK EXTERIOR SIDING PER OWNER O/ APPROVED BUILDING PAPER
- 306 NOT USED
- 307 6 x 6 WOOD POSTS
- 308 METAL SECTIONAL ROLL-UP GARAGE DOOR
- 309 NOT USED
- 310 2 x 4 WOOD TRIM AROUND ALL WINDOWS AND DOORS ALL POSSIBLE CORNERS
- 311 APPROXIMATE SOLAR PANEL LOCATION, DO NOT PENETRATE ROOF
- 312 HARDI-SOFFIT UNDER ALL EXPOSED EAVES, SOFFITS & LIDS OF COVERED PORCHES/PATIOS
- 313 ALUMINUM SEAMLESS GUTTERS W/ DOWNSPOUTS PROVIDE MEANS TO PREVENT ACCUMULATION OF LEAVES AND DEBRIS

ELEVATION NOTES

- GLASS SKYLIGHTS SHALL BE TEMPERED AND COMPLY WITH CBC.
- ALL ROOFING MATERIAL SHALL BE GLASS 'A', AND SHALL BE ICBO APPROVED.
- ROOF VALLEY FLASHING SHALL BE PROVIDED OF NOT LESS THAN 26 GALV. SHEET CORROSION-RESISTANT METAL, AND SHALL EXTEND AT LEAST 18" FROM THE CENTER LINE EACH WAY. SECTIONS OF FLASHING SHALL EXTEND AT LEAST 18" FROM THE CENTERLINE EACH WAY. SECTIONS OF FLASHING SHALL HAVE AN END LAP OF NOT LESS THAN 4". ALTERNATIVELY, THE VALLEY SHALL CONSIST OF INOVEN ASPHALT SHINGLES APPLIED IN ACCORDANCE WITH THE MANUFACTURER'S PRINTED INSTRUCTIONS. R905.2.5.2.
- ATTIC INSULATION SHALL BE CONFINED SO AS NOT TO BLOCK EAVE OR CORNICE (ONE INCH MIN. CLEARANCE REQUIRED)
- ATTIC VENTS ARE TO BE PROTECTED WITH CORROSION-RESISTANT WIRE CLOTH SCREENING, HARDWARE CLOTH, OR SIMILAR MATERIAL WITH OPENINGS HAVING A LEAST DIMENSION OF MINIMUM 1/8" AND MAXIMUM 1/4". PER CRC R806.1
- THE CHIMNEY SHALL BE EQUIPPED WITH A SPARK ARRESTOR. THE NET FREE AREA OF THE SPARK ARRESTOR SHALL NOT BE LESS THAN 4 TIMES THE NET FREE AREA OF THE OUTLET OF THE CHIMNEY. SPARK ARRESTOR SCREEN SHALL BE CORROSION RESISTANT AND SHALL HAVE OPENINGS LESS THAN 1/2" AND GREATER THAN 3/8" IN SIZE.
- FACTORY BUILT CHIMNEYS SHALL EXTEND AT LEAST 2 FEET ABOVE ANY PART OF THE BUILDING WITHIN 10 FEET



2121 Pine St., SUITE A
Paso Robles, California 93446
Tel: 805.231.3146
Fax: 805.231.1866
Email: nelsonnrddrafting.biz

ATTENTION: IF PLAN CHECK CORRECTION DATE DOES NOT APPEAR IN THE REVISION BLOCK BELOW, DO NOT LAYOUT / BUILD STRUCTURE FROM THIS COPY OF CONSTRUCTION DRAWINGS, UNLESS OTHERWISE INDICATED WITH 'APPROVED' RED STAMP FROM LOCAL BUILDING AND PLANNING DEPARTMENT. COPIES WITHOUT CORRECTION DATE INDICATED ARE MOST LIKELY PRELIMINARY DOCUMENTS ONLY.

JON GLASS
APN: 041-075-011
CAYUCOS AVE.
TEMPLETON, CA 93465

20028

ELEVATIONS

PMTR: 2020-00921

REVISIONS	
DESCRIPTION	DATE
CORRECTIONS	10-10-20

DRAWN	SCALE	DATE
PJ	1/4" = 1'-0"	04-10-20
JOB NO:	DWG NAME	CHECKED
20028		

SHEET

A-3.2