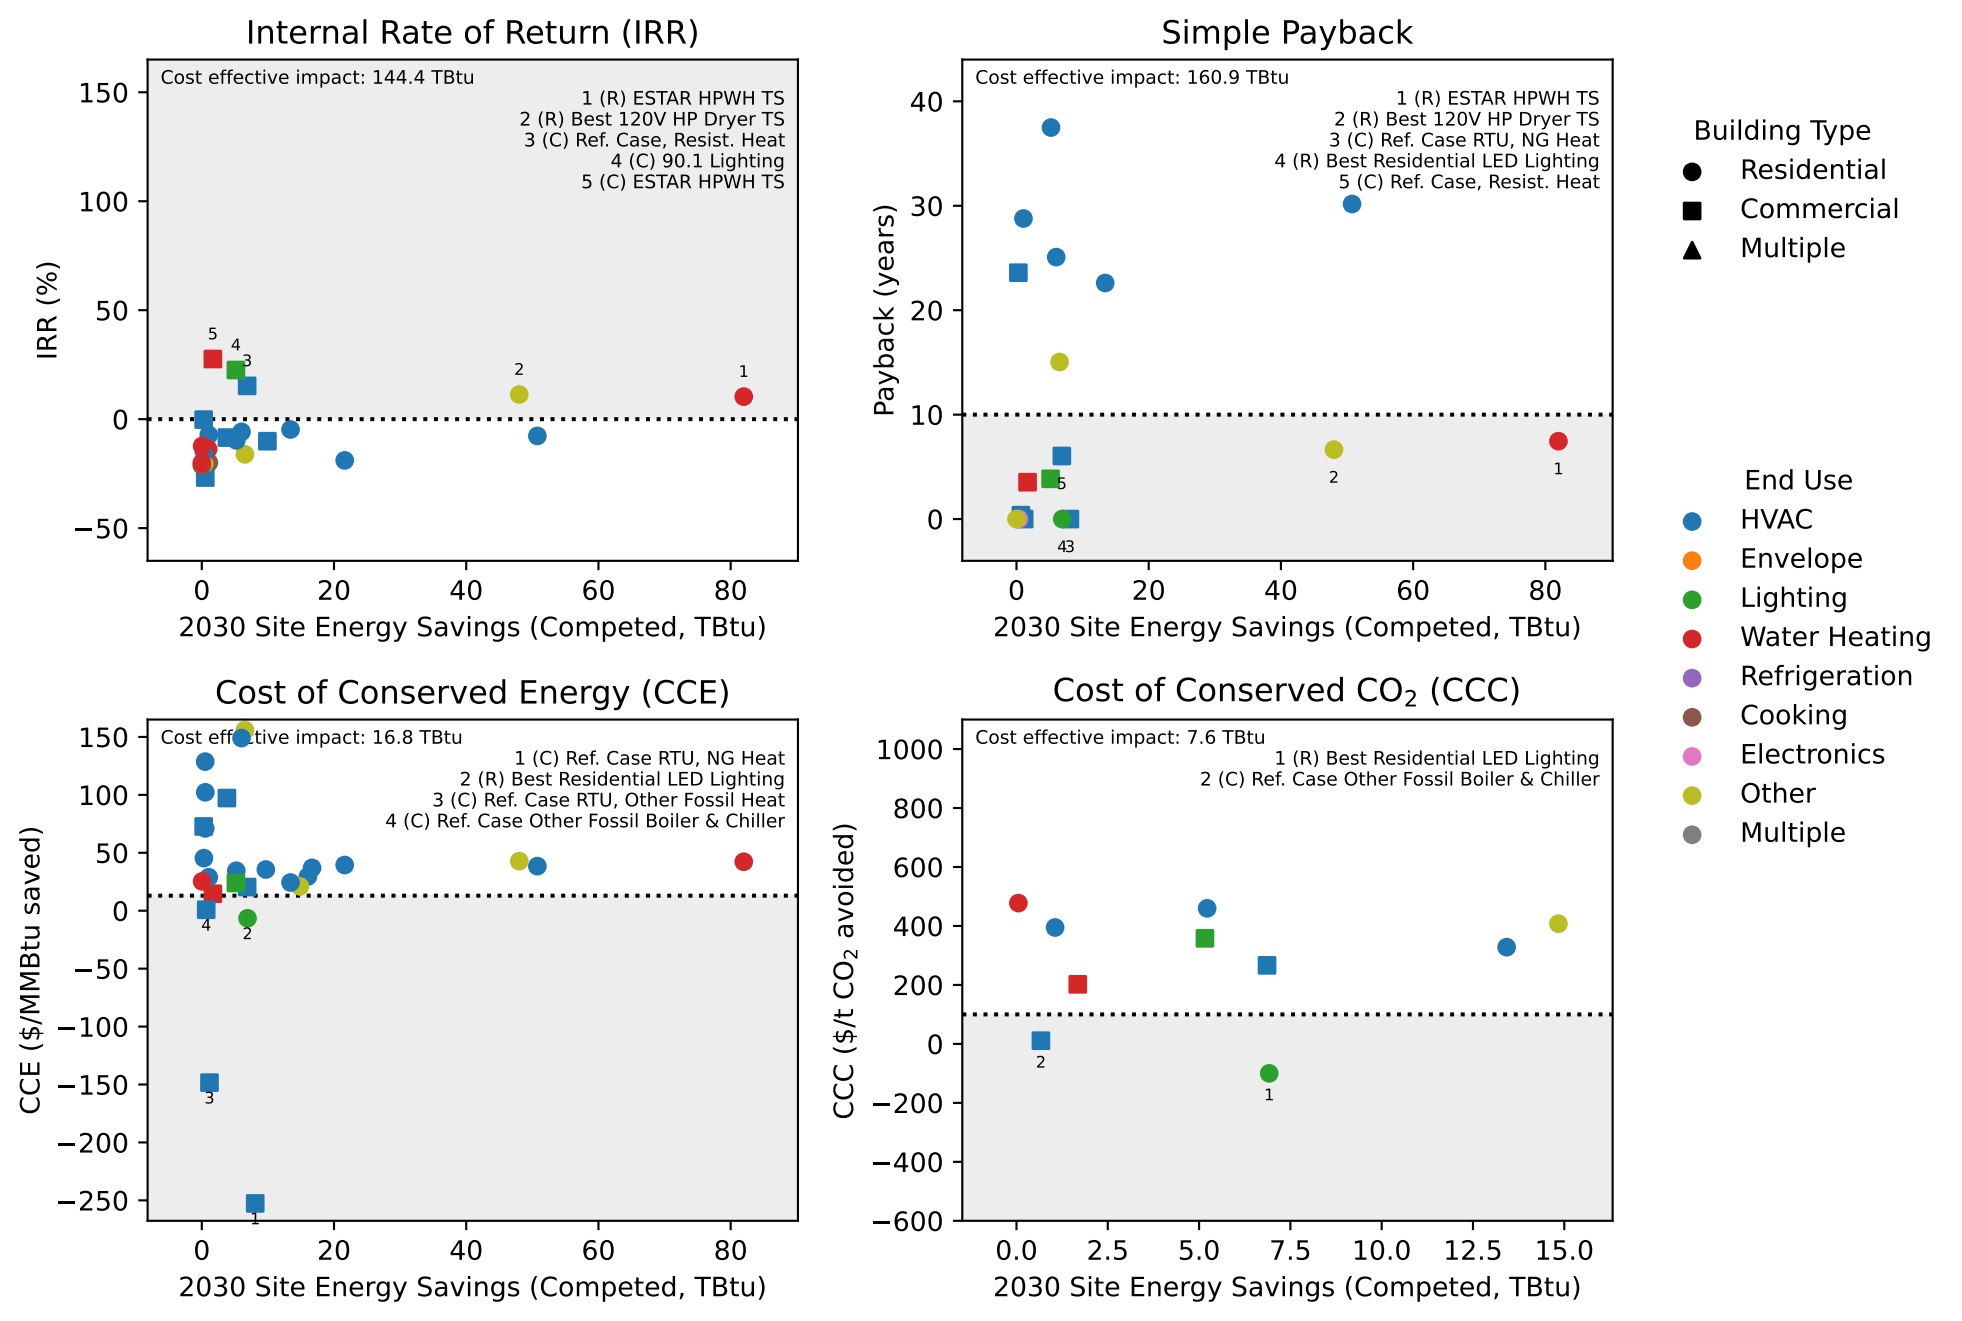
Internal Rate of Return (IRR)
Cost effective impact: 144.4 TBtu
1 (R) ESTAR HPWH TS
2 (R) Best 120V HP Dryer TS
3 (C) Ref. Case, Resist. Heat
4 (C) 90.1 Lighting
5 (C) ESTAR HPWH TS
IRR (%)
2030 Site Energy Savings (Competed, TBtu)
Simple Payback
Cost effective impact: 160.9 TBtu
1 (R) ESTAR HPWH TS
2 (R) Best 120V HP Dryer TS
3 (C) Ref. Case RTU, NG Heat
4 (R) Best Residential LED Lighting
5 (C) Ref. Case, Resist. Heat
Payback (years)
2030 Site Energy Savings (Competed, TBtu)
Cost of Conserved Energy (CCE)
Cost effective impact: 16.8 TBtu
1 (C) Ref. Case RTU, NG Heat
2 (R) Best Residential LED Lighting
3 (C) Ref. Case RTU, Other Fossil Heat
4 (C) Ref. Case Other Fossil Boiler & Chiller
CCE ($/MMBtu saved)
2030 Site Energy Savings (Competed, TBtu)
Cost of Conserved CO_2 (CCC)
Cost effective impact: 7.6 TBtu
1 (R) Best Residential LED Lighting
2 (C) Ref. Case Other Fossil Boiler & Chiller
CCC ($/t CO_2 avoided)
2030 Site Energy Savings (Competed, TBtu)
Building Type
Residential
Commercial
Multiple
End Use
HVAC
Envelope
Lighting
Water Heating
Refrigeration
Cooking
Electronics
Other
Multiple