



Near eye (primary) - Age, per 10 years -
Interdaily stability

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

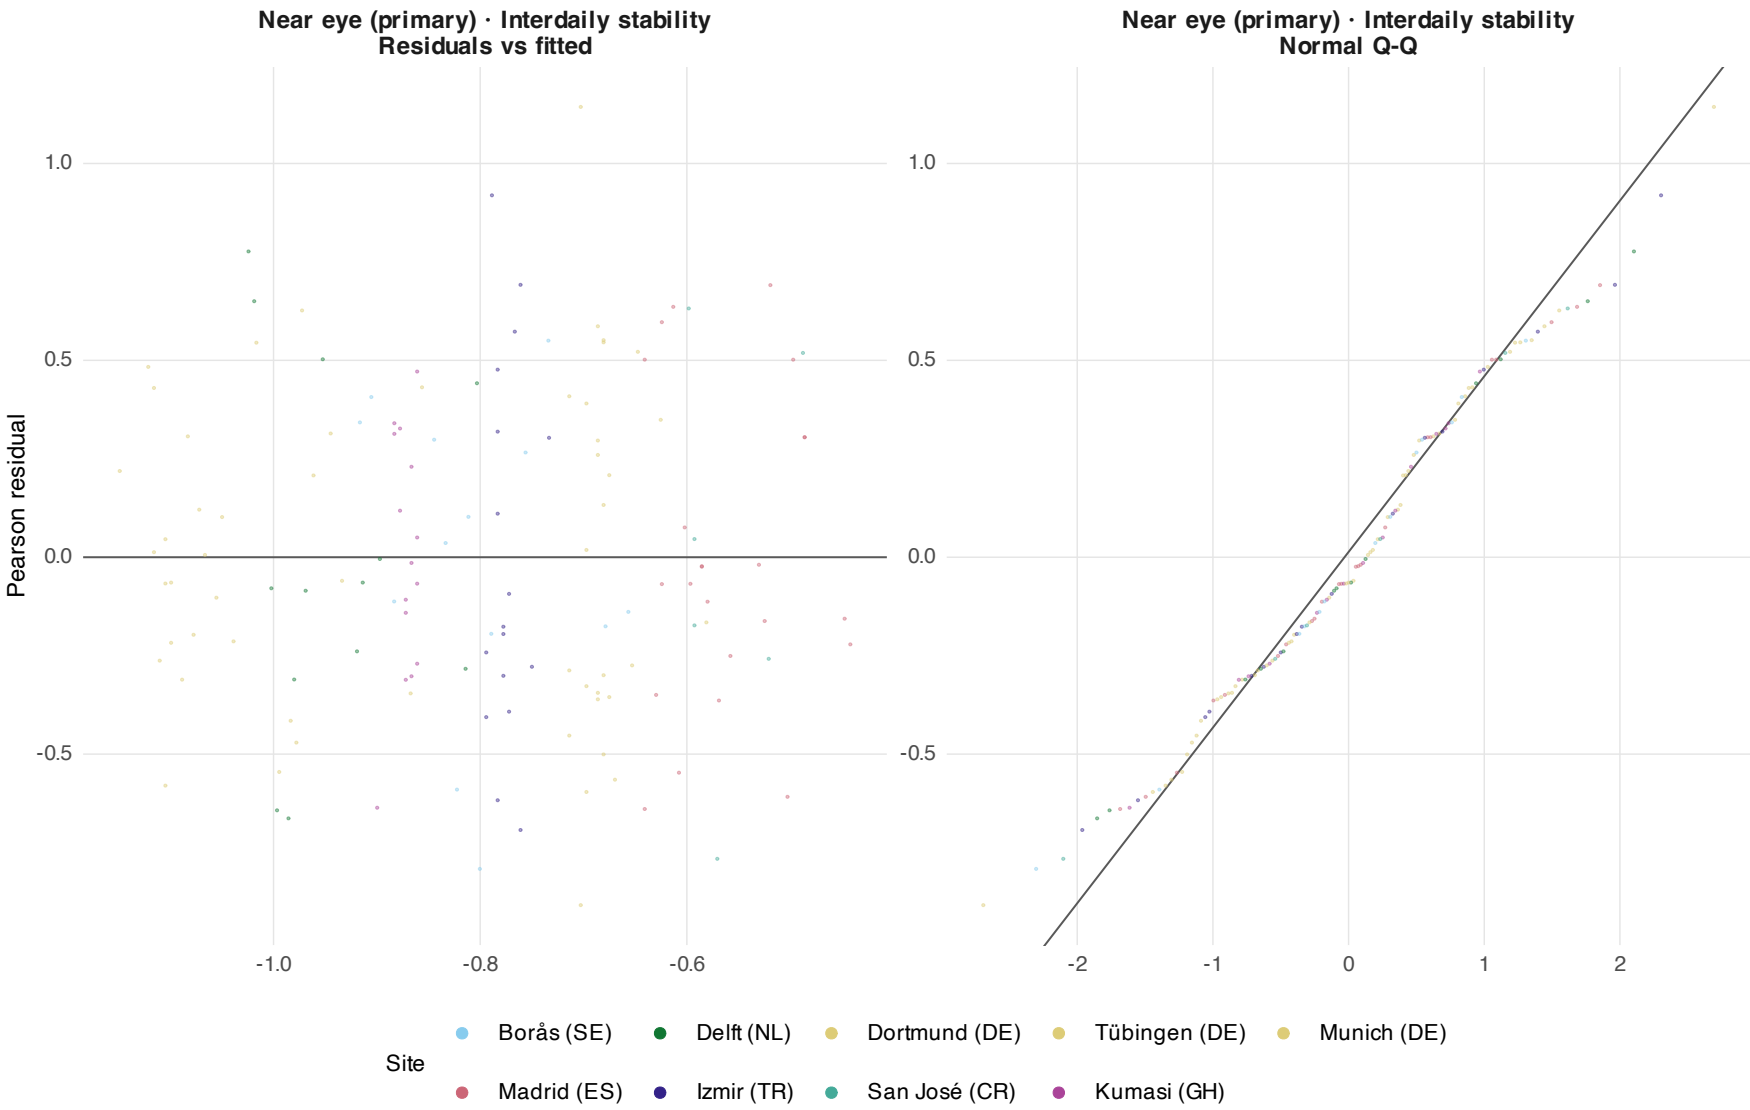


Near eye (primary) - Age, per 10 years -
Intradaily variability

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

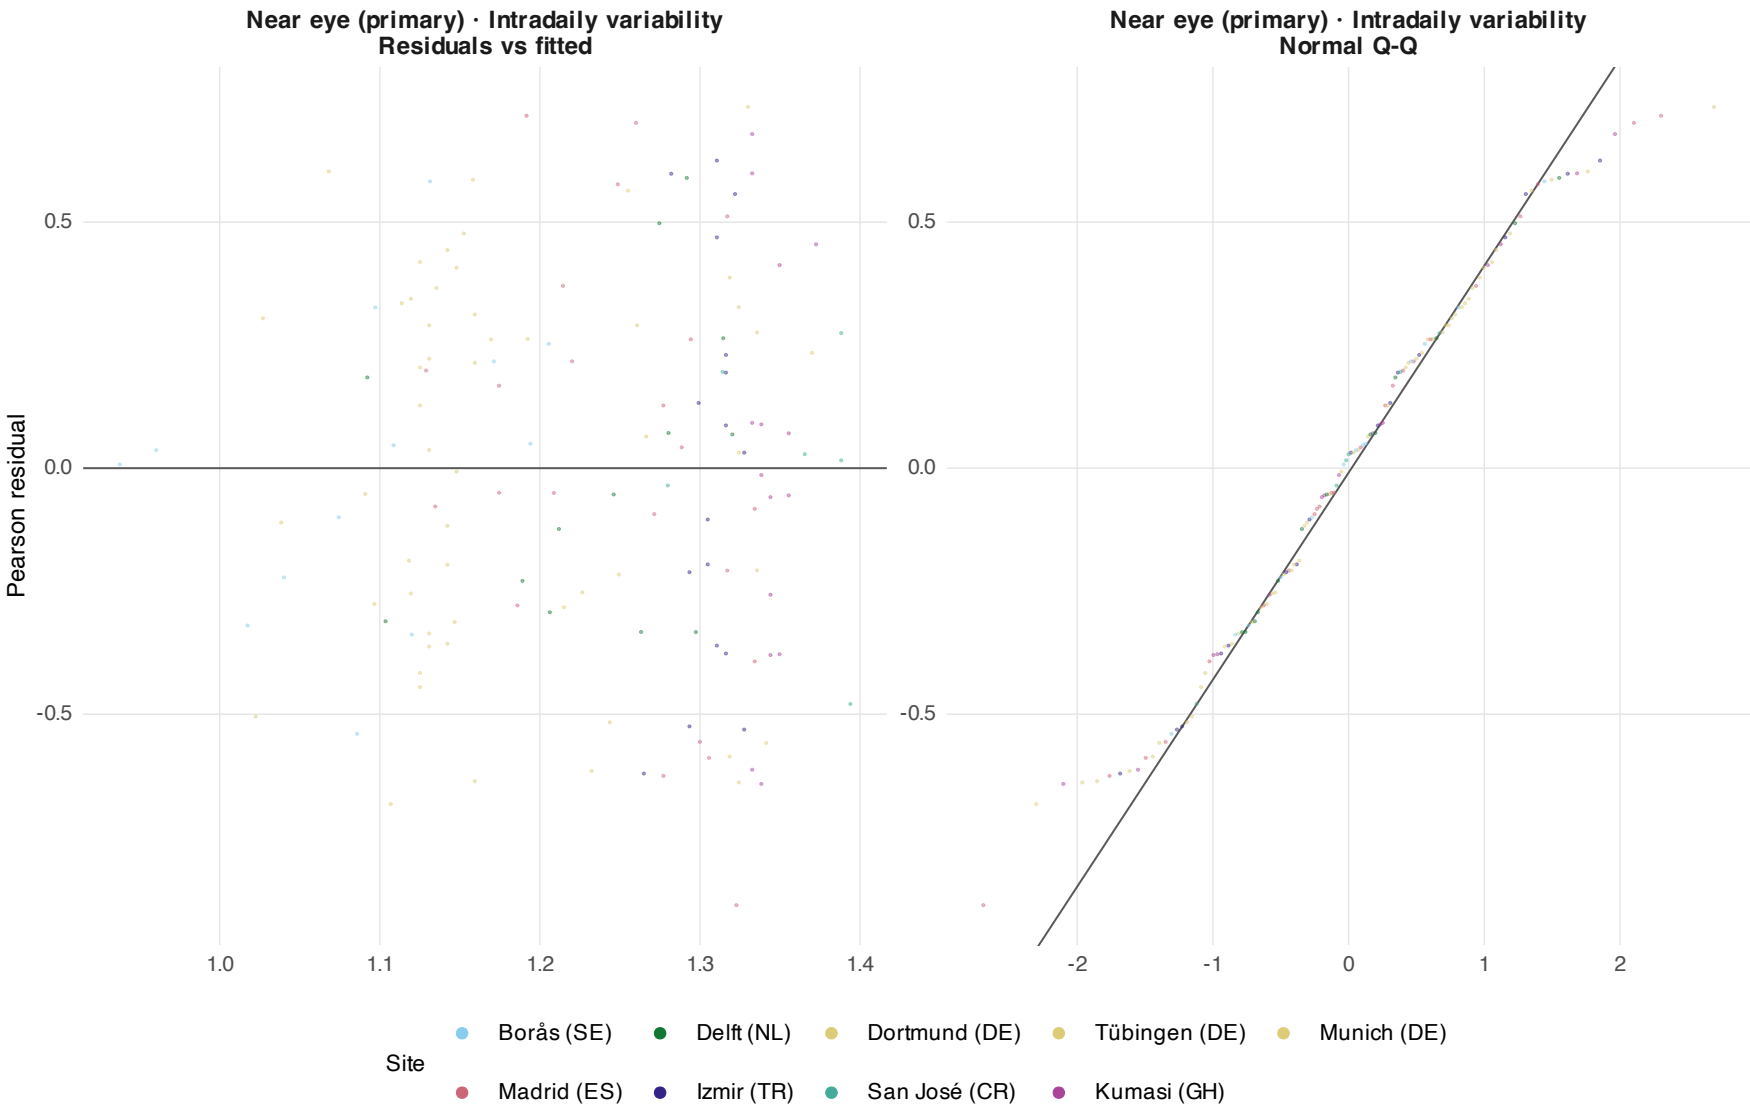


Near eye (primary) - Age, per 10 years -
Mean meEDI

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

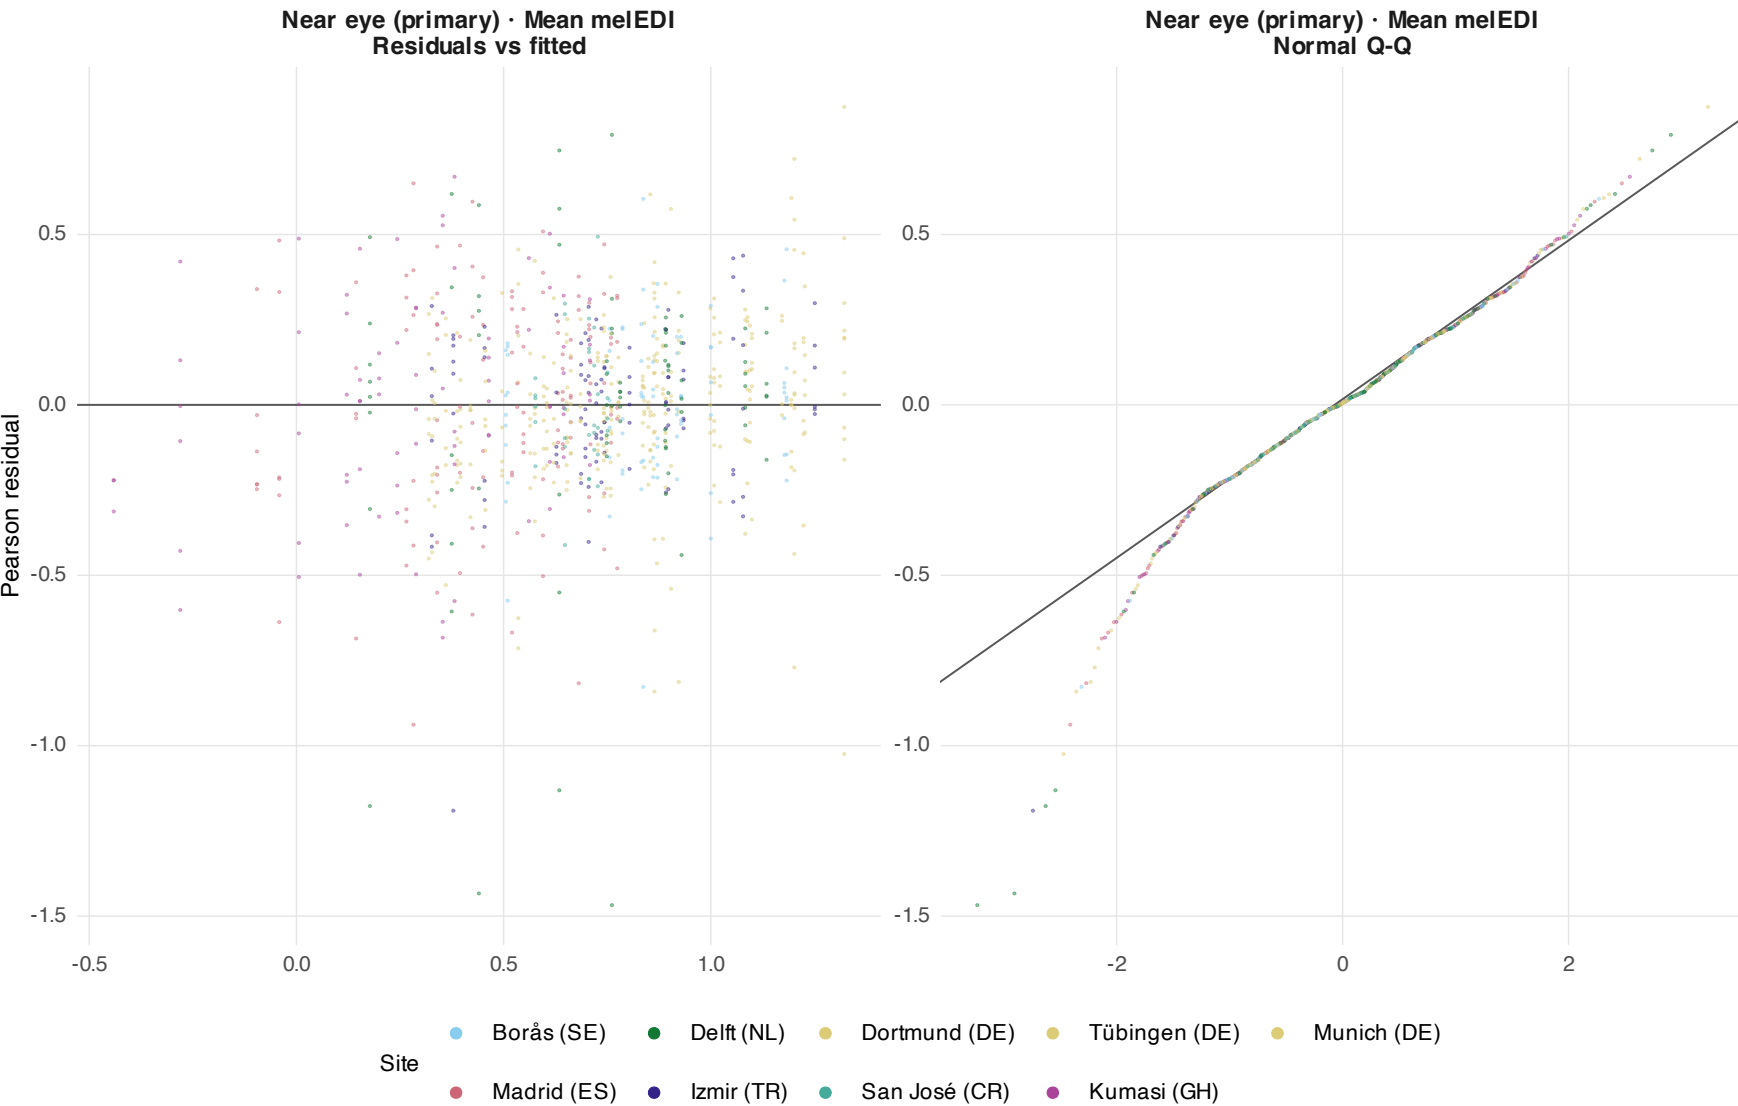


Near eye (primary) - Age, per 10 years -
Brightest 10 h mean

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

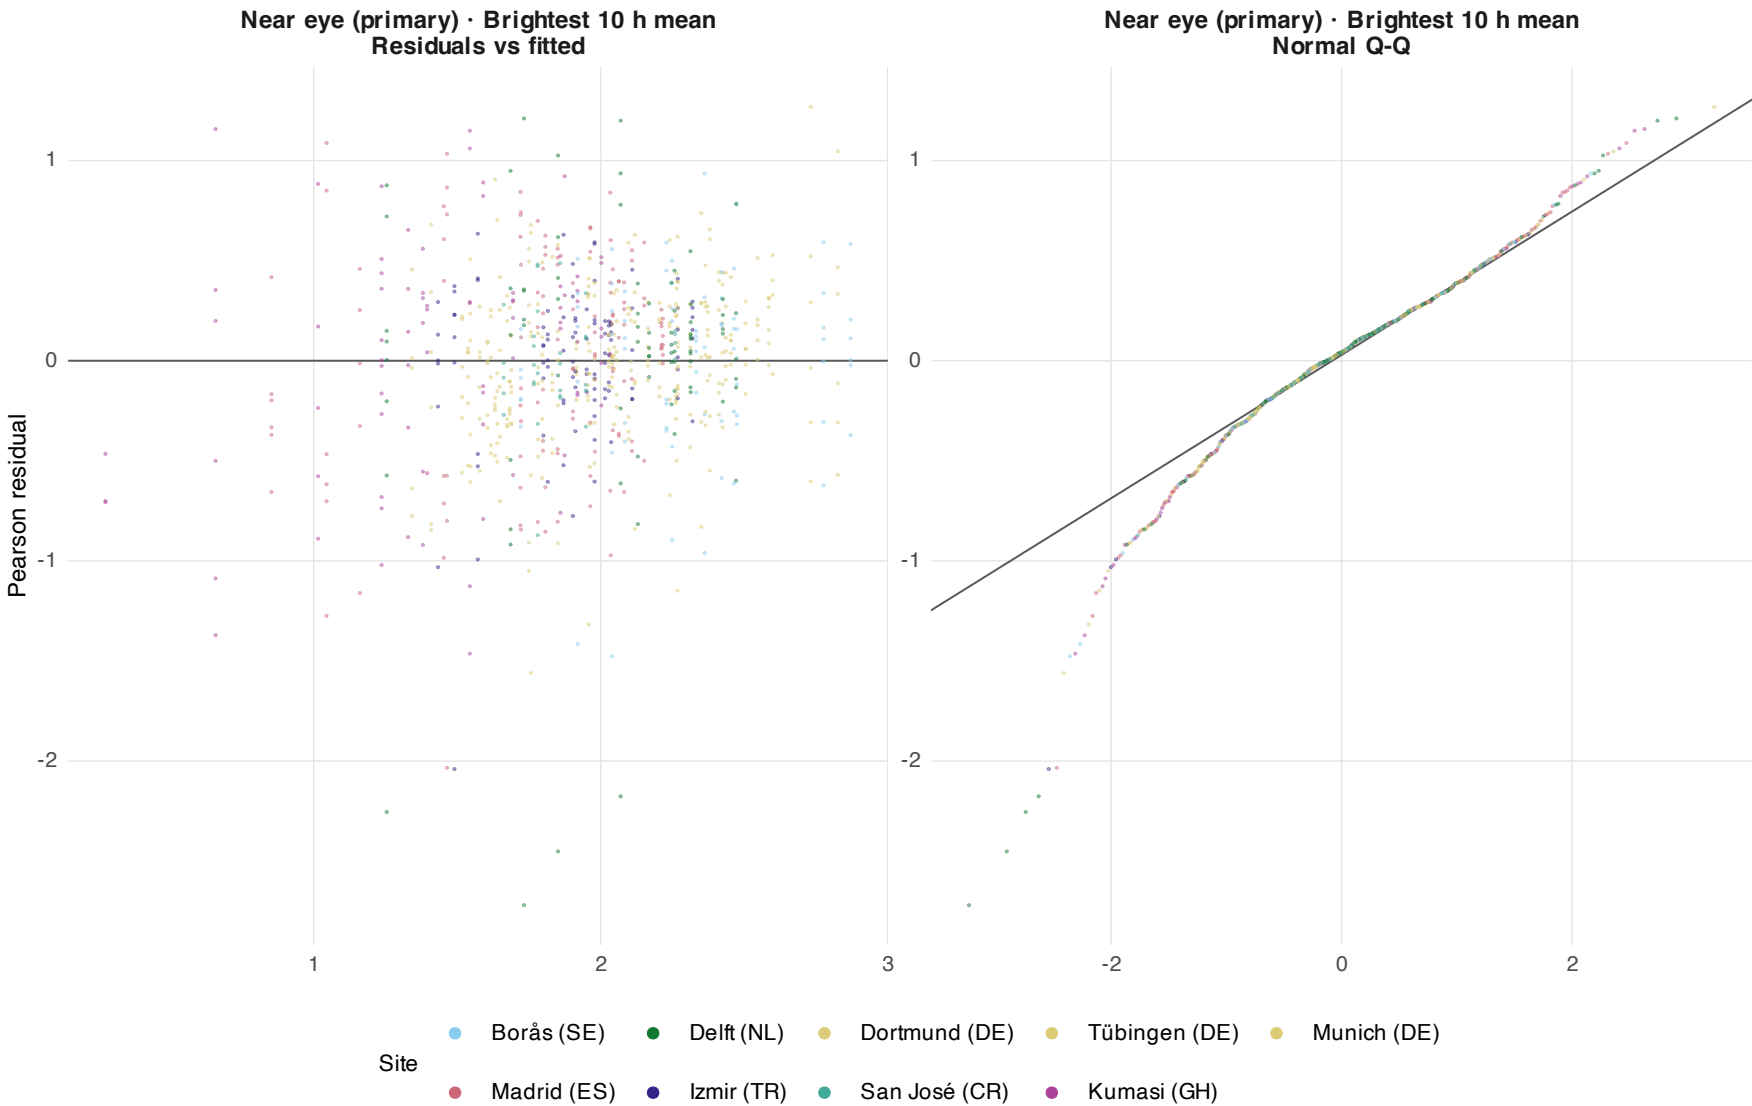


Near eye (primary) - Age, per 10 years -
Darkest 10 h mean

Assessment: acceptable with limitations; residual screen: RESIDUAL SPREAD REVIEW.

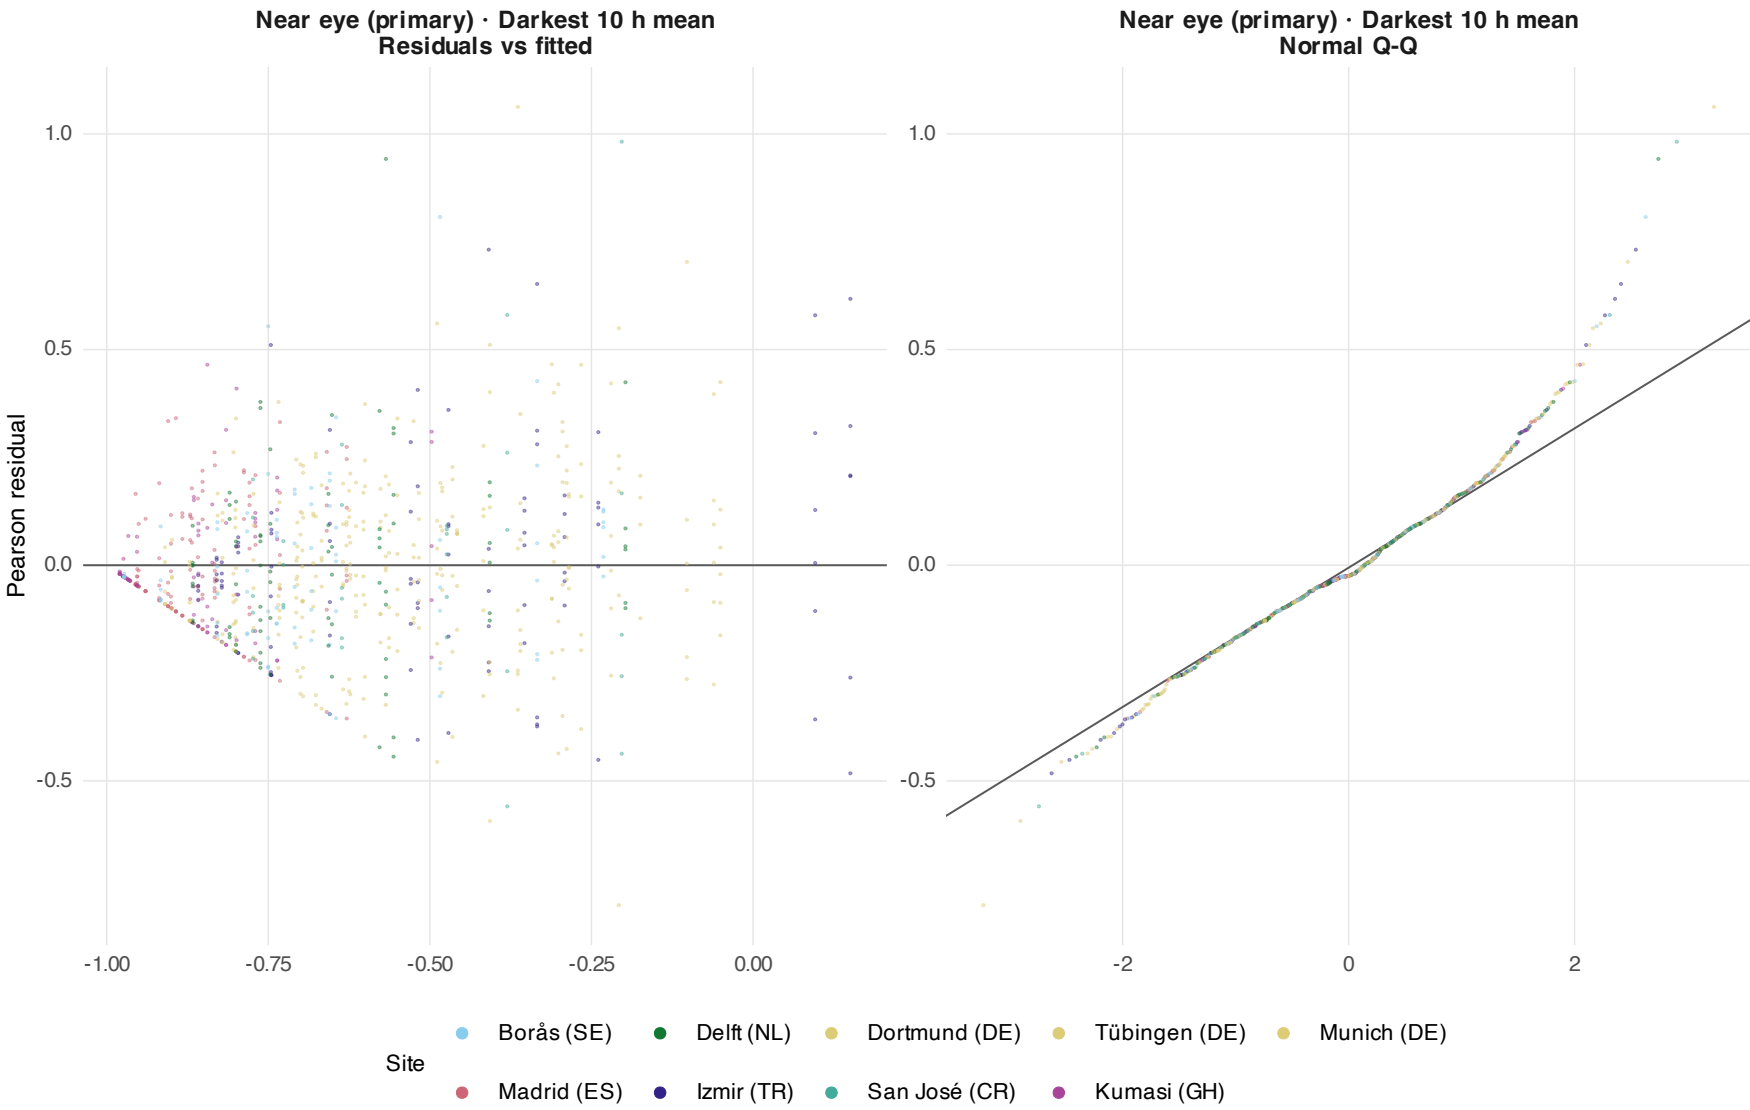

Near eye (primary) - Age, per 10 years -
Time above 1,000 lx meIEDI


Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

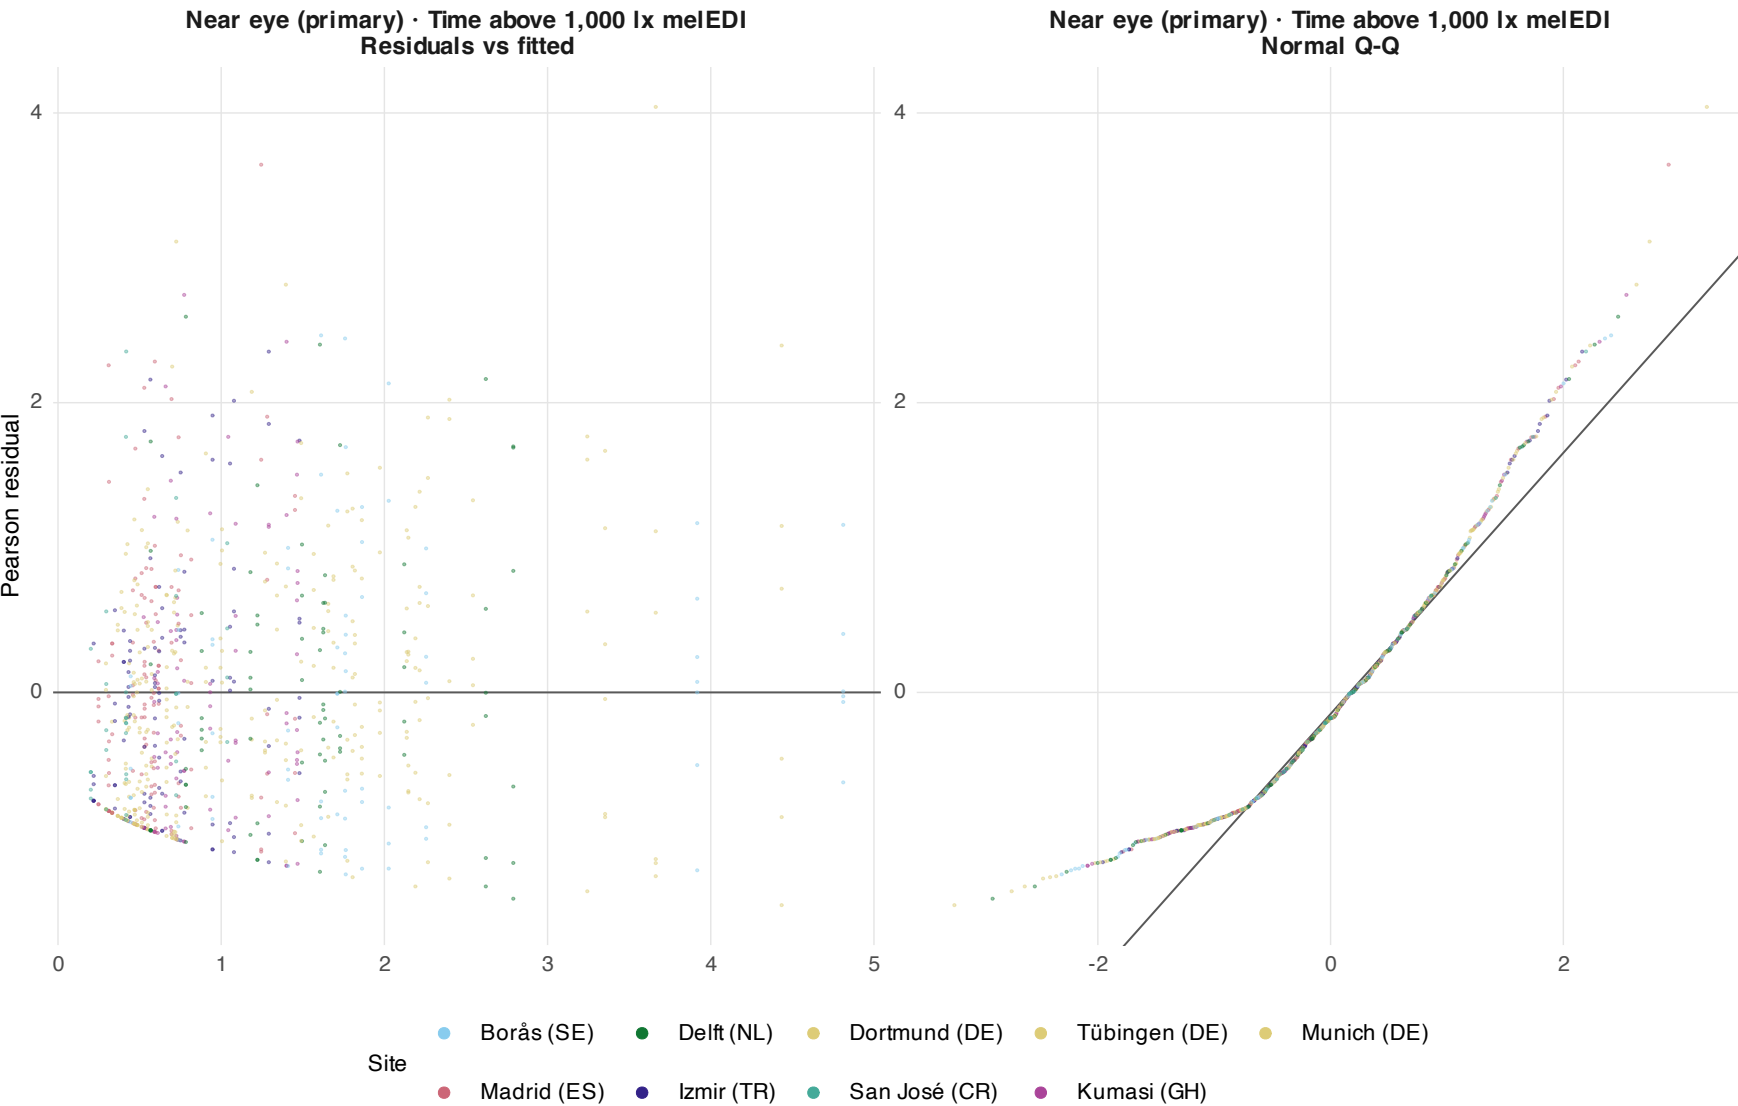


Near eye (primary) - Age, per 10 years -
Time above 250 lx melEDI during wake

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

Near eye (primary) · Time above 250 lx melEDI during wake
Residuals vs fitted

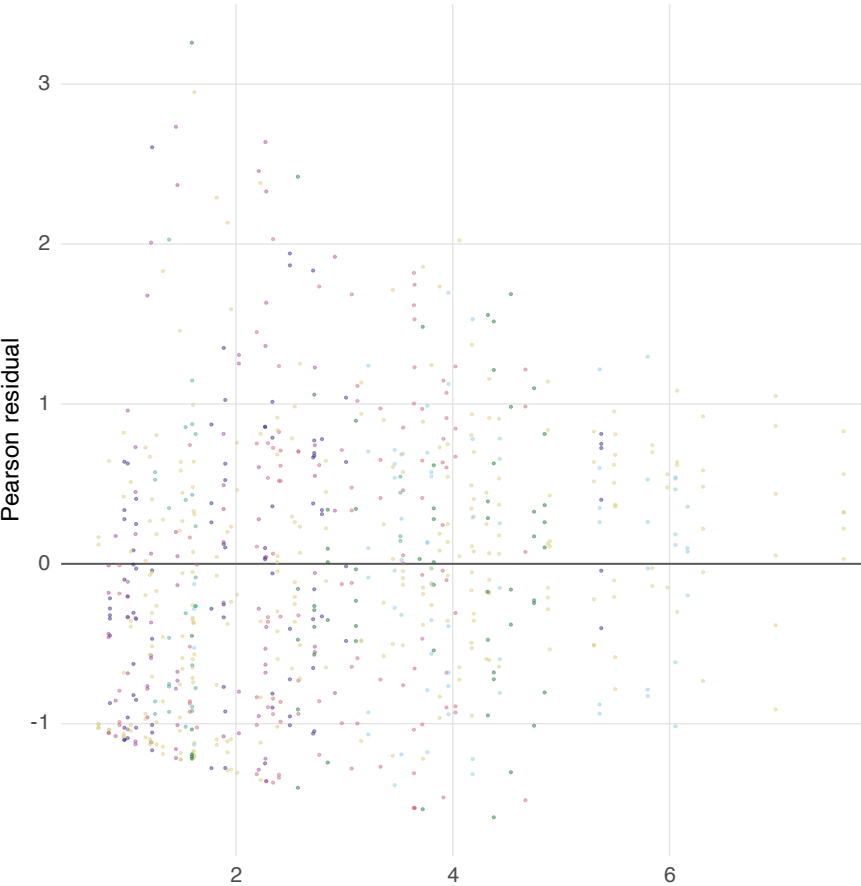

Near eye (primary) · Time above 250 lx melEDI during wake
Normal Q-Q

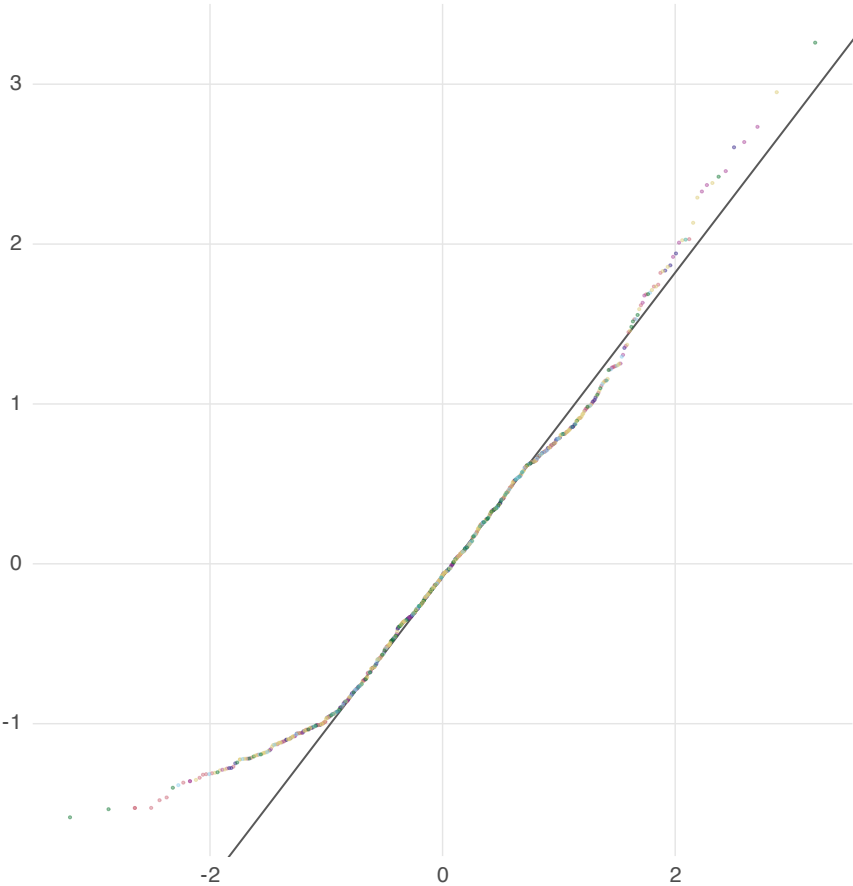

- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Tübingen (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)


Near eye (primary) - Age, per 10 years -
Time below 10 lx melEDI before sleep

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

Near eye (primary) · Time below 10 lx melEDI before sleep
Residuals vs fitted




Near eye (primary) · Time below 10 lx melEDI before sleep
Normal Q-Q

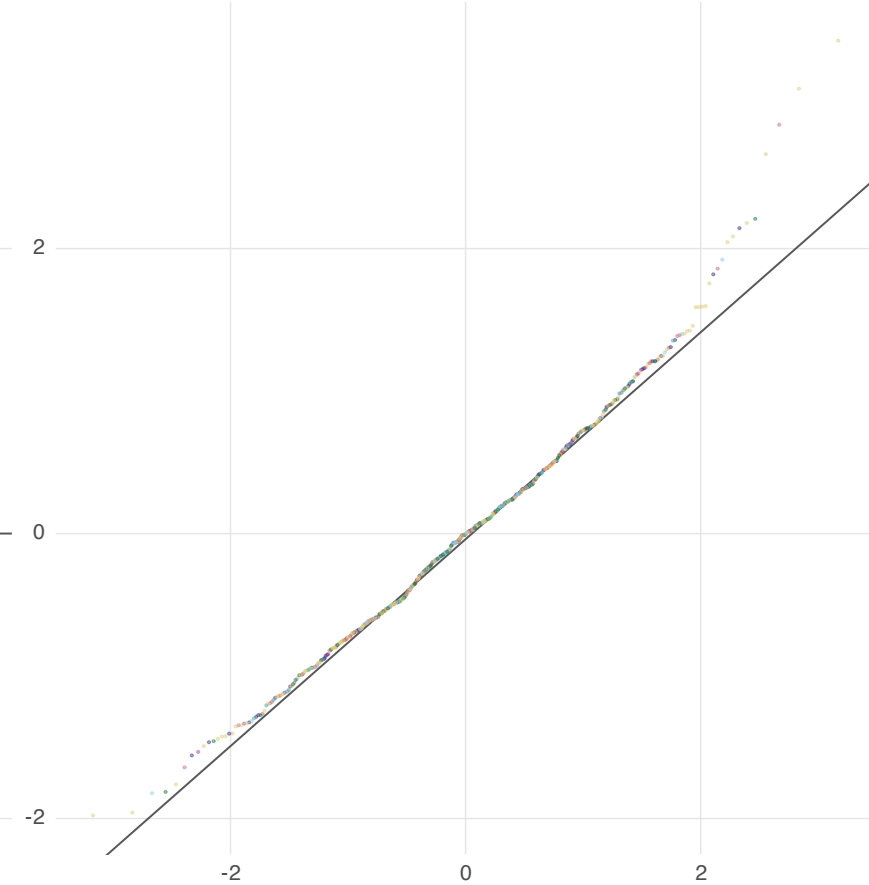

- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Tübingen (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)


Near eye (primary) - Age, per 10 years -
Time below 1 lx meEDI during sleep

Assessment: acceptable with limitations; residual screen: ZERO MASS REVIEW.

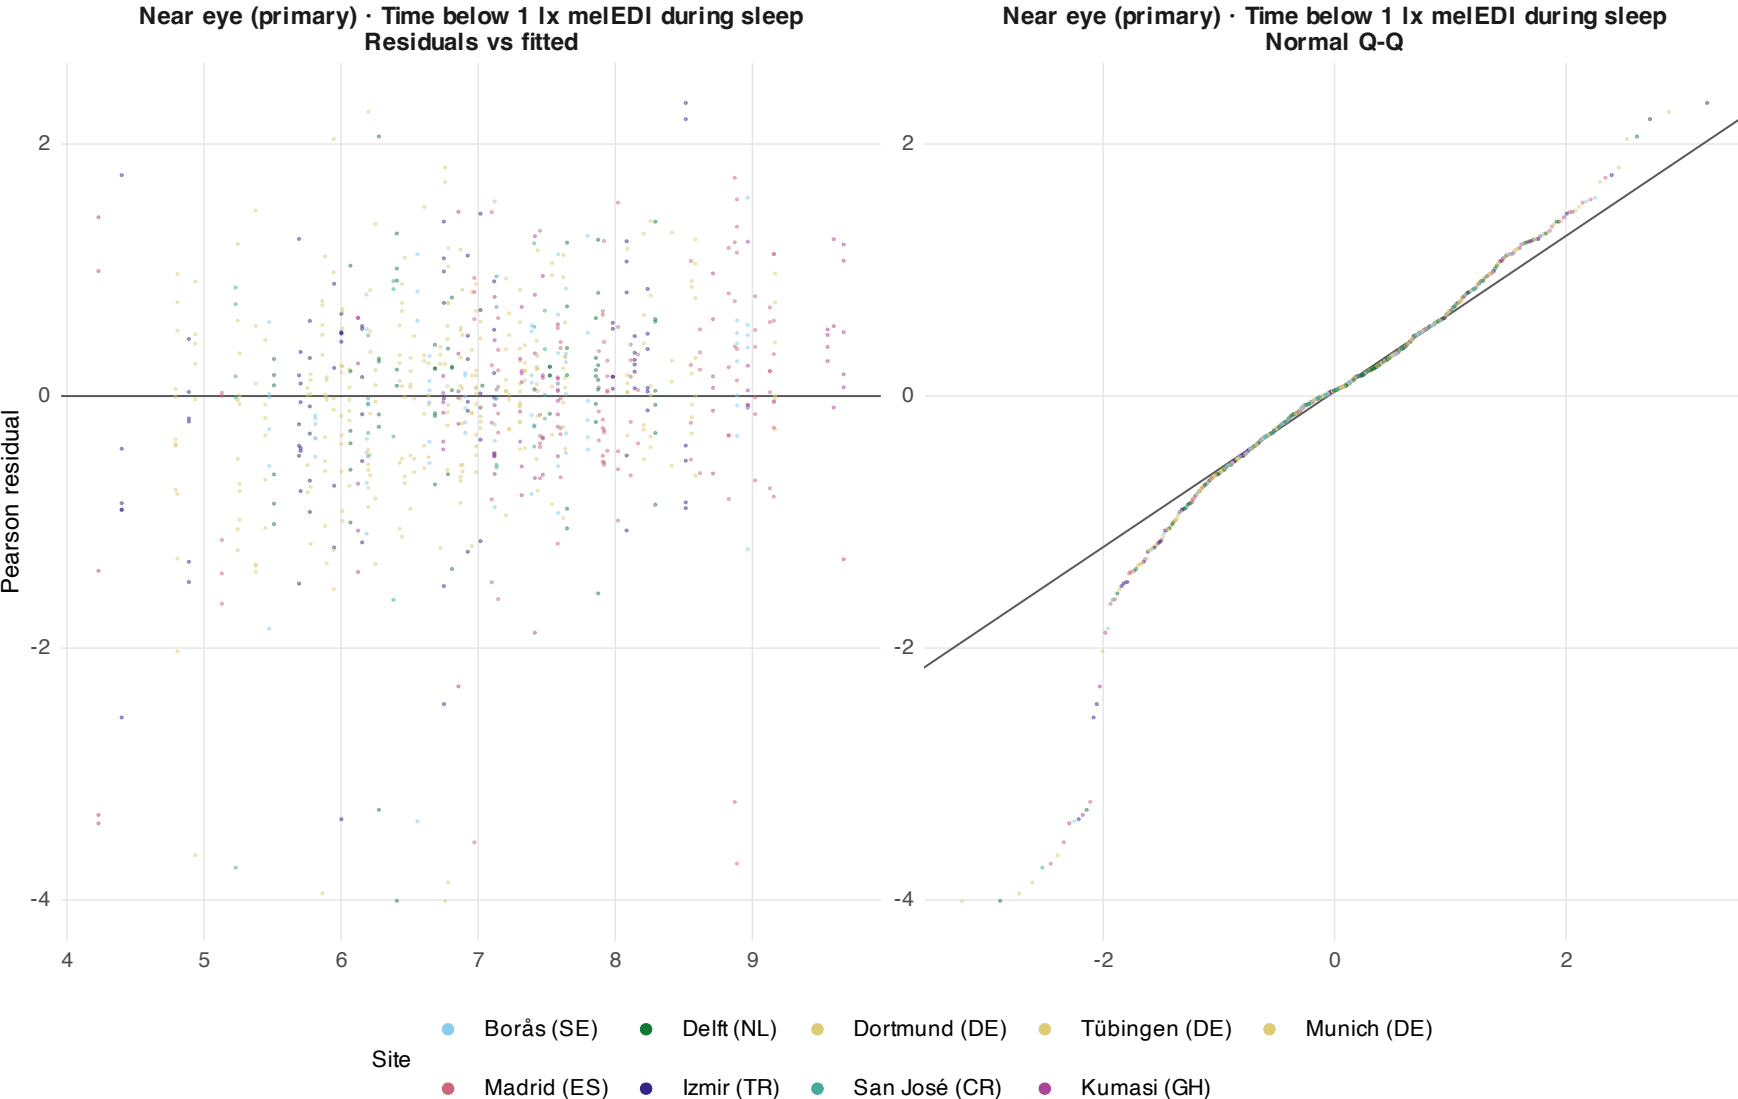

Near eye (primary) - Age, per 10 years
- Longest continuous period above 250 lx meEDI
meEDI

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

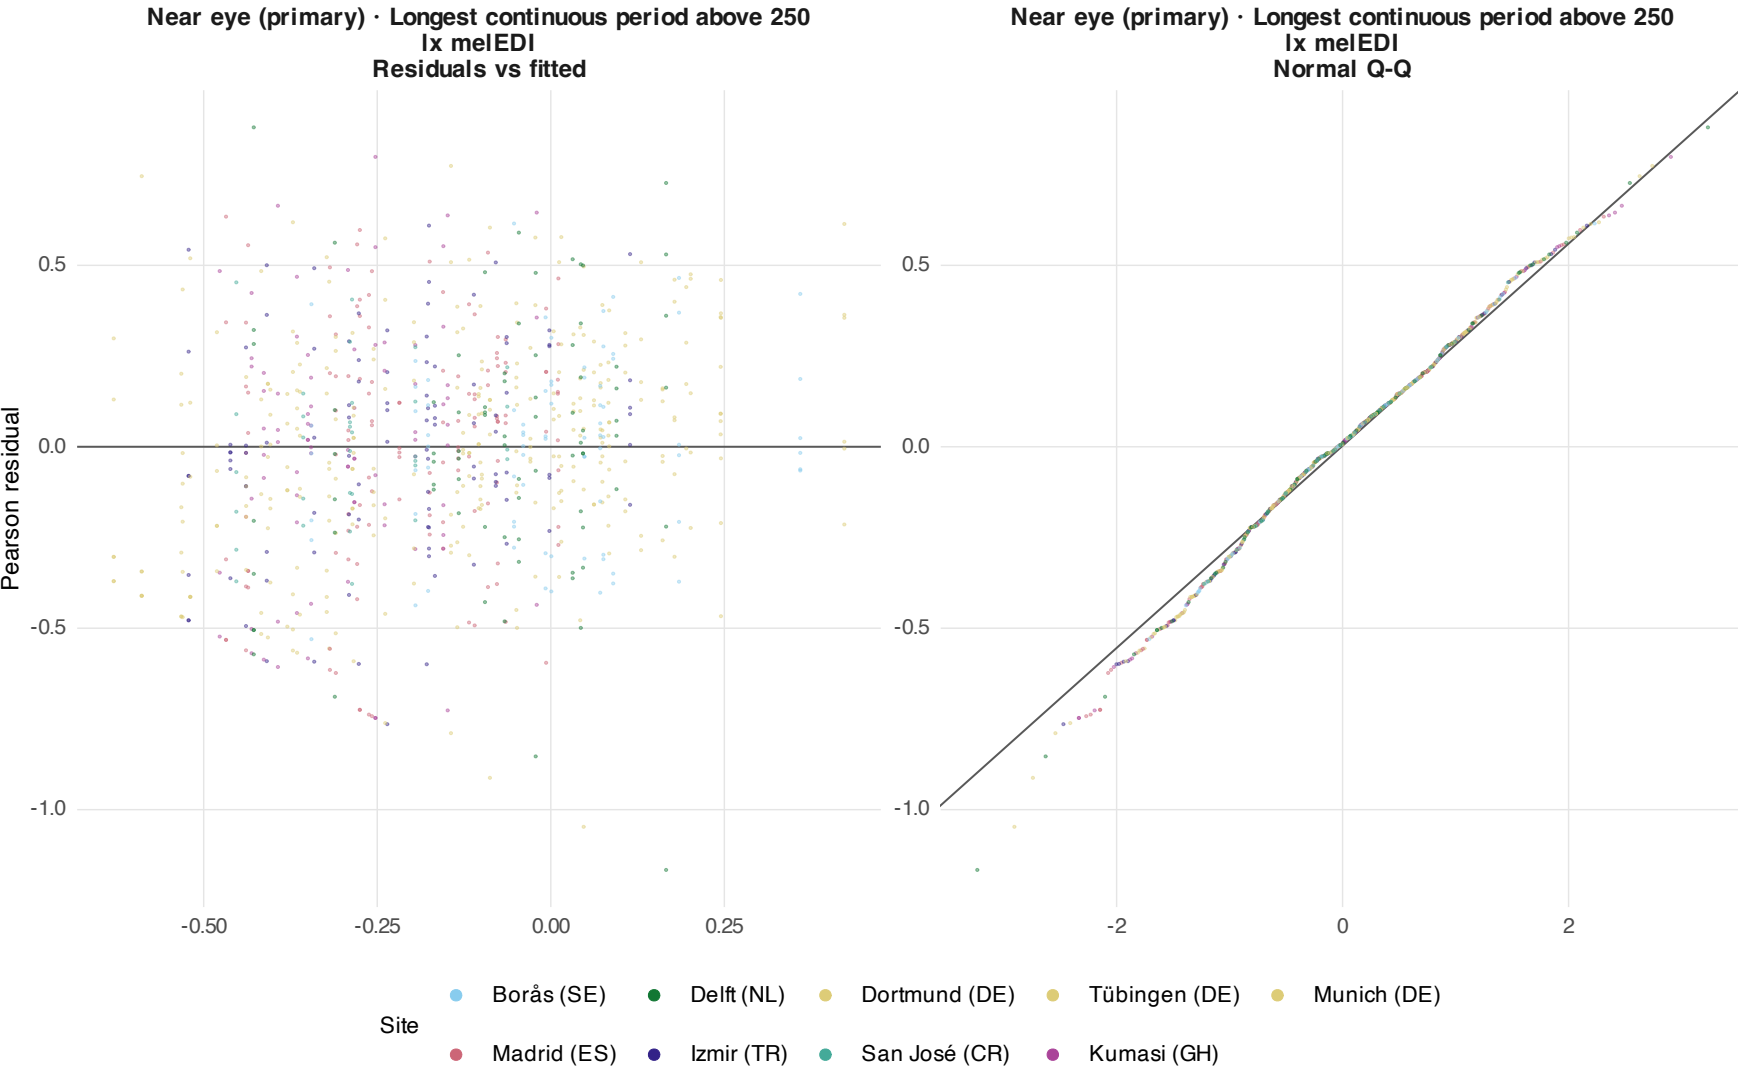


Near eye (primary) - Age, per 10 years -
Midpoint of the brightest 10 hours

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

Near eye (primary) · Midpoint of the brightest 10 hours
Residuals vs fitted




Near eye (primary) · Midpoint of the brightest 10 hours
Normal Q-Q

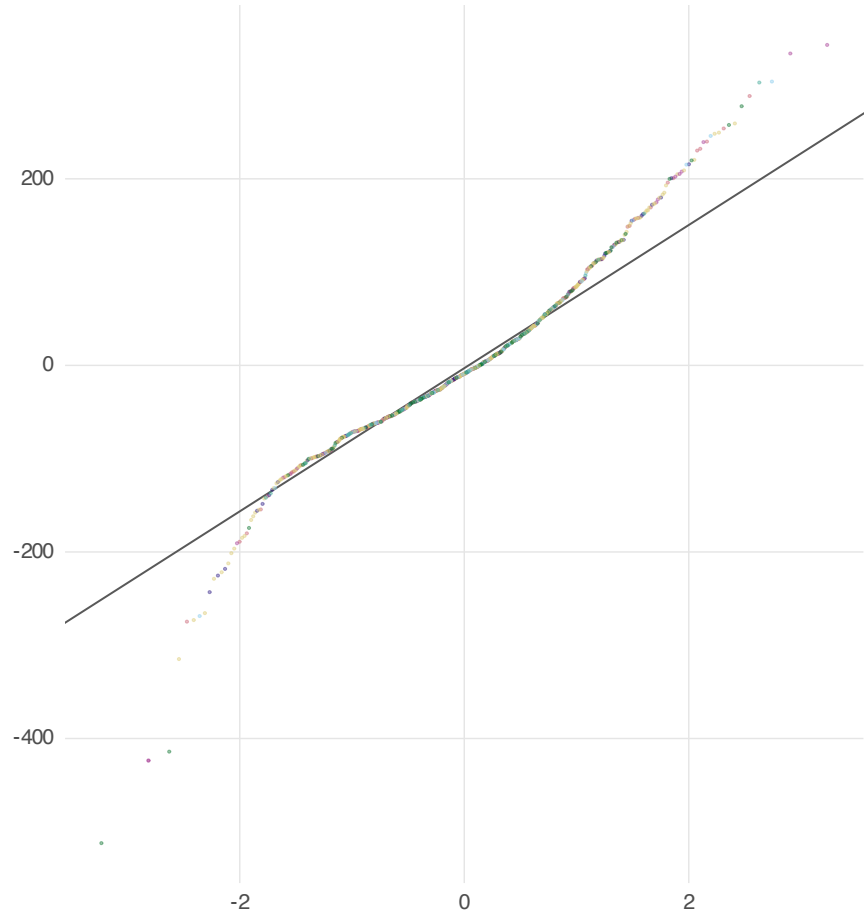

- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Tübingen (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)

Near eye (primary) - Age, per 10 years -
Midpoint of the darkest 10 hours


Assessment: acceptable with limitations; residual screen: Q-Q review.

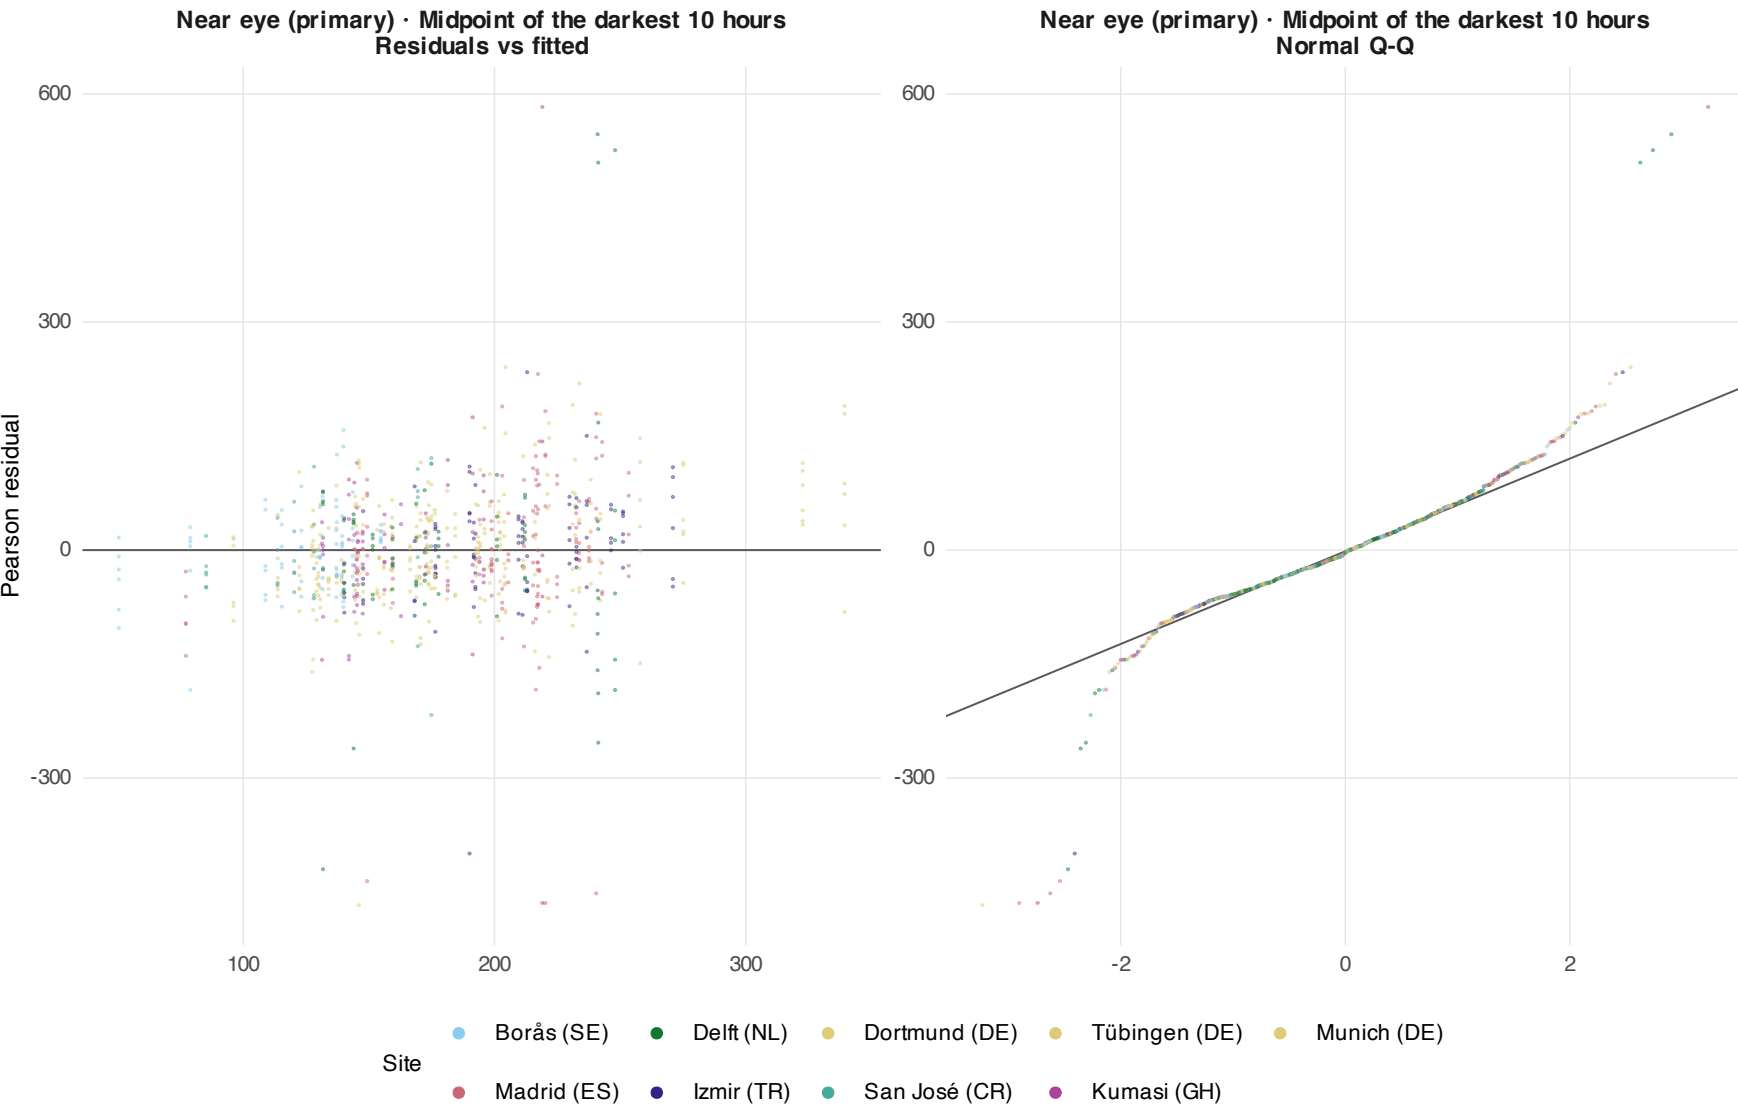


Near eye (primary) - Age, per 10 years
- Mean timing of exposure above 250 lx
meEDI

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

Near eye (primary) · Mean timing of exposure above 250
lx meEDI
Residuals vs fitted

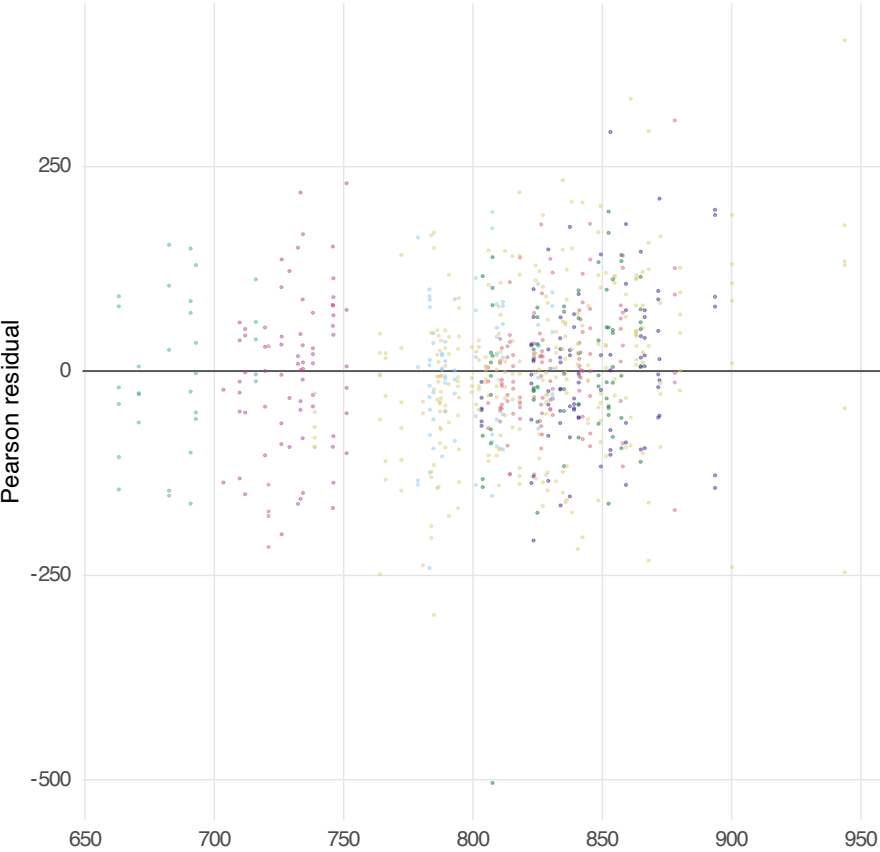

Near eye (primary) · Mean timing of exposure above 250
lx meEDI
Normal Q-Q

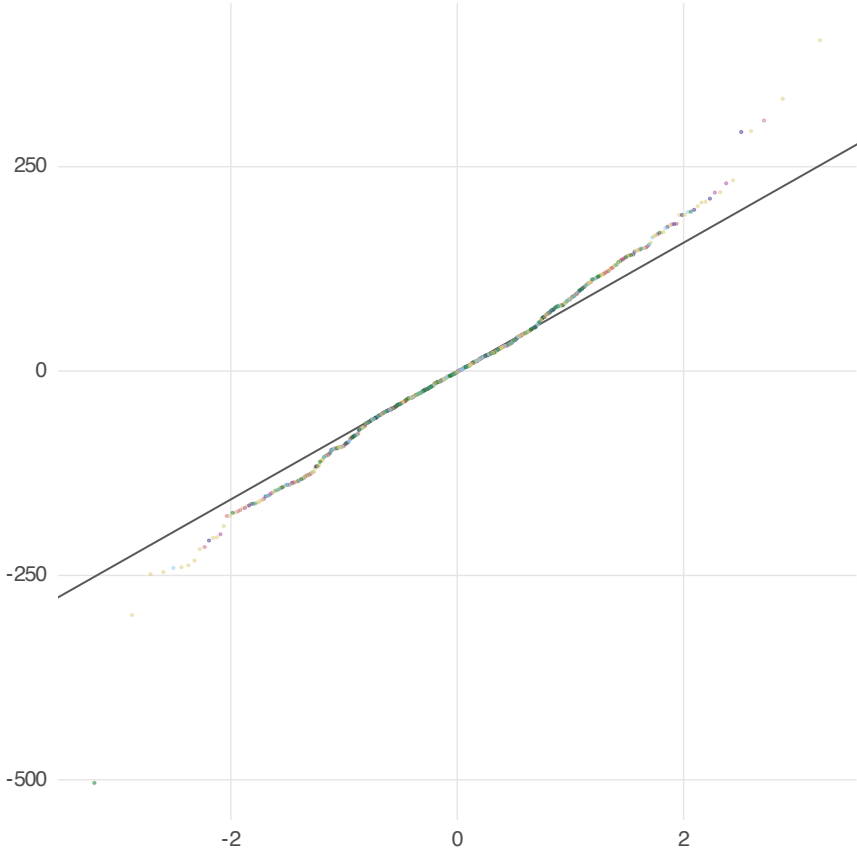

- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Tübingen (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)


Near eye (primary) - Age, per 10 years -
First light timing above 250 lx meEDI

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

Near eye (primary) · First light timing above 250 lx
meEDI
Residuals vs fitted



Near eye (primary) · First light timing above 250 lx
meEDI
Normal Q-Q

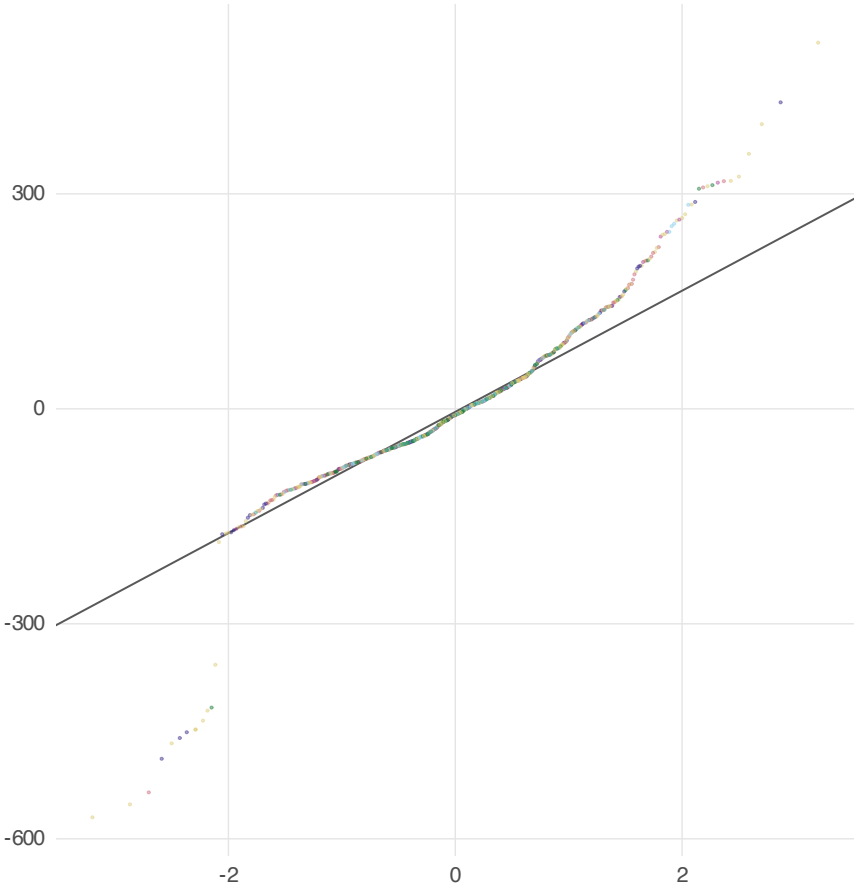

- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Tübingen (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)


Near eye (primary) - Age, per 10 years -
Last light timing above 250 lx meEDI

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

Near eye (primary) · Last light timing above 250 lx
meEDI
Residuals vs fitted




Near eye (primary) · Last light timing above 250 lx
meEDI
Normal Q-Q

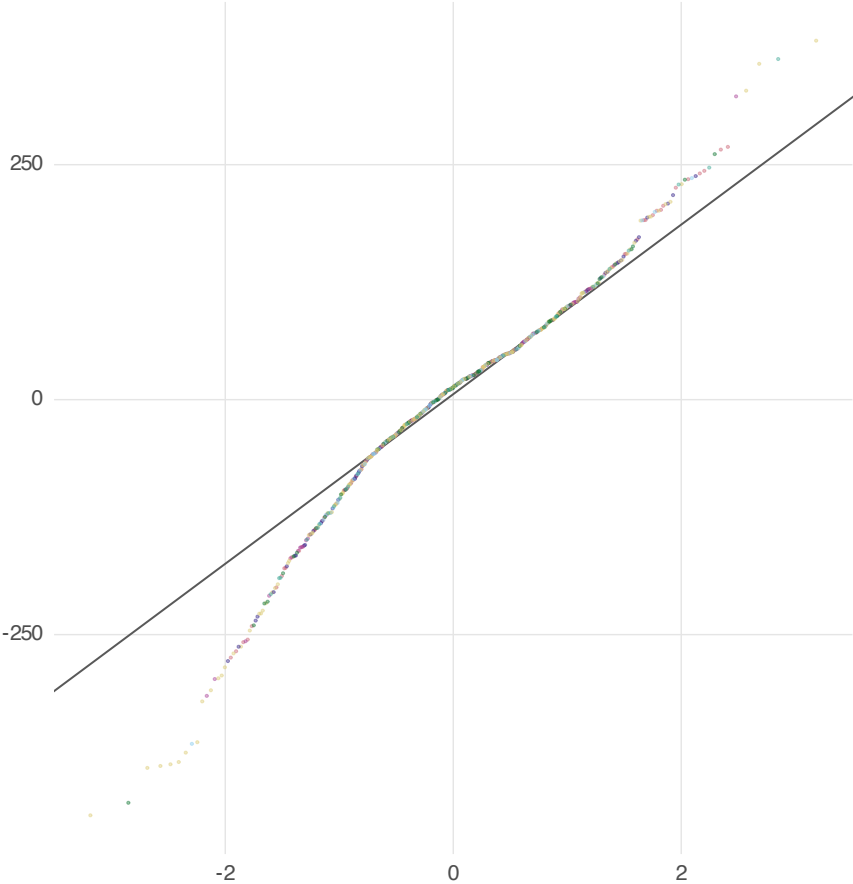

- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Tübingen (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)


Near eye (primary) - Age, per 10 years -
meEDI dose

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

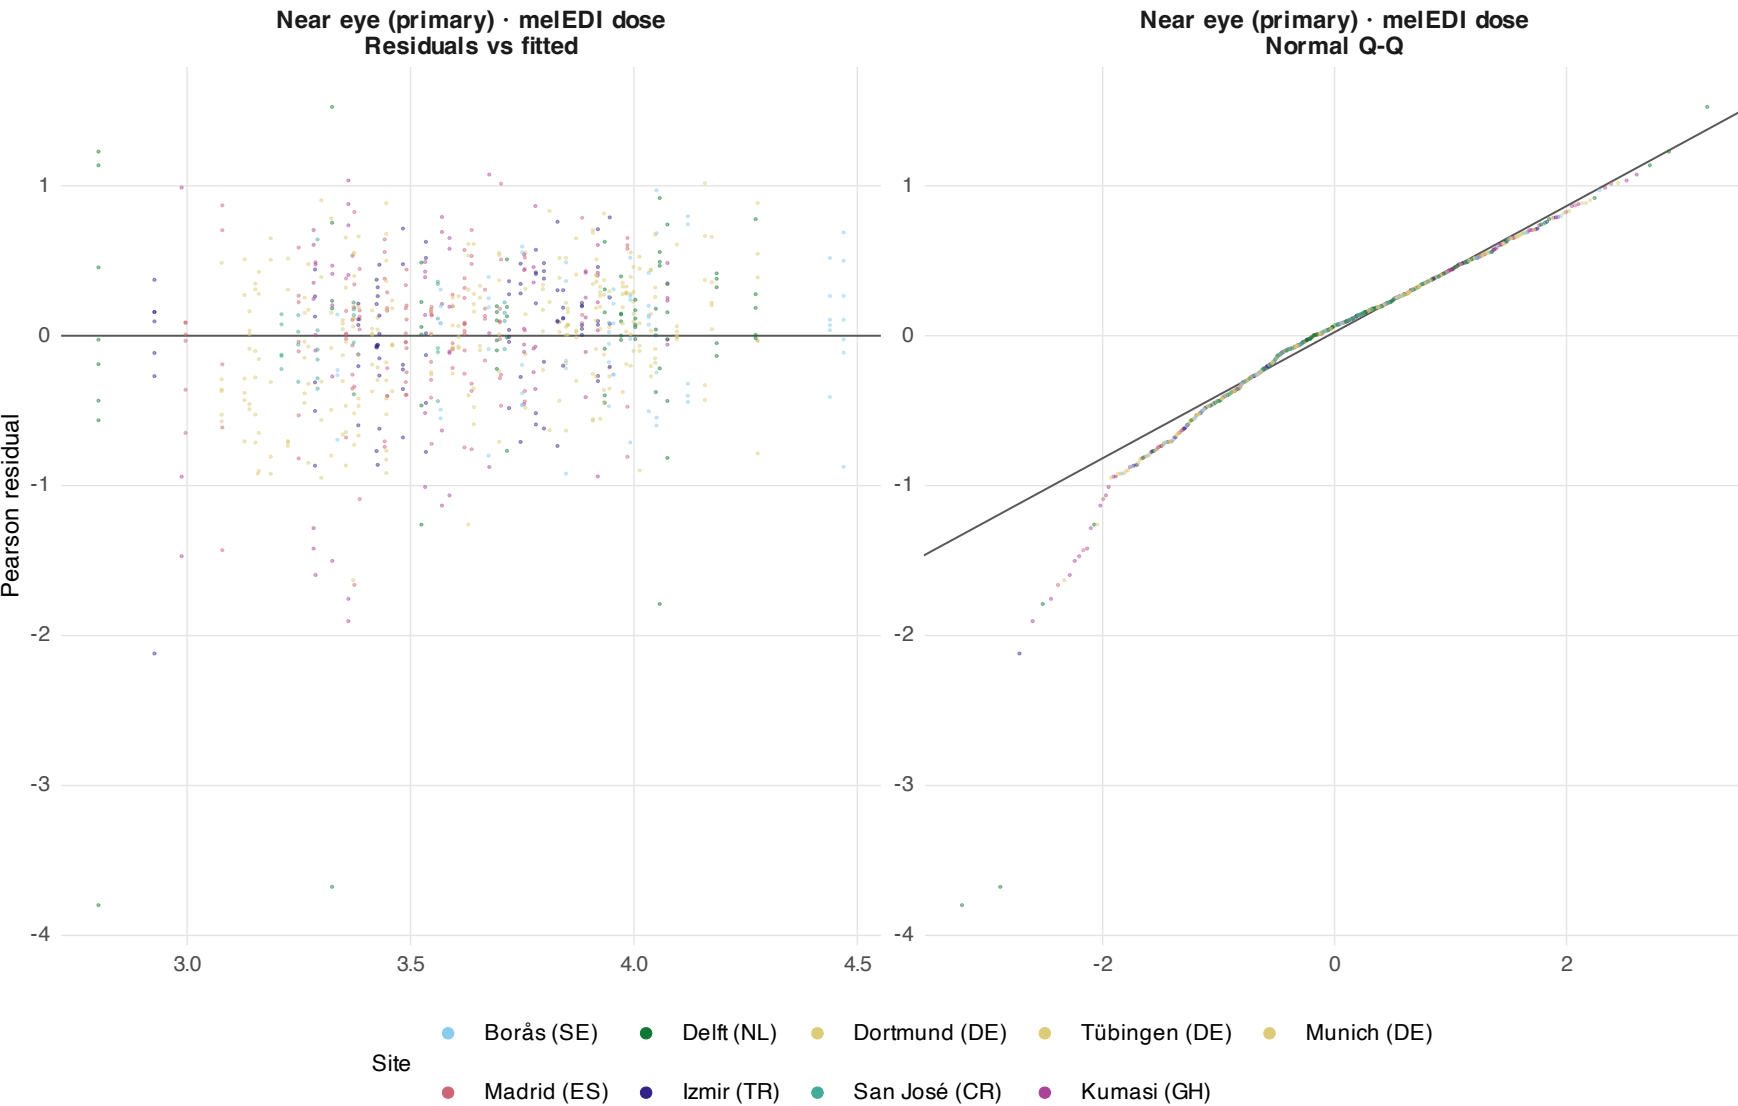


Near eye (primary) - Age, per 10 years -
Melanopic daylight efficacy ratio

Assessment: acceptable with limitations; residual screen: Q-Q review.

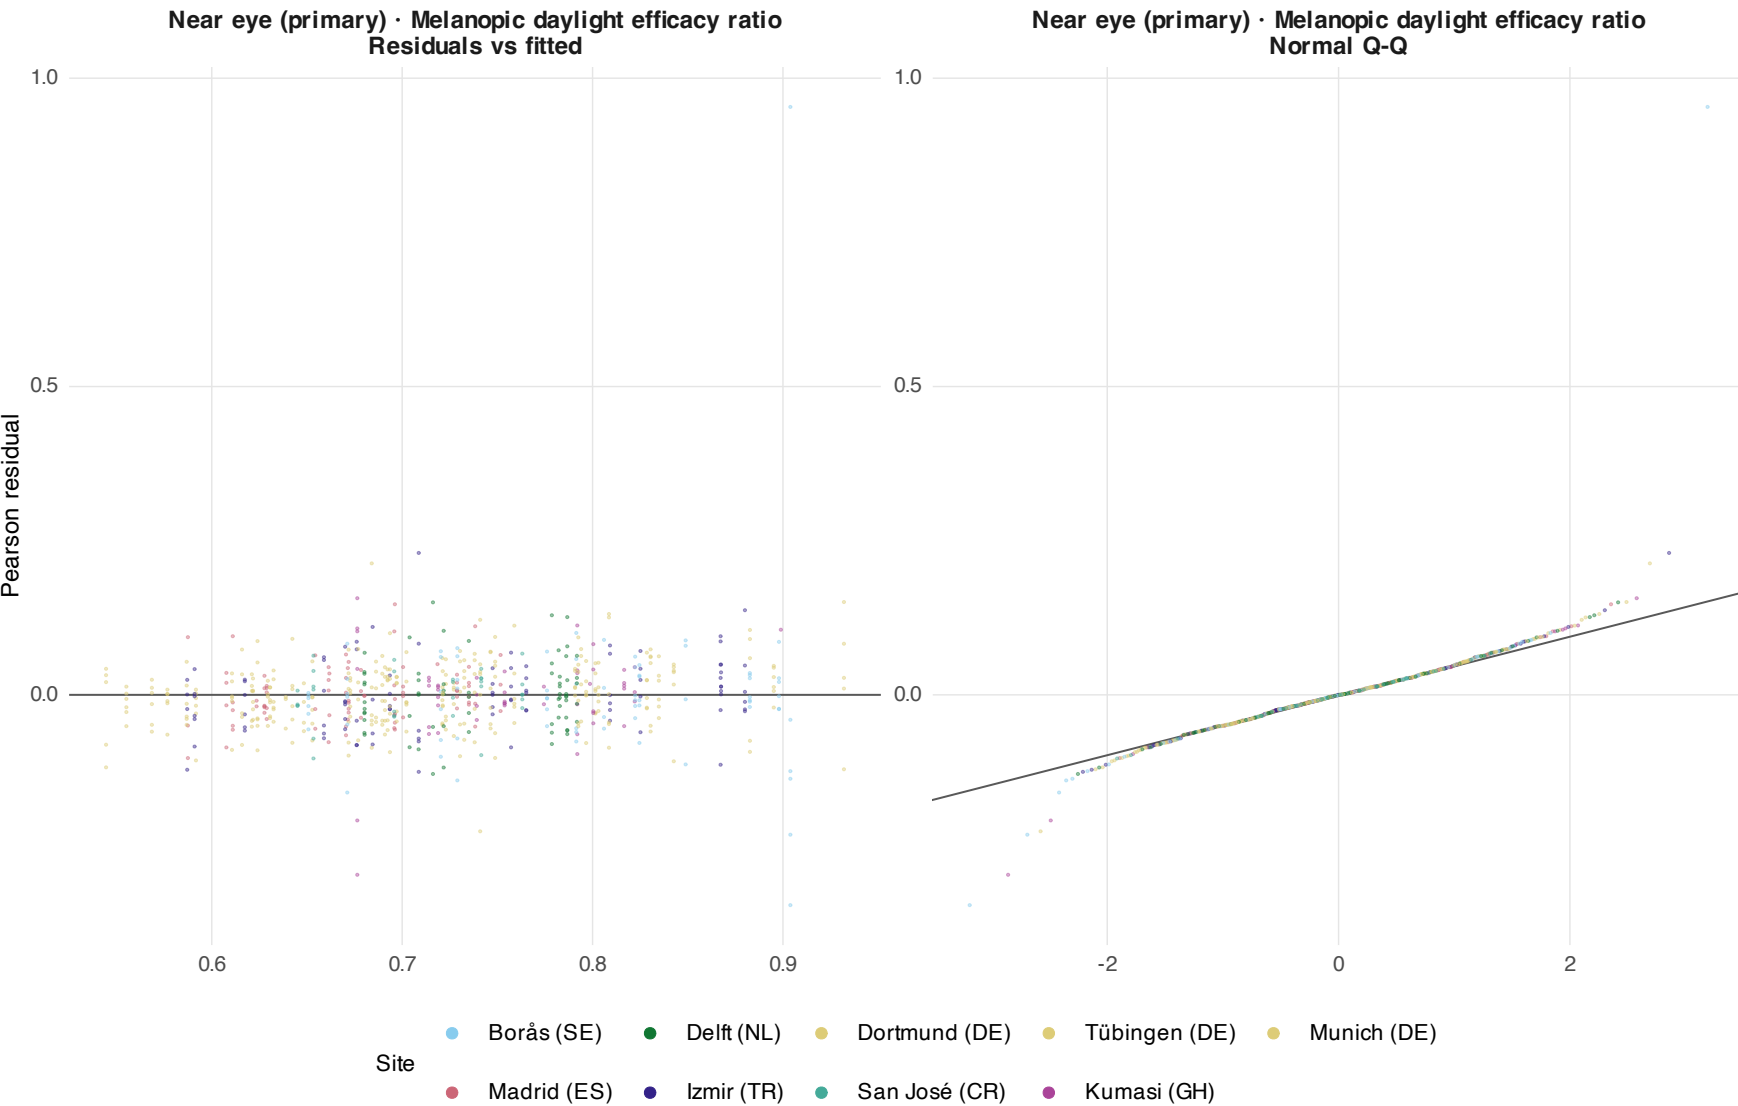


Near eye (primary) - Measured biological sex, Female minus Male - Interdaily stability

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

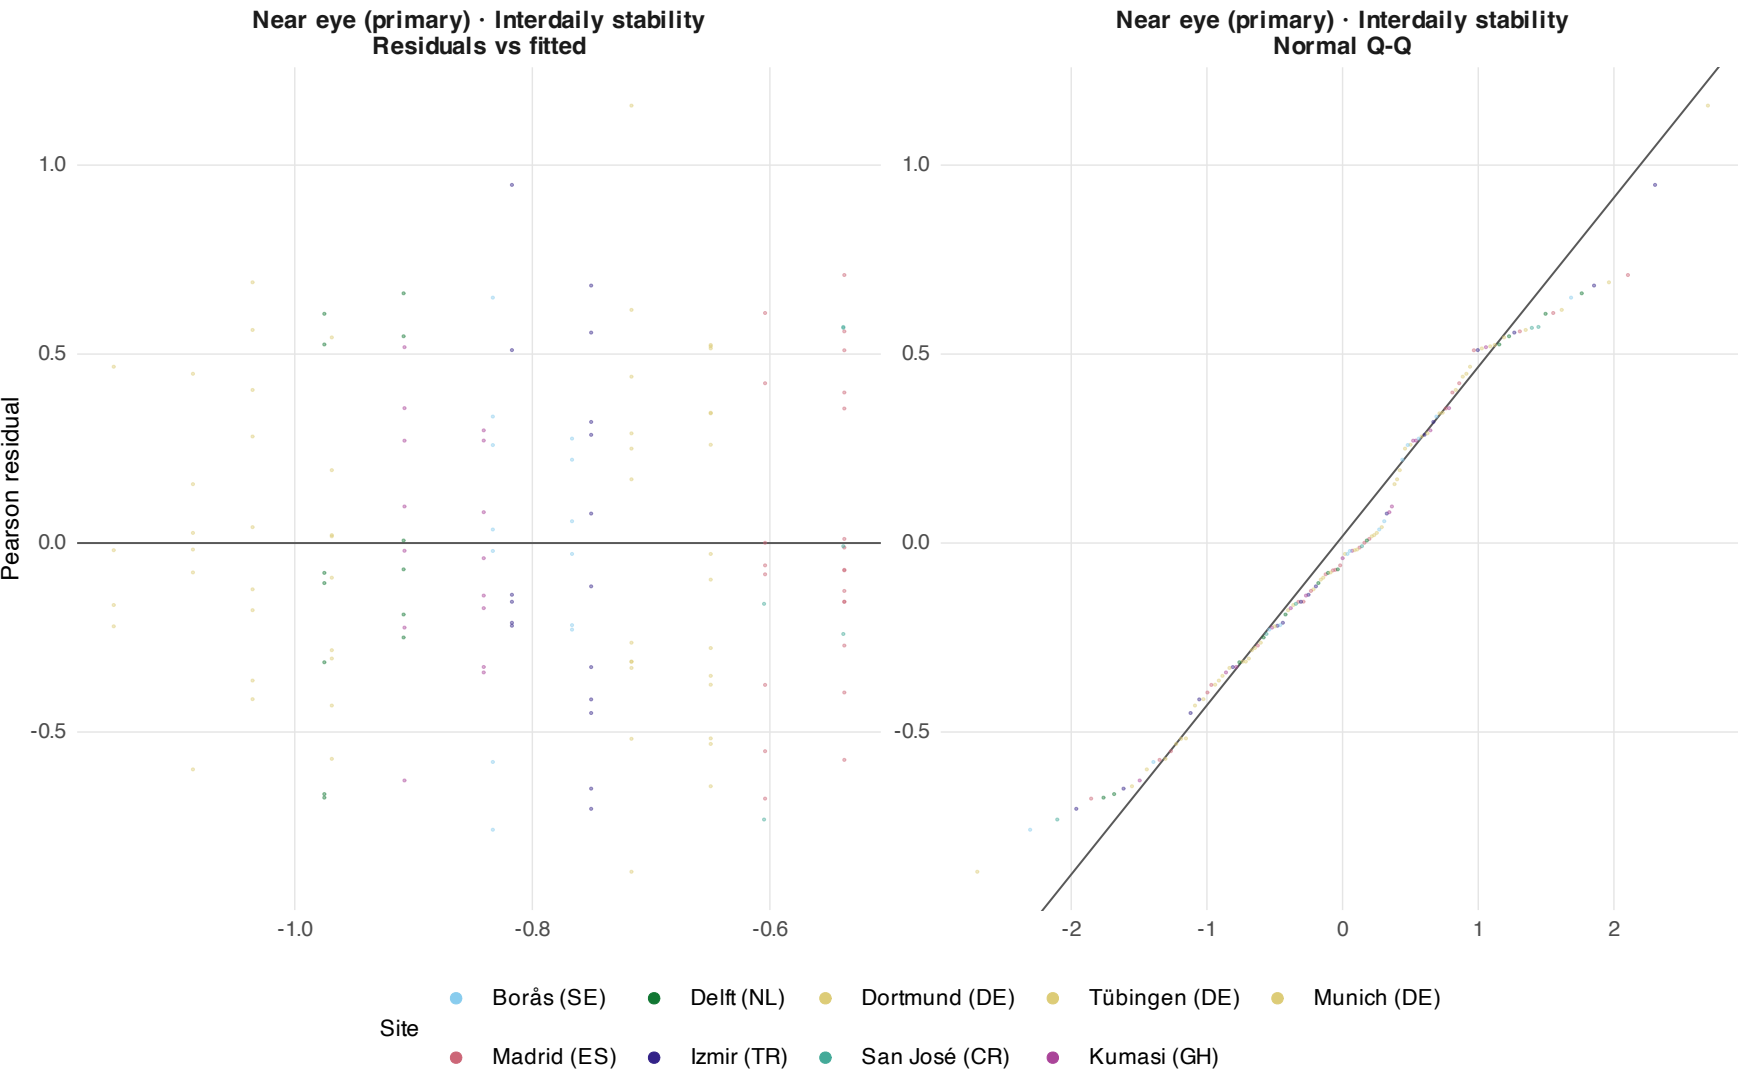


Near eye (primary) - Measured biological sex, Female minus Male - Intradaily variability

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

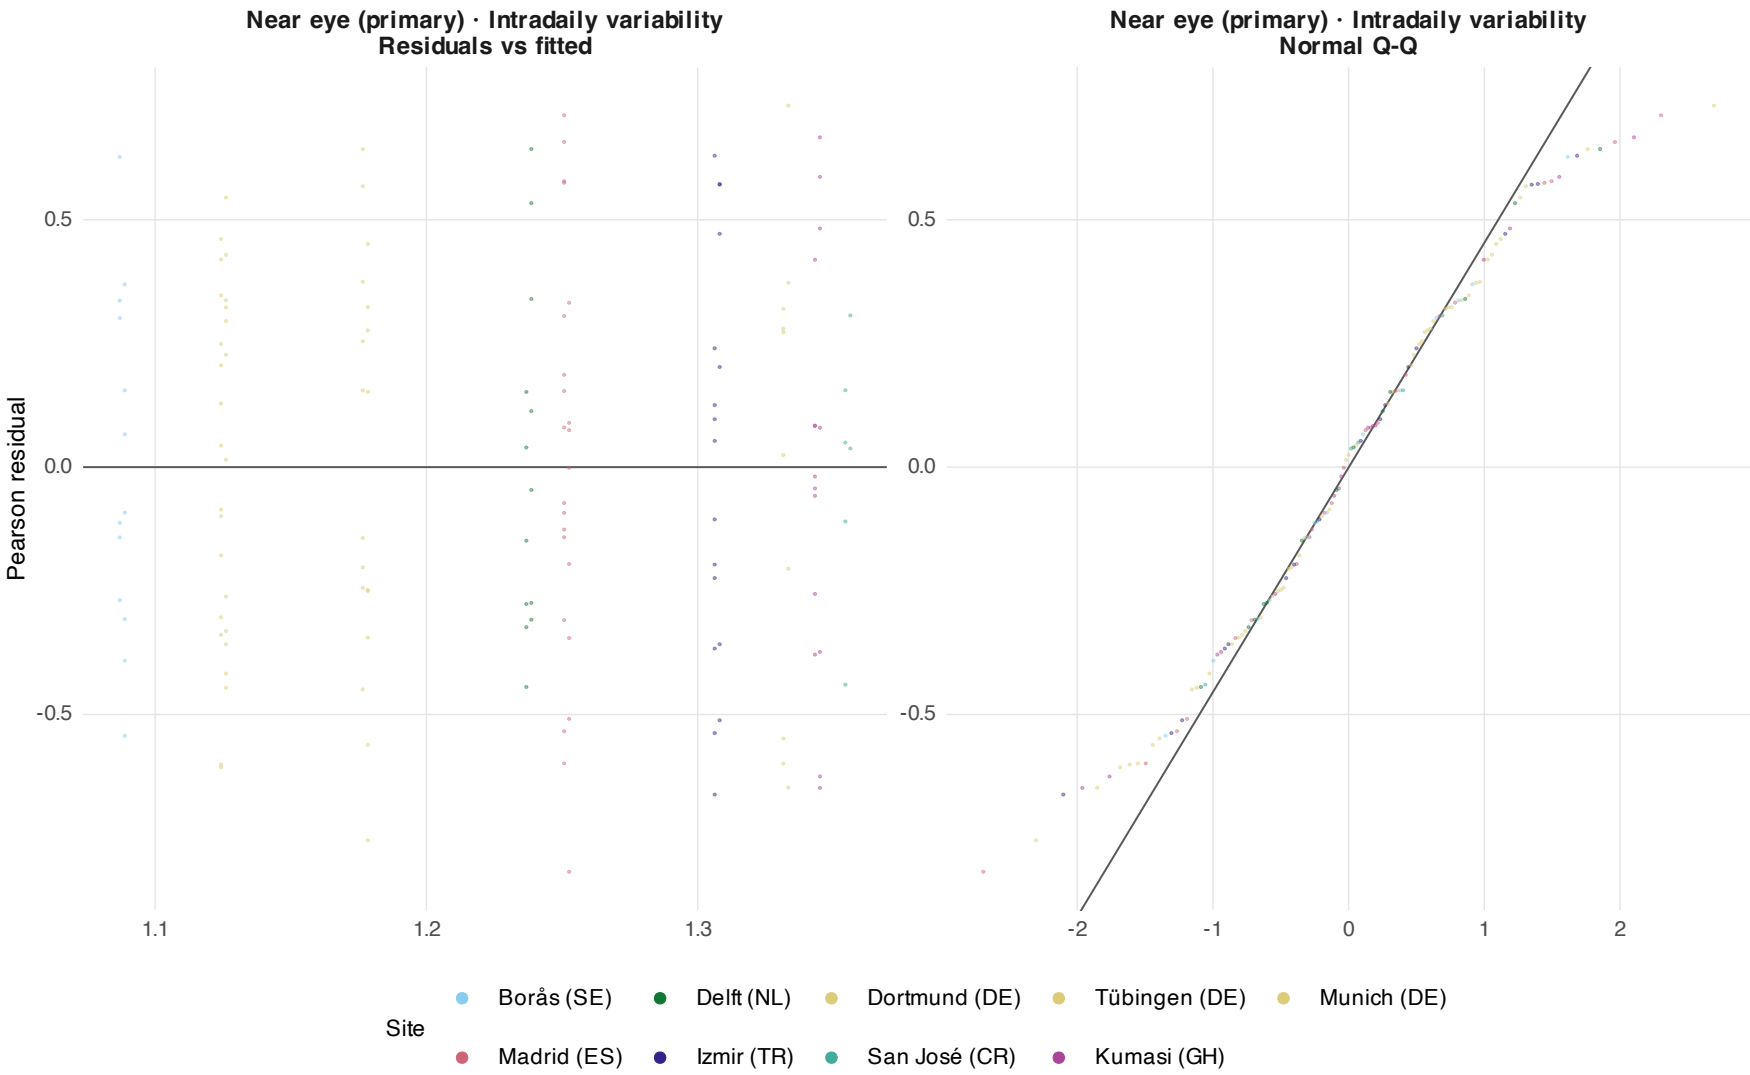


Near eye (primary) - Measured biological sex, Female minus Male - Mean meEDI

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

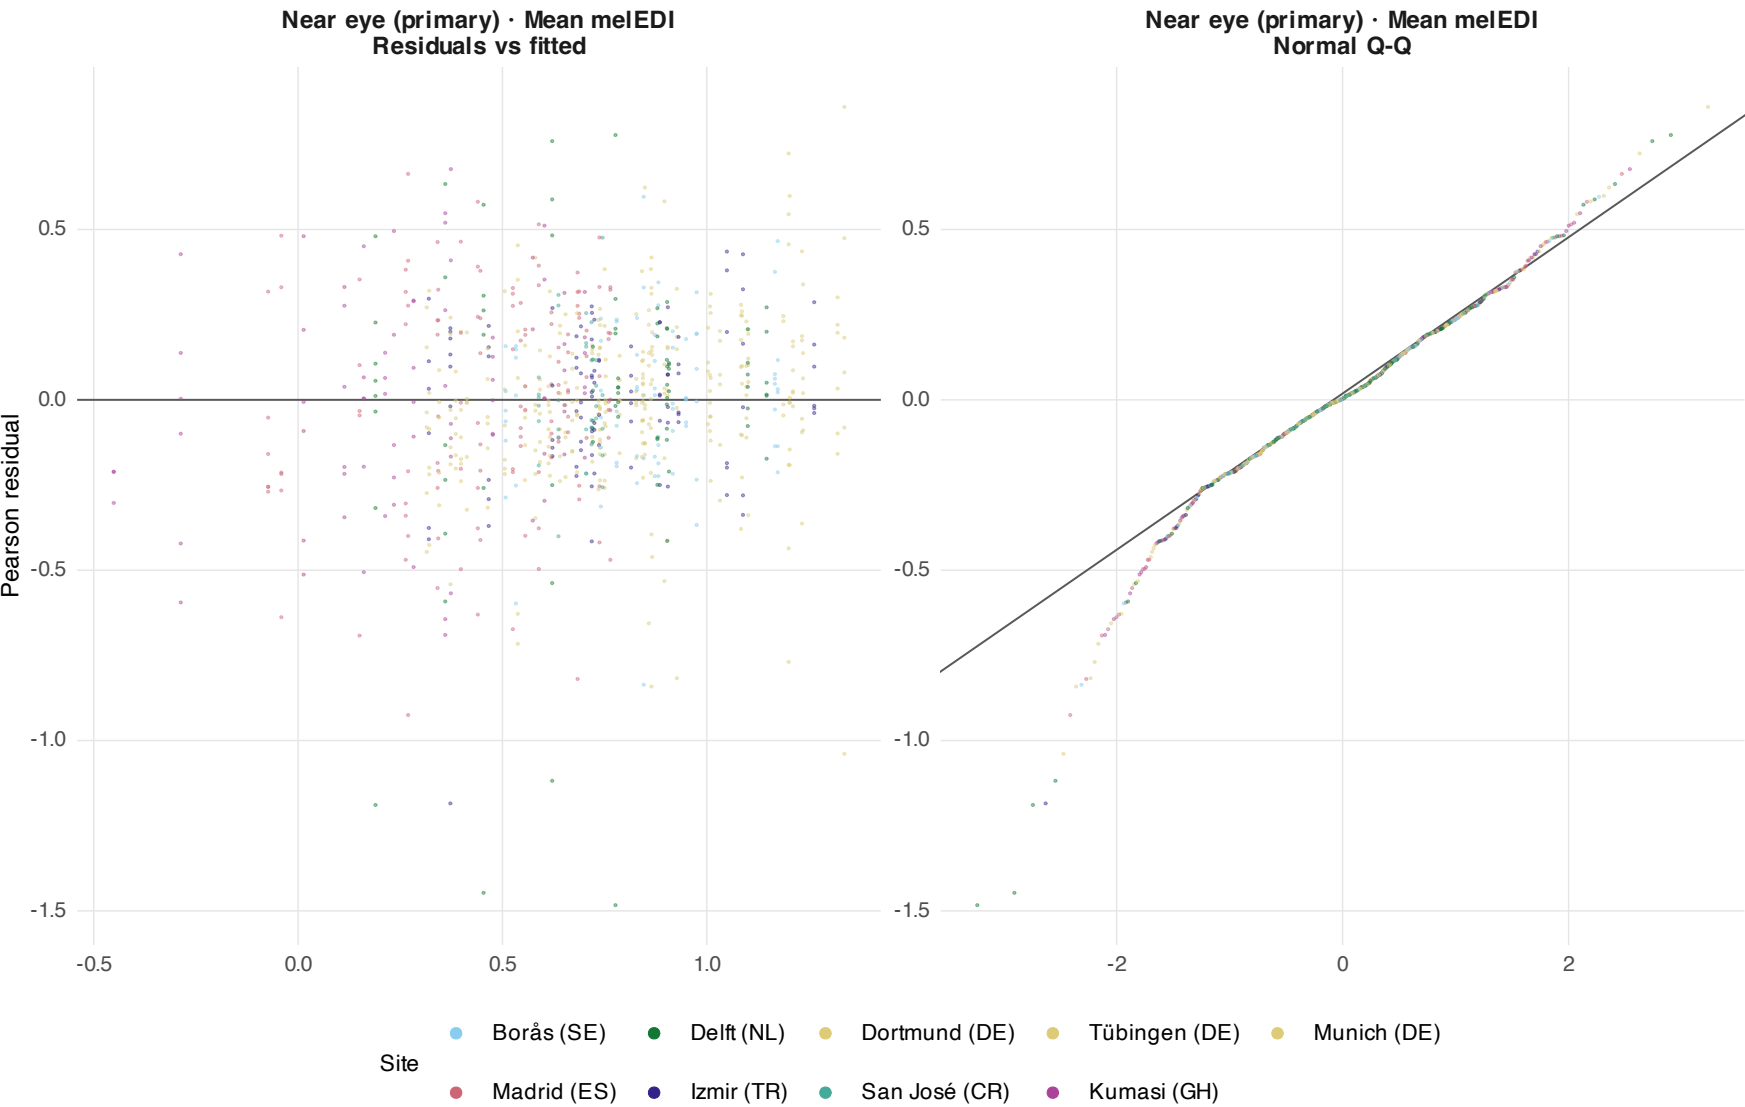


Near eye (primary) - Measured biological sex, Female minus Male - Brightest 10 h mean

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

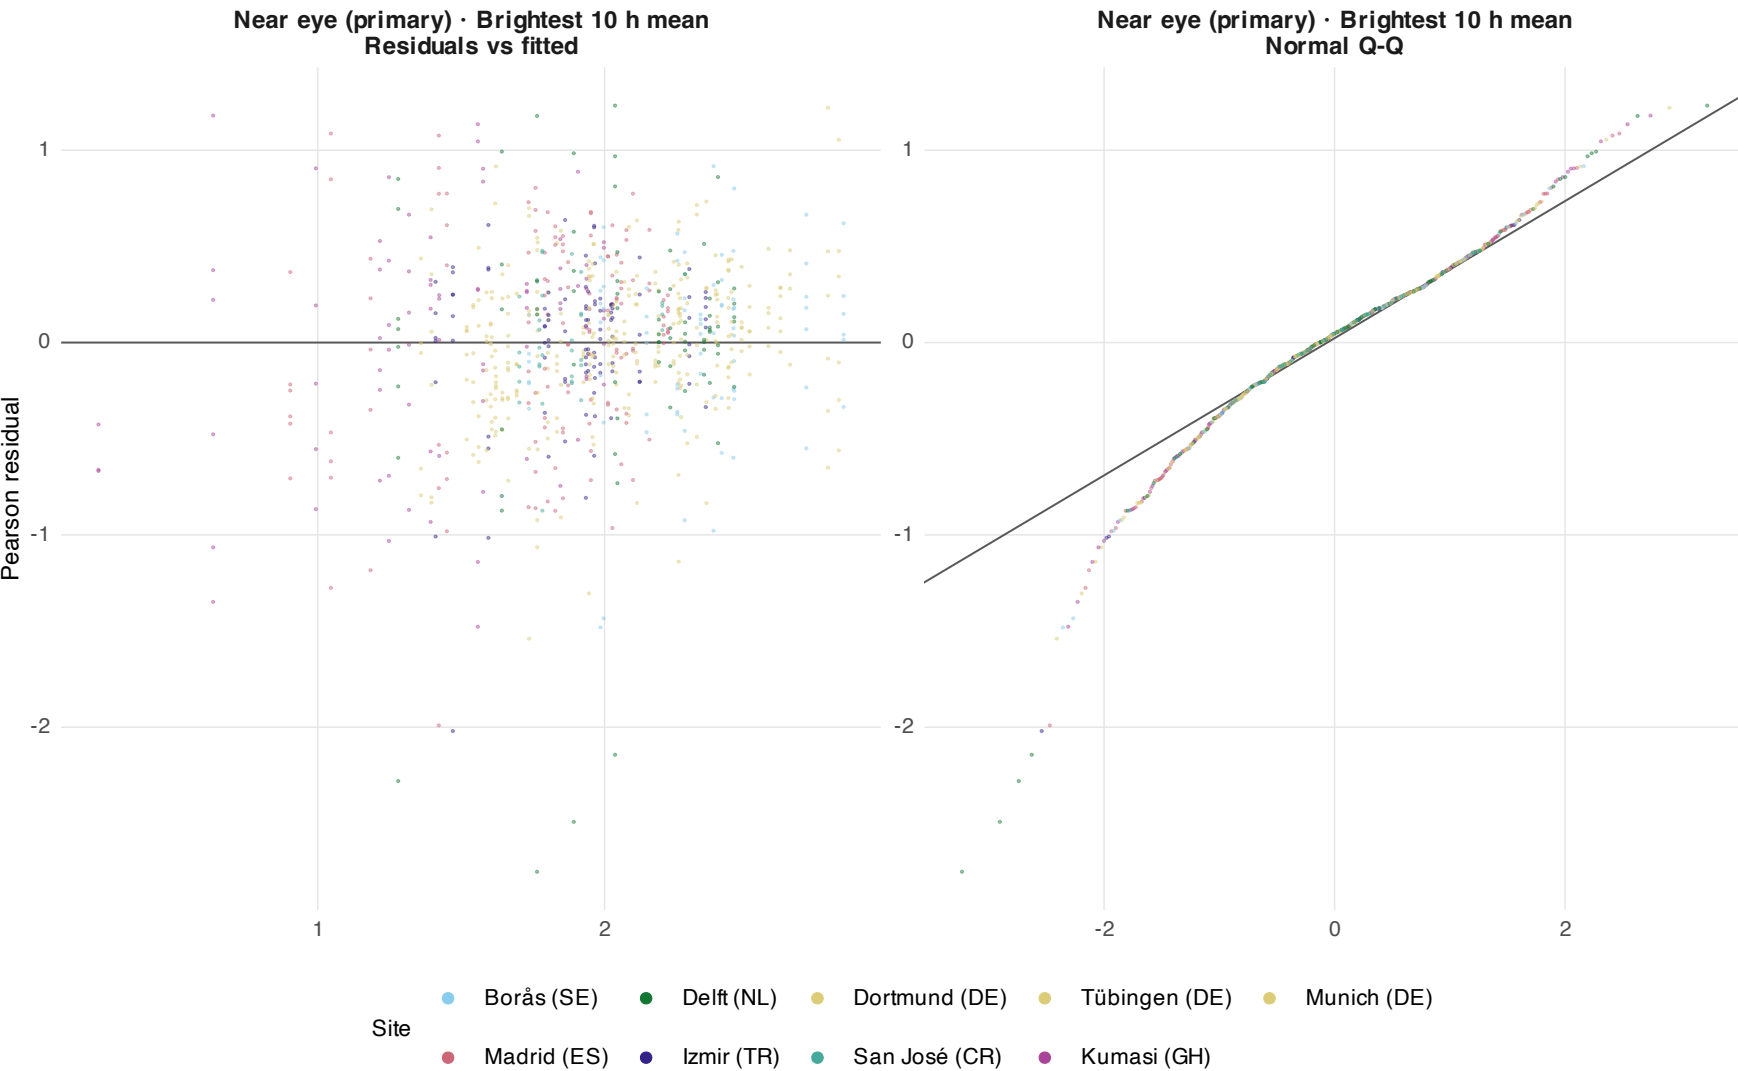

Near eye (primary) - Measured biological sex, Female minus Male - Darkest 10 h mean


Assessment: acceptable with limitations; residual screen: RESIDUAL SPREAD REVIEW.

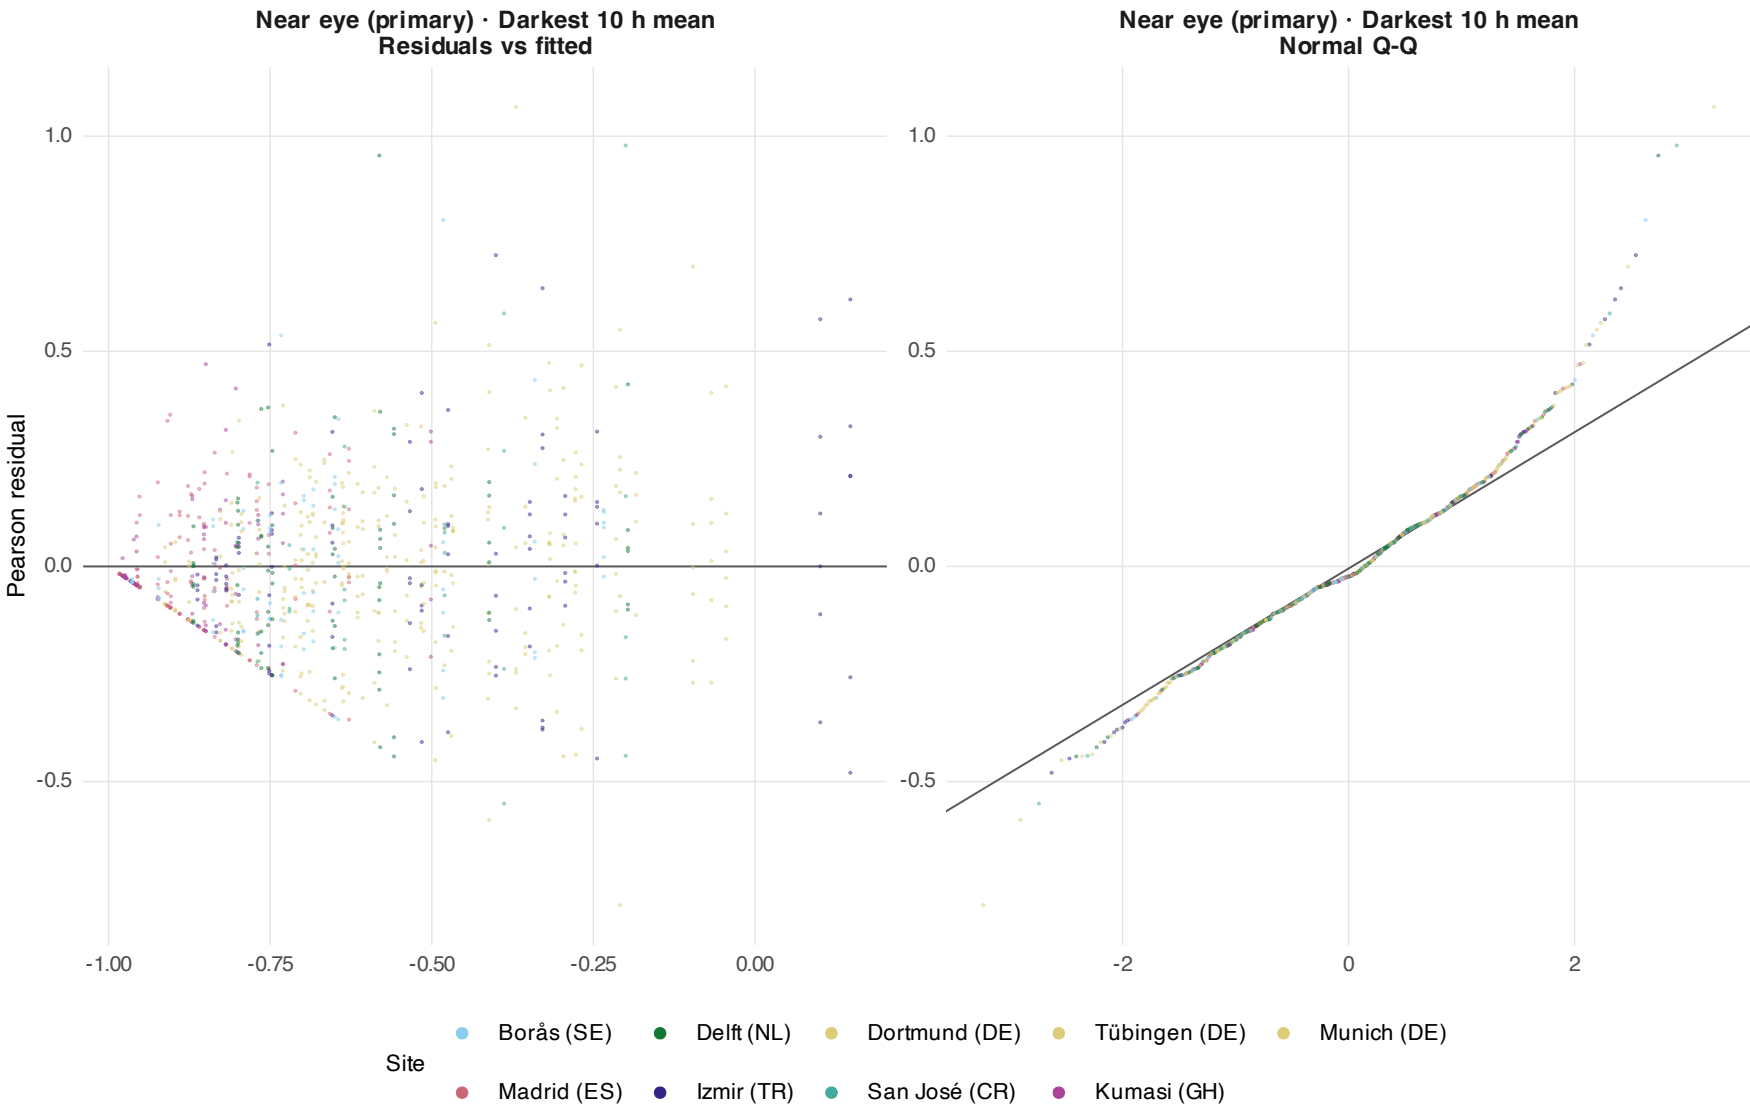


Near eye (primary) - Measured biological
sex, Female minus Male - Time above 1,000
lx meEDI

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

Near eye (primary) · Time above 1,000 lx meEDI
Residuals vs fitted

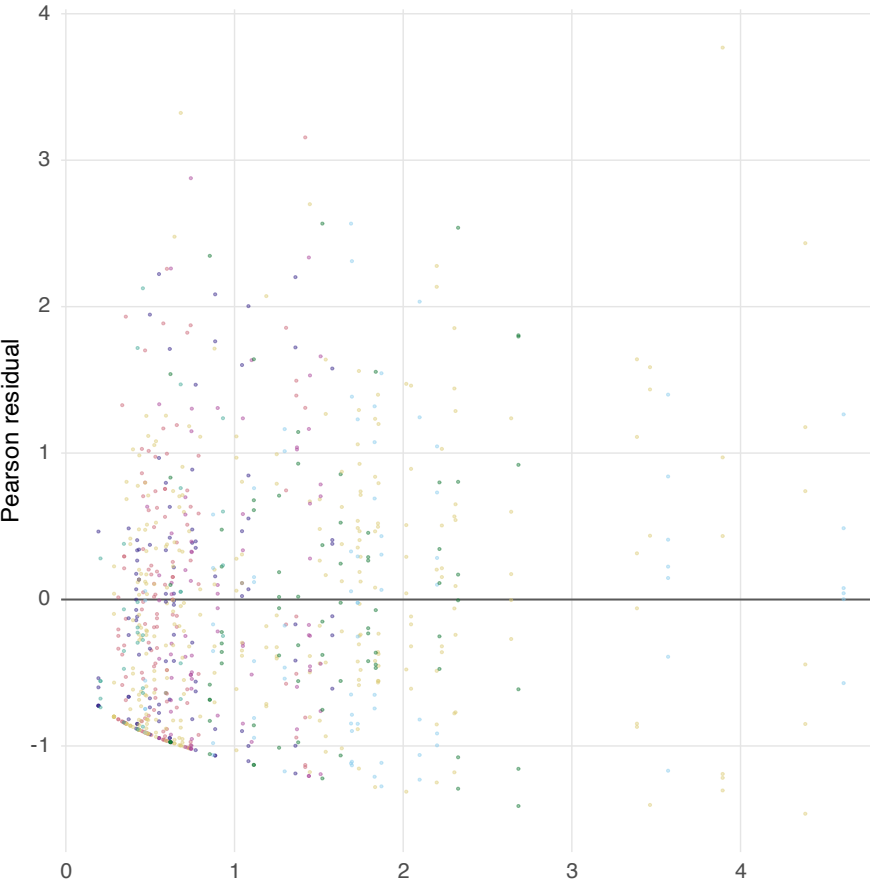

Near eye (primary) · Time above 1,000 lx meEDI
Normal Q-Q

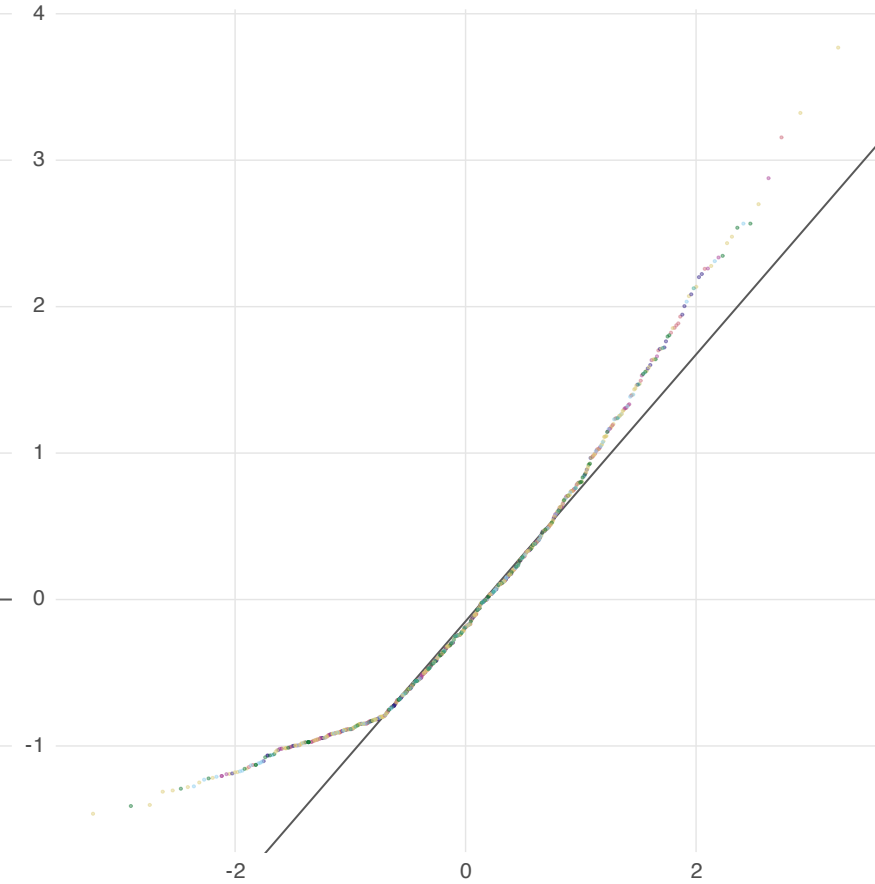


- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Tübingen (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)


Near eye (primary) - Measured biological
sex, Female minus Male - Time above 250 lx
meEDI during wake

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

Near eye (primary) · Time above 250 lx meEDI during
wake
Residuals vs fitted

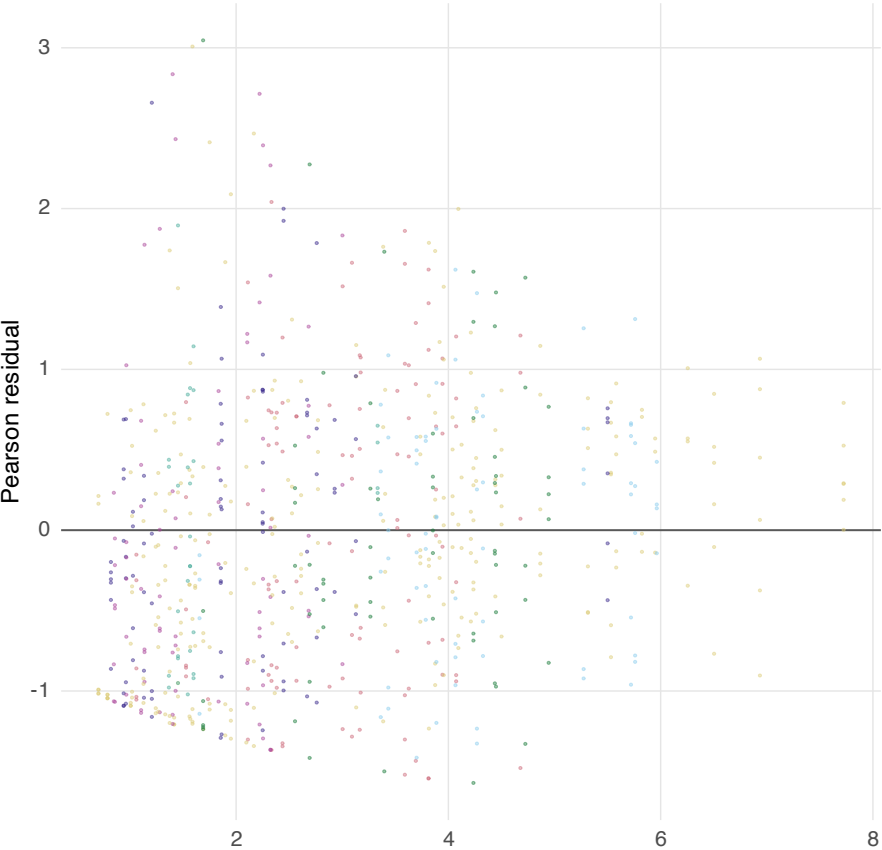

Near eye (primary) · Time above 250 lx meEDI during
wake
Normal Q-Q

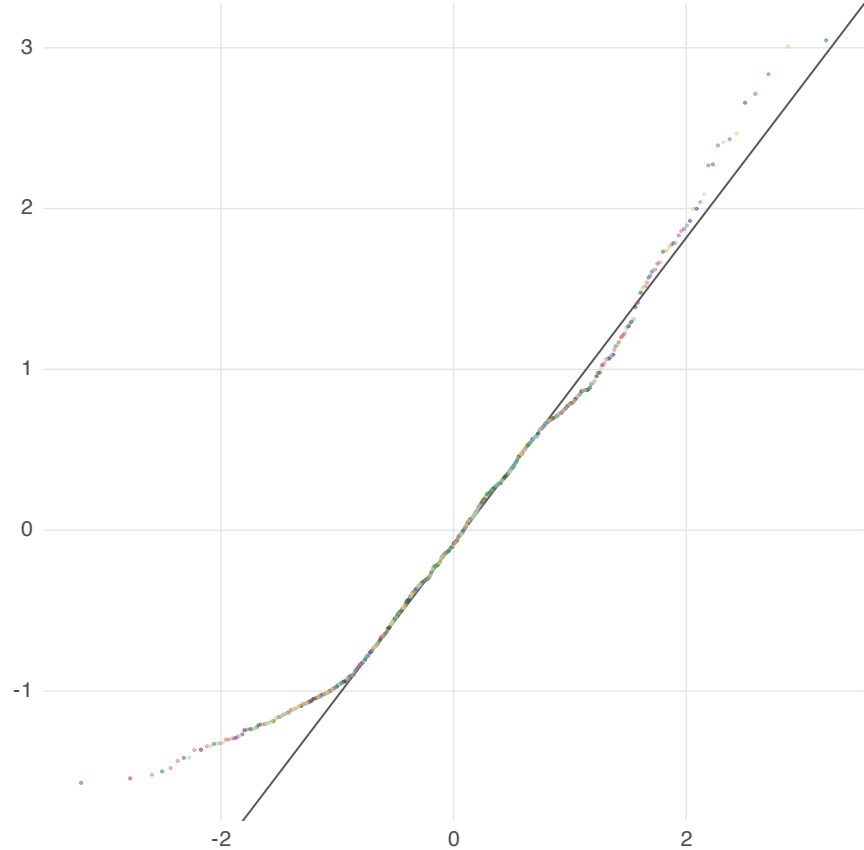

- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Tübingen (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)


Near eye (primary) - Measured biological
sex, Female minus Male - Time below 10 lx
meEDI before sleep

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

Near eye (primary) · Time below 10 lx meEDI before
sleep
Residuals vs fitted




Near eye (primary) · Time below 10 lx meEDI before
sleep
Normal Q-Q

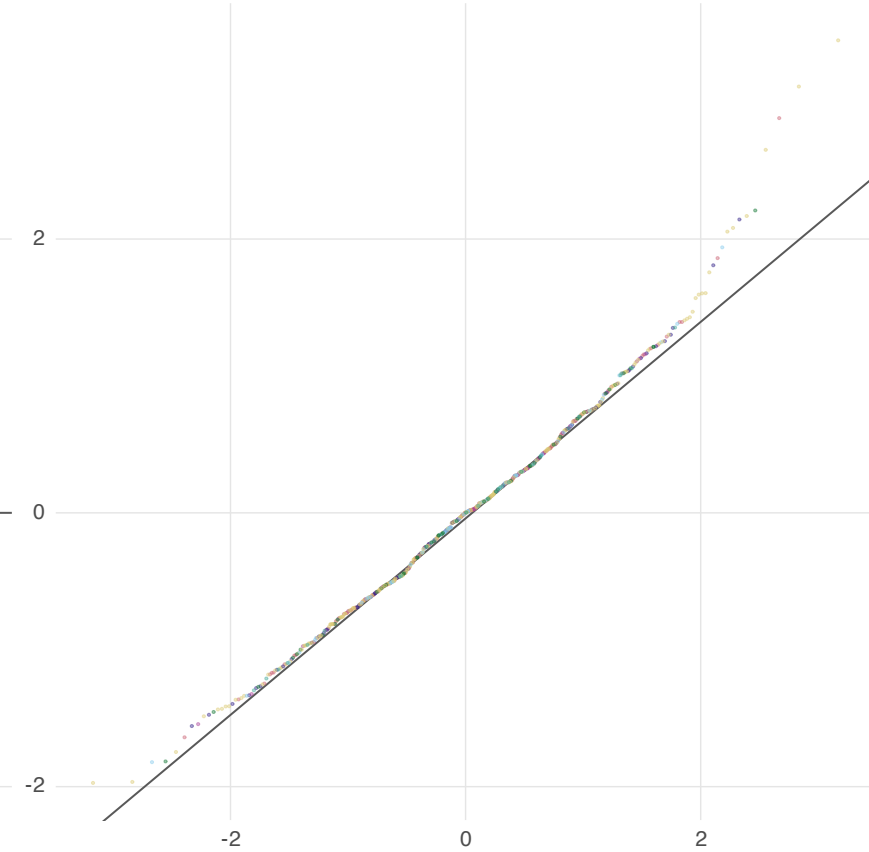

- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Tübingen (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)


Near eye (primary) - Measured biological sex, Female minus Male - Time below 1 lx meEDI during sleep

Assessment: acceptable with limitations; residual screen: ZERO MASS REVIEW.

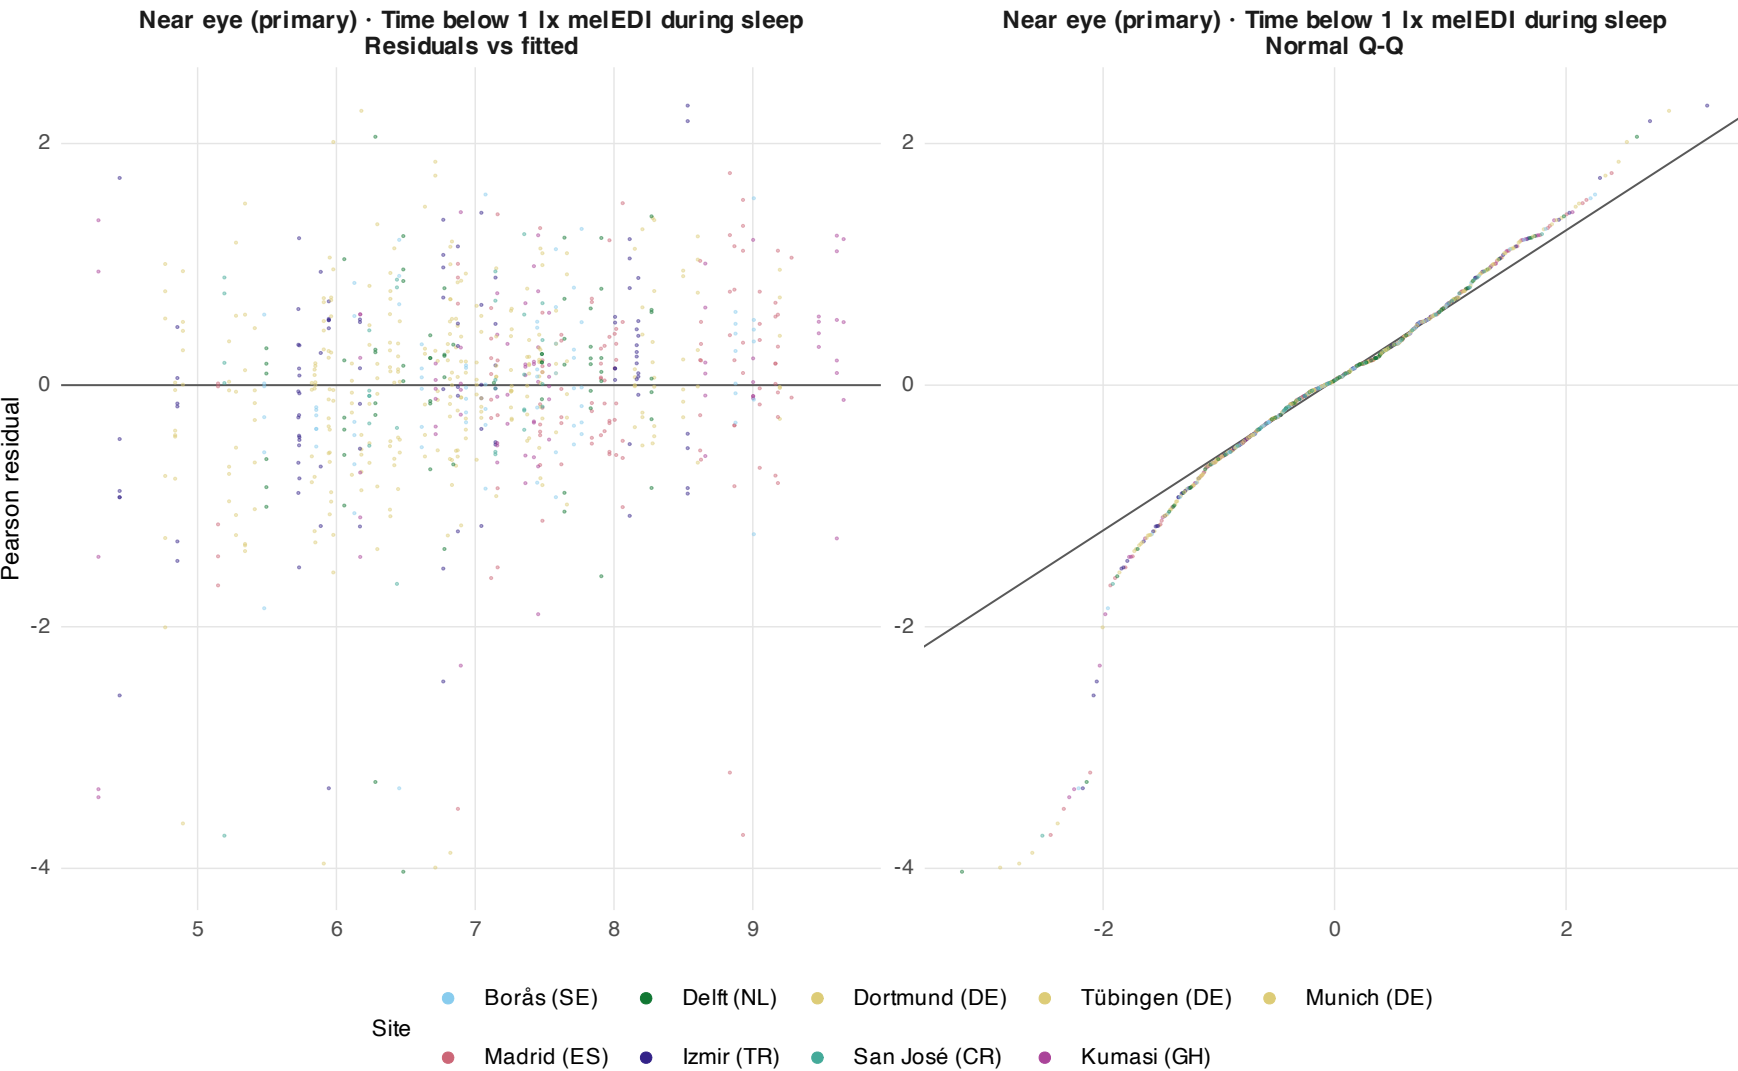

Near eye (primary) - Measured biological sex, Female minus Male - Longest continuous period above 250 lx meEDI

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

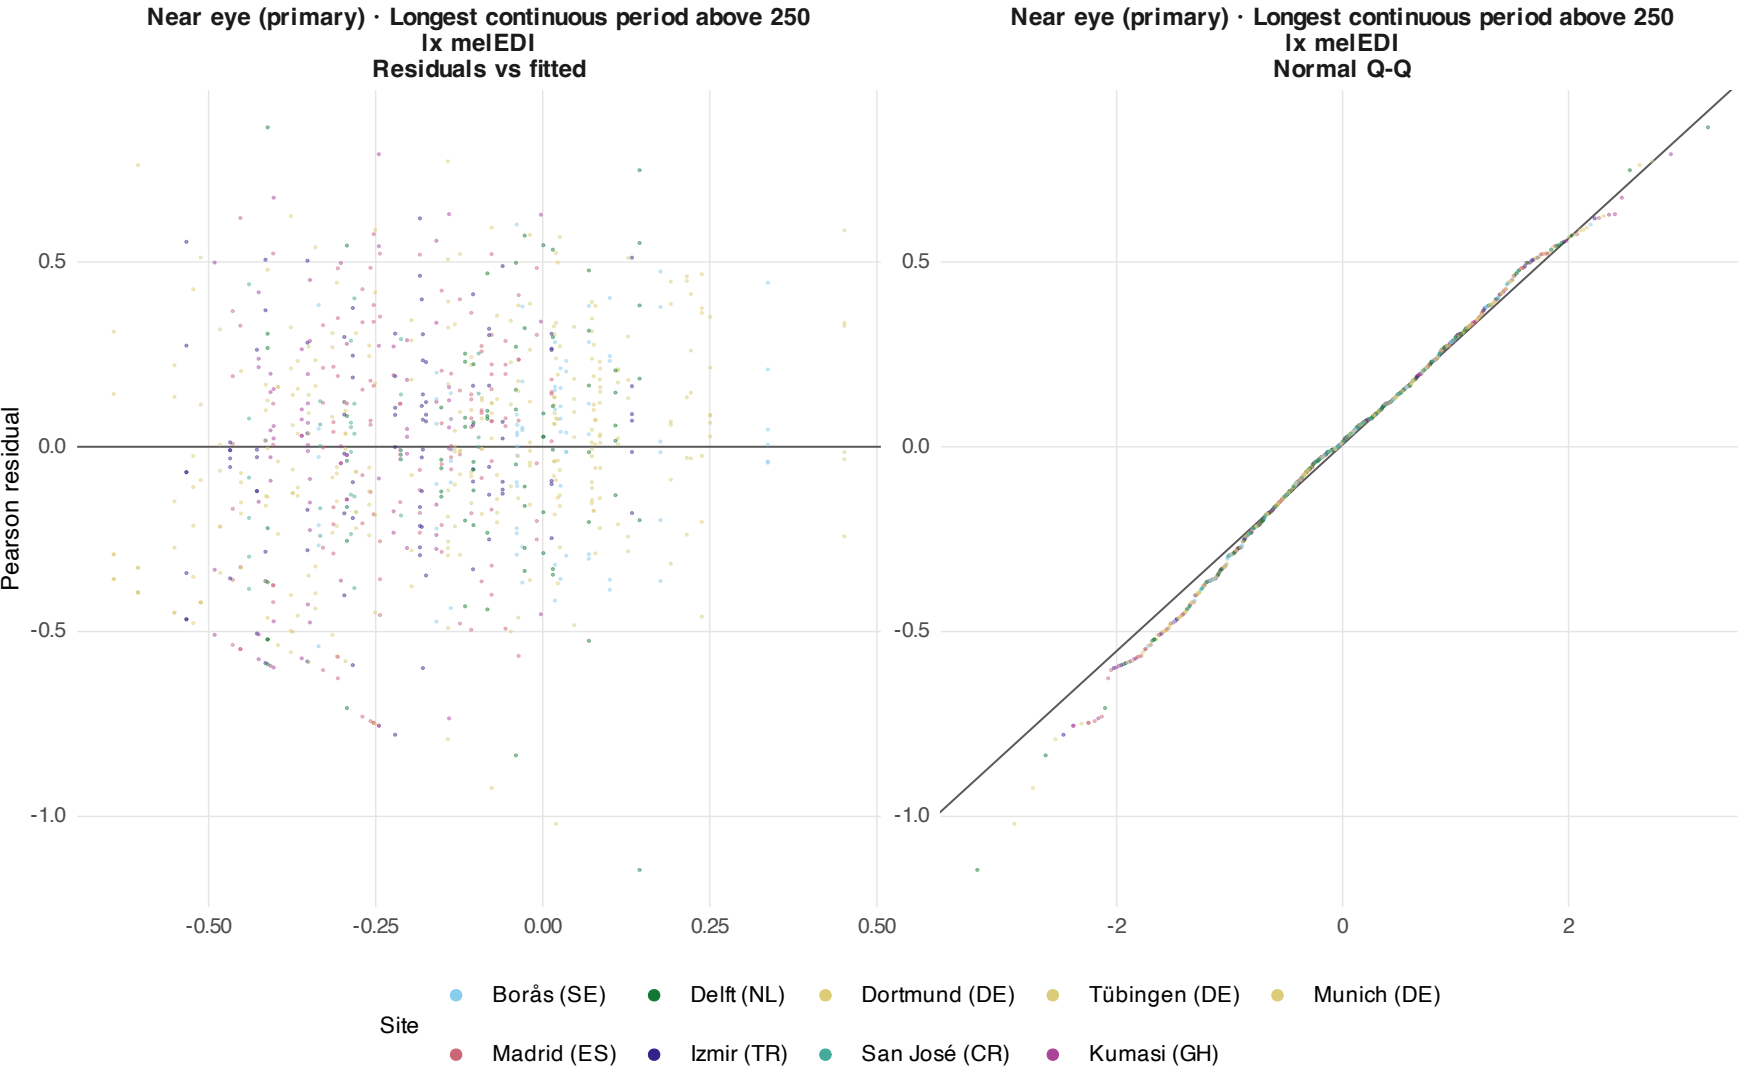


Near eye (primary) - Measured biological sex, Female minus Male - Midpoint of the brightest 10 hours

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

Near eye (primary) · Midpoint of the brightest 10 hours
Residuals vs fitted



Near eye (primary) · Midpoint of the brightest 10 hours
Normal Q-Q

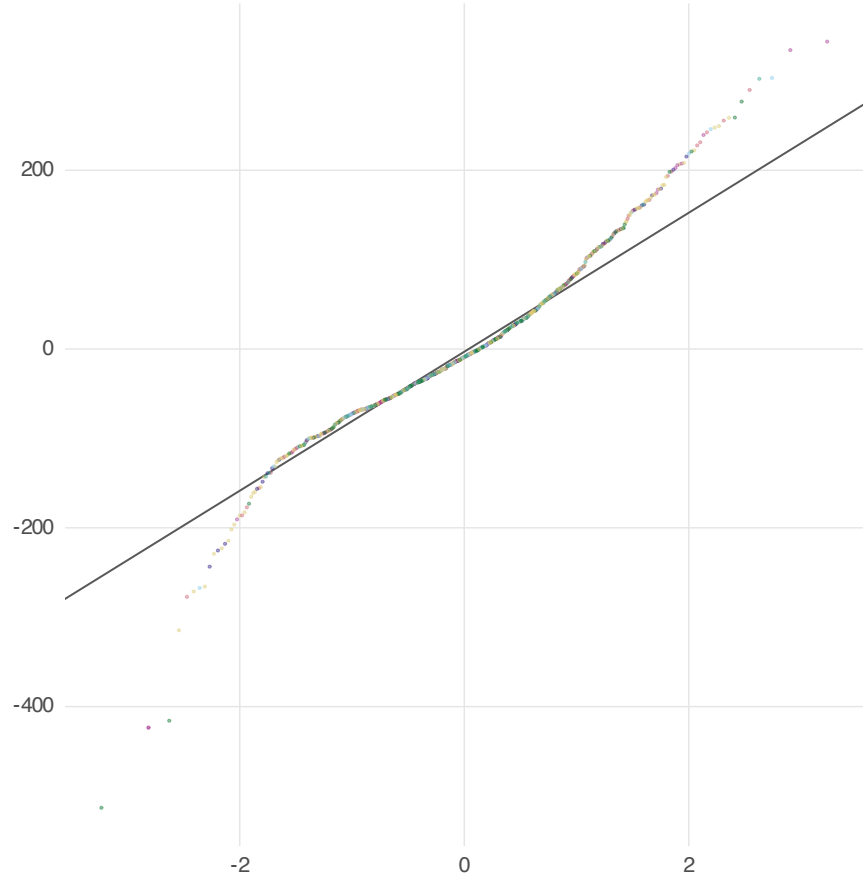

- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Tübingen (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)


Near eye (primary) - Measured biological sex, Female minus Male - Midpoint of the darkest 10 hours

Assessment: acceptable with limitations; residual screen: Q-Q review.

Near eye (primary) · Midpoint of the darkest 10 hours
Residuals vs fitted



Near eye (primary) · Midpoint of the darkest 10 hours
Normal Q-Q

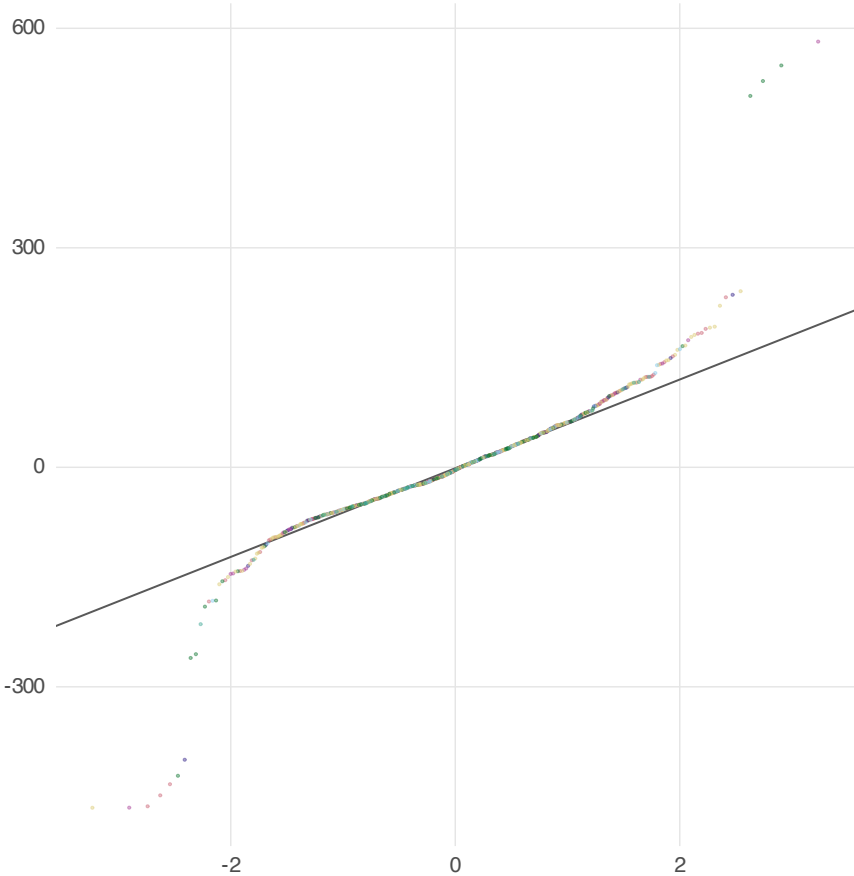

- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Tübingen (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)


Near eye (primary) - Measured biological sex, Female minus Male - Mean timing of exposure above 250 lx meEDI

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

Near eye (primary) · Mean timing of exposure above 250 lx meEDI
Residuals vs fitted



Near eye (primary) · Mean timing of exposure above 250 lx meEDI
Normal Q-Q

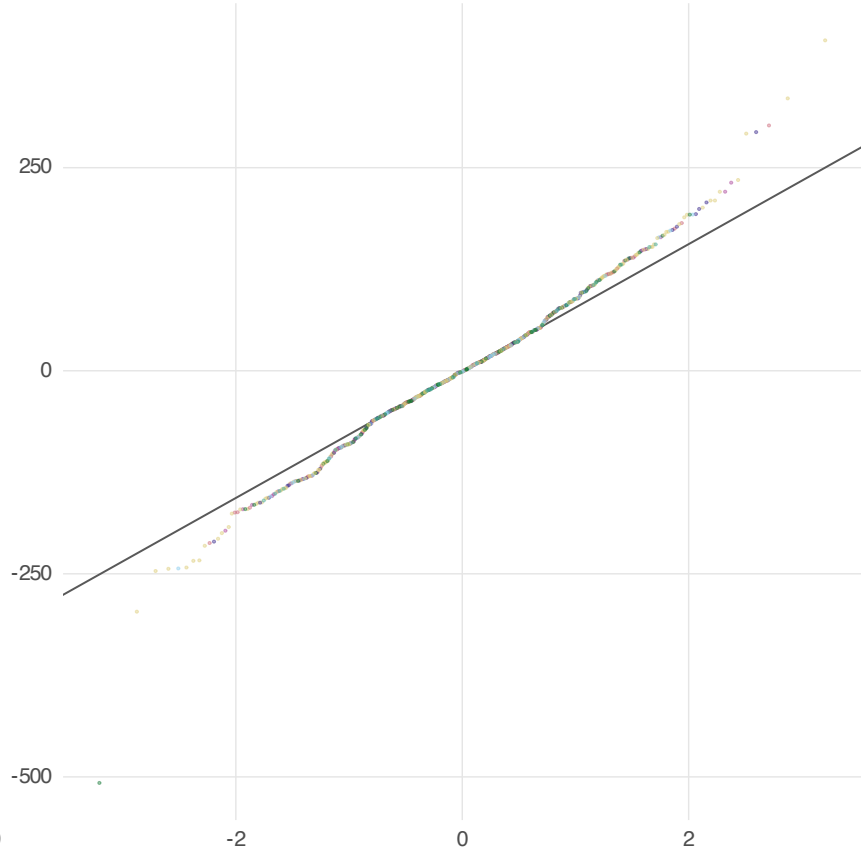

- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Tübingen (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)


Near eye (primary) - Measured biological sex, Female minus Male - First light timing above 250 lx meEDI

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

Near eye (primary) · First light timing above 250 lx
meEDI
Residuals vs fitted



Near eye (primary) · First light timing above 250 lx
meEDI
Normal Q-Q

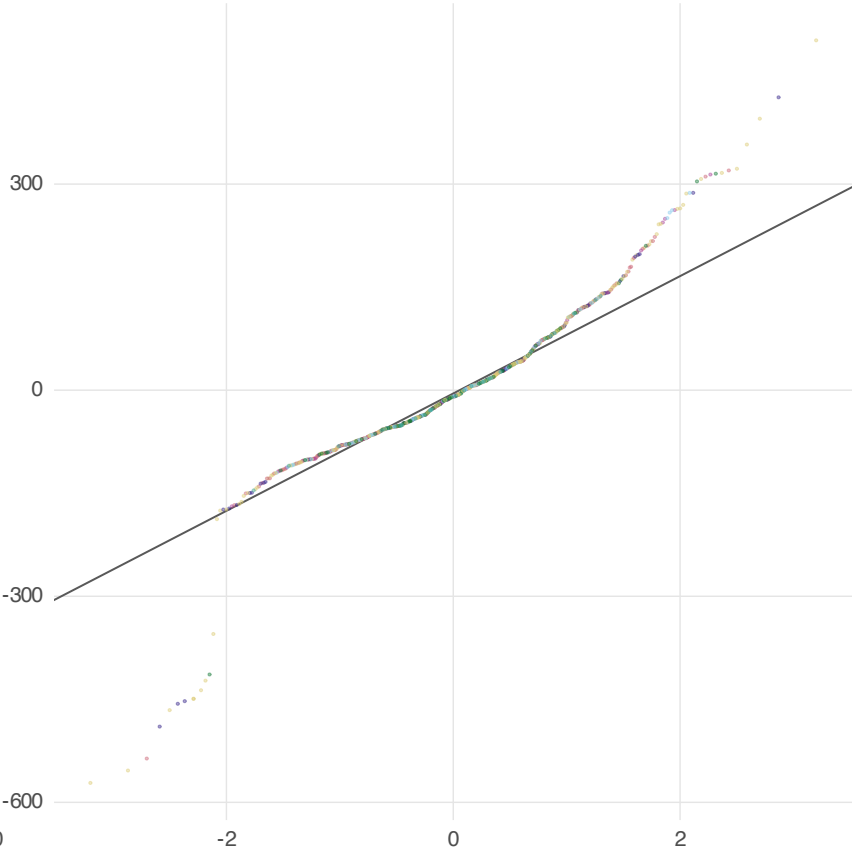

- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Tübingen (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)


Near eye (primary) - Measured biological sex, Female minus Male - Last light timing above 250 lx meEDI

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

Near eye (primary) · Last light timing above 250 lx
meEDI
Residuals vs fitted




Near eye (primary) · Last light timing above 250 lx
meEDI
Normal Q-Q

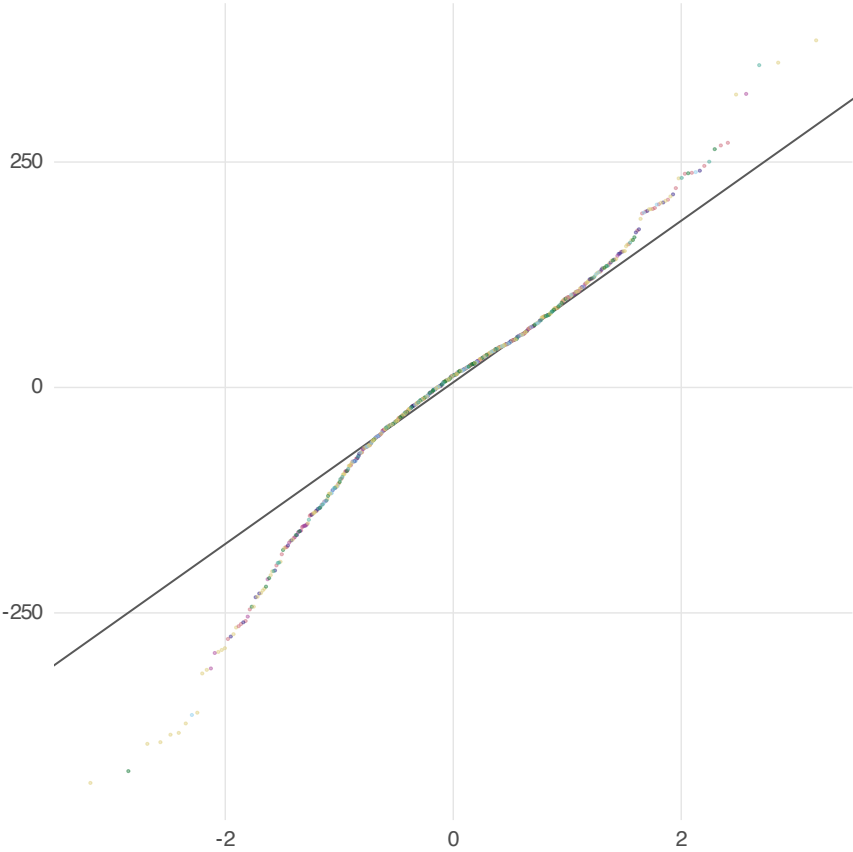

- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Tübingen (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)


Near eye (primary) - Measured biological sex, Female minus Male - meEDI dose

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

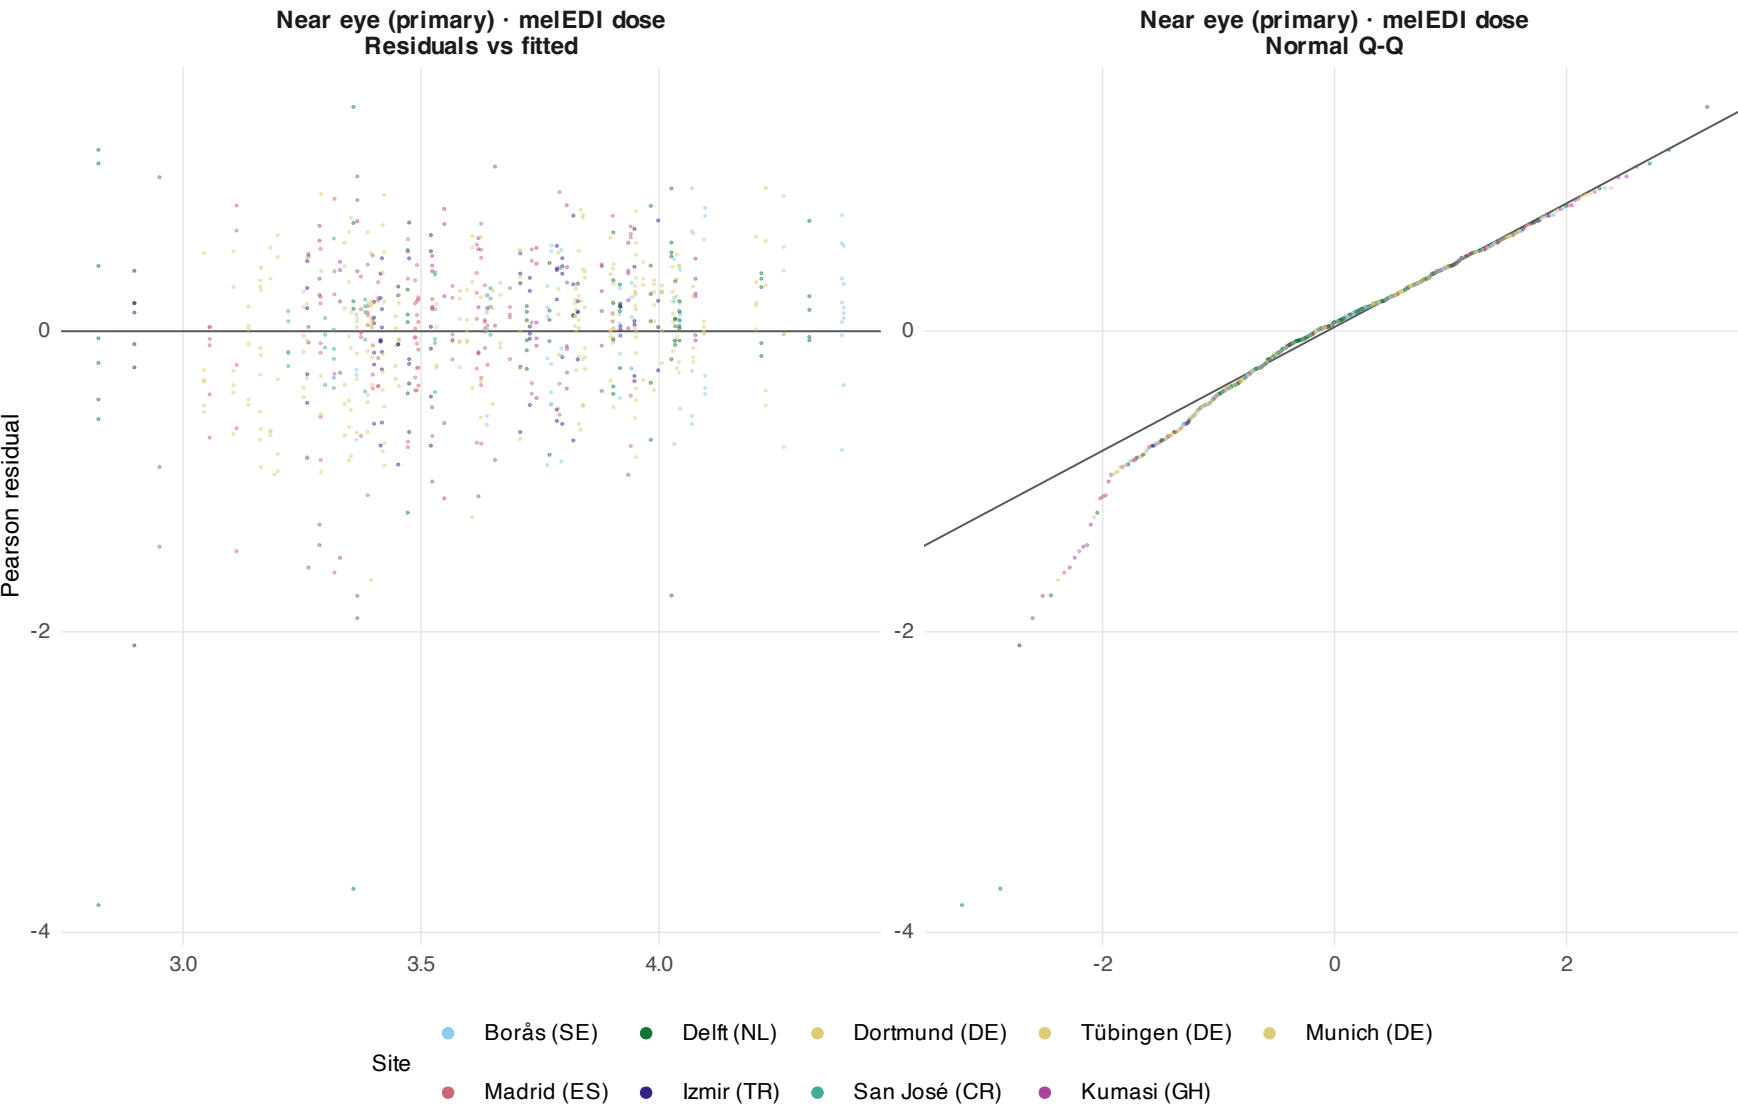

Near eye (primary) - Measured biological sex, Female minus Male - Melanopic daylight efficacy ratio

Assessment: acceptable with limitations; residual screen: Q-Q review.

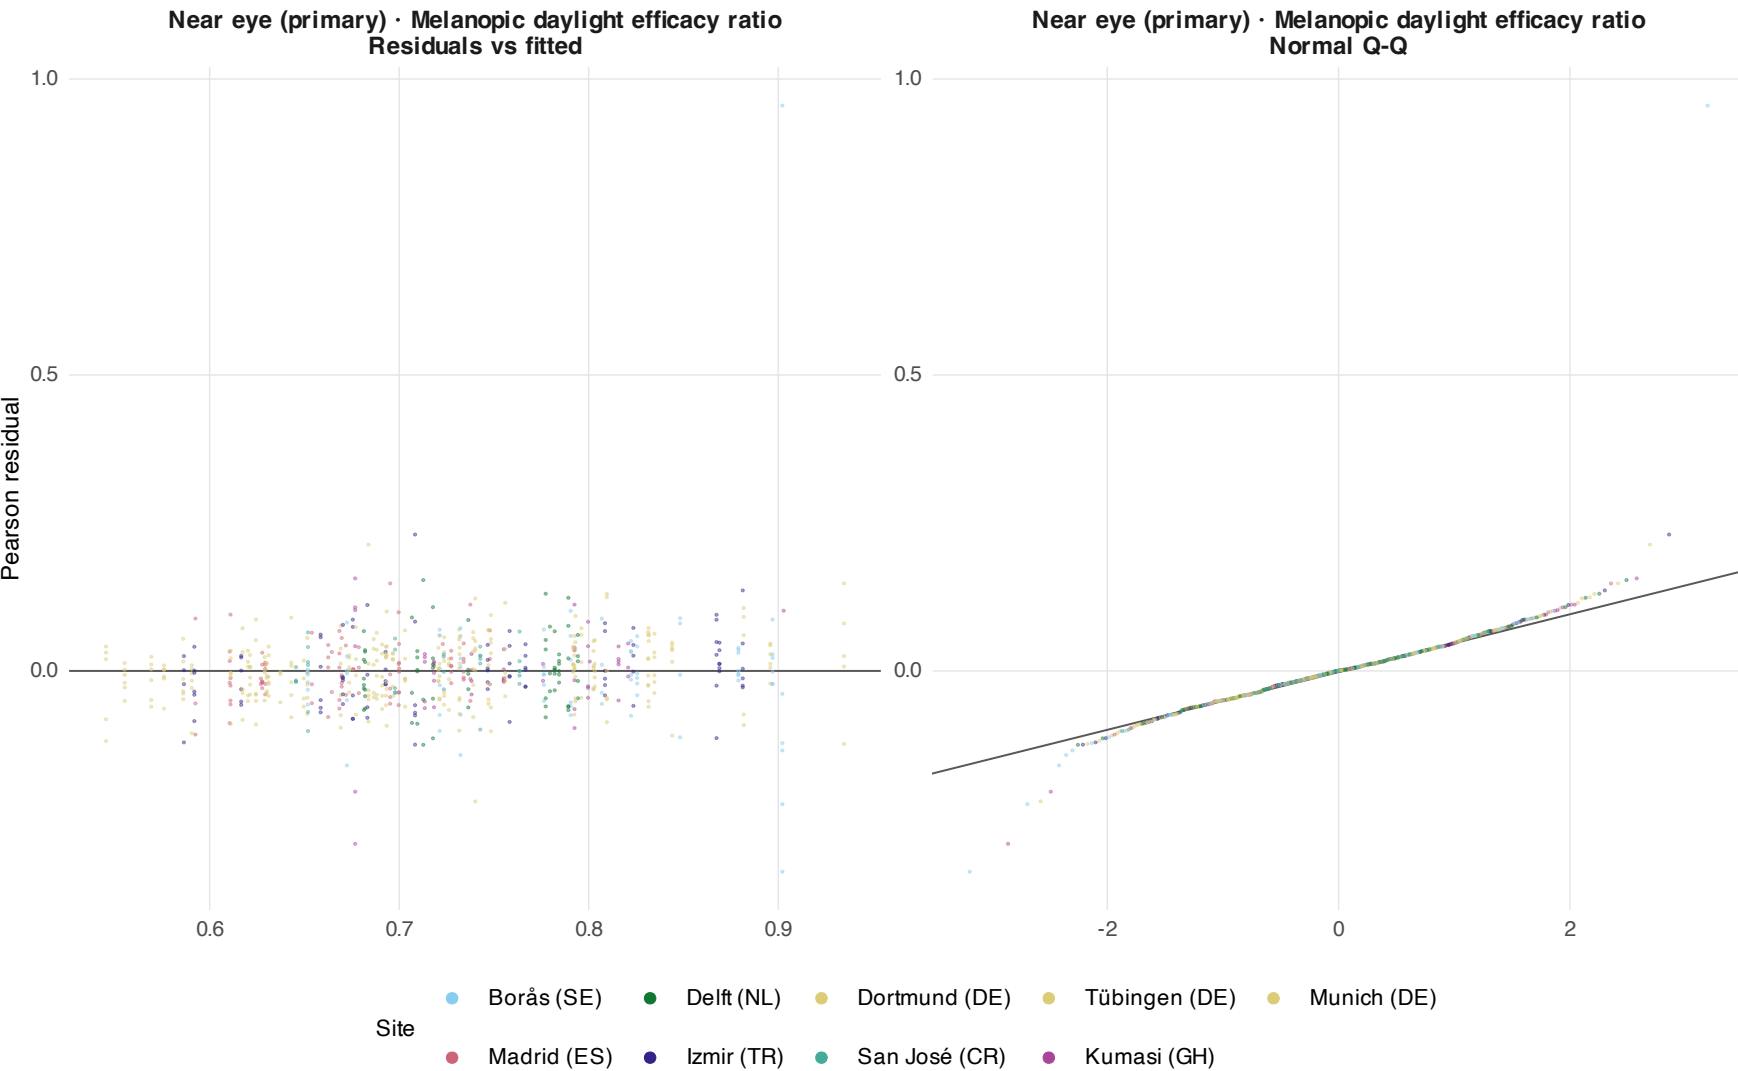


Chest (complementary) - Age, per 10 years
- Interdaily stability

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

Chest (complementary) · Interdaily stability
Residuals vs fitted



Chest (complementary) · Interdaily stability
Normal Q-Q

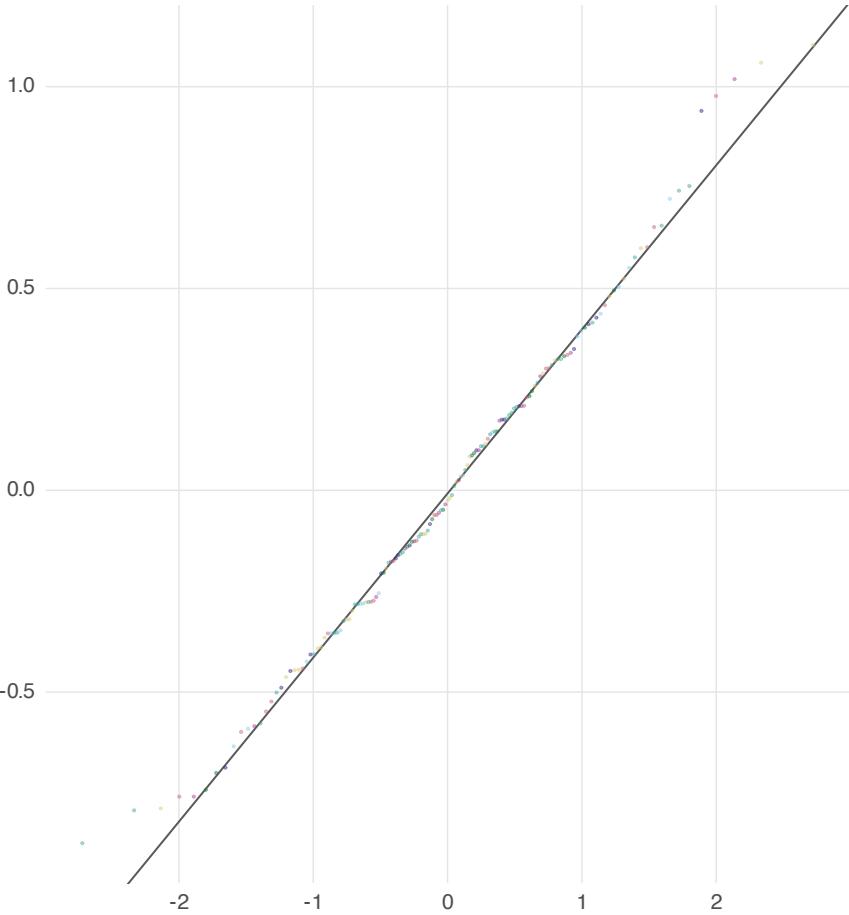


- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)


Chest (complementary) - Age, per 10 years
- Intradaily variability

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

Chest (complementary) · Intradaily variability
Residuals vs fitted

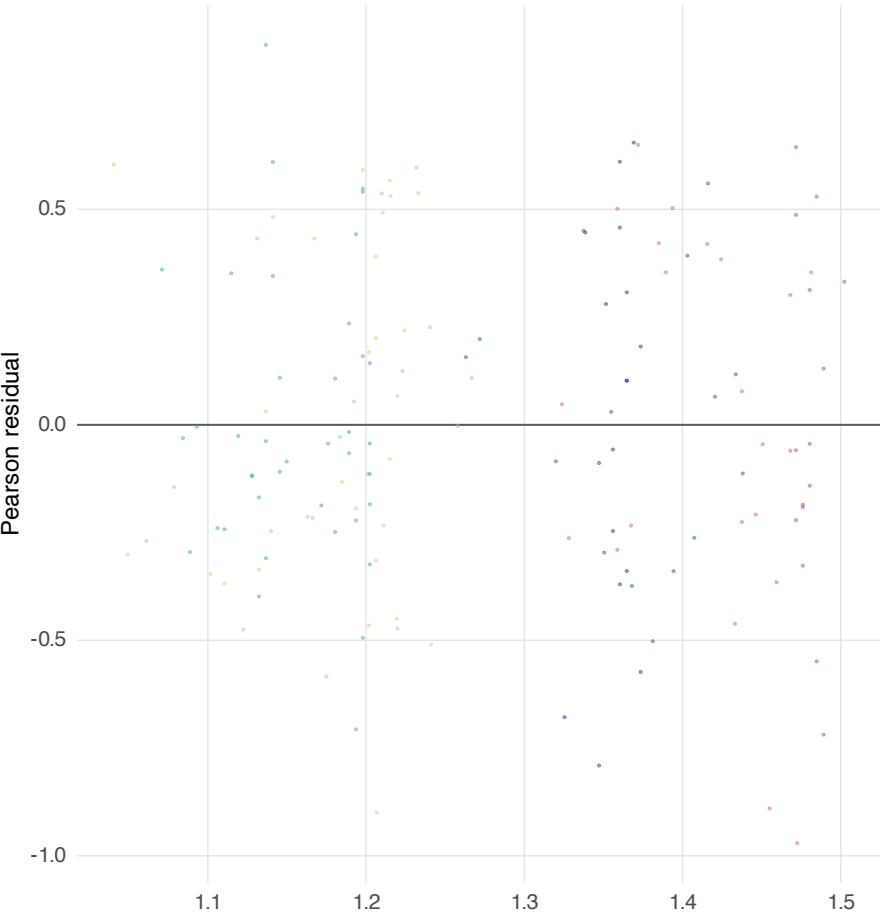


Chest (complementary) · Intradaily variability
Normal Q-Q

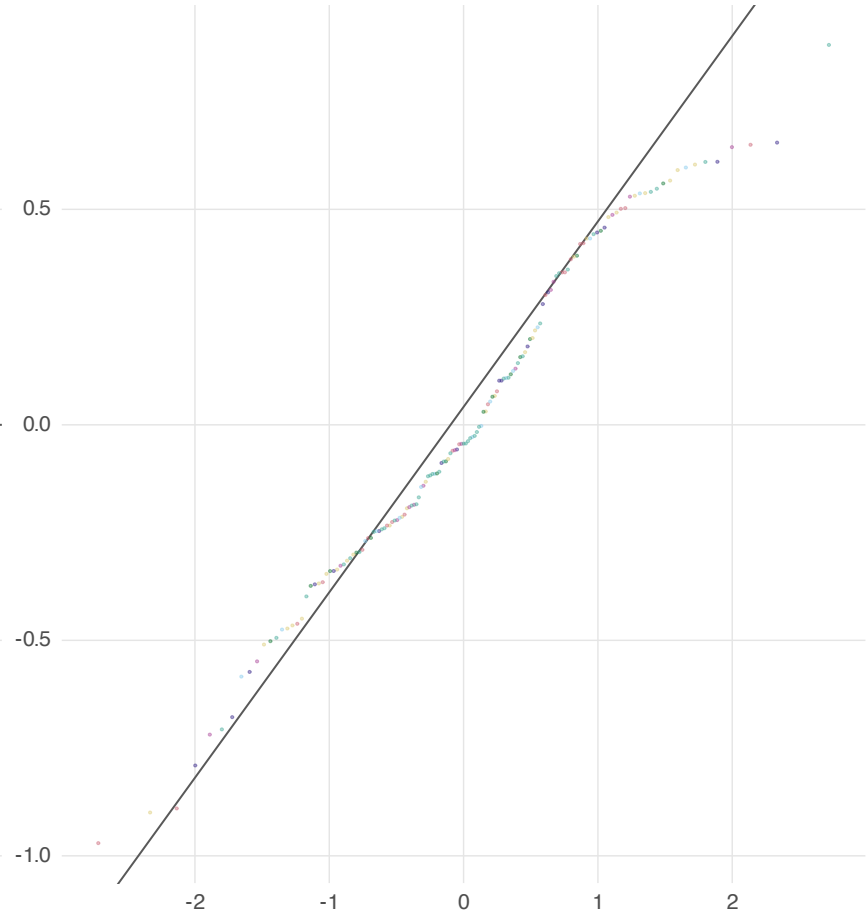

- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)

Chest (complementary) - Age, per 10 years
- Mean meIEDI

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

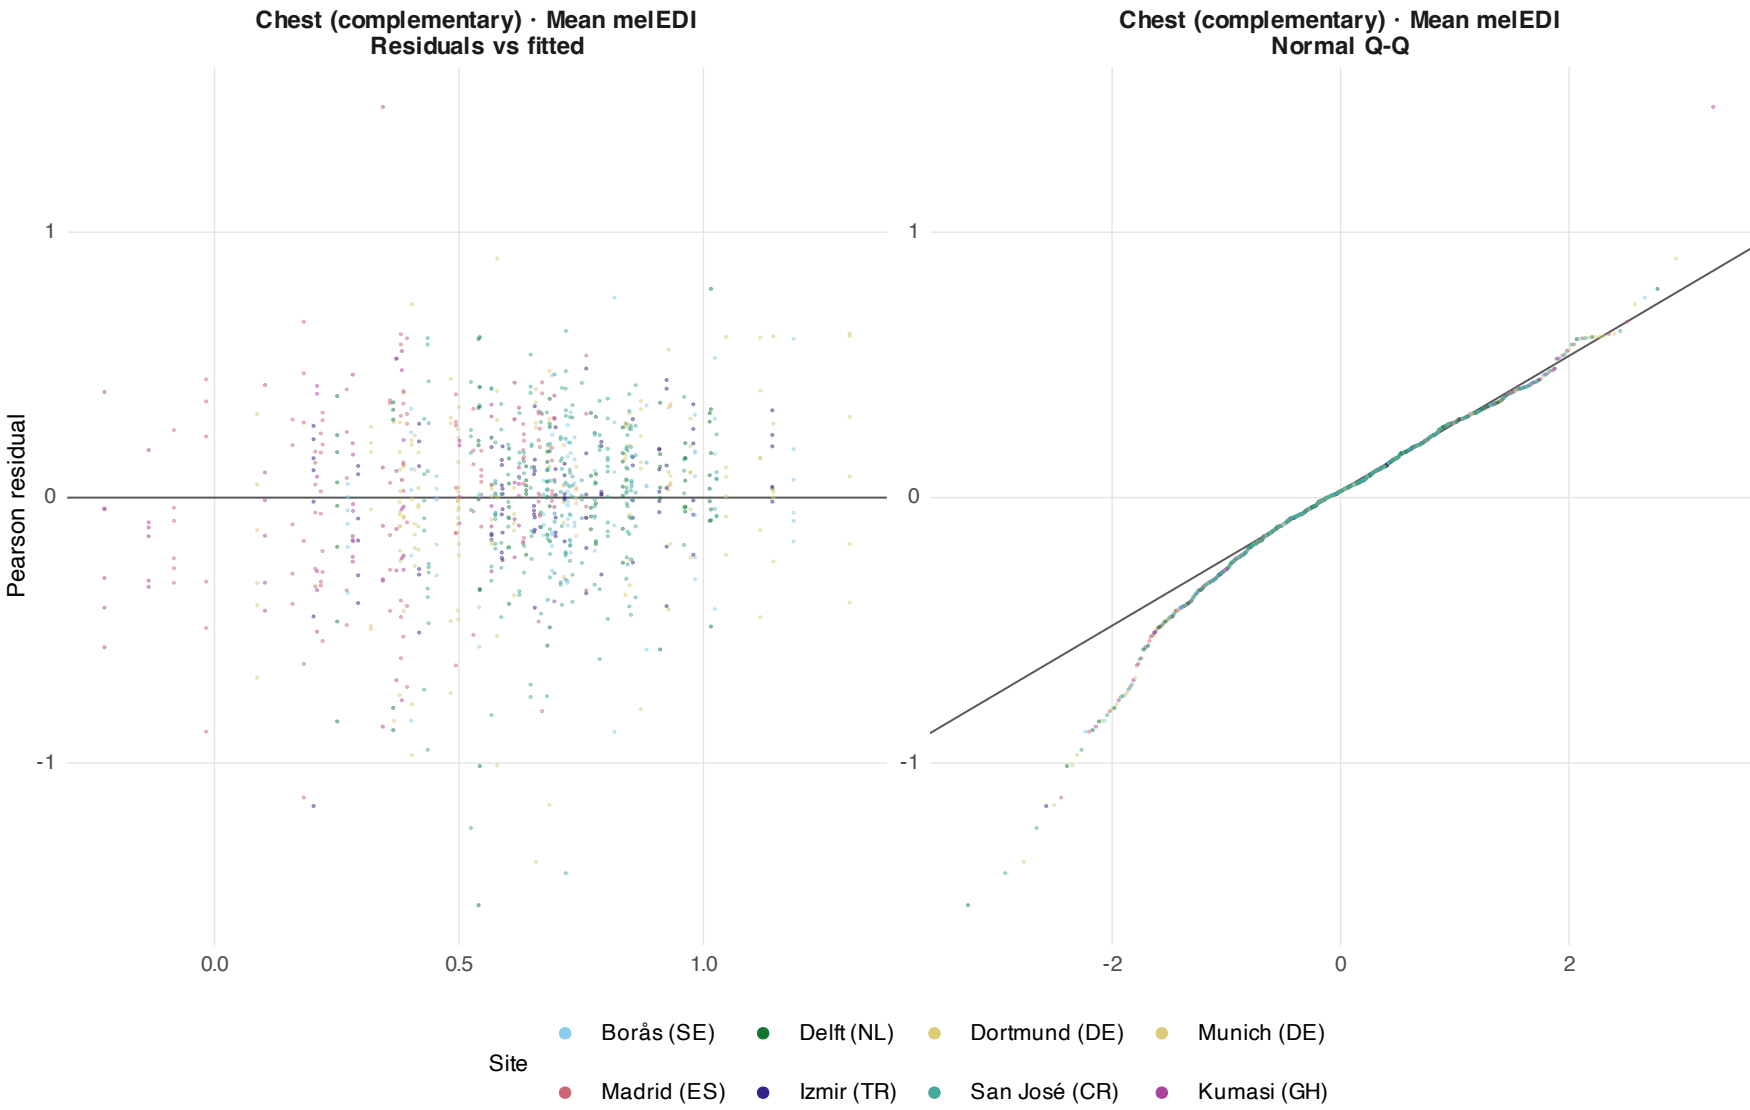


Chest (complementary) - Age, per 10 years
- Brightest 10 h mean

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

Chest (complementary) · Brightest 10 h mean
Residuals vs fitted



Chest (complementary) · Brightest 10 h mean
Normal Q-Q

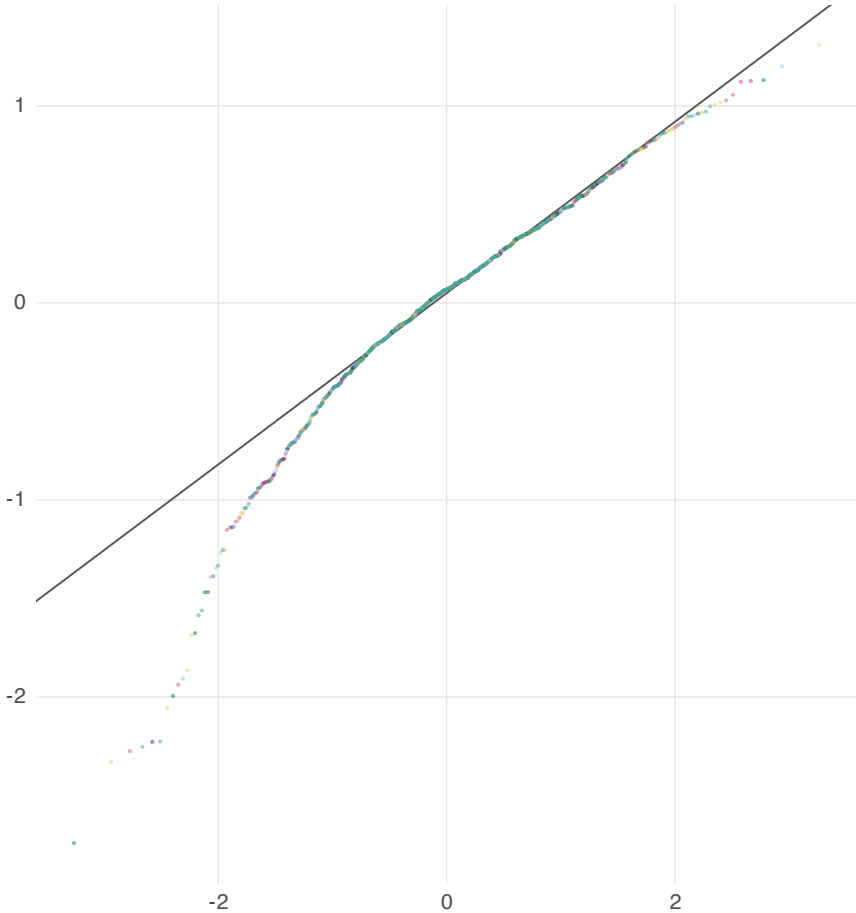

- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)


Chest (complementary) - Age, per 10 years
- Darkest 10 h mean

Assessment: acceptable with limitations; residual screen: RESIDUAL SPREAD REVIEW.

Chest (complementary) · Darkest 10 h mean
Residuals vs fitted



Chest (complementary) · Darkest 10 h mean
Normal Q-Q

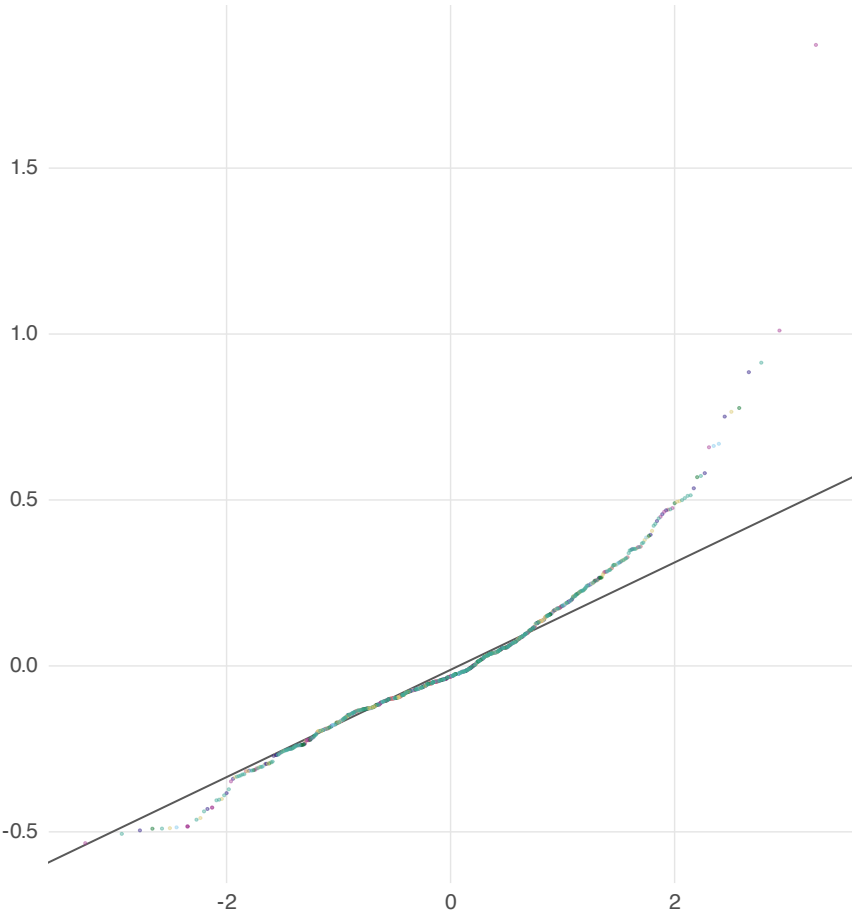


- Site
- | | | | |
|---------------|--------------|-----------------|---------------|
| ● Borås (SE) | ● Delft (NL) | ● Dortmund (DE) | ● Munich (DE) |
| ● Madrid (ES) | ● Izmir (TR) | ● San José (CR) | ● Kumasi (GH) |


Chest (complementary) - Age, per 10 years
- Time above 1,000 lx meEDI

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

Chest (complementary) · Time above 1,000 lx meEDI
Residuals vs fitted

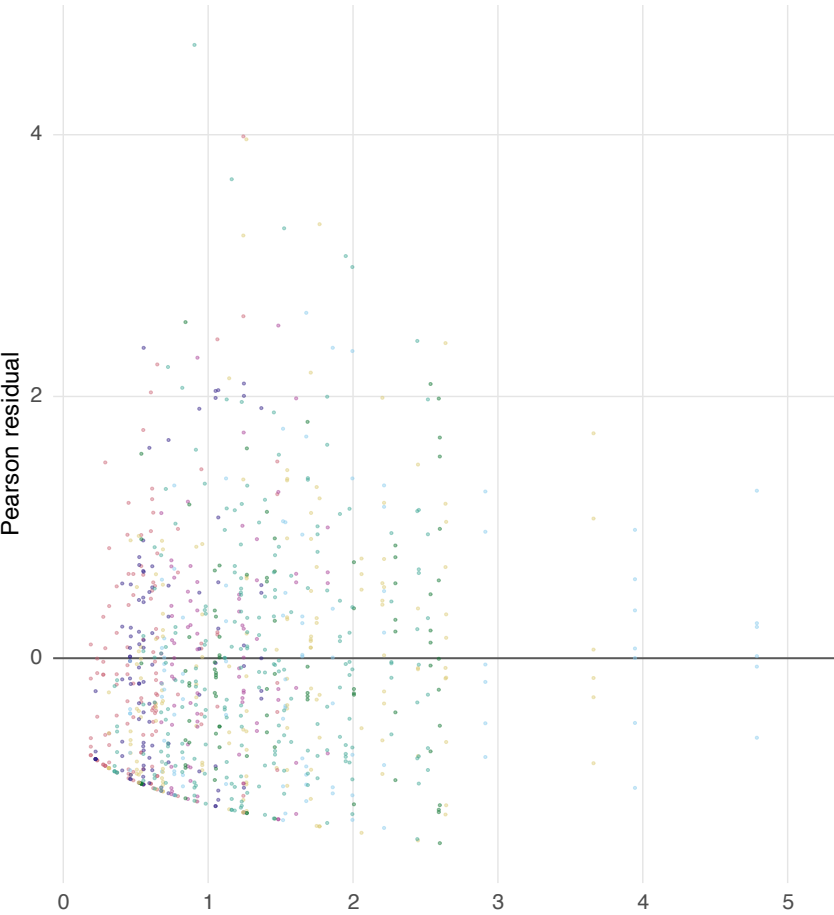


Chest (complementary) · Time above 1,000 lx meEDI
Normal Q-Q

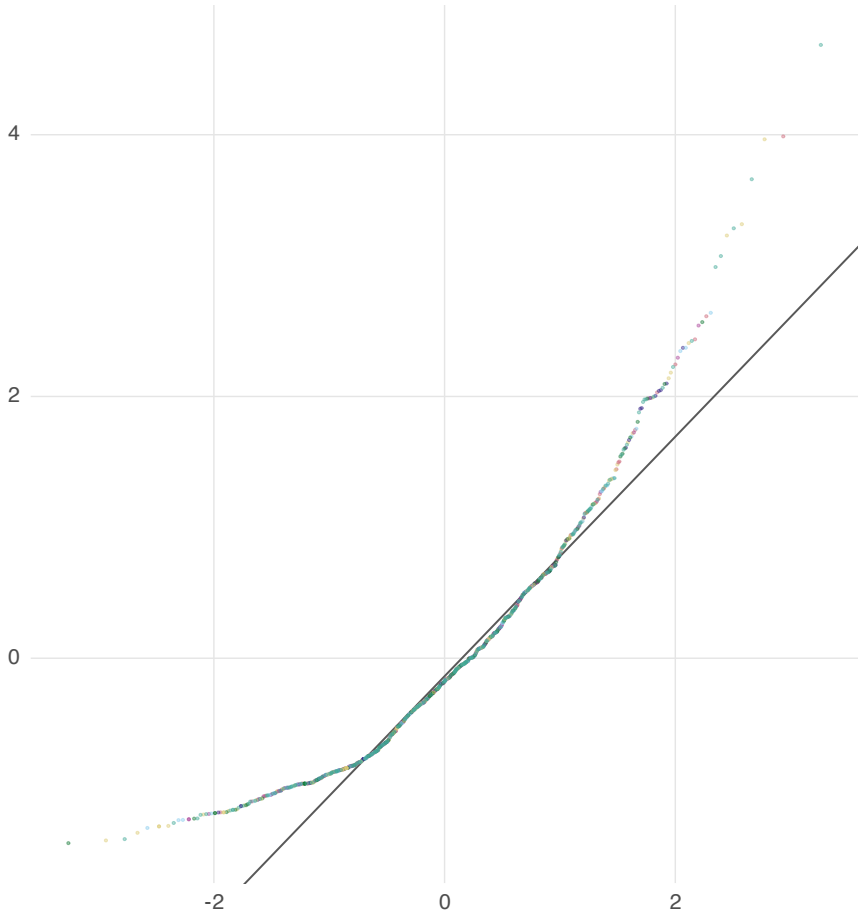

- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)


Chest (complementary) - Age, per 10 years
- Time above 250 lx melEDI during wake

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

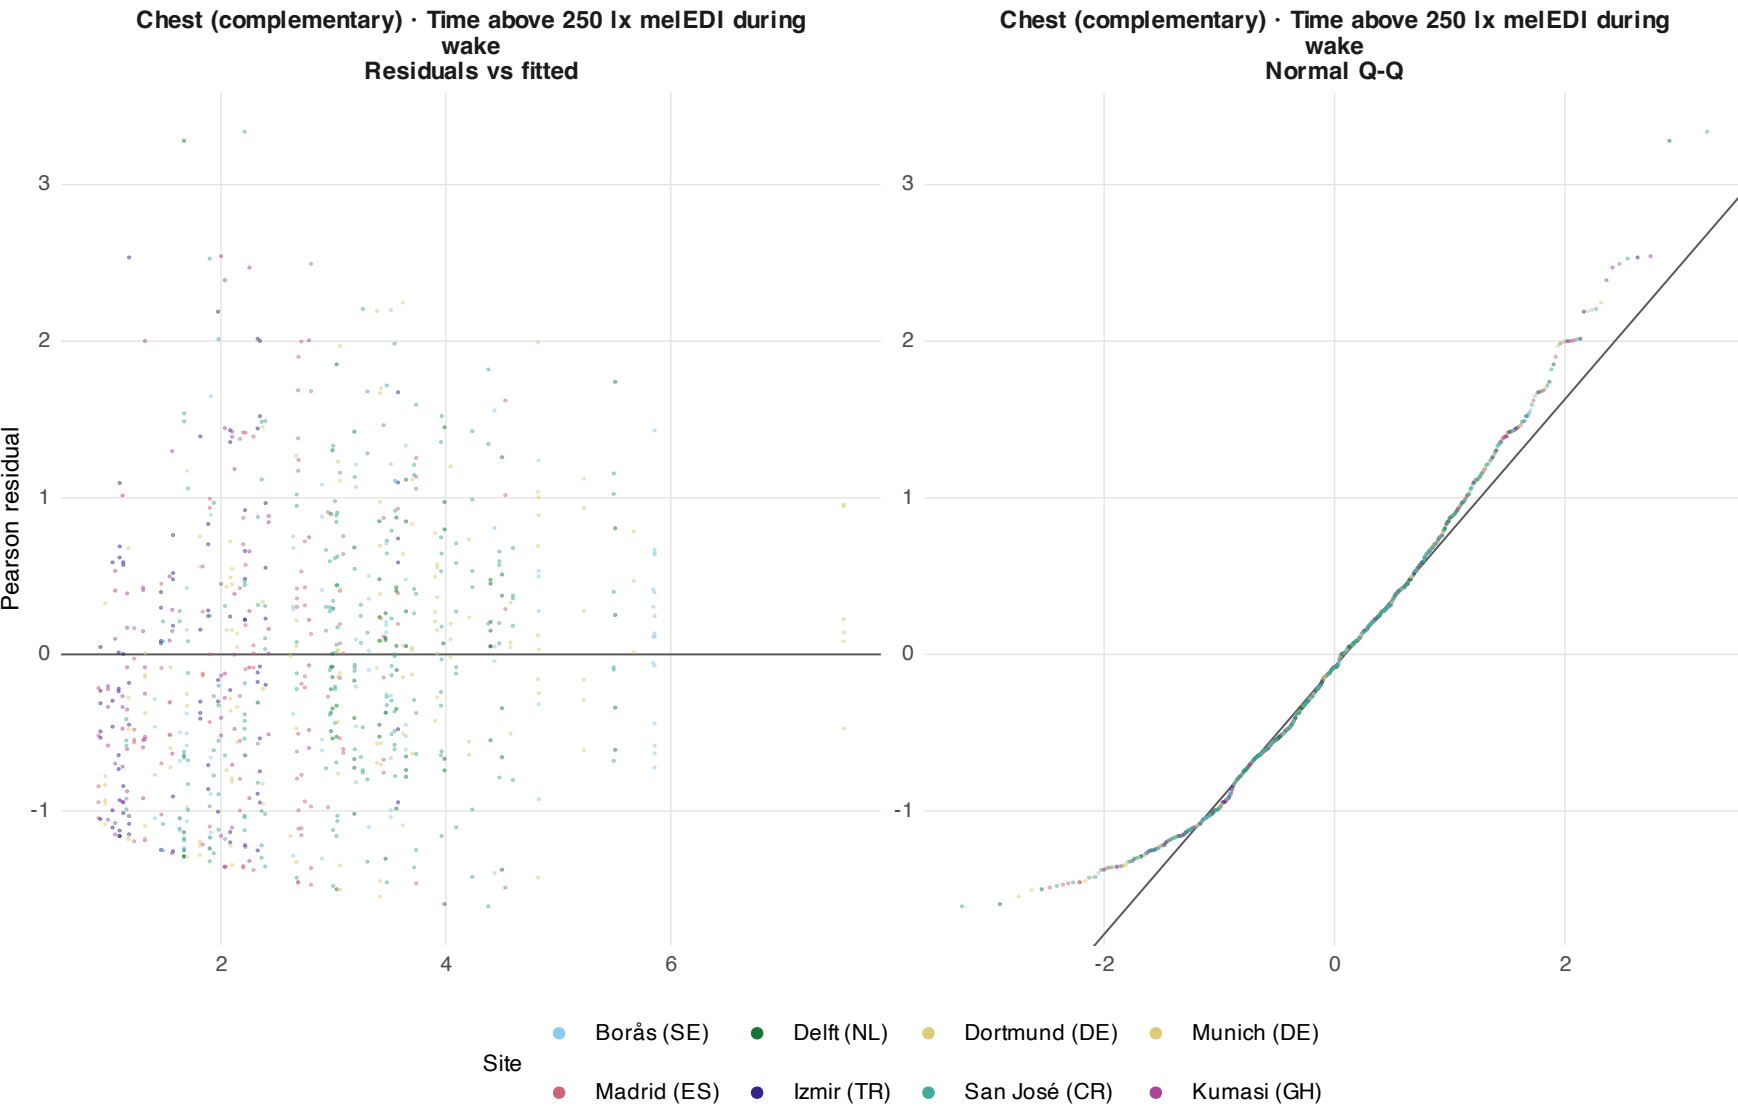


Chest (complementary) - Age, per 10 years
- Time below 10 lx melEDI before sleep

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

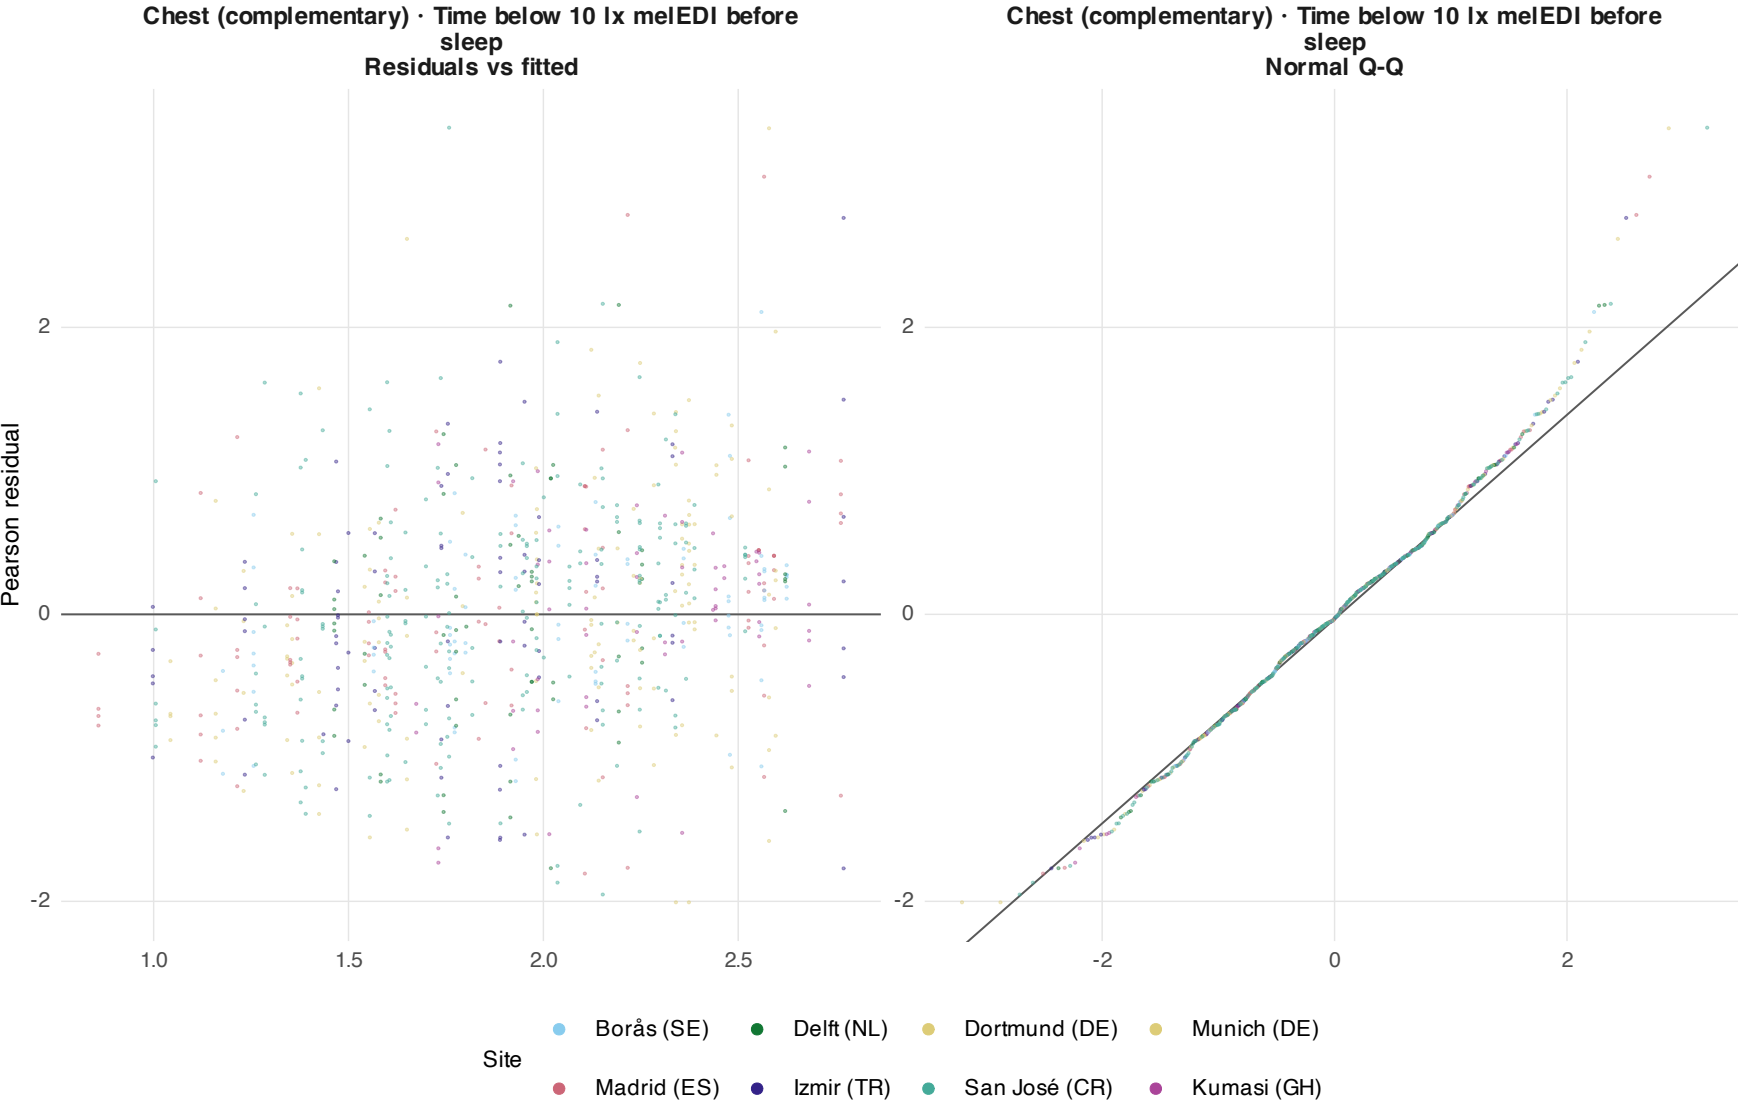


Chest (complementary) - Age, per 10 years
- Time below 1 lx melEDI during sleep

Assessment: acceptable with limitations; residual screen: ZERO MASS REVIEW.

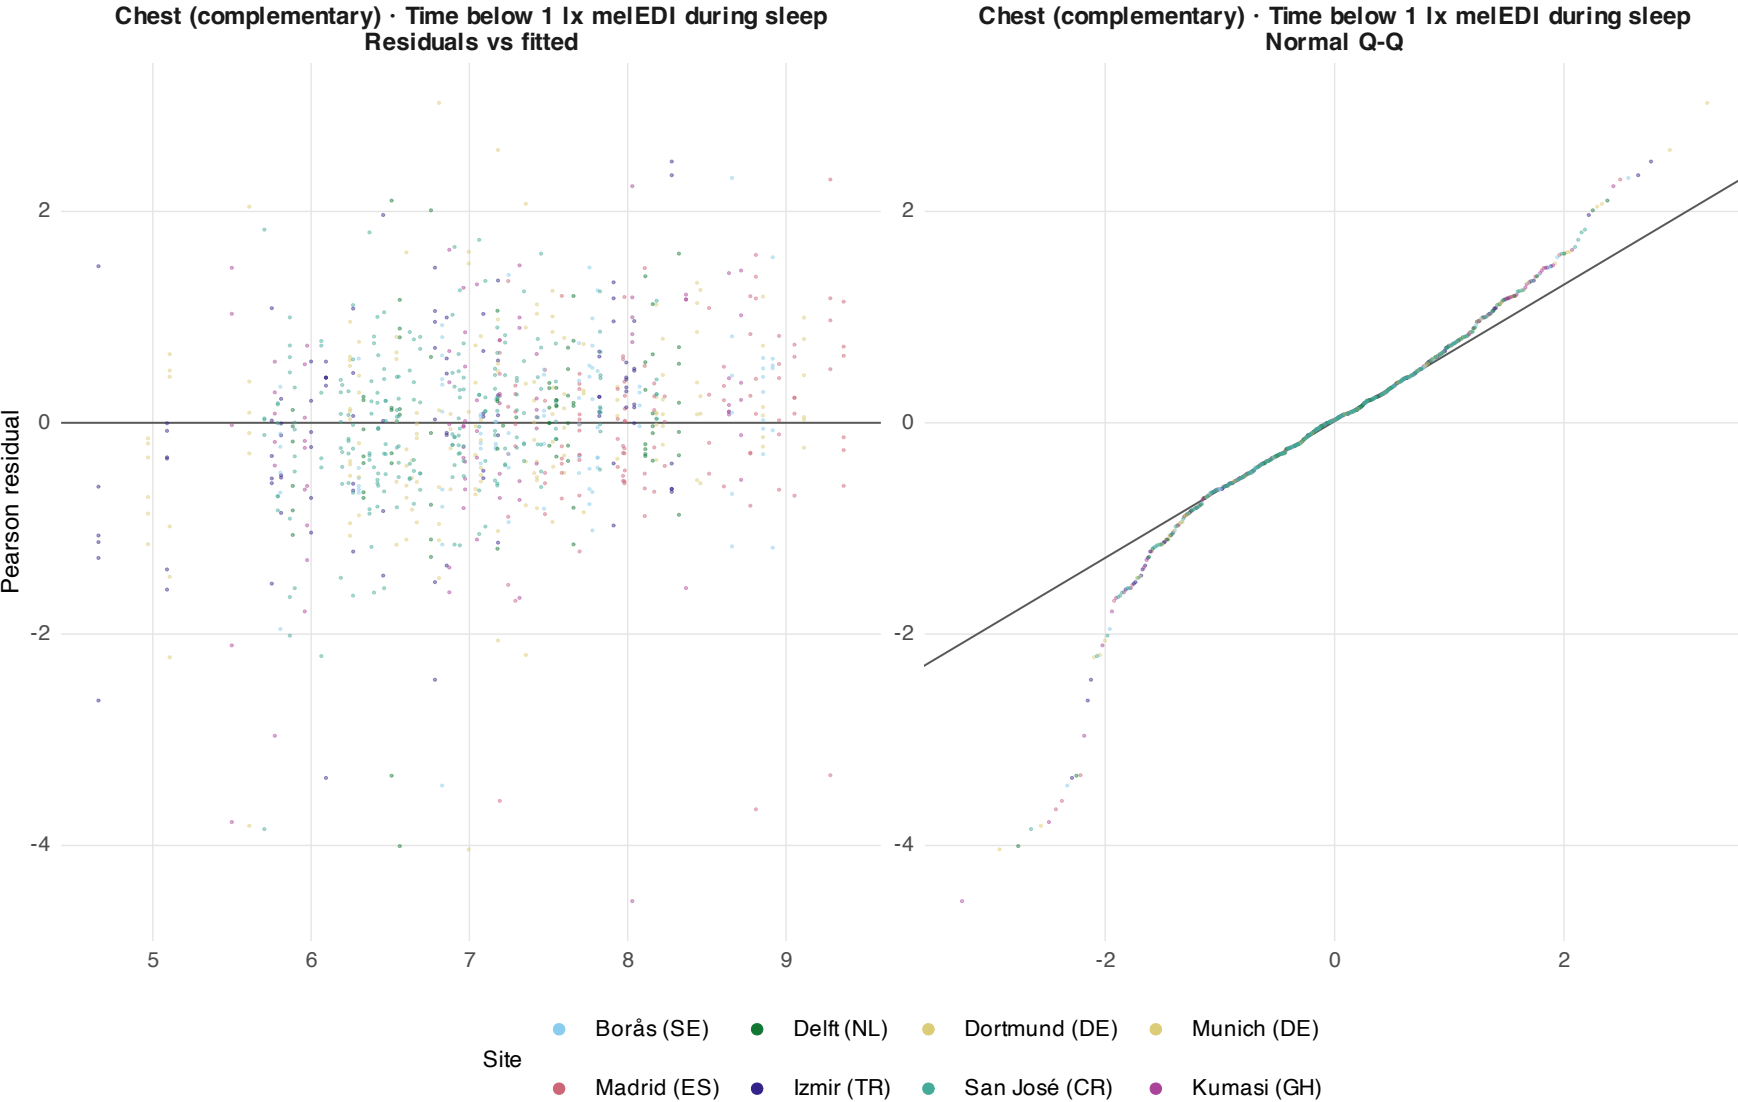


Chest (complementary) - Age, per 10 years
- Longest continuous period above 250
meEDI

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

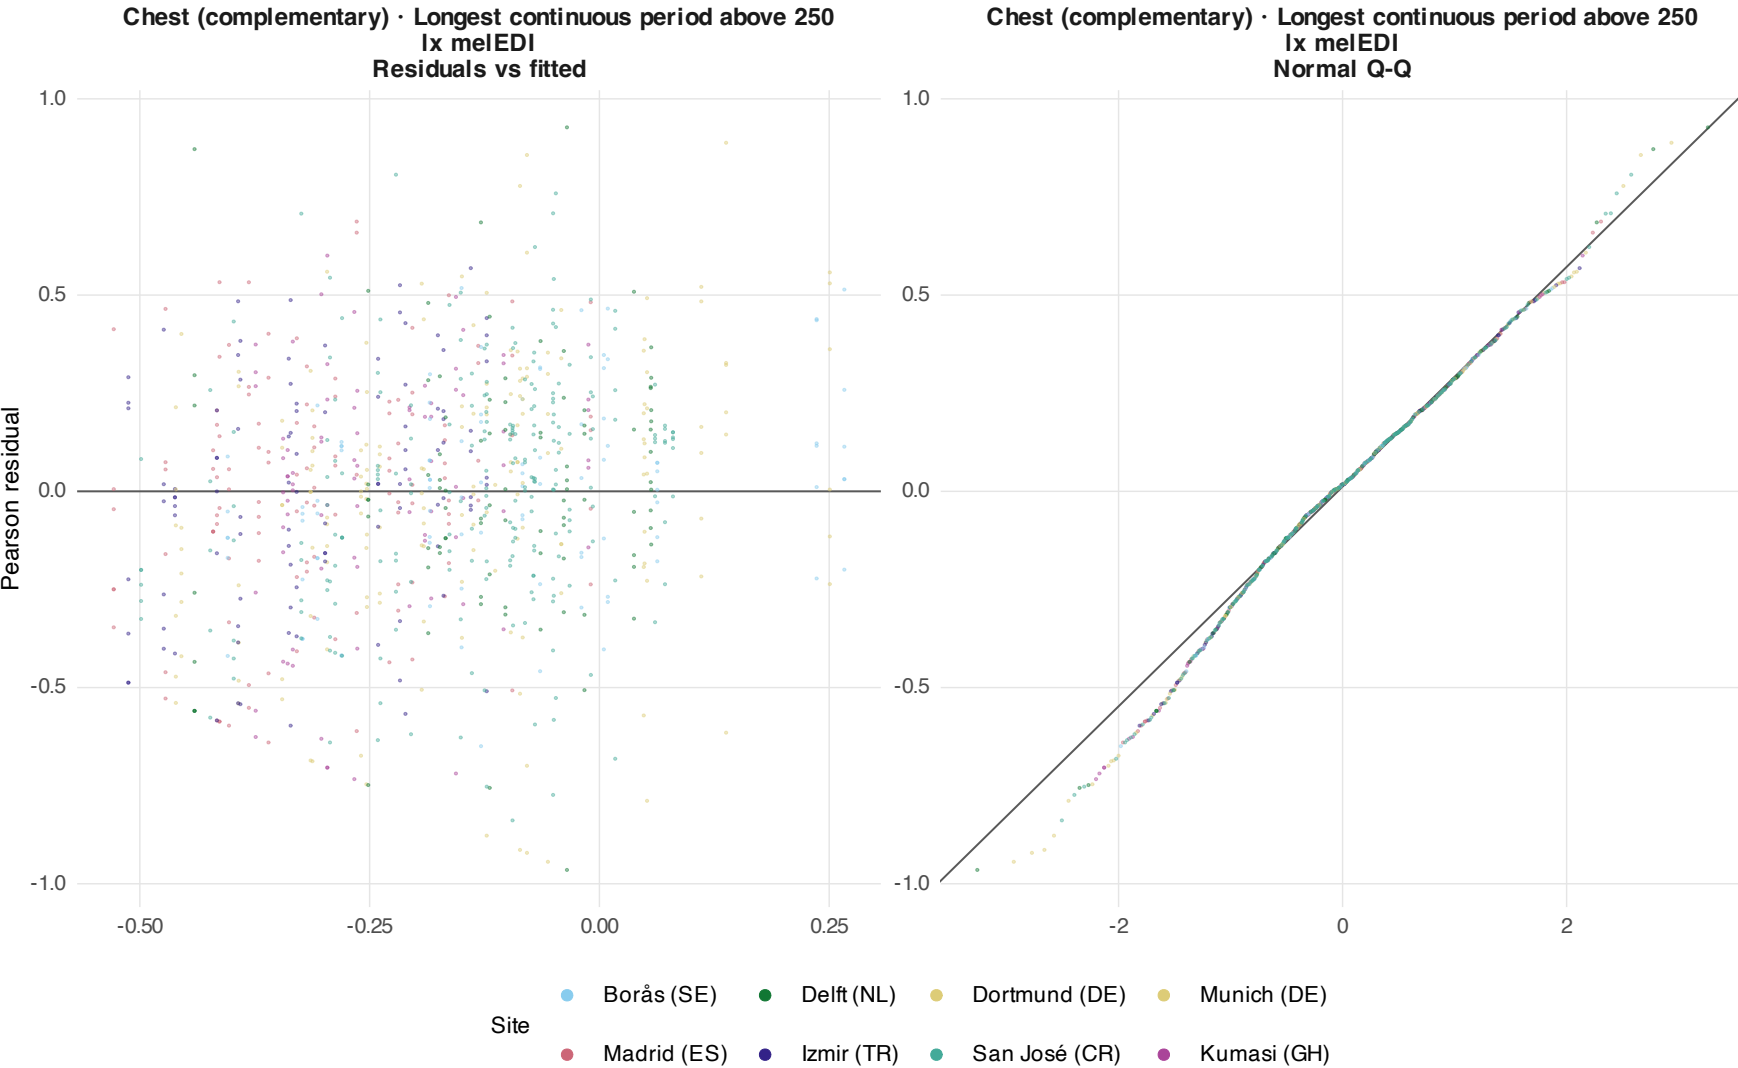


Chest (complementary) - Age, per 10 years
- Midpoint of the brightest 10 hours

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

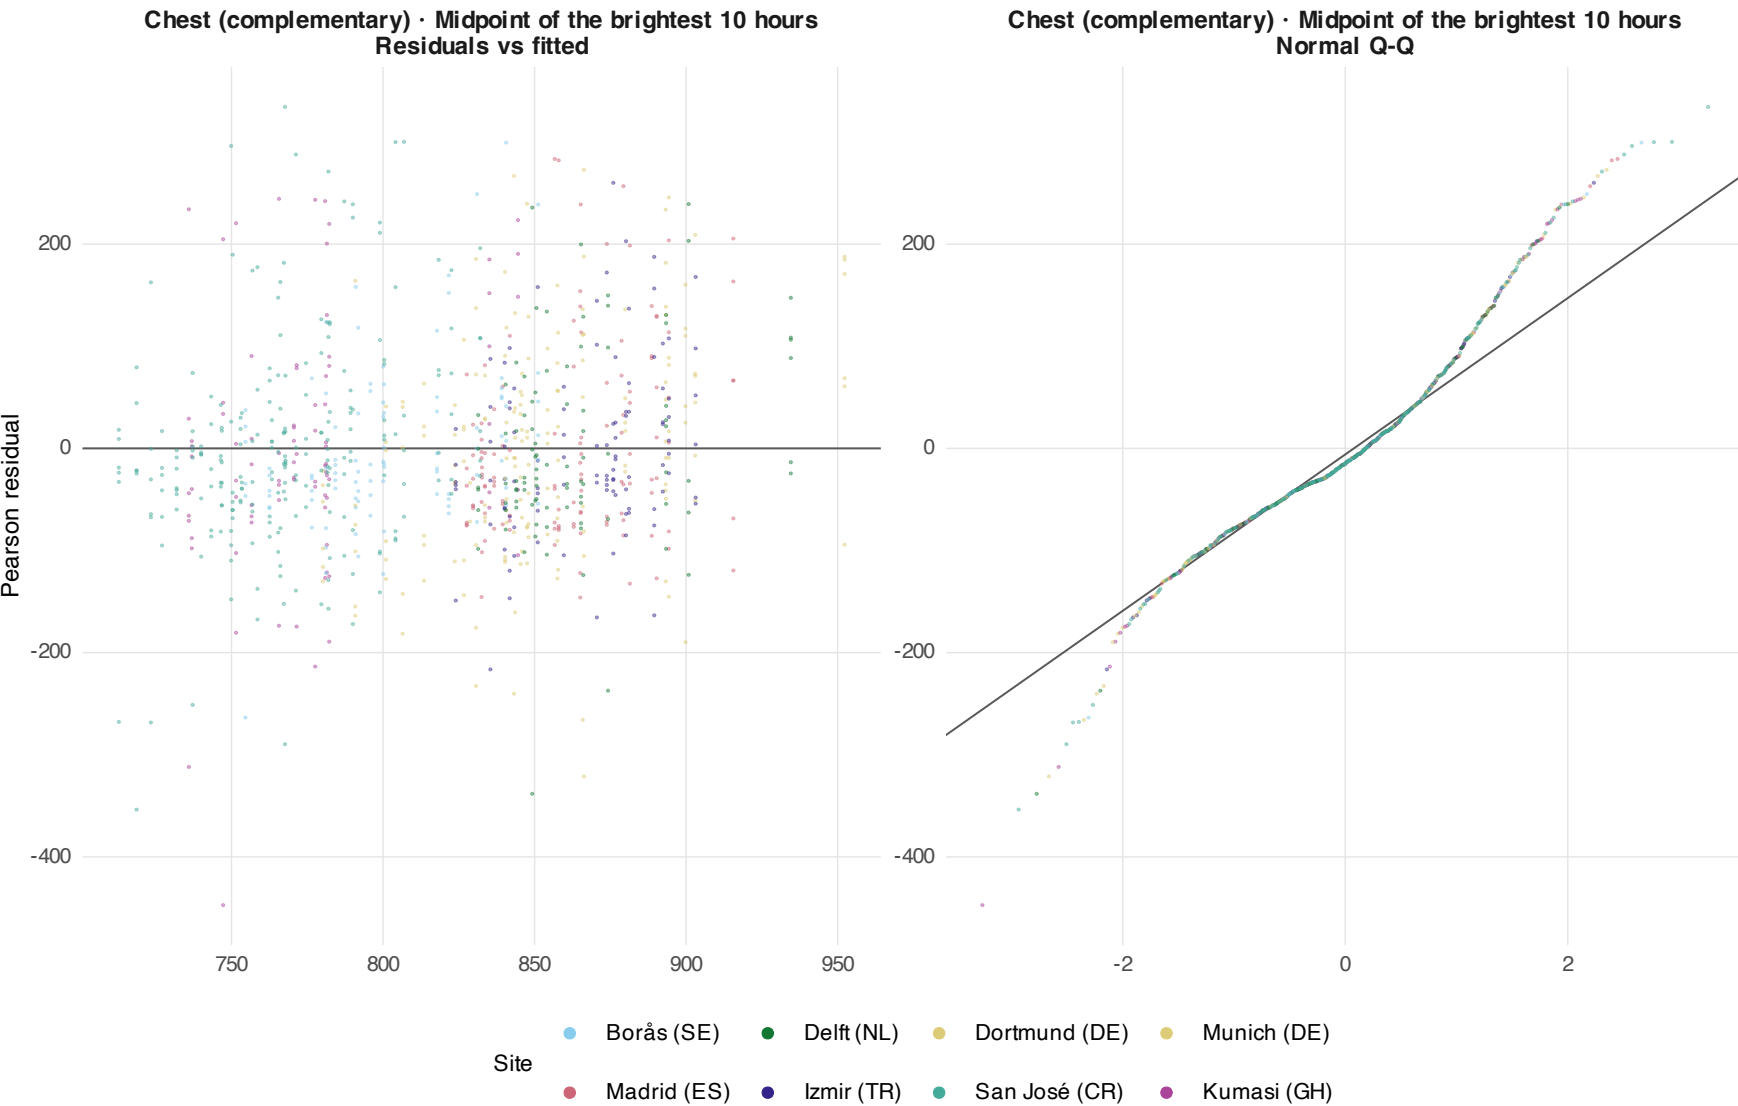


Chest (complementary) - Age, per 10 years
- Midpoint of the darkest 10 hours

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

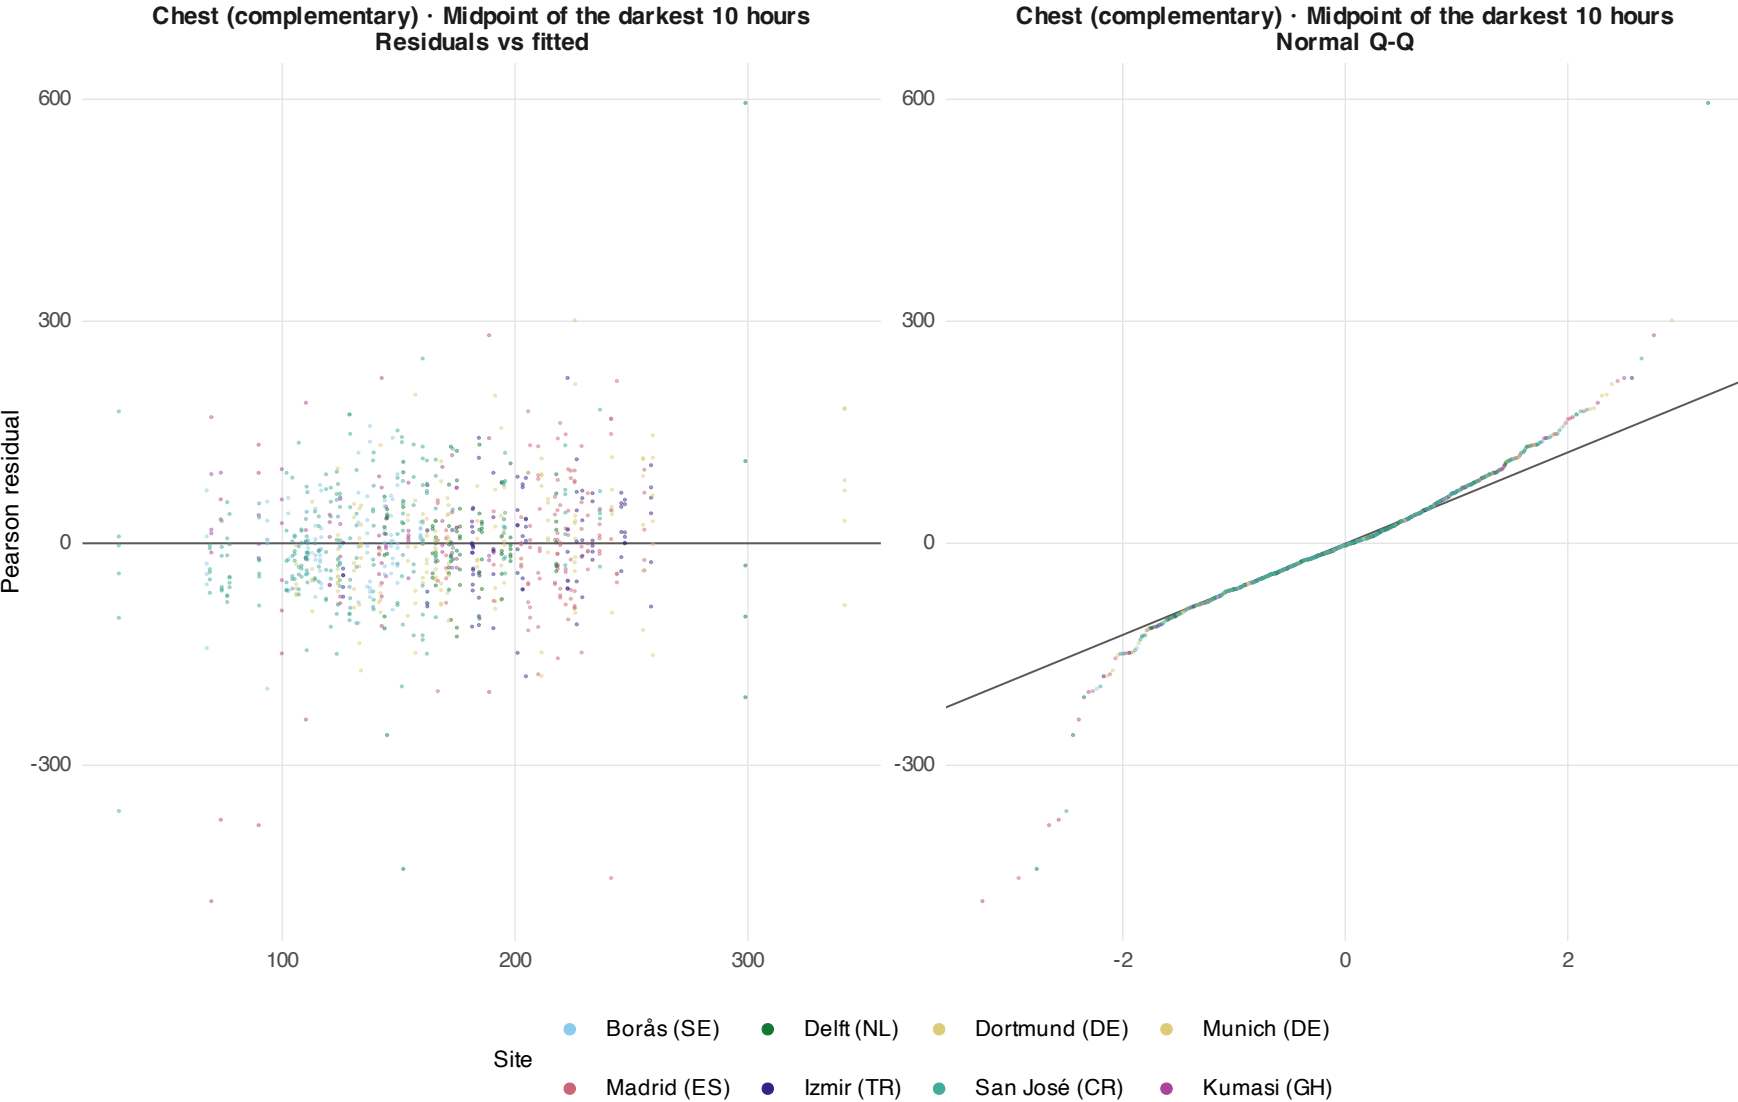

Chest (complementary) - Age, per 10 years
- Mean timing of exposure above 250 lx
meIEDI


Assessment: acceptable; residual screen: no residual/distribution threshold flag.

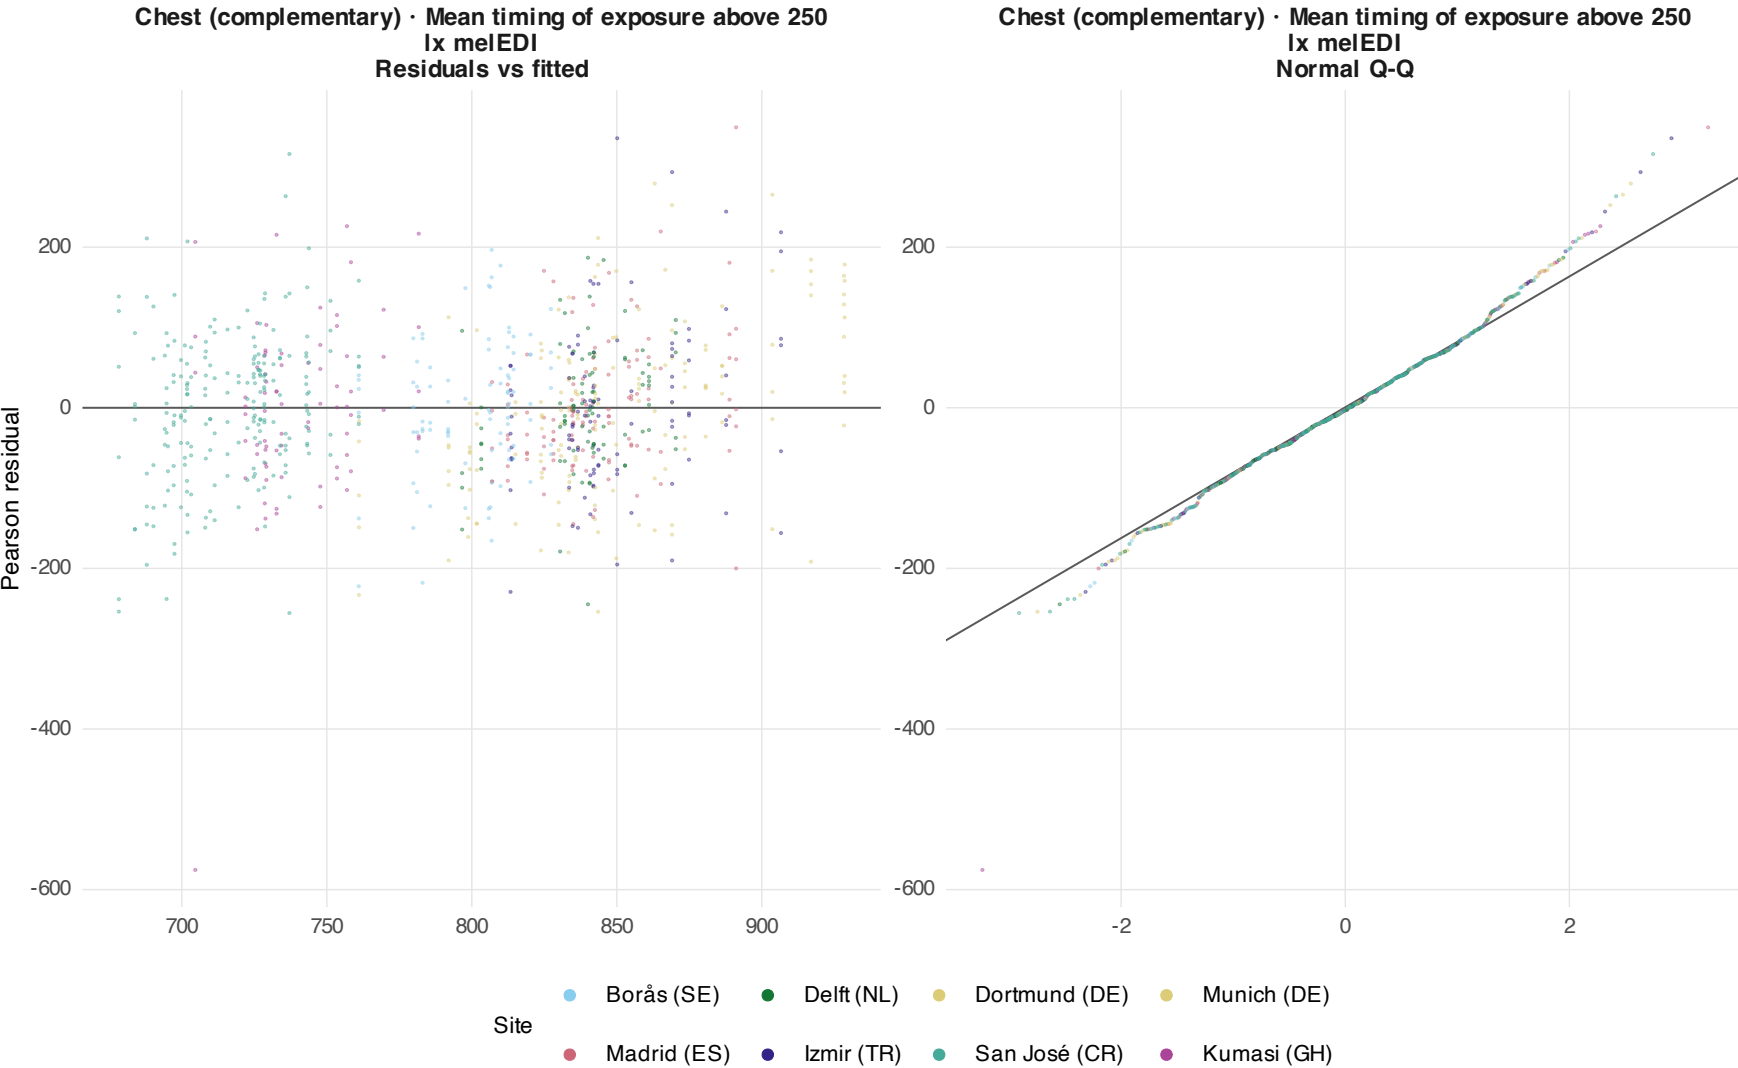


Chest (complementary) - Age, per 10 years
- First light timing above 250 lx meIEDI

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

**Chest (complementary) · First light timing above 250 lx
meIEDI**
Residuals vs fitted

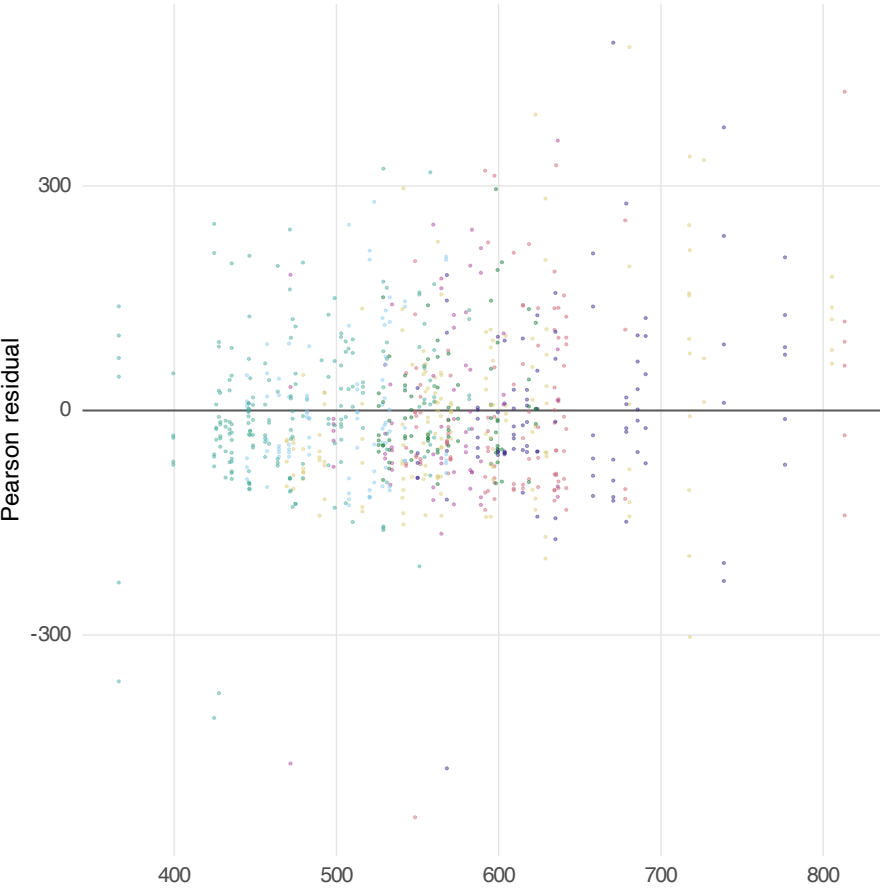

**Chest (complementary) · First light timing above 250 lx
meIEDI**
Normal Q-Q

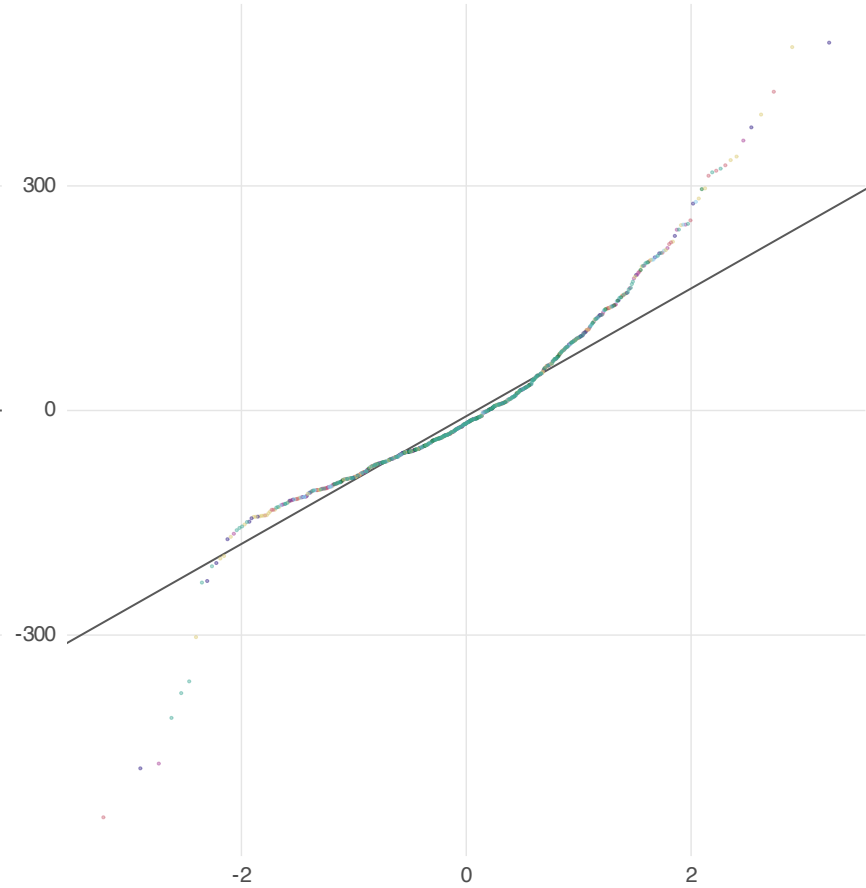

- Site
- | | | | |
|--|---|--|--|
| ● Borås (SE) | ● Delft (NL) | ● Dortmund (DE) | ● Munich (DE) |
| ● Madrid (ES) | ● Izmir (TR) | ● San José (CR) | ● Kumasi (GH) |


Chest (complementary) - Age, per 10 years
- Last light timing above 250 lx melEDI

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

**Chest (complementary) · Last light timing above 250 lx
melEDI**
Residuals vs fitted




**Chest (complementary) · Last light timing above 250 lx
melEDI**
Normal Q-Q

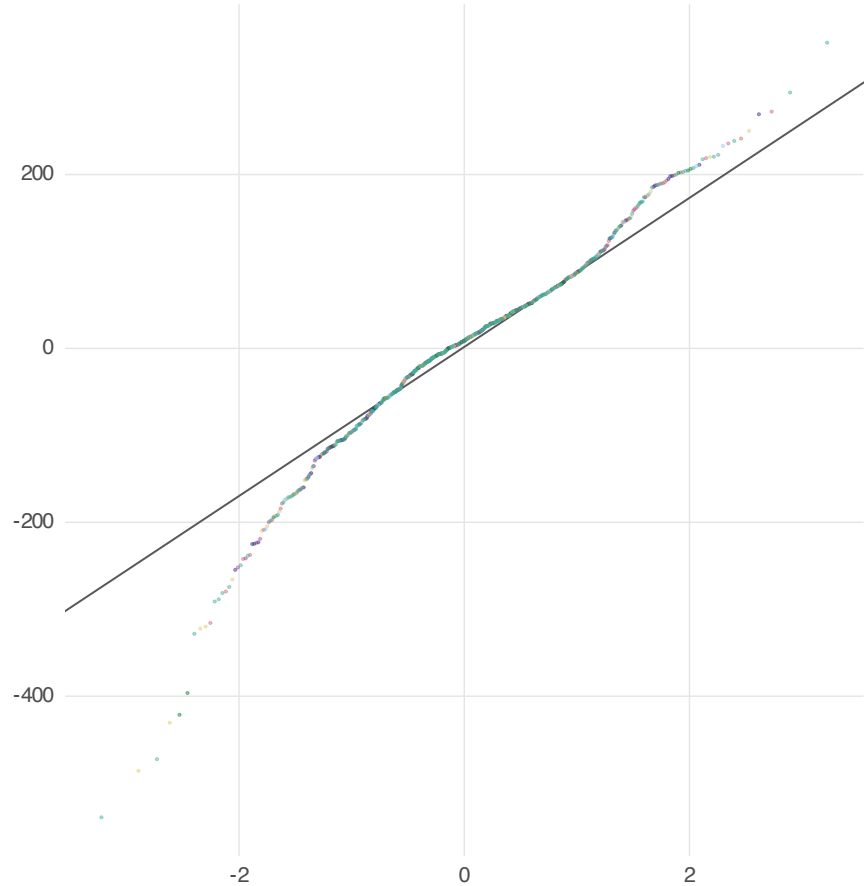

- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)


Chest (complementary) - Age, per 10 years
- meEDI dose

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

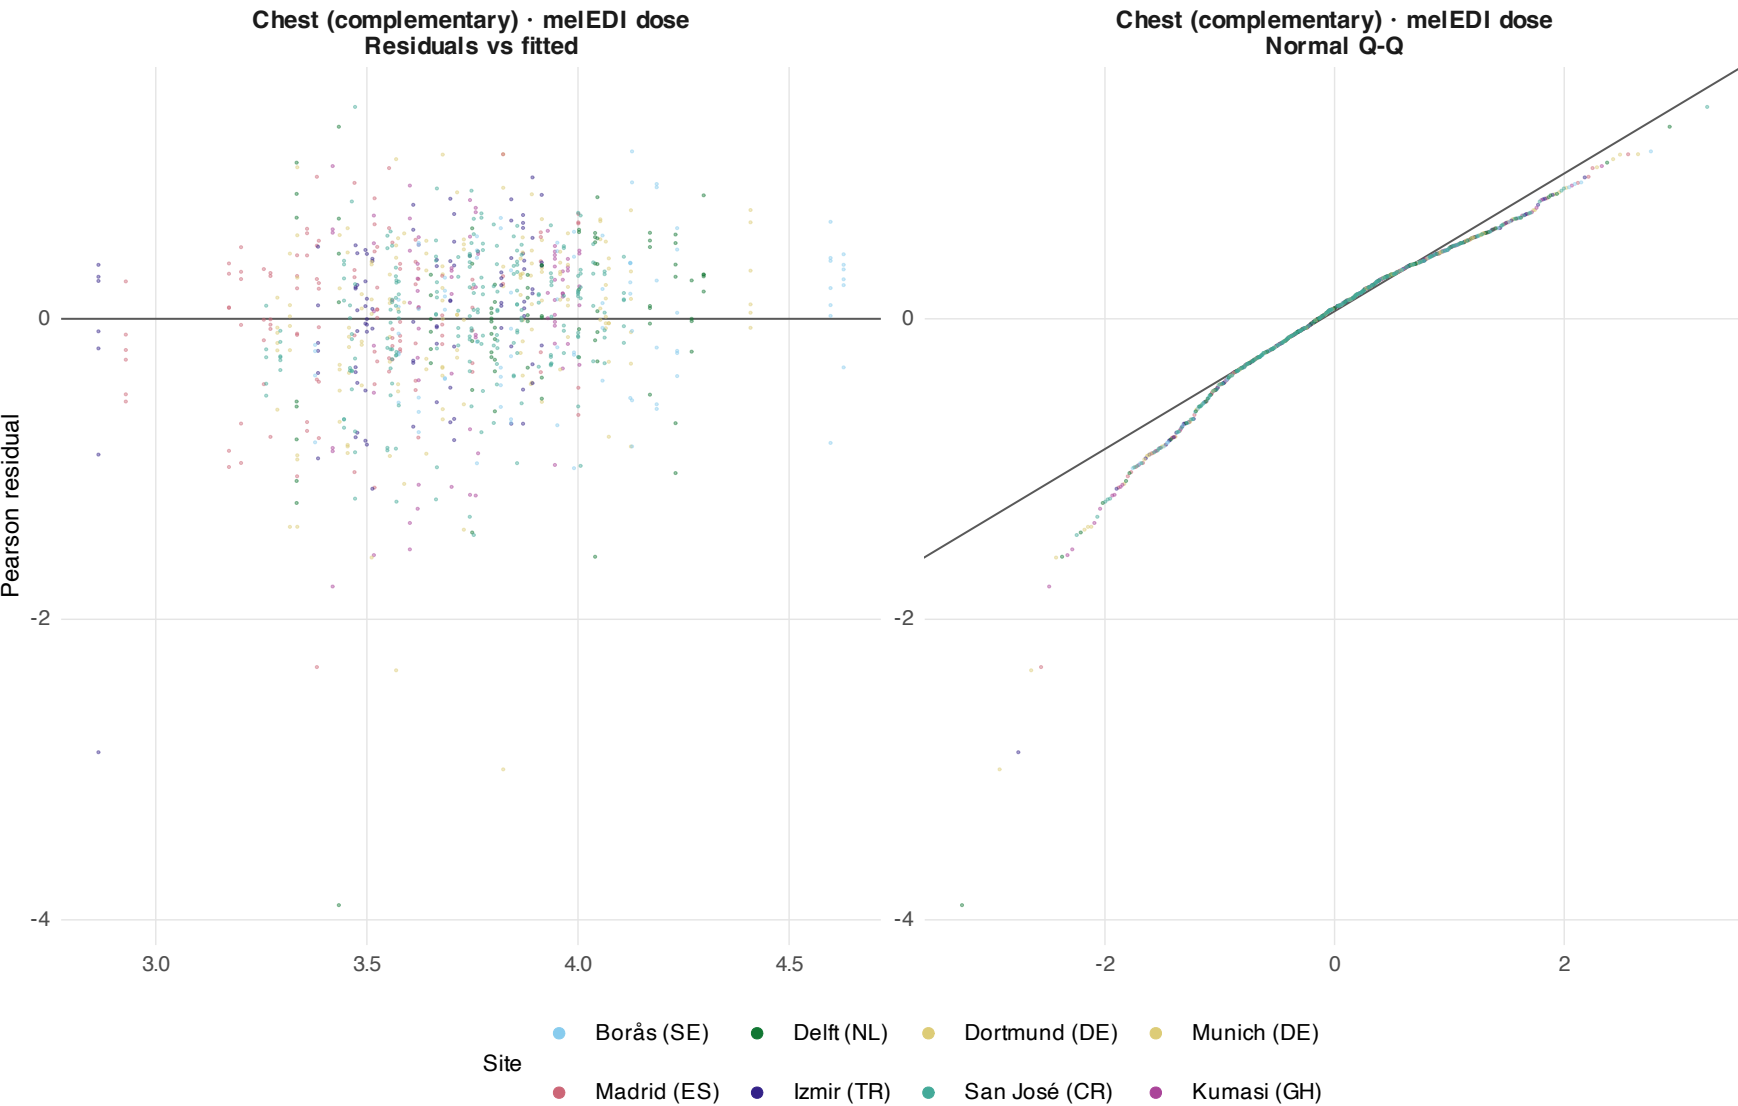

Chest (complementary) - Age, per 10 years
- Melanopic daylight efficacy ratio


Assessment: acceptable with limitations; residual screen: Q-Q review.

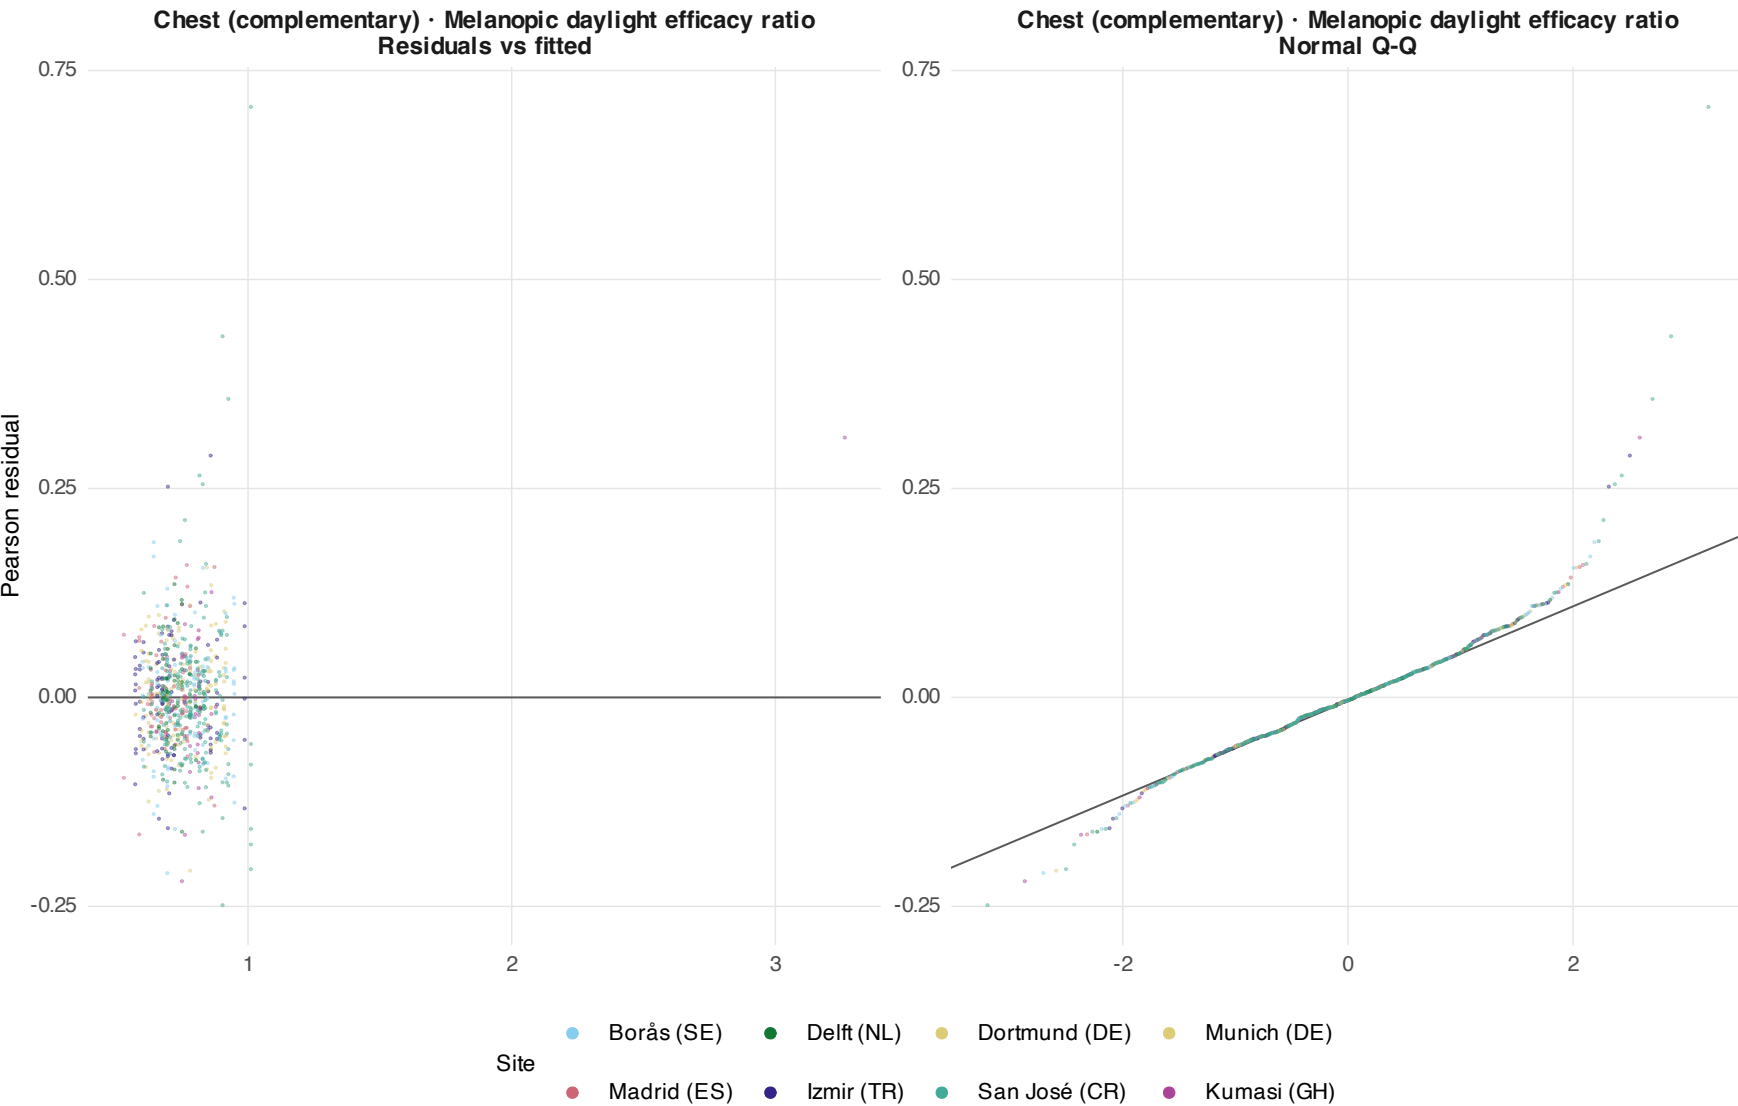


**Chest (complementary) - Measured
biological sex, Female minus Male -
Interdaily stability**

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

**Chest (complementary) · Interdaily stability
Residuals vs fitted**

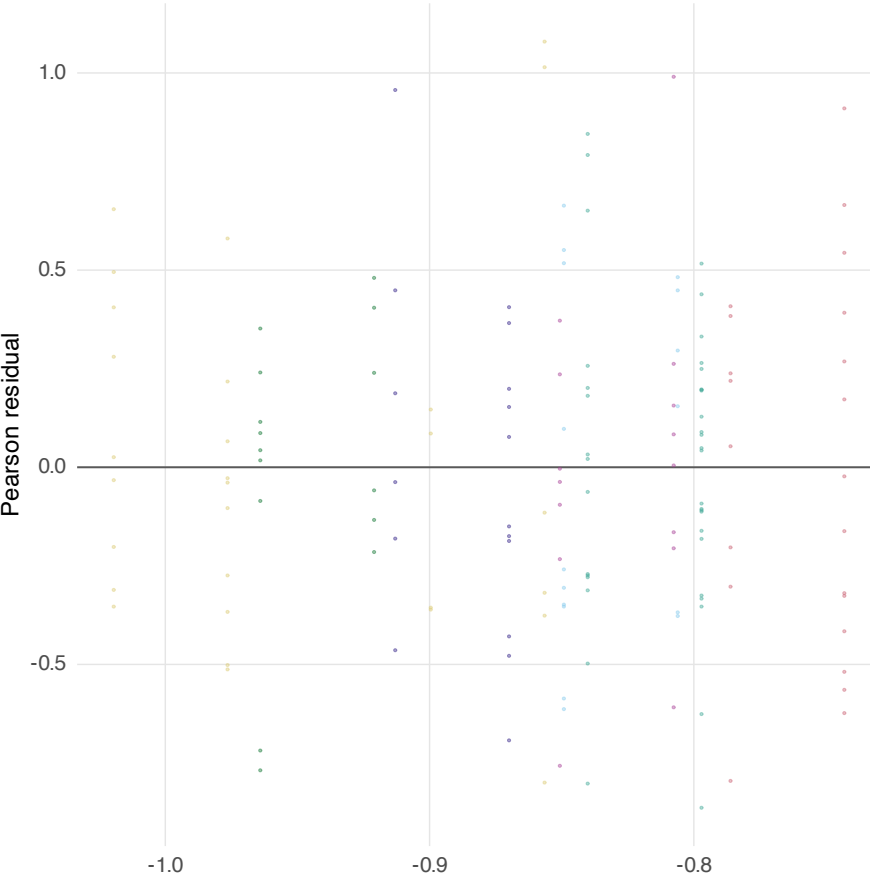

**Chest (complementary) · Interdaily stability
Normal Q-Q**

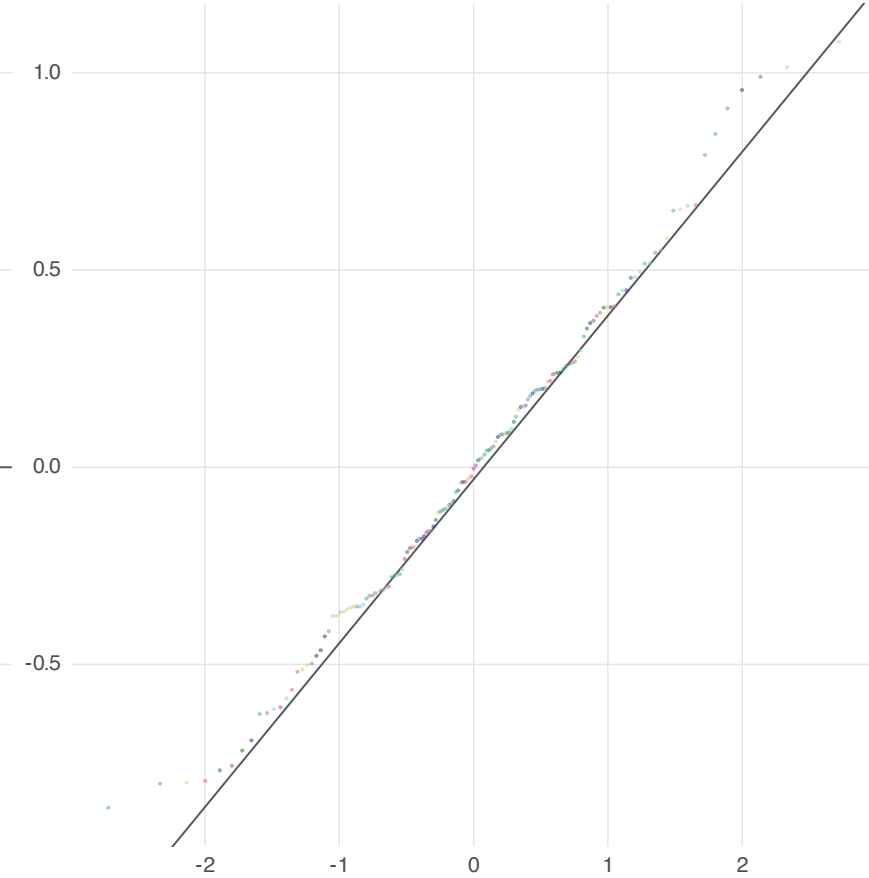


- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)


**Chest (complementary) - Measured
biological sex, Female minus Male -
Intradaily variability**

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

**Chest (complementary) · Intradaily variability
Residuals vs fitted**

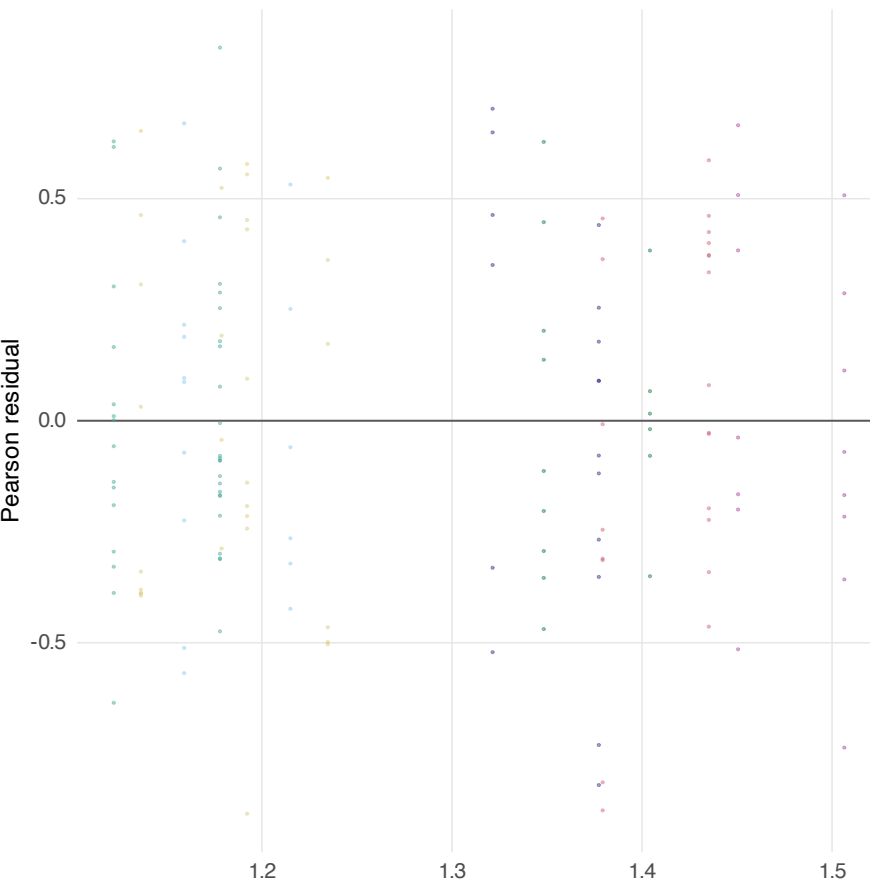


**Chest (complementary) · Intradaily variability
Normal Q-Q**

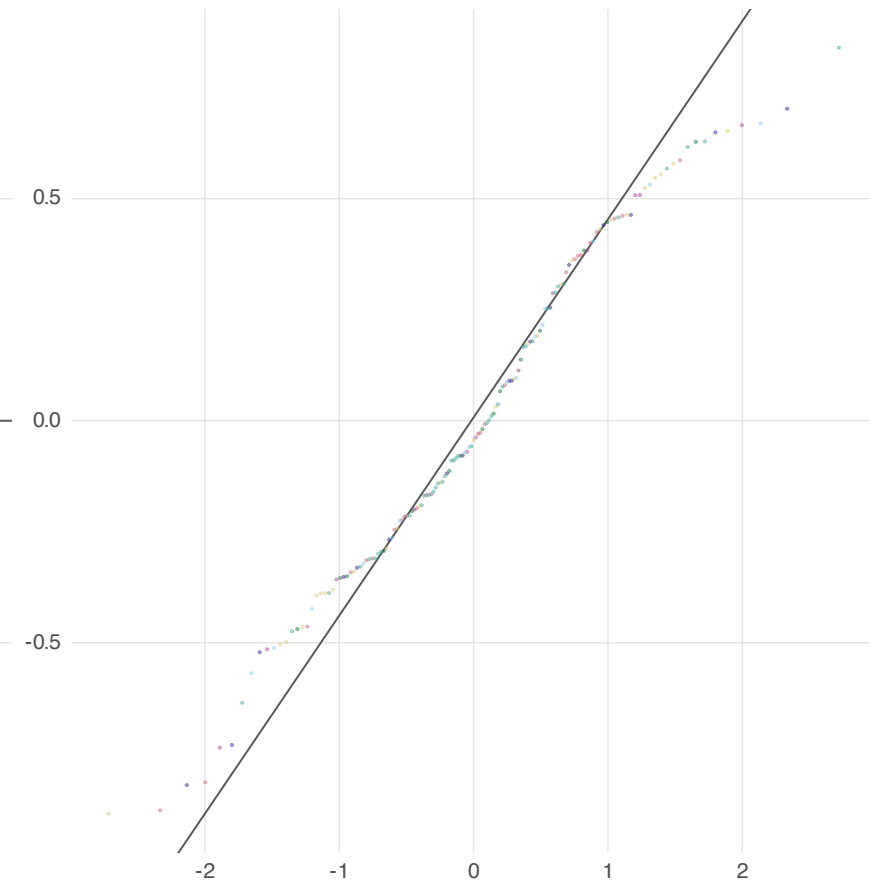

- Site
- | | | | |
|---|---|---|---|
| ● Borås (SE) | ● Delft (NL) | ● Dortmund (DE) | ● Munich (DE) |
| ● Madrid (ES) | ● Izmir (TR) | ● San José (CR) | ● Kumasi (GH) |

**Chest (complementary) - Measured
biological sex, Female minus Male - Mean
meEDI**

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

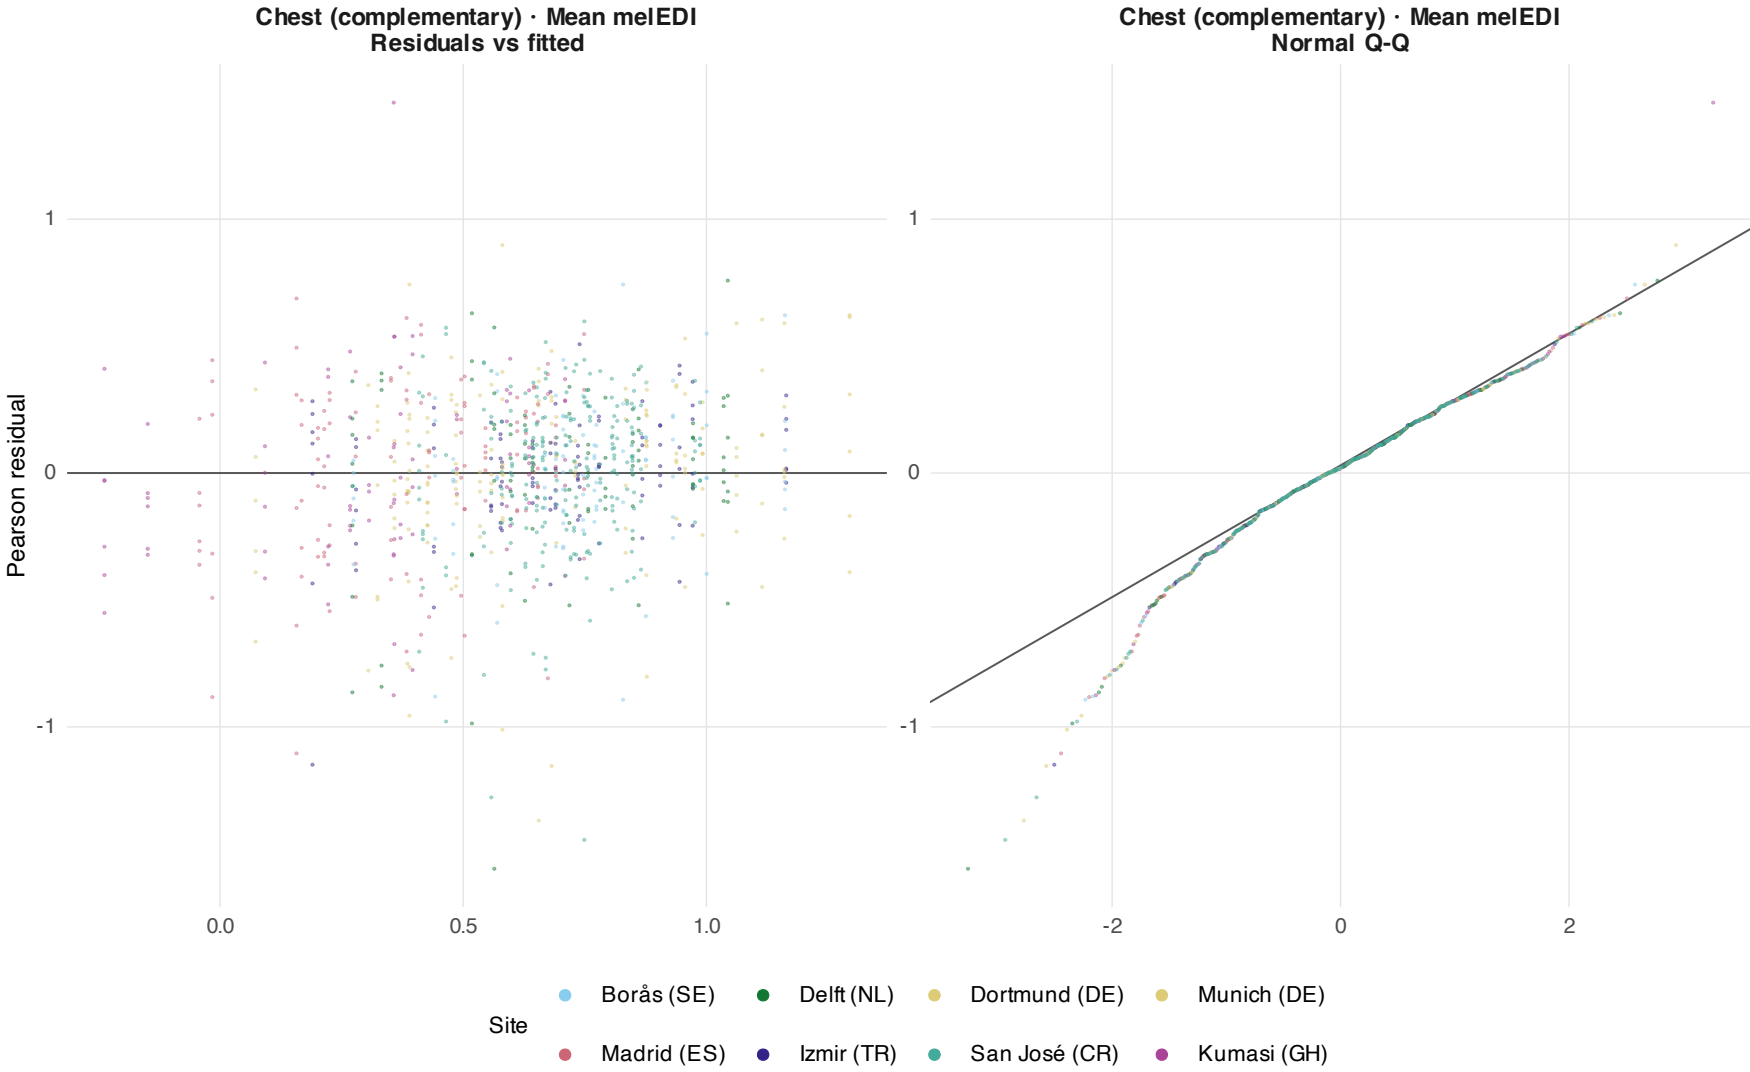


**Chest (complementary) - Measured
biological sex, Female minus Male -
Brightest 10 h mean**

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

**Chest (complementary) · Brightest 10 h mean
Residuals vs fitted**



**Chest (complementary) · Brightest 10 h mean
Normal Q-Q**

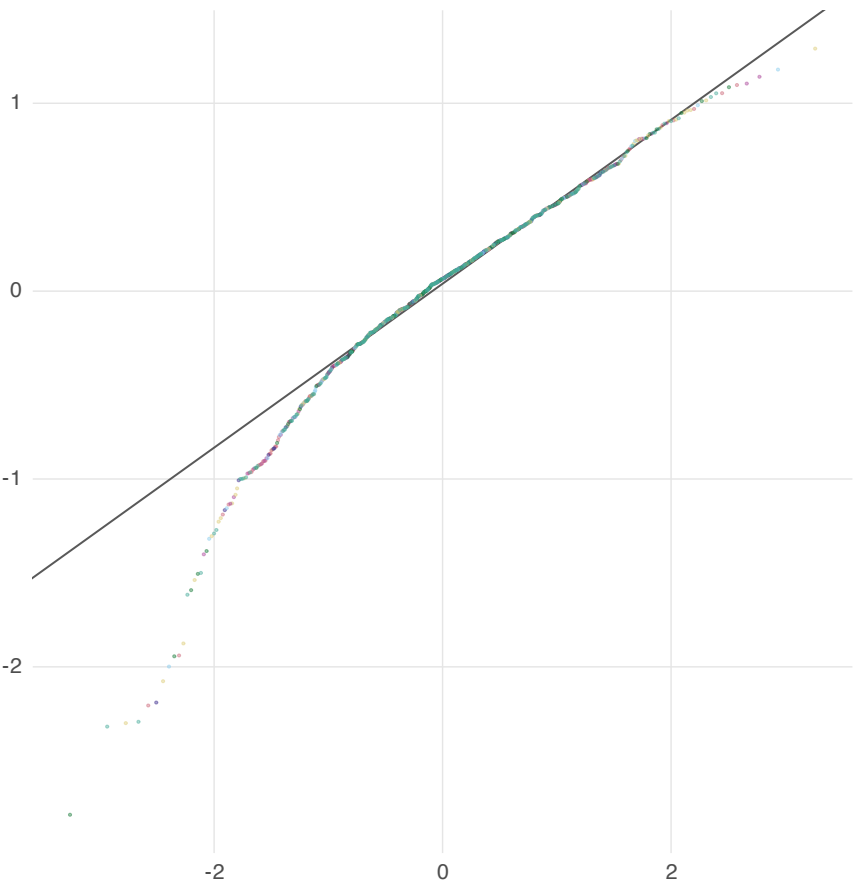


**Chest (complementary) - Measured
biological sex, Female minus Male -
Darkest 10 h mean**

Assessment: acceptable with limitations; residual screen: RESIDUAL SPREAD REVIEW.

**Chest (complementary) · Darkest 10 h mean
Residuals vs fitted**



**Chest (complementary) · Darkest 10 h mean
Normal Q-Q**

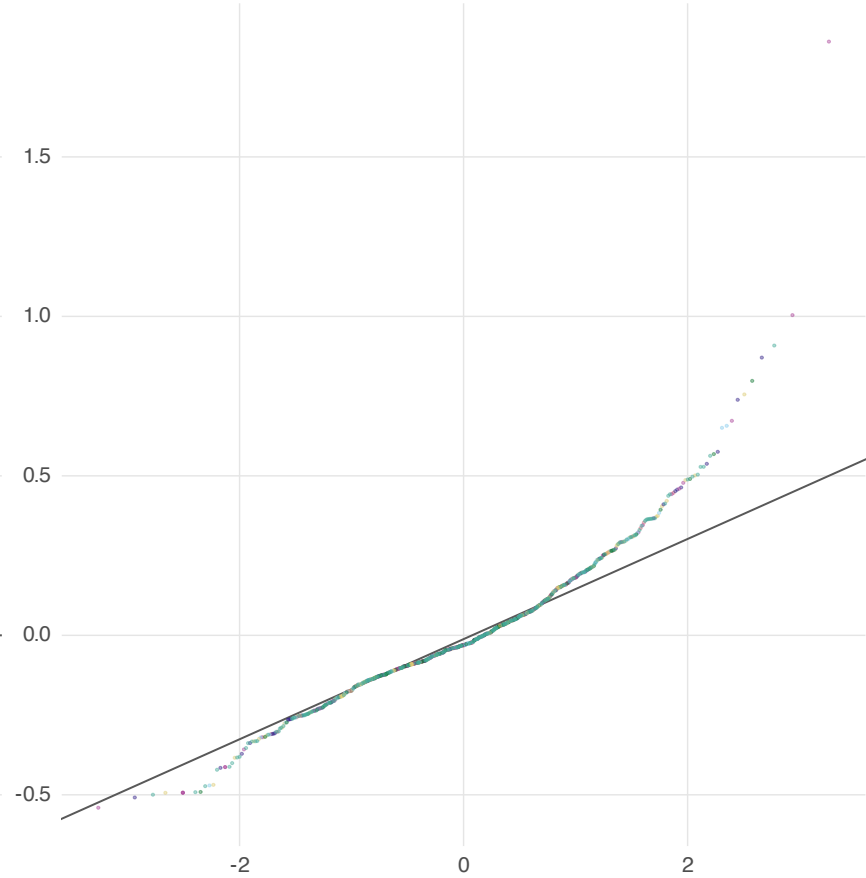


- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)


**Chest (complementary) - Measured
biological sex, Female minus Male - Time
above 1,000 lx meIEDI**

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

Chest (complementary) · Time above 1,000 lx meIEDI
Residuals vs fitted

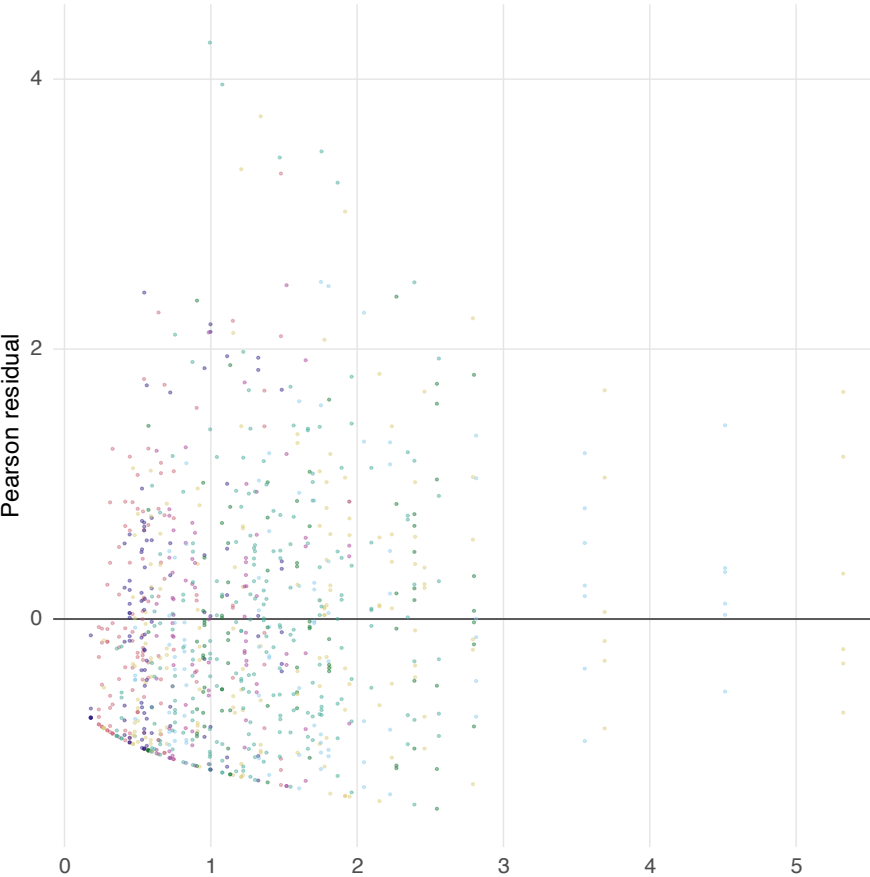


Chest (complementary) · Time above 1,000 lx meIEDI
Normal Q-Q

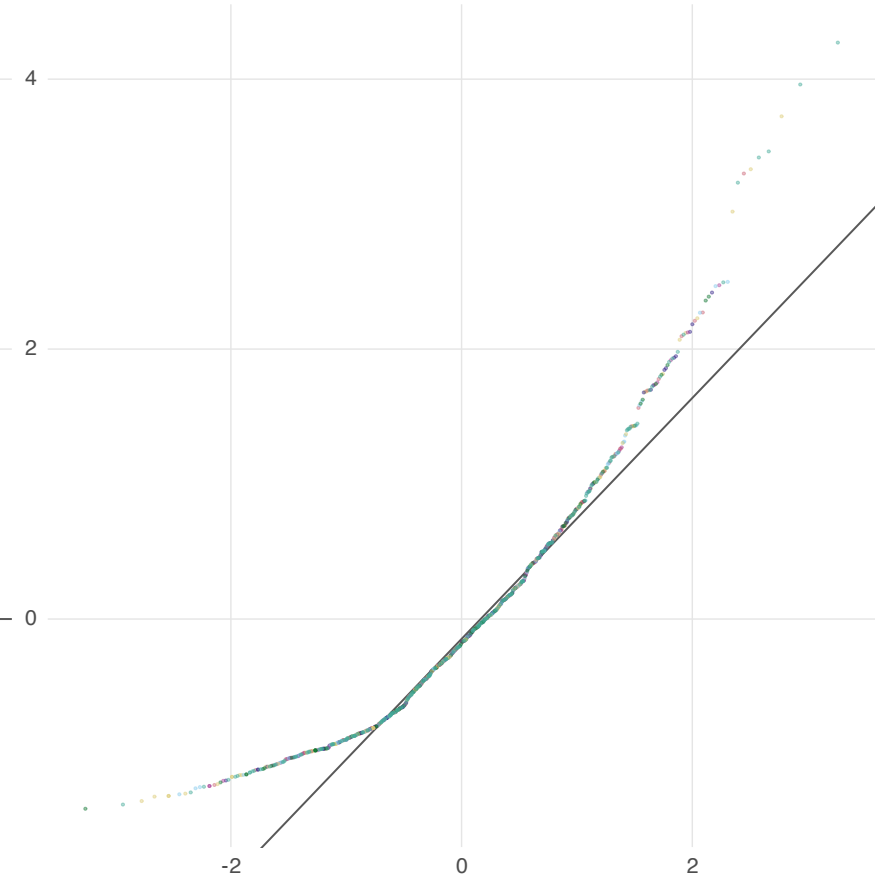

- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)


**Chest (complementary) - Measured
biological sex, Female minus Male - Time
above 250 lx meEDI during wake**

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

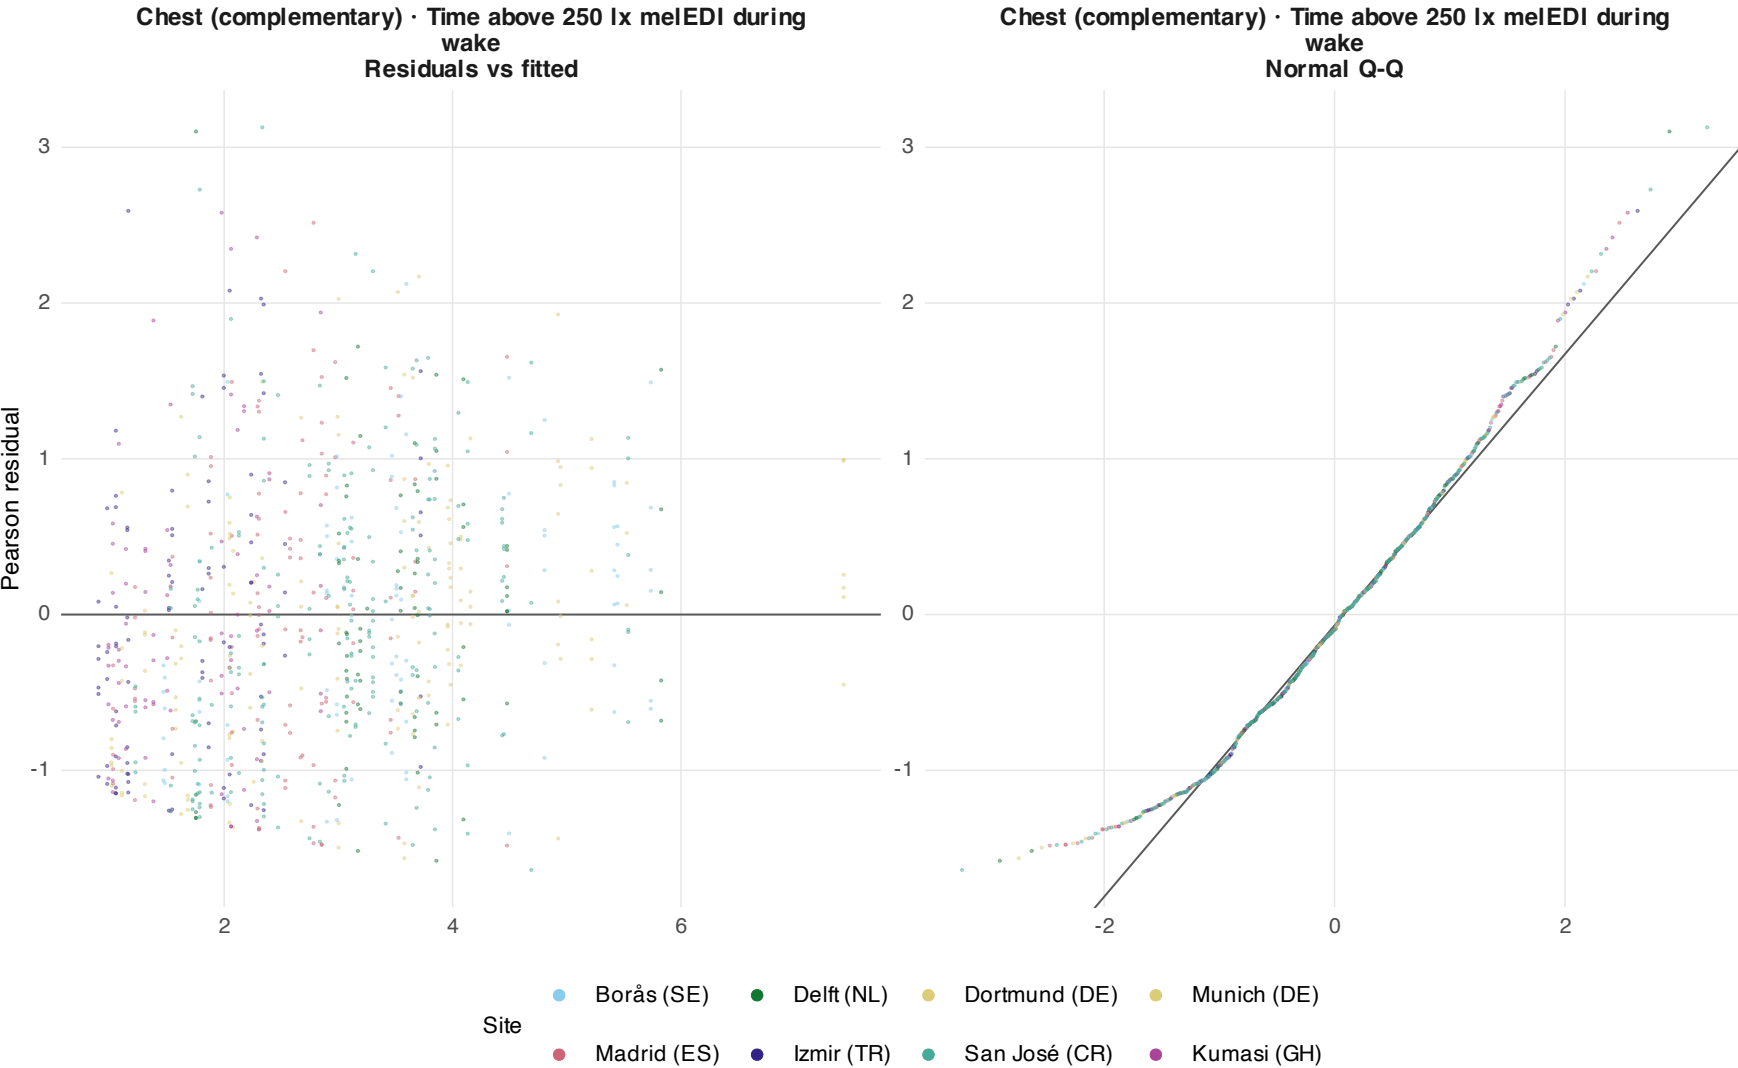


**Chest (complementary) - Measured
biological sex, Female minus Male - Time
below 10 lx melEDI before sleep**

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

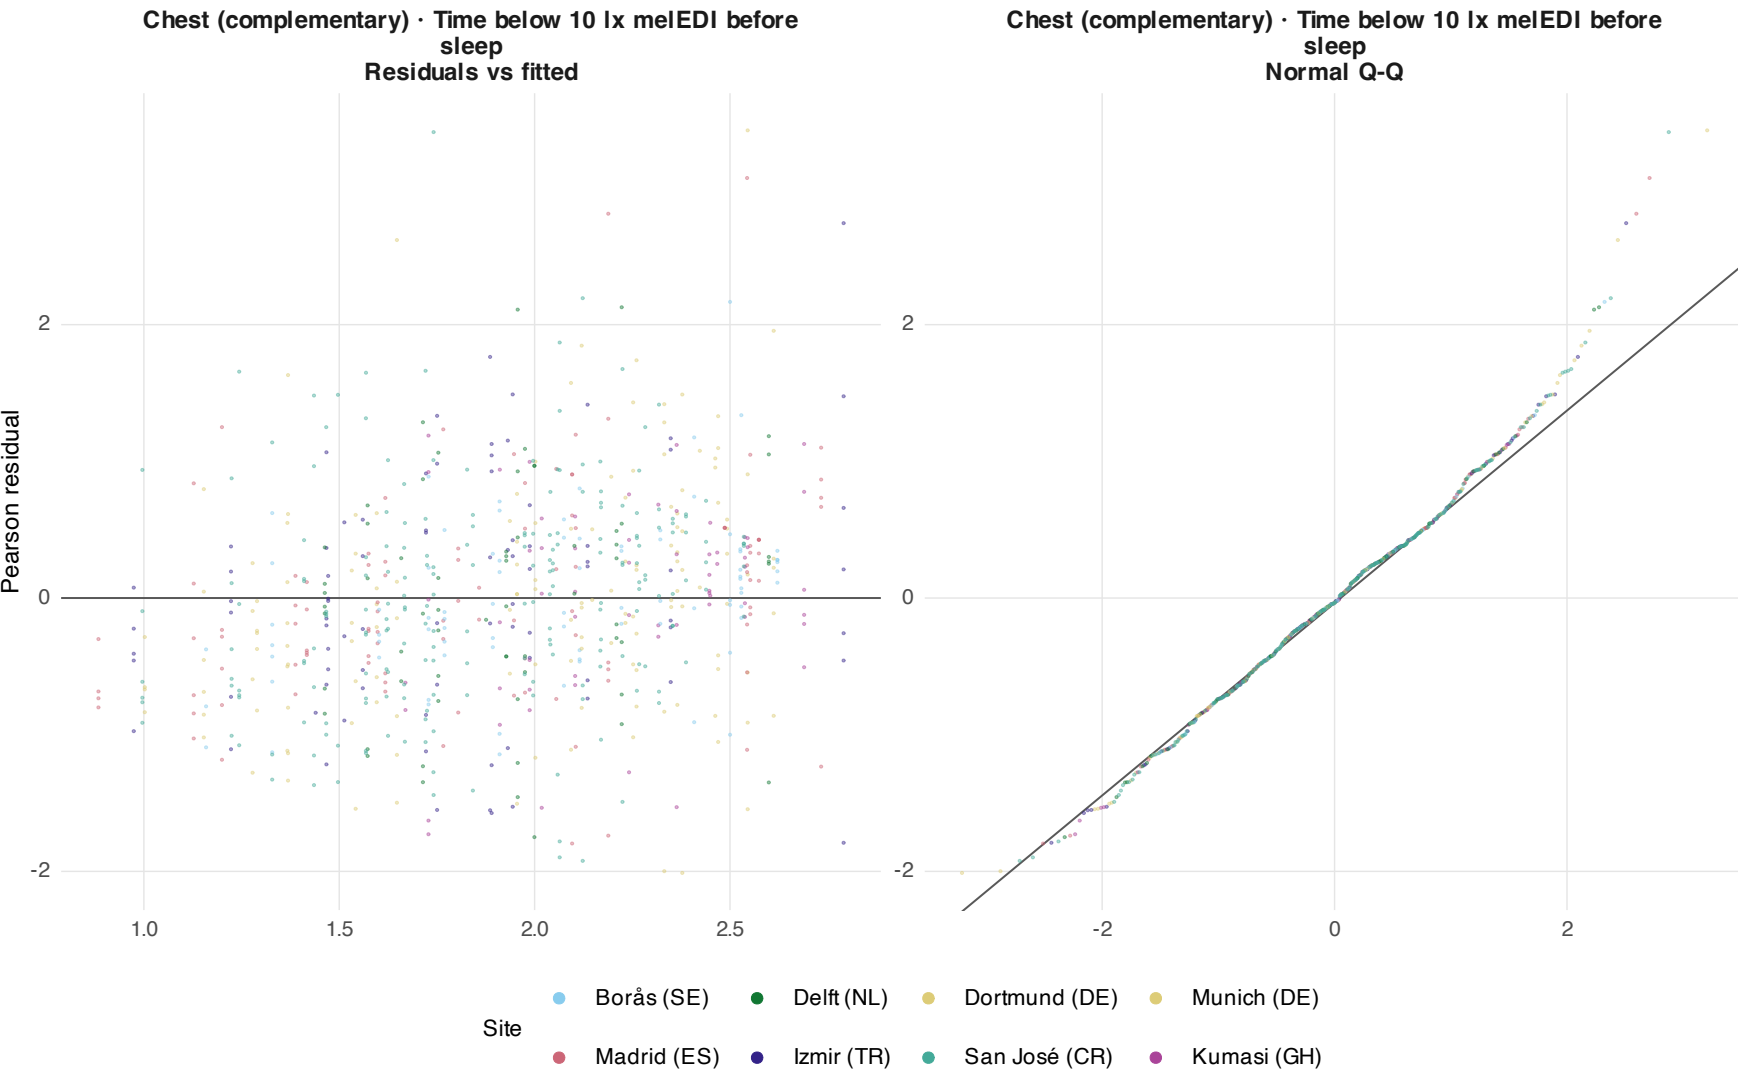


Chest (complementary) - Measured
biological sex, Female minus Male - Time
below 1 lx melEDI during sleep

Assessment: acceptable with limitations; residual screen: ZERO MASS REVIEW.

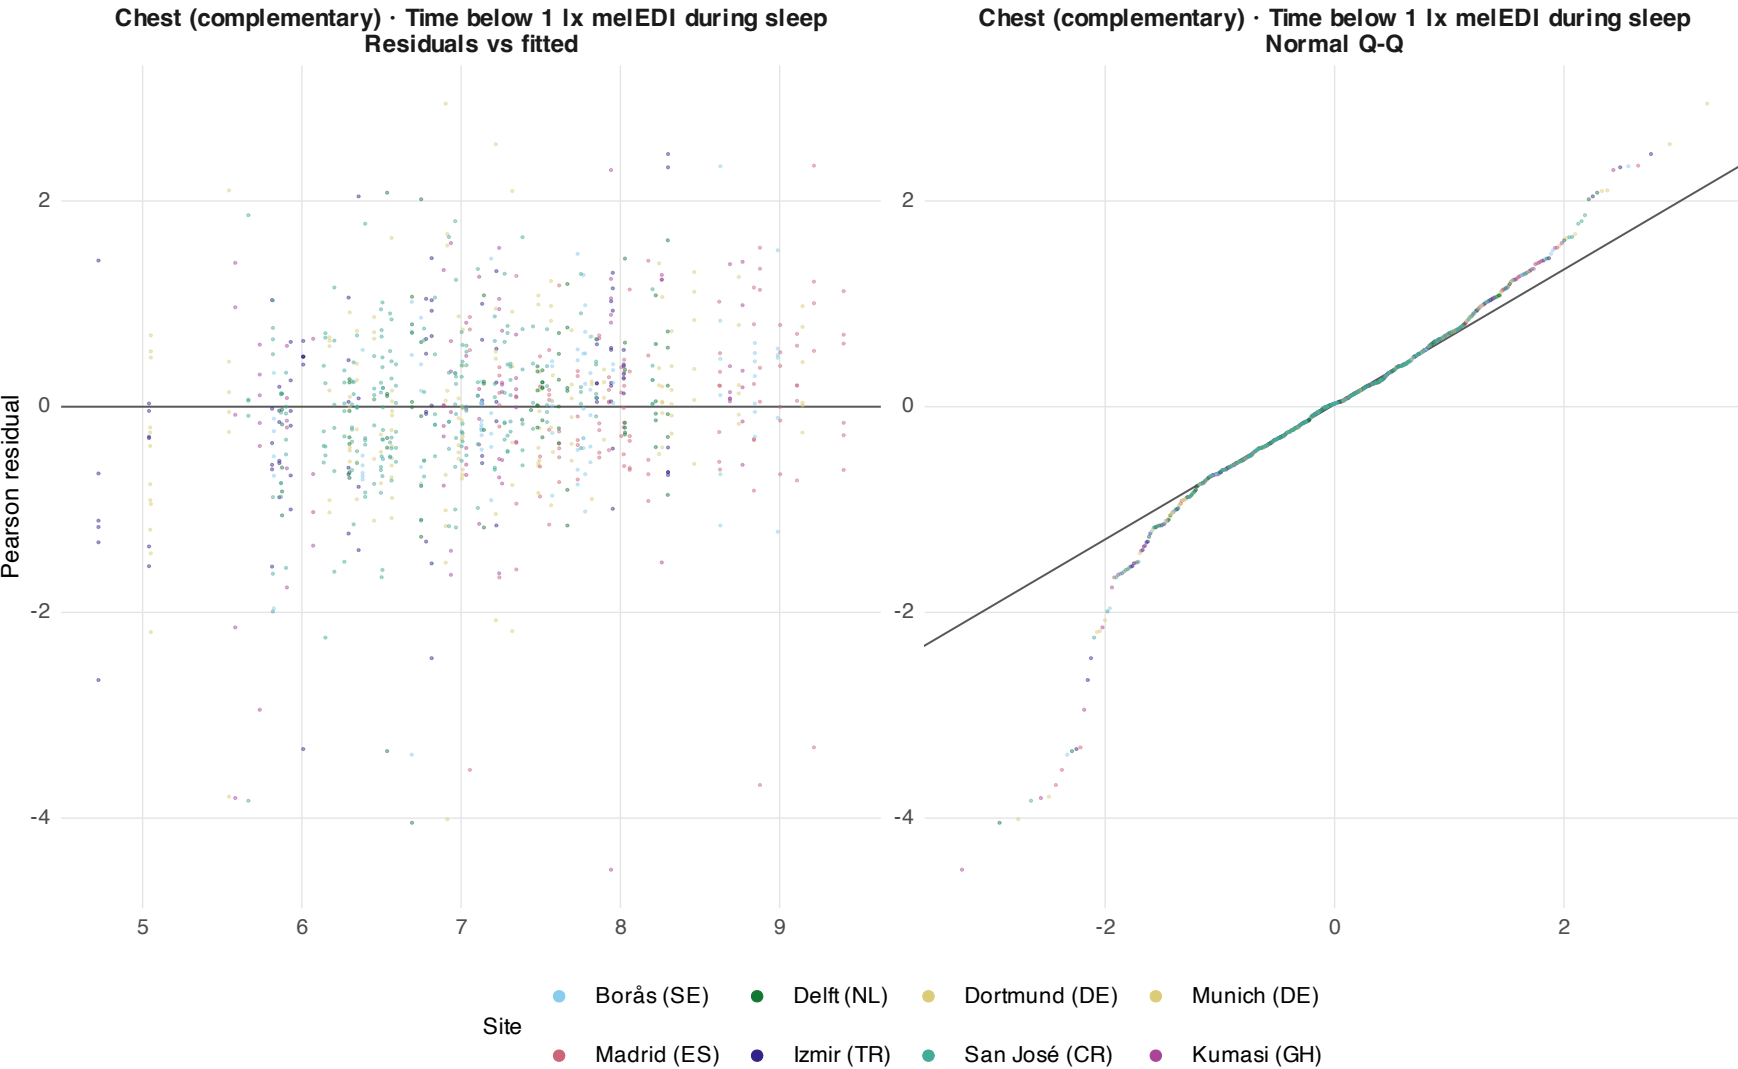


**Chest (complementary) - Measured
biological sex, Female minus Male -
Longest continuous period above 250 lx
meEDI**

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

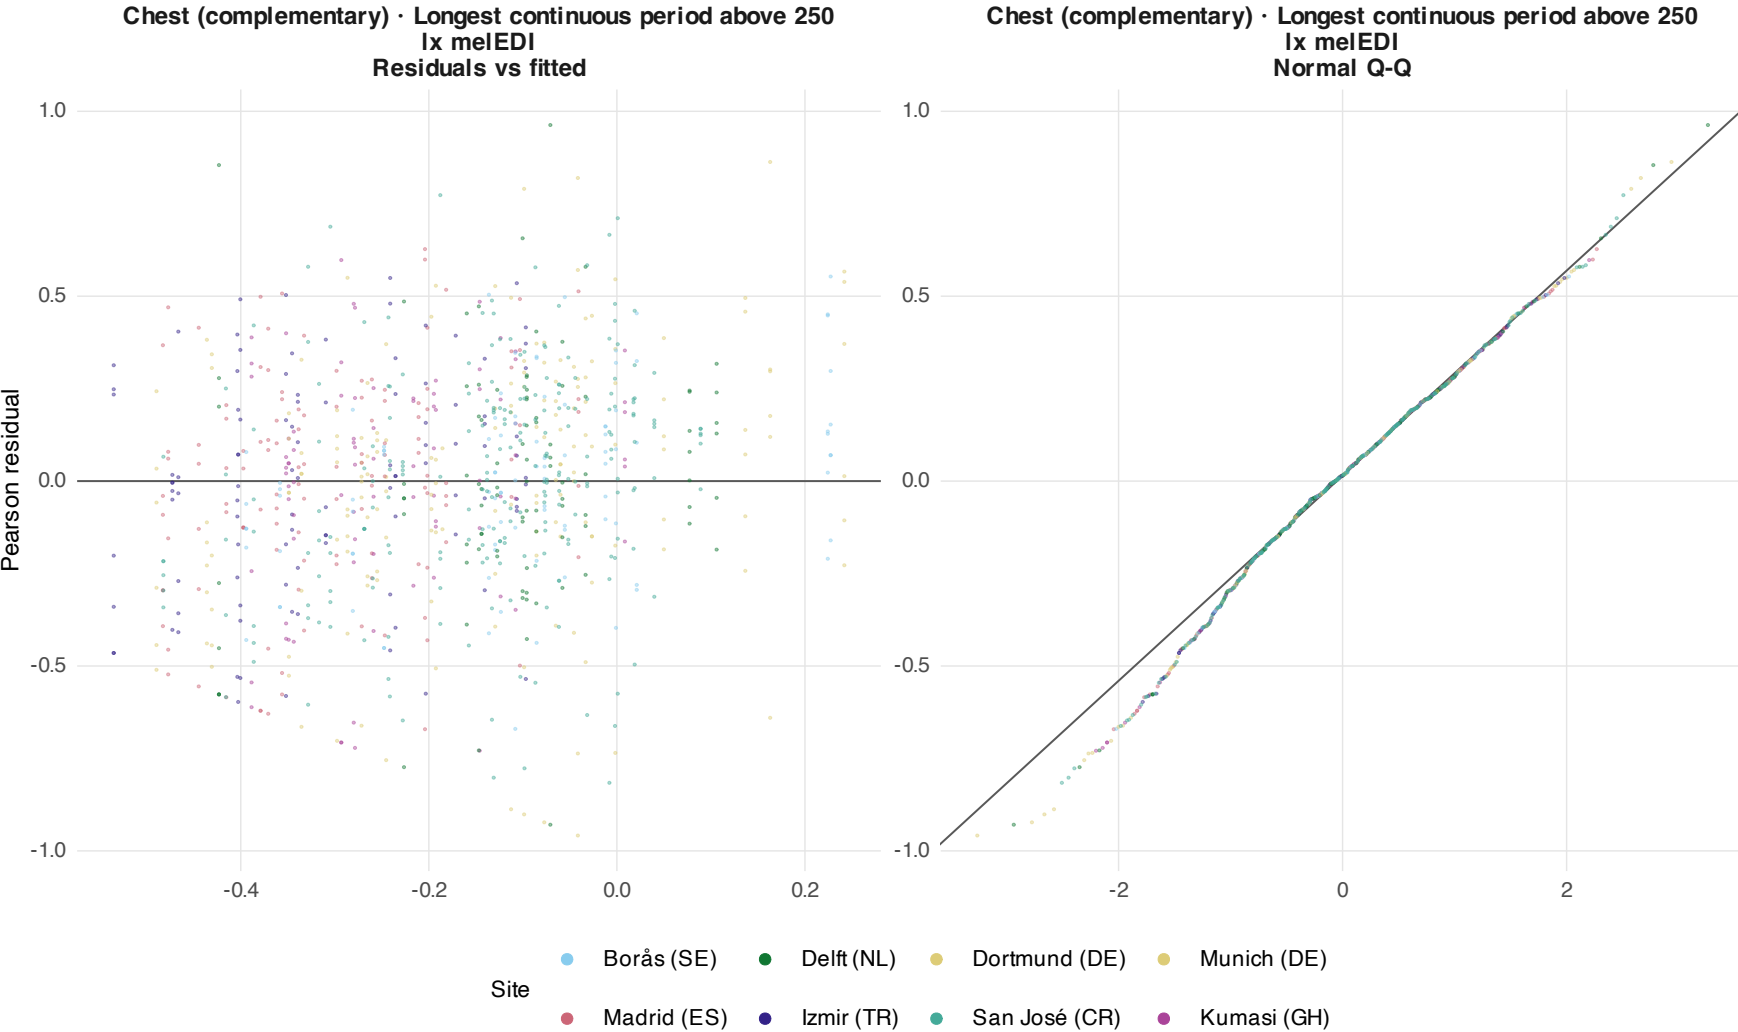


**Chest (complementary) - Measured
biological sex, Female minus Male -
Midpoint of the brightest 10 hours**

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

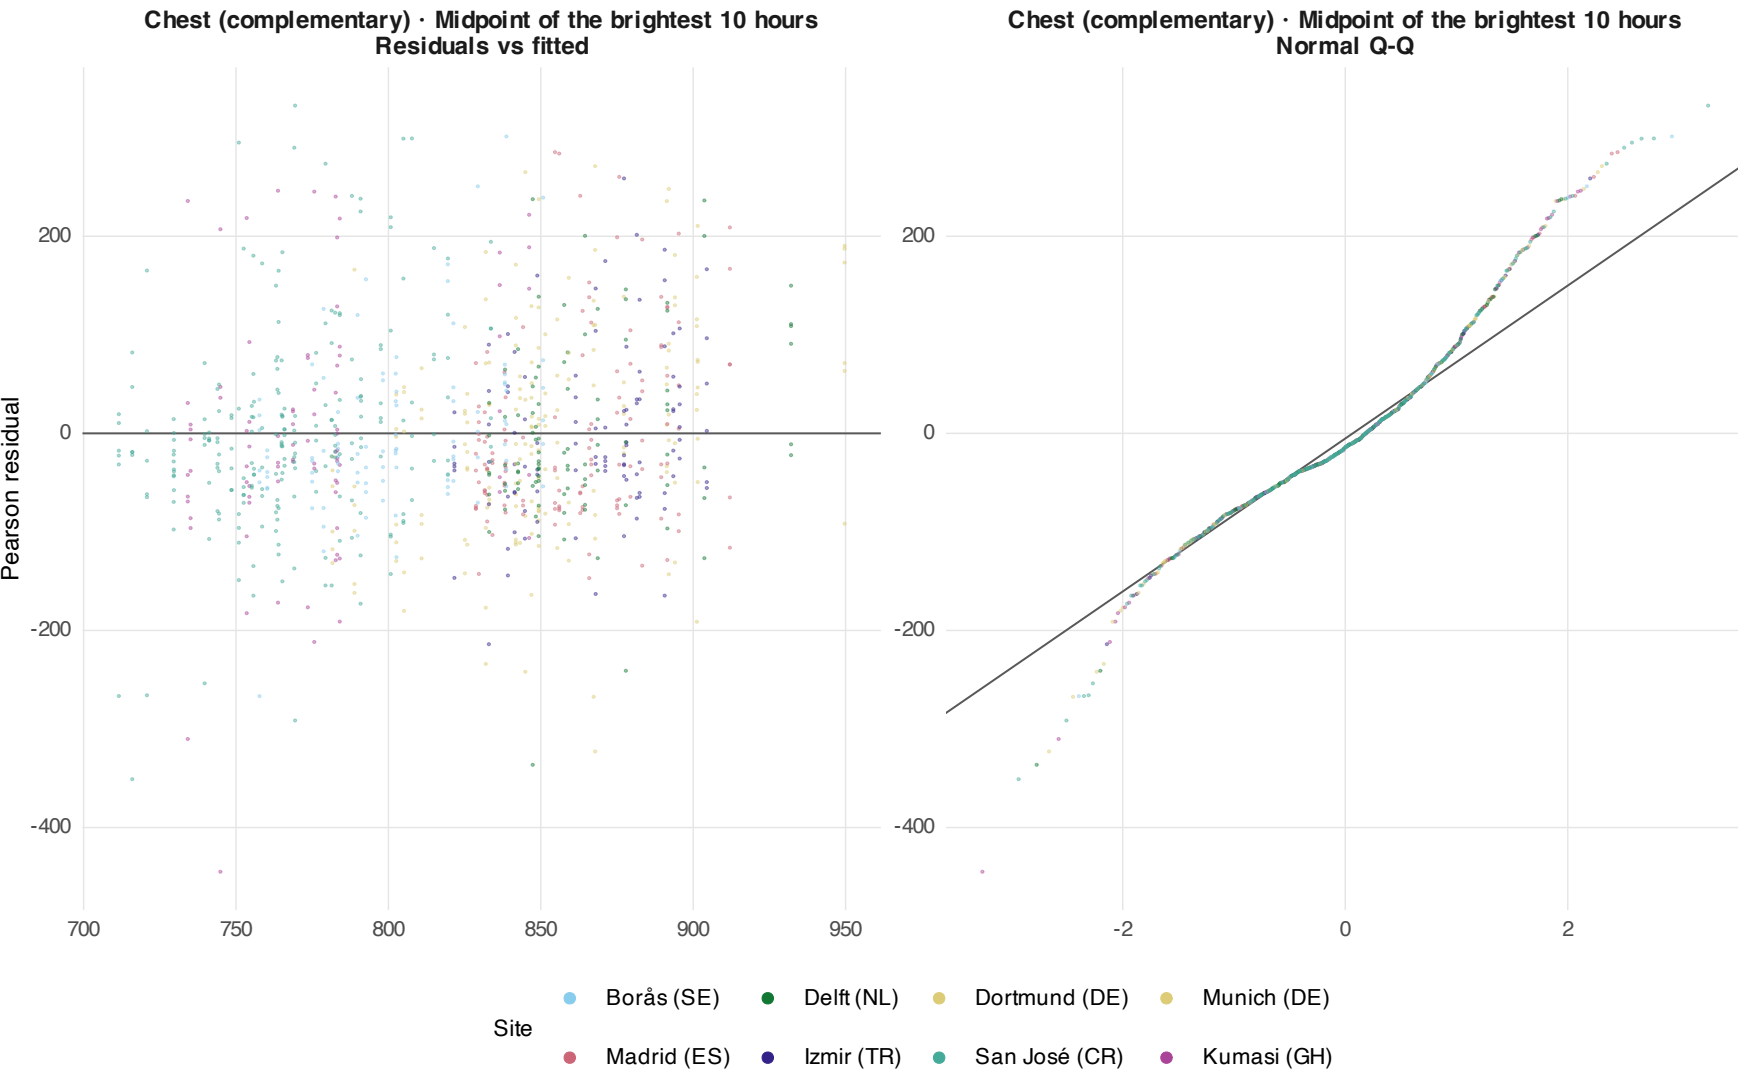


**Chest (complementary) - Measured
biological sex, Female minus Male -
Midpoint of the darkest 10 hours**

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

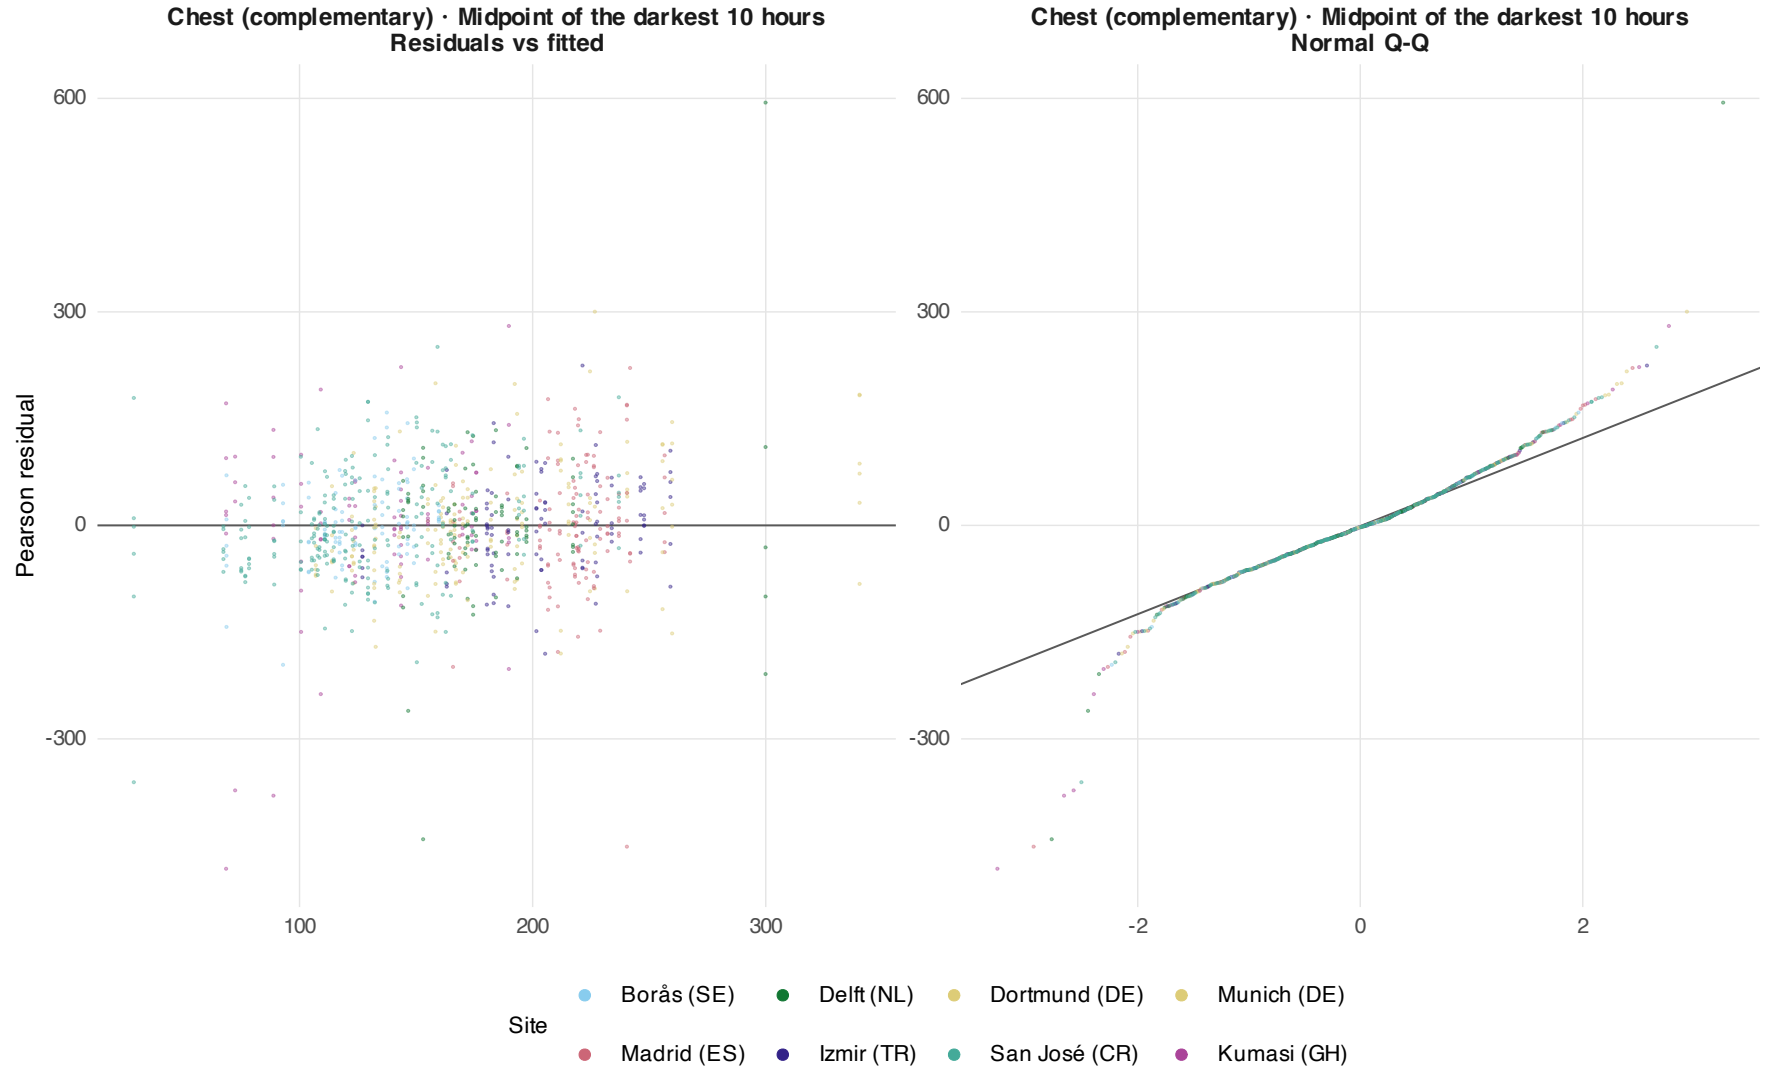

**Chest (complementary) - Measured
biological sex, Female minus Male - Mean
timing of exposure above 250 lx meIEDI**

Assessment: acceptable; residual screen: no residual/distribution threshold flag.

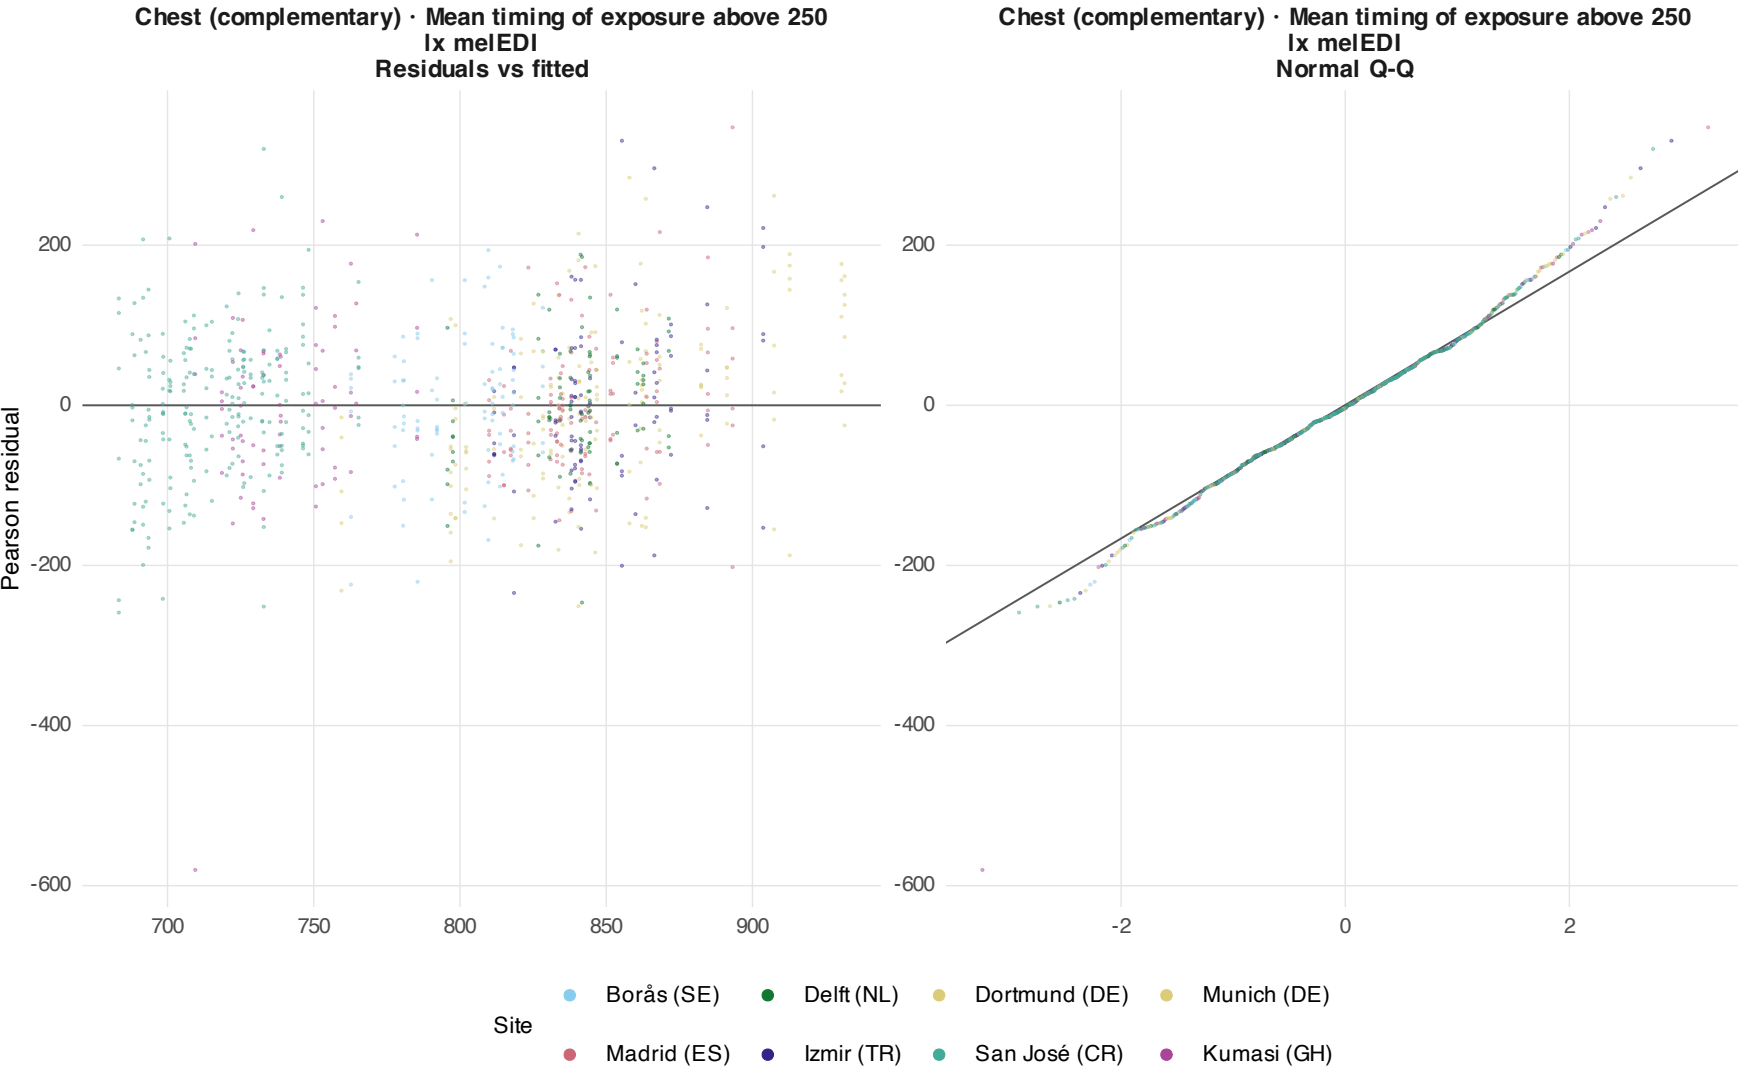


**Chest (complementary) - Measured
biological sex, Female minus Male - First
light timing above 250 lx meIEDI**

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

**Chest (complementary) · First light timing above 250 lx
meIEDI
Residuals vs fitted**



**Chest (complementary) · First light timing above 250 lx
meIEDI
Normal Q-Q**

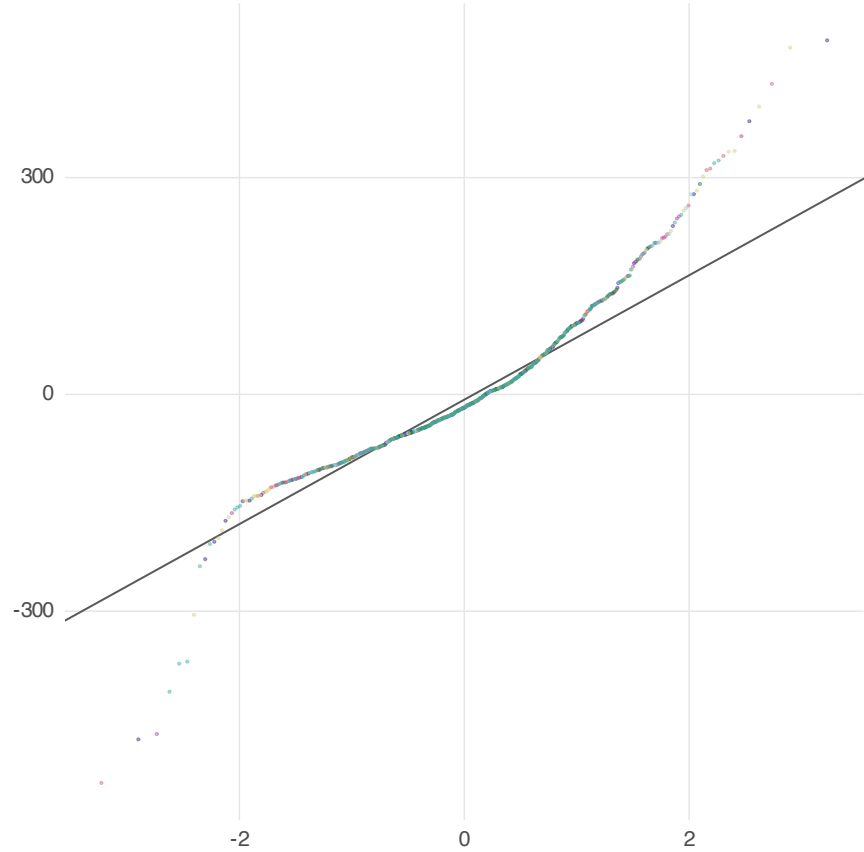

- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)


**Chest (complementary) - Measured
biological sex, Female minus Male - Last
light timing above 250 lx meEDI**

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

**Chest (complementary) · Last light timing above 250 lx
meEDI
Residuals vs fitted**




**Chest (complementary) · Last light timing above 250 lx
meEDI
Normal Q-Q**

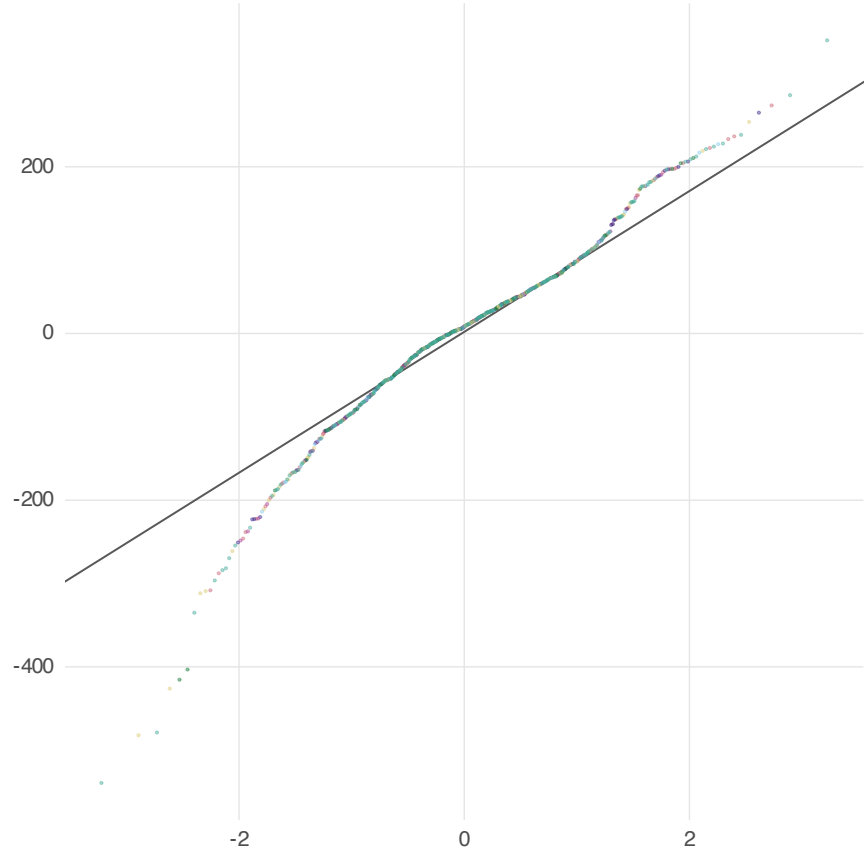

- Site
- Borås (SE)
 - Delft (NL)
 - Dortmund (DE)
 - Munich (DE)
 - Madrid (ES)
 - Izmir (TR)
 - San José (CR)
 - Kumasi (GH)

**Chest (complementary) - Measured
biological sex, Female minus Male - meEDI
dose**

Assessment: acceptable with limitations; residual screen: no residual/distribution threshold flag.

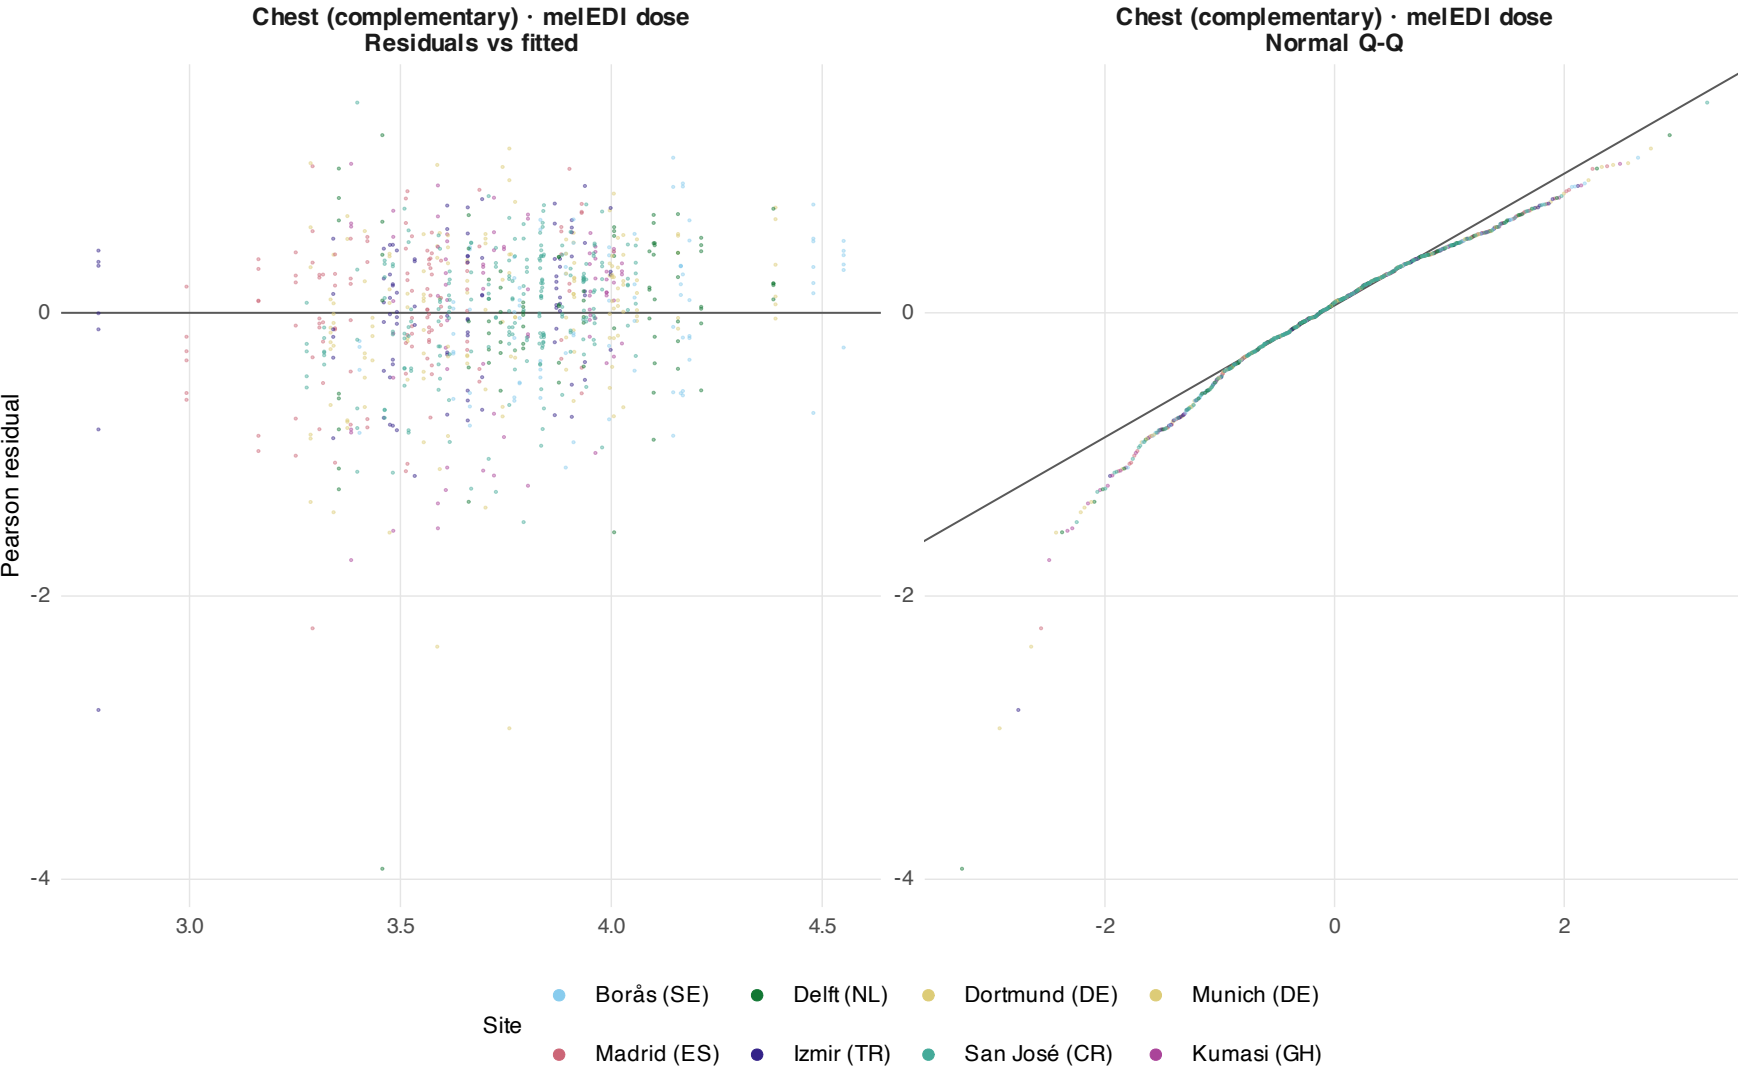

**Chest (complementary) - Measured
biological sex, Female minus Male -
Melanopic daylight efficacy ratio**

Assessment: acceptable with limitations; residual screen: Q-Q review.

