




COBALT HARBOR SYSTEMS

AEGIS AC-27

EVIDENCE QUALITY INSPECTION

AUDIT LENS

EVIDENCE QUALITY INSPECTION

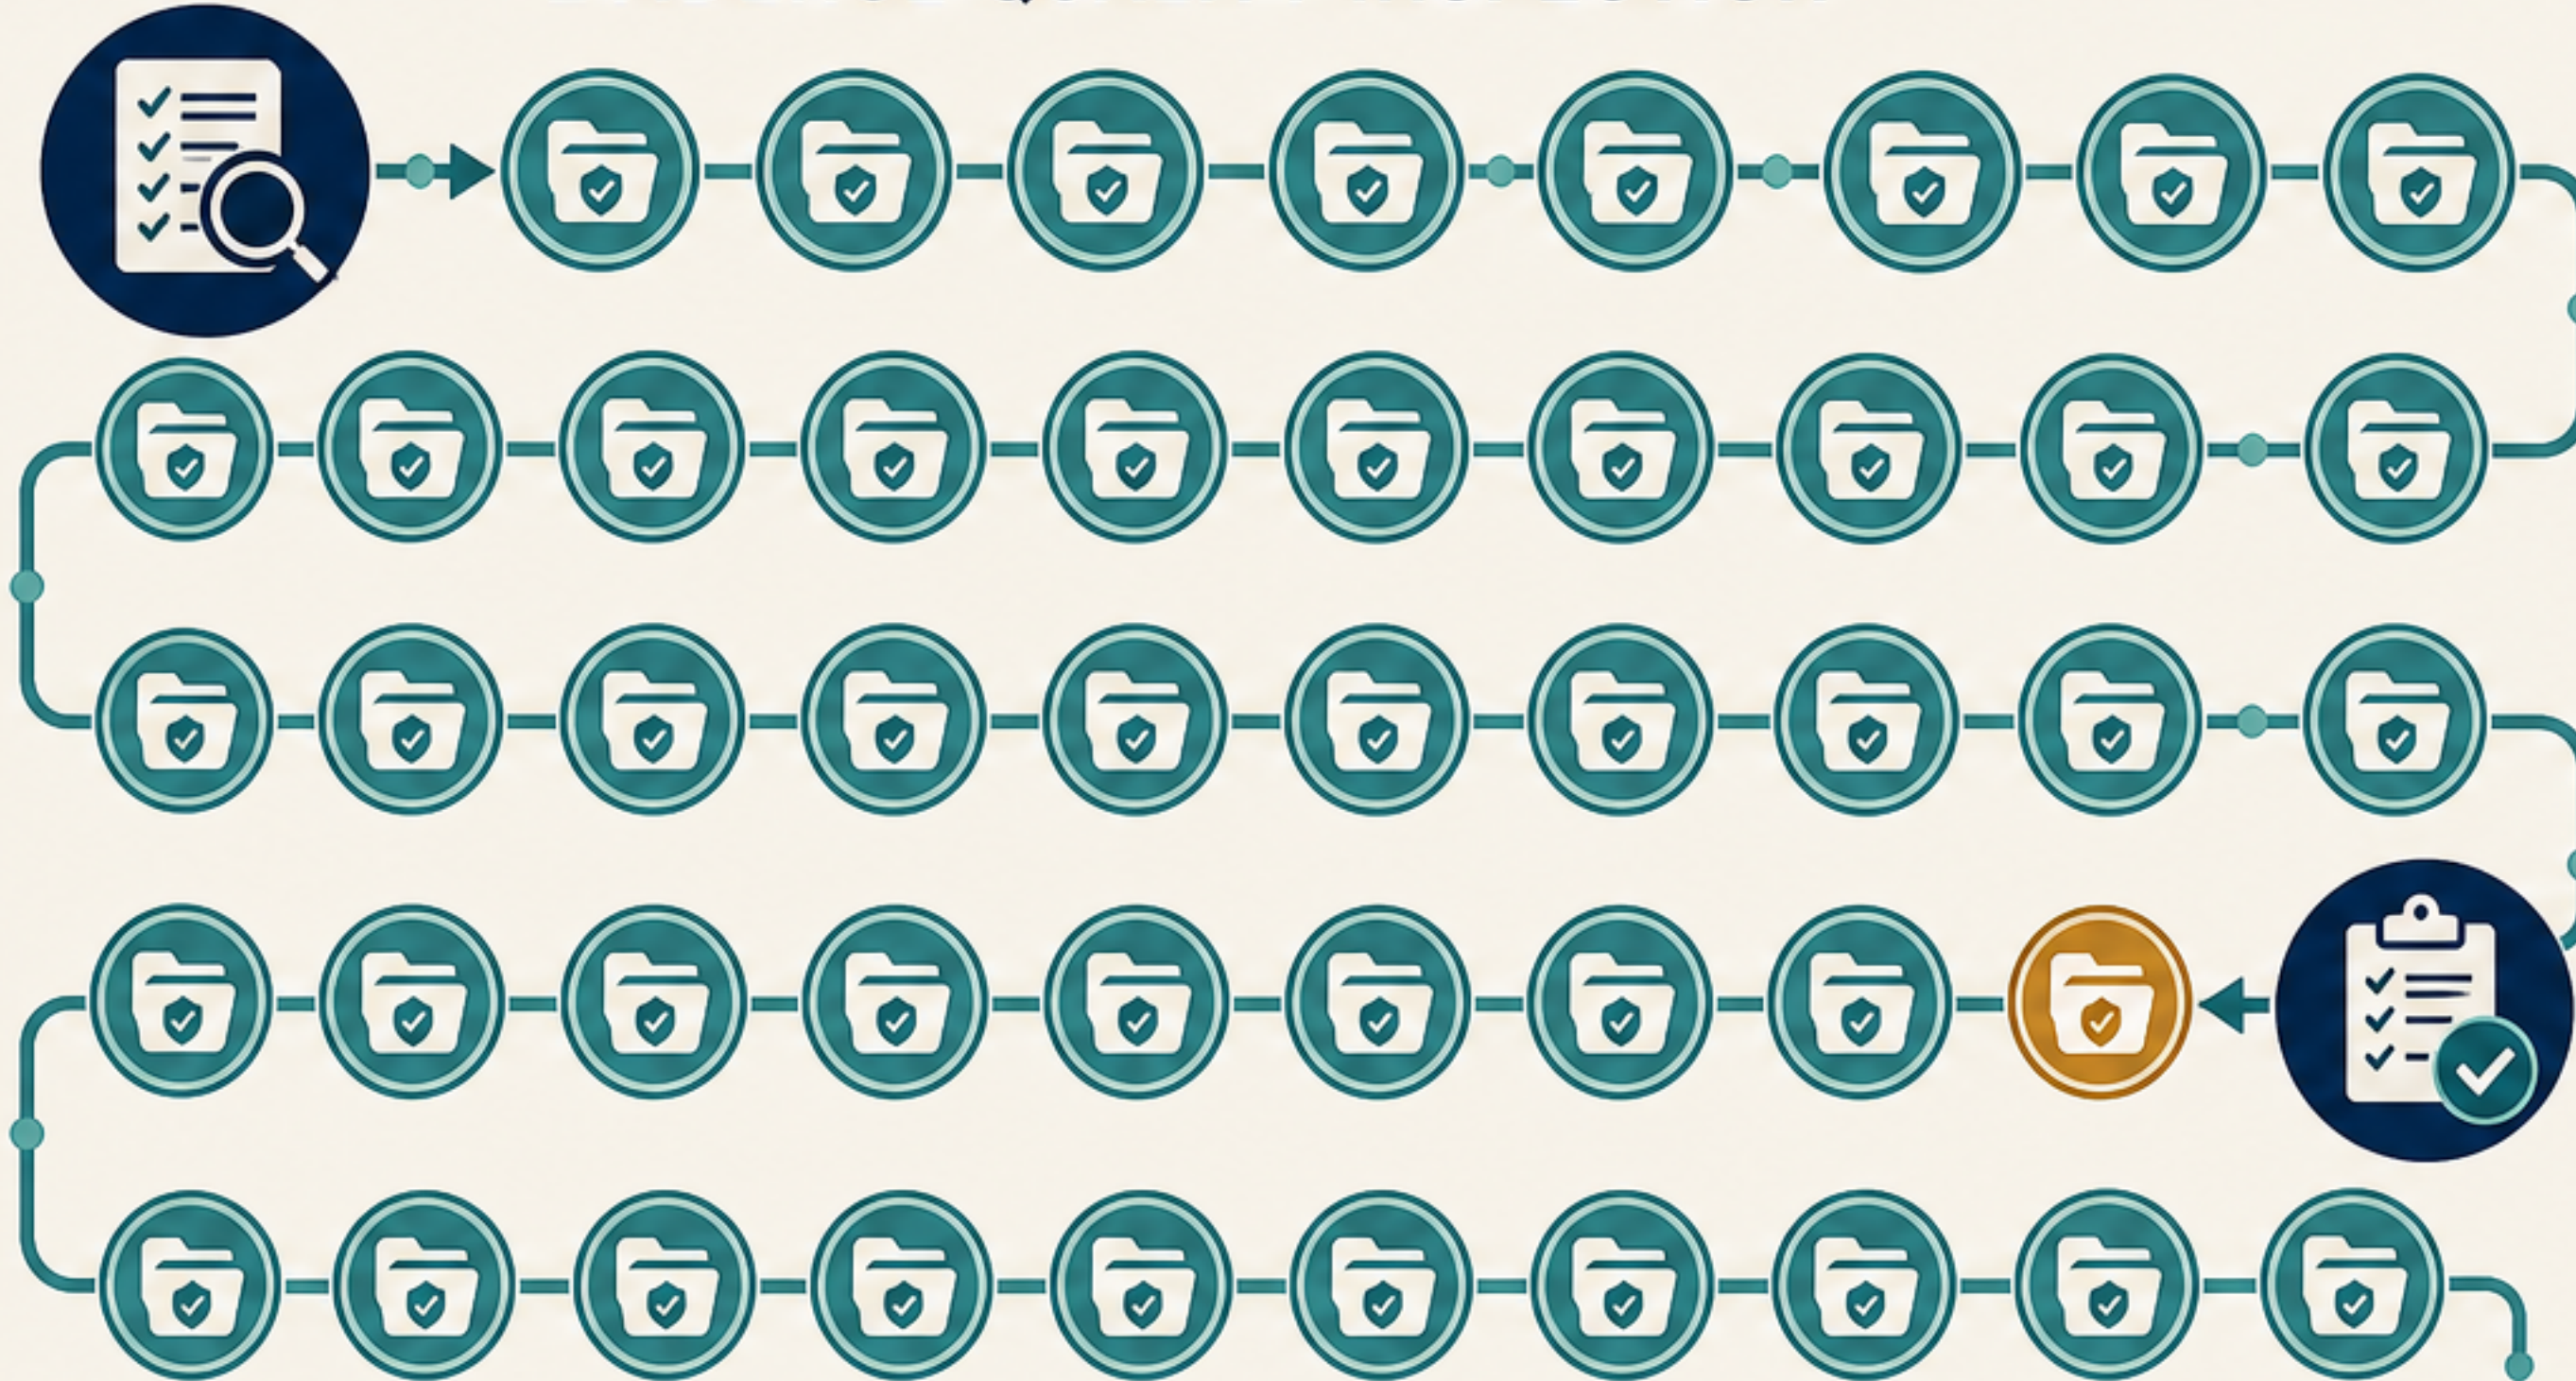

EVIDENCE SET 184



CASE-260713-184



RISK-031



2026-07-14



97.9%



47 OF 48

RISK TREATMENT



MEDIUM