

COBALT HARBOR SYSTEMS



AEGIS AC-27



EVIDENCE SET 184



CASE-260713-184




RISK-031



2026-07-14

TREATMENT PATH

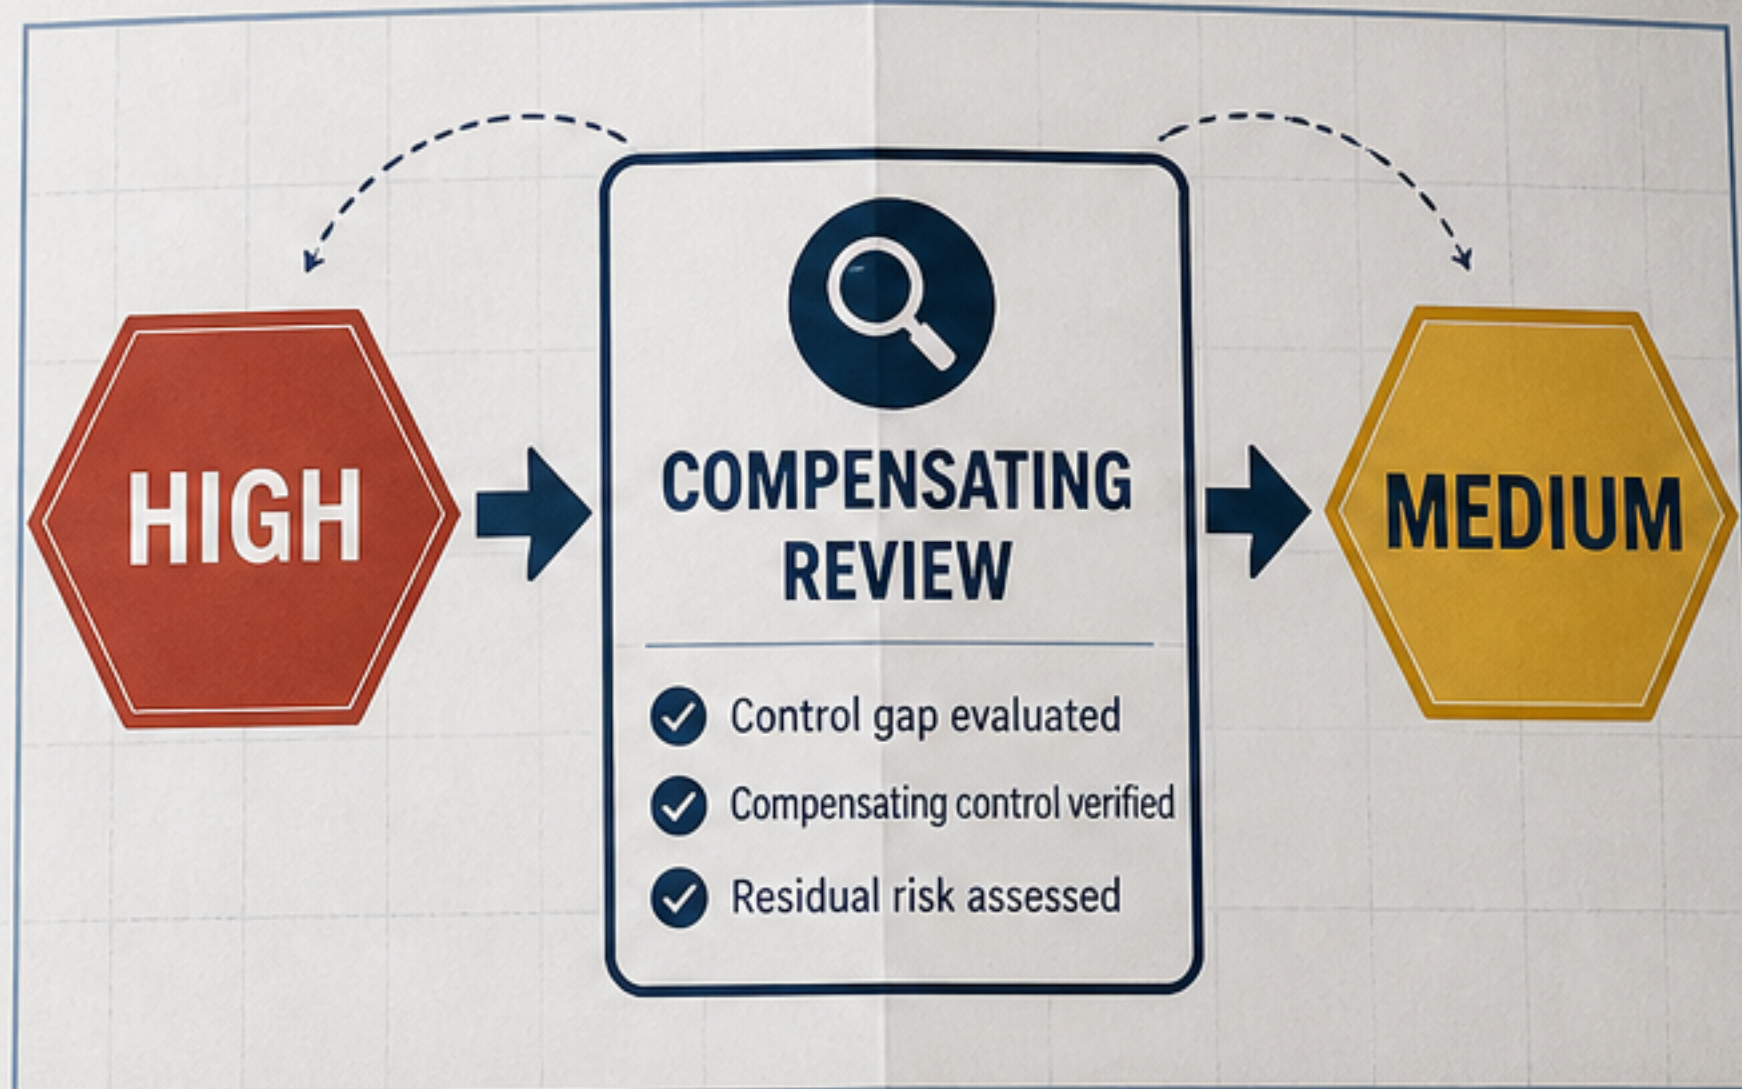

Risk reduced from **HIGH** to **MEDIUM** through **COMPENSATING REVIEW**.

**CONTAINED
EXCEPTION**



**ACTION
ACKNOWLEDGED**

Treatment plan approved.
Residual risk accepted
within tolerance.

