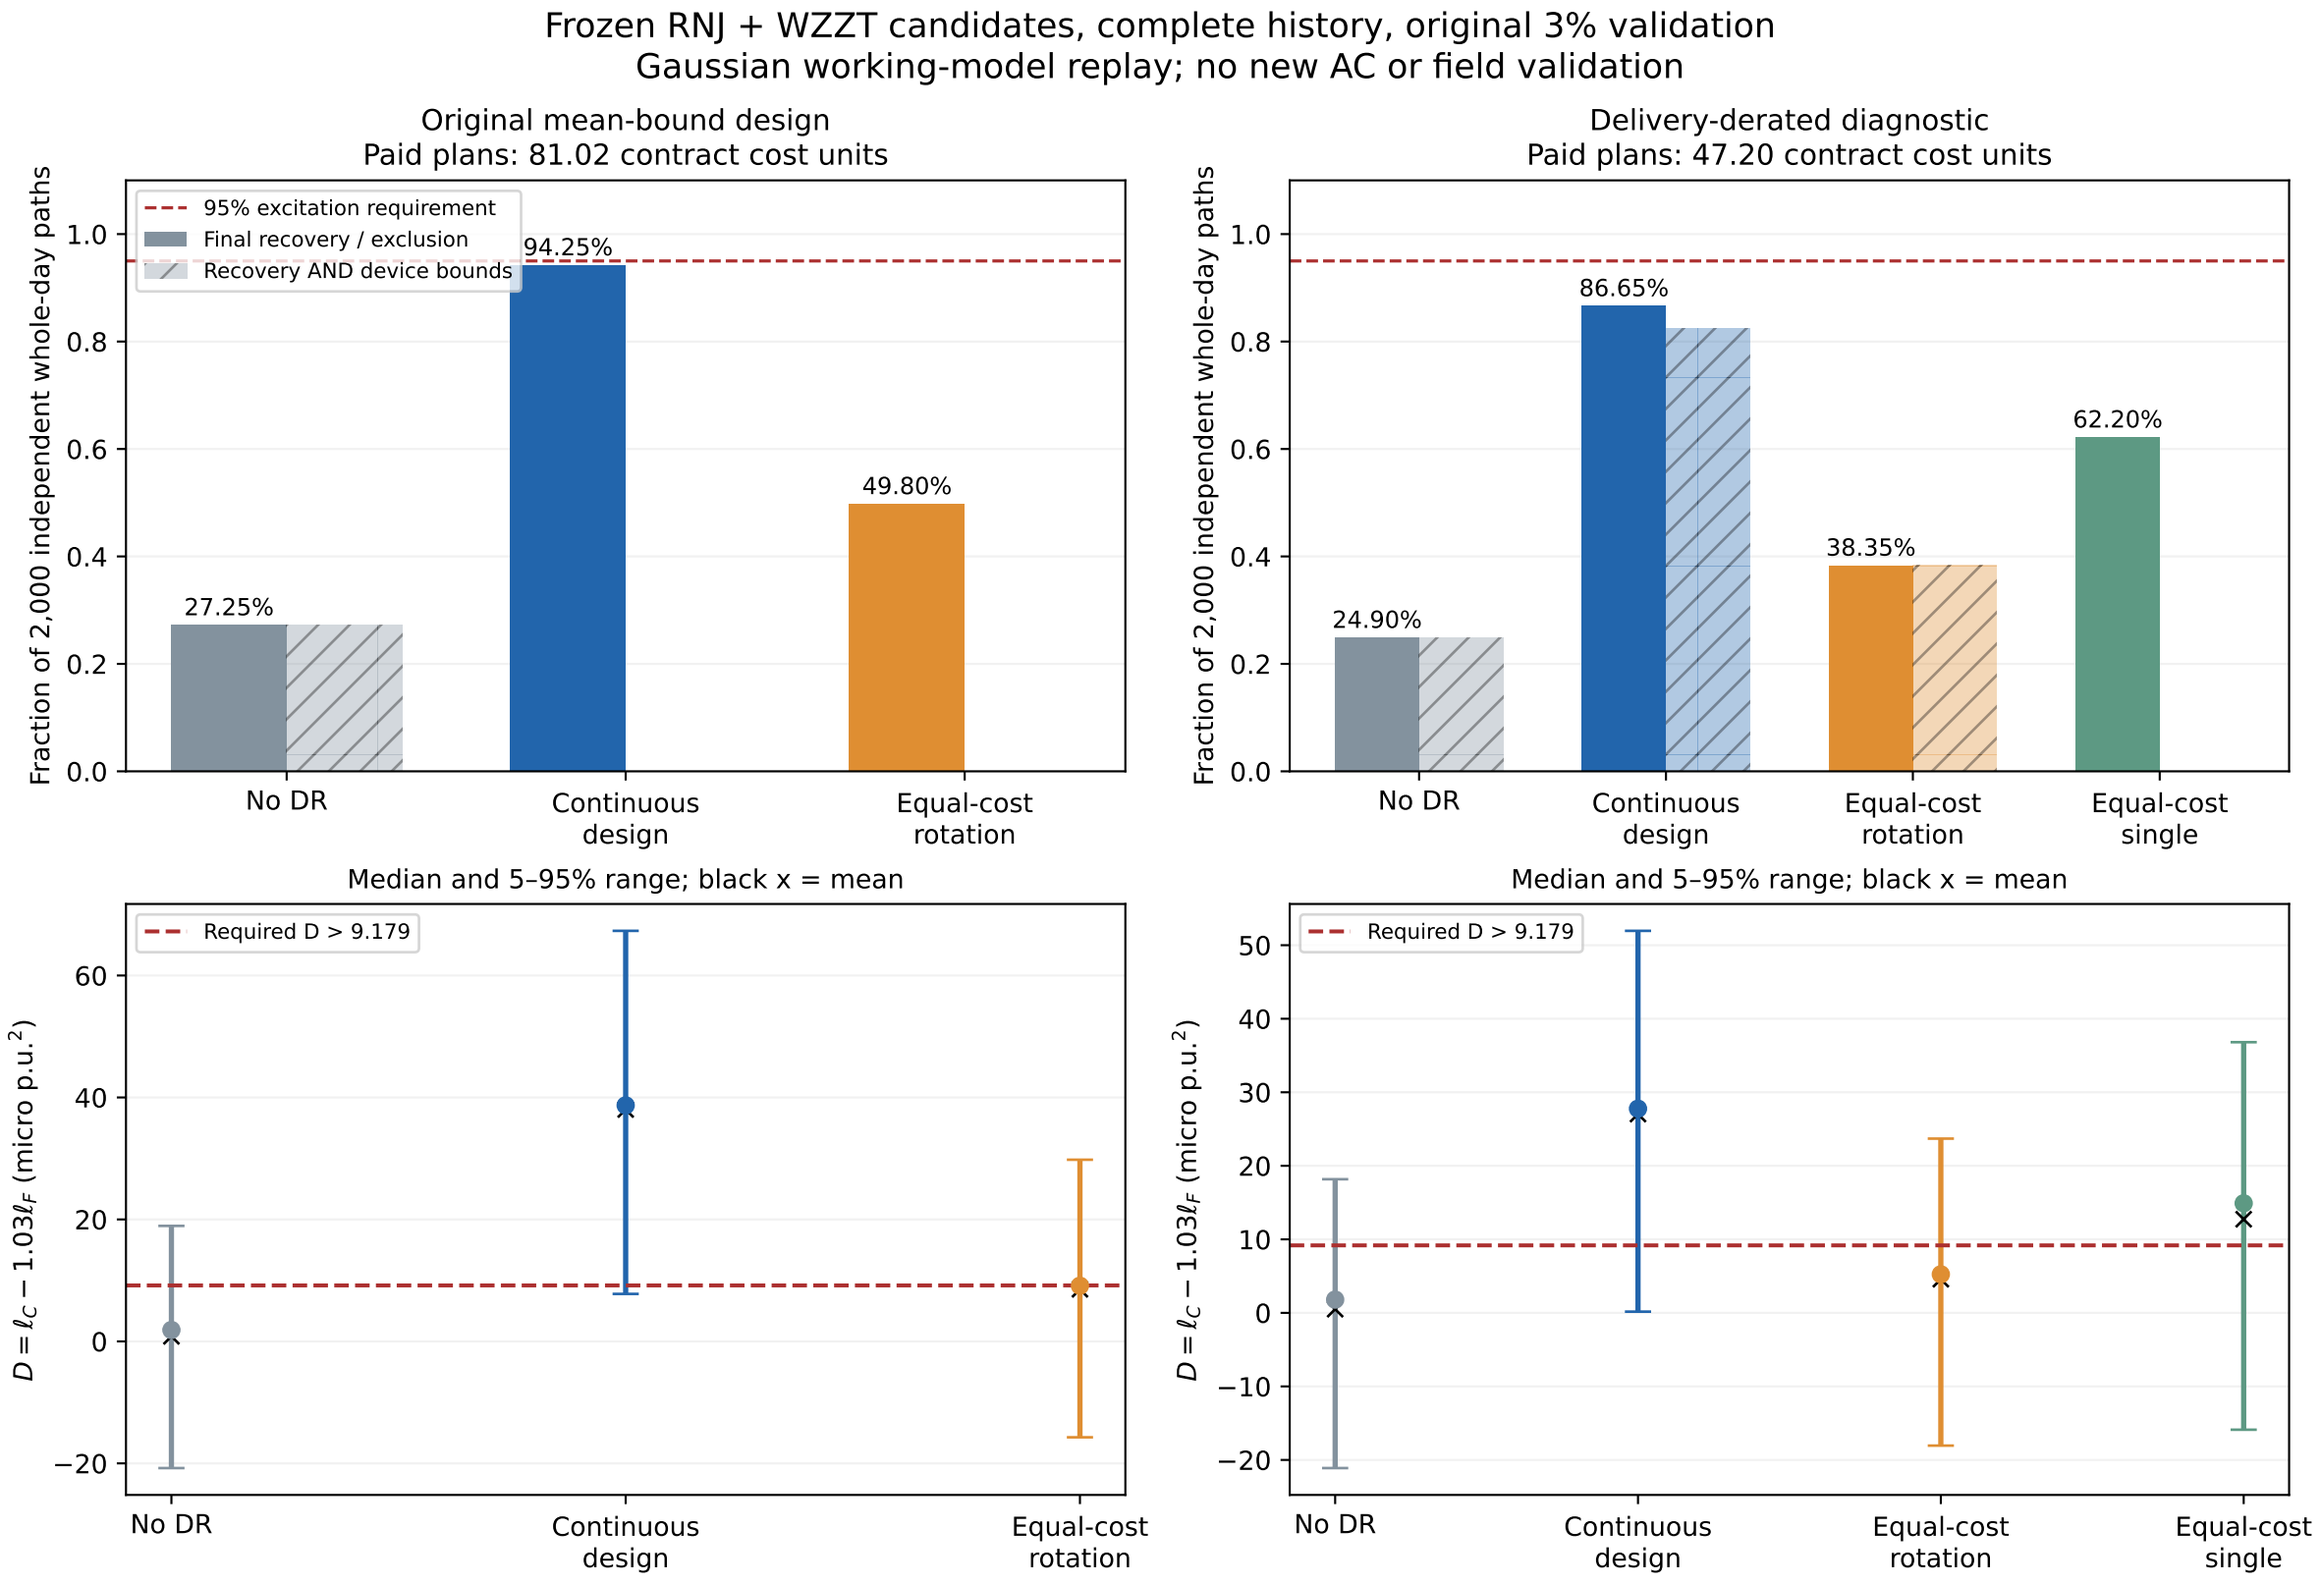
Frozen RNJ + WZZT candidates, complete history, original 3% validation
Gaussian working-model replay; no new AC or field validation
Original mean-bound design
Paid plans: 81.02 contract cost units
Delivery-derated diagnostic
Paid plans: 47.20 contract cost units
95% excitation requirement
Final recovery / exclusion
Recovery AND device bounds
Fraction of 2,000 independent whole-day paths
27.25%
94.25%
49.80%
24.90%
86.65%
38.35%
62.20%
No DR
Continuous design
Equal-cost rotation
Equal-cost single
Median and 5–95% range; black x = mean
Required D > 9.179
$D = \ell_C - 1.03\ell_F$ (micro p.u.$^2$)