



XHEZC.SP761 Firestop Systems

[Page Bottom](#)

Firestop Systems

[See General Information for Firestop Systems](#)

System No. SP761


July 16, 2007

(For Horizontal or Vertical Separations)

F Rating - 1-1/2 h

FT Rating - 0 and 3/4 h (See Item 2 and Item 6)

FH and FTH Ratings - 0 h

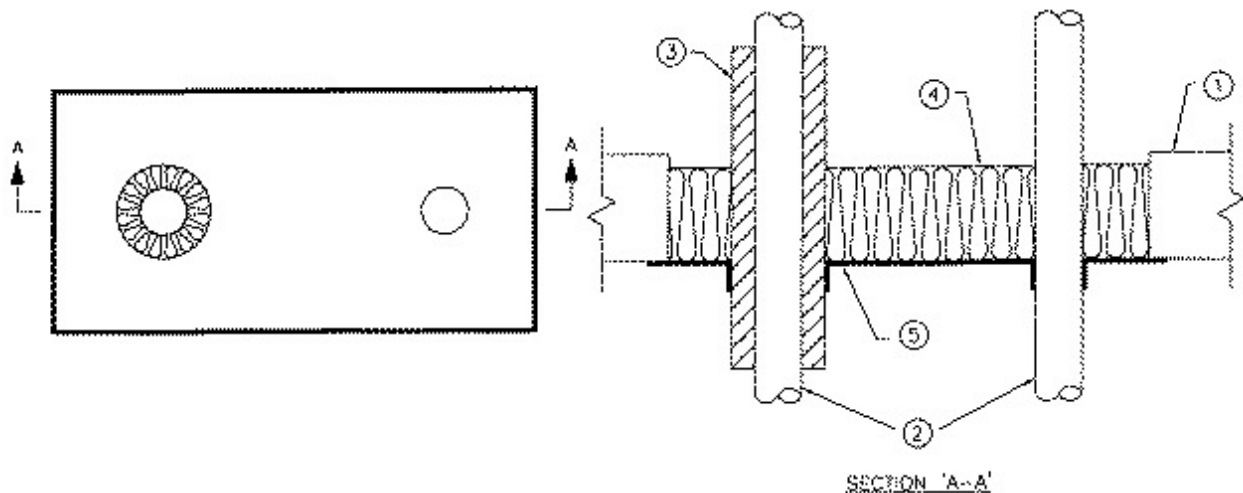

1. **Floor or Wall Assembly** — Minimum 115 mm thick reinforced concrete floor or wall of normal-density concrete. Wall may also be constructed of nominal 200 mm thick concrete block laid up with mortar. Maximum size of opening is 305 mm by 610 mm.

2. **Copper Pipe** — Nominal 50 mm diameter (or smaller), 1.6 mm wall thickness (or heavier) copper pipe, rigidly supported on both sides of opening. A maximum of two pipes may be installed within opening. Pipes to be installed minimum 250 mm apart and 76 mm from edge of opening. When pipe is wrapped with Pipe Insulation (Item 3), FT Rating is 3/4 h. Pipe may be installed concentrically within circular openings with a maximum annular space of 75 mm.

3. **Pipe Insulation** — Pipes (Item 2) may be wrapped with nominal 25 mm thick, nominal 64 kg/m³ density, ULC labelled fibreglass pipe insulation jacketed on the outside with an all service jacket. Longitudinal joints sealed with factory-applied, self-sealing lap tape. Transverse joints secured with butt strip tape supplied with the product.

4. **Batts and Blankets** — Mineral wool insulation, Type "A/D FIREBARRIER Mineral Wool", compressed 33% and installed within the opening to a minimum depth of 100 mm flush with bottom or top surface of floor. When extended pipe sleeves (item 6) are used, mineral wool insulation compressed 33% and installed within the opening to a minimum depth equal to the length of the sleeve.

A/D FIRE PROTECTION SYSTEMS INC

5. **Firestop System Components** — (XHJZC). Type "A/D FIREBARRIER Seal NS" sprayed to the bottom or top of assembly to cover mineral wool to a minimum wet thickness of 5 mm. Material is applied to overlap floor slab and pipe by minimum 25 mm. For vertical separations, material is applied symmetrically to both sides of the assembly. When extended pipe sleeves (item 6) are used, material applied to overlap completely the edges of the sleeves.

A/D FIRE PROTECTION SYSTEMS INC

6. **Pipe Sleeve** — (optional) - Nominal 250 mm diameter (or smaller), Schedule 40 (or heavier) steel pipe sleeve. When pipe sleeve is used, FT Rating is 0 h. The ends of the sleeve may project a maximum of 44 mm beyond both surfaces of floor or wall.

Last Updated on 2007-07-16

[Questions?](#)

[Print this page](#)

[Terms of Use](#)

[Page Top](#)

Copyright © 2016 Underwriters Laboratories of Canada Inc.

When the UL Leaf Mark is on the product, or when the word "Environment" is included in the UL Mark, please search the [UL Environment database](#) for additional information regarding this product's certification.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under ULC's Follow-Up Service. Only those products bearing the ULC Mark should be considered to be Listed and covered under ULC's Follow-Up Service. Always look for the Mark on the product.

ULC permits the reproduction of the material contained in the ULC Online Directories subject to the following conditions: 1. The Guide Information, Designs and/or Listings (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the ULC Online Directories with permission from Underwriters Laboratories of Canada Inc." must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "Copyright © 2016 Underwriters Laboratories of Canada Inc."

An independent organization working for a safer world with integrity, precision and knowledge.

