



XHEZC.SP764 Firestop Systems

[Page Bottom](#)

Firestop Systems

[See General Information for Firestop Systems](#)


System No. SP764

June 26, 2007

(For Horizontal or Vertical Separations)

FT and FTH Ratings - 0 and 3/4 h (See item 6)

F and FH Ratings - 1 h

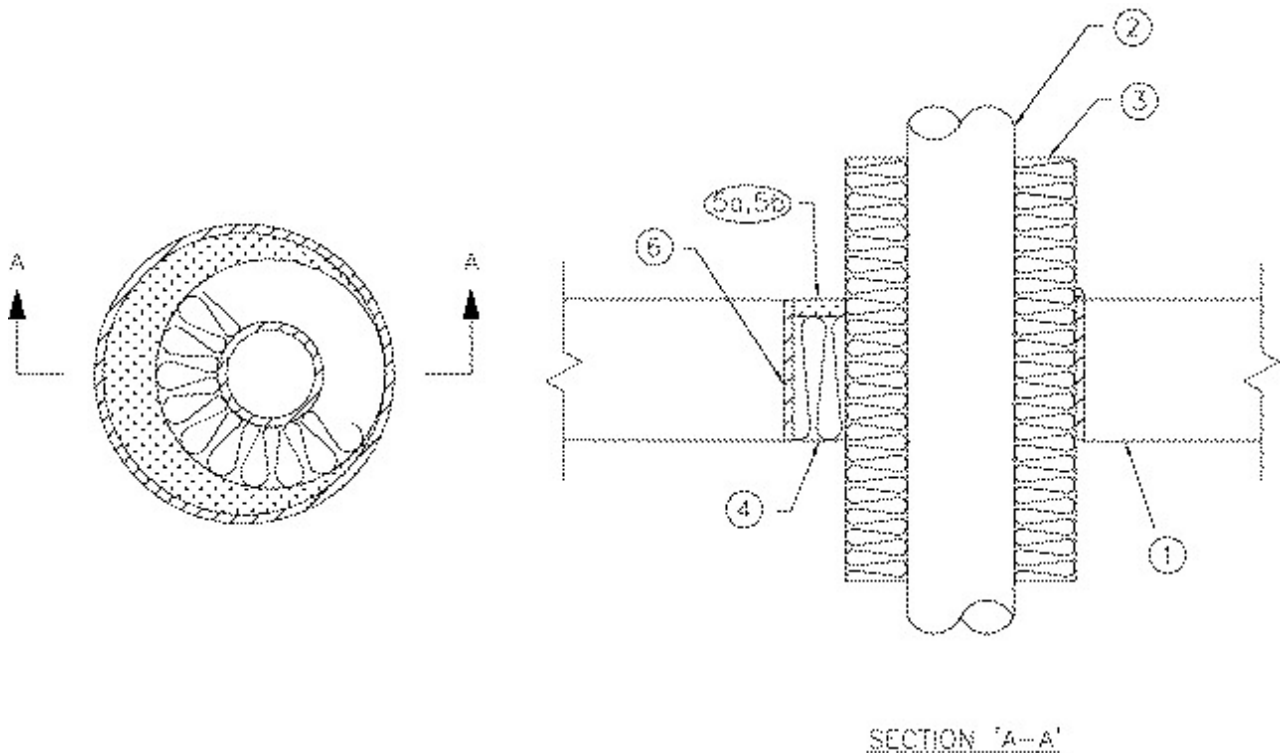

1. **Floor or Wall Assembly** — Minimum 115 mm thick reinforced concrete floor or wall of normal-density concrete. Floor may also be constructed of minimum 152 mm thick hollow-core precast concrete units having a fire resistance rating equal to or greater than that of the firestop system. Wall may also be constructed of nominal 200 mm thick concrete block laid up with mortar. Maximum size of opening is 250 mm diameter. When precast concrete units are used, maximum diameter of opening is 178 mm.

2. **Copper Pipe** — Nominal 100 mm diameter (or smaller), 1.6 mm thick (or heavier) copper pipe, reliably supported on both sides of opening. Pipe to be wrapped with Pipe Insulation (Item 3) and installed such that the annular space is 0 (point contact) to 50 mm maximum.

3. **Pipe Insulation** — Pipe to be wrapped with nominal 50 mm thick, nominal 64 kg/m³ density, ULC labelled fibreglass pipe insulation jacketed on the outside with an all service jacket. Longitudinal joints sealed with factory-applied, self-sealing lap tape. Transverse joints secured with butt strip tape supplied with the product.

4. **Batts and Blankets** — BZJZC. Mineral wool insulation, Type "A/D Firebarrier Mineral Wool", compressed 33% and installed within the opening to a minimum depth of 100 mm recessed 13 mm from top surface of floor or both surfaces of wall. When extended pipe sleeves (item 6) are used, mineral wool insulation compressed 33% and installed within the

opening to a minimum depth equal to the length of the sleeve. Mineral wool recessed 13 mm from the top of the sleeve installed in a floor or 13 mm from both sides of the sleeve installed in a wall.

A/D FIRE PROTECTION SYSTEMS INC

- **5. Firestop System Components** — (XHJZC). The firestop system shall consist of the following:

(a) Type "A/D FIREBARRIER Silicone Sealant" caulk grade, applied to top of mineral wool insulation to a minimum depth of 13 mm. In floors constructed of hollow-core precast concrete units, silicone sealant installed symmetrically on both sides of floor. Additional material to be installed to form a crown bead of 6.4 mm at the point contact location between penetrating item and edge of opening. For vertical installations, sealant to be applied symmetrically on both sides of wall.

(b) Type "A/D FIREBARRIER Silicone Sealant S/L", for horizontal installations only (with the exception of hollow-core precast concrete units), applied to top of mineral wool insulation to a minimum depth of 13 mm. Additional caulk grade material (Item 4a) installed to form a crown bead of 6.4 mm at the point contact location between penetrating item and edge of opening.

A/D FIRE PROTECTION SYSTEMS INC

- 6. Pipe Sleeve** — (optional) - Nominal 250 mm diameter (or smaller), Schedule 40 (or heavier) steel pipe sleeve cast or grouted into floor or wall assembly flush with floor or wall surfaces. The ends of the sleeve may project a maximum of 44 mm beyond both surfaces of floor or wall. When sleeve projects beyond surface of floor or wall, FT and FTH Rating is 0 h.

Last Updated on 2007-06-26

[Questions?](#)

[Print this page](#)

[Terms of Use](#)

[Page Top](#)

Copyright © 2016 Underwriters Laboratories of Canada Inc.

When the UL Leaf Mark is on the product, or when the word "Environment" is included in the UL Mark, please search the [UL Environment database](#) for additional information regarding this product's certification.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under ULC's Follow-Up Service. Only those products bearing the ULC Mark should be considered to be Listed and covered under ULC's Follow-Up Service. Always look for the Mark on the product.

ULC permits the reproduction of the material contained in the ULC Online Directories subject to the following conditions: 1. The Guide Information, Designs and/or Listings (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the ULC Online Directories with permission from Underwriters Laboratories of Canada Inc." must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "Copyright © 2016 Underwriters Laboratories of Canada Inc."

An independent organization working for a safer world with integrity, precision and knowledge.

