



System No. W-L-2155 XHEZ.W-L-2155 Through-penetration Firestop Systems

[Page Bottom](#)

Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

XHEZ - Through-penetration Firestop Systems


[See General Information for Through-penetration Firestop Systems](#)

System No. W-L-2155

December 20, 2013

F Rating — 2 Hr

T Rating — 1-1/2 and 2 Hr (See Item 2)

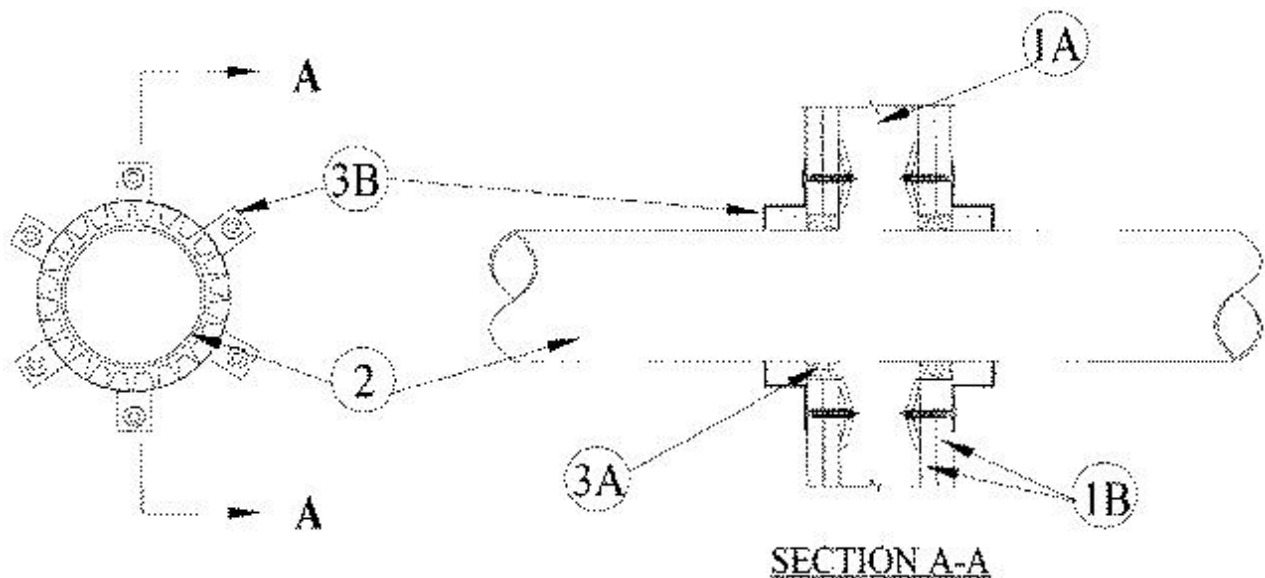

1. Wall Assembly — The 2 hr fire-rated gypsum wallboard/stud wall assembly shall be constructed of the materials and in the manner specified in the individual U300 or U400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:

A. Studs — Wall framing may consist of either wood studs or steel channel studs. Wood studs to consist of nom 2 by 4 in. lumber spaced 16 in. OC. Steel studs to be min 3-5/8 in. wide and spaced max 24 in. OC.

B. Gypsum Board* — 1/2 in. thick, 4 ft wide with square or tapered edges. The gypsum wallboard type, thickness, number of layers, fastener type and sheet orientation shall be as specified in the individual U300 or U400 Series Design in the UL Fire Resistance Directory. Max diam of opening is 7-1/8 in.

2. Through Penetrants — One nonmetallic pipe or conduit centered within the firestop system. The annular space between the pipe or conduit and the periphery of the opening shall be a nom 1/4 in. Pipe or conduit to be rigidly supported on both sides of wall. The following types and sizes of pipes or conduits may be used:

A. **Polyvinyl Chloride (PVC) Pipe** — Nom 6 in. diam (or smaller) Schedule 40 solid core PVC pipe for use in closed (process or supply) or vented (drain, waste, or vent) piping systems.

B. **Chlorinated Polyvinyl Chloride (CPVC) Pipe** — Nom 6 in. diam (or smaller) SDR 17 CPVC pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.

C. **Rigid Nonmetallic Conduit+** — Nom 6 in. diam (or smaller) Schedule 40 PVC conduit installed in accordance with Article 347 of the National Electrical Code, (NFPA No. 70).

The T Rating of the firestop system is dependent upon the nom diam of the through penetrant as shown in the table below:

Nom Diam of Through Penetrant In.	T Rating Hr
6	2
4	1-1/2
3	1-1/2

3. Firestop System — The firestop system shall consist of the following:

A. **Fill, Void or Cavity Material* — Sealant** — Min 1 in. thickness applied within annulus, flush with both surfaces of wall. For through penetrants having a nom diam 4 in. or less, the sealant is optional.

A/D FIRE PROTECTION SYSTEMS INC — A/D FireBarrier Silicone

B. **Firestop Device*** — Galv steel sleeve lined with an intumescent material sized to fit the specific diam of the through penetrant. Device to be wrapped around outer circumference of through penetrant and secured together in accordance with the installation instructions supplied with the product. Device incorporates anchor tabs for securement to each surface of wall assembly by means of 1/8 in. diam by 3 in. long molly bolts in conjunction 1/4 in. by 3/4 in. diam steel washers and 1/4 in. diam by 1-1/4 in. steel fender washers.

A/D FIRE PROTECTION SYSTEMS INC — A/D FIREBARRIER Collar

*Bearing the UL Classification Marking

+Bearing the UL Listing Mark

Last Updated on 2013-12-20

[Questions?](#)

[Print this page](#)

[Terms of Use](#)

[Page Top](#)

© 2017 UL LLC

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2017 UL LLC".