


System No. C-AJ-1299

June 09, 2003

F Rating — 2 Hr

T Rating — 0 Hr

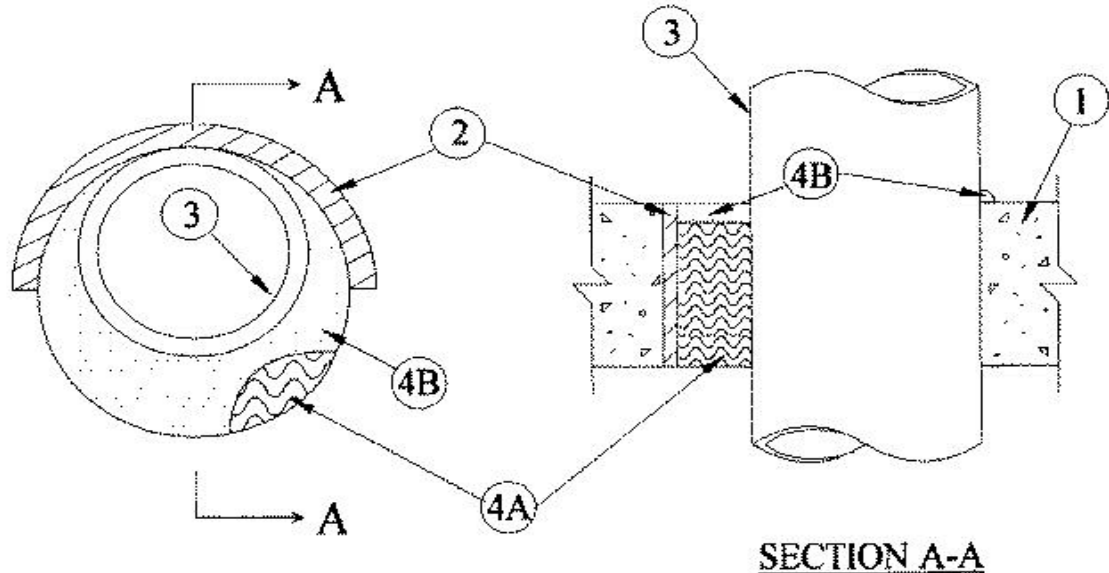

1. **Floor or Wall Assembly** — Min 4-1/2 in. thick reinforced normal weight (140-150 pcf) concrete floor or min 5 in. thick reinforced normal weight concrete wall. Floor may also be constructed of any min 6 in. thick UL Classified hollow-core **Precast Concrete Units***. Wall may also be constructed of any UL Classified **Concrete Blocks***. Max diam of opening is 20 in. If the firestop system is installed within a hollow-core precast concrete unit, max diam of opening shall be 7 in.

See **Concrete Blocks** (CAZT) and **Precast Concrete Units** (CFTV) categories in the Fire Resistance Directory for names of manufacturers.

2. **Metallic Sleeve** — (Optional) — Nom 20 in. diam (or smaller) Schedule 40 (or heavier) steel sleeve cast or grouted into floor or wall assembly, flush with floor or wall surfaces.

3. **Through Penetrant** — One metallic pipe or conduit to be installed either concentrically or eccentrically within the firestop system. The annular space between pipe or conduits and periphery of opening shall be min 0 in. (point contact) to max 3-1/4 in. Pipe or conduit to be rigidly supported on both sides of floor or wall assembly. The following types and sizes of metallic pipes or conduits may be used:

A. **Steel Pipe** — Nom 16 in. diam (or smaller) Schedule 40 (or heavier) steel pipe.

B. **Iron Pipe** — Nom 16 in. diam (or smaller) cast or ductile iron pipe.

C. **Conduit** — Nom 4 in. diam (or smaller) steel electrical metallic tubing or nom 6 in.

diam steel conduit.

4. Firestop System — The firestop system shall consist of the following:

A. Packing Material — Min 4 in. thickness of min 4 pcf mineral wool batt insulation firmly packed into opening as a permanent form. Packing material to be recessed from top surface of floor or from both surfaces of wall as required to accommodate the required thickness of fill material. When the floor is constructed of hollow-core precast concrete units, packing material shall be recessed from both surfaces of floor to accommodate the required thickness of fill material.

B. Fill, Void or Cavity Material* — Sealant — Min 1/2 in. thickness of fill material applied within the annulus, flush with top surface of floor or with both surfaces of wall assembly. When the floor is constructed of hollow-core precast concrete units, fill material shall be installed symmetrically on both sides of floor, flush with both floor surfaces. At the point contact location between through penetrant and concrete, a min 3/8 in. diam bead of fill material shall be applied at the concrete/through penetrant interface on the top surface of concrete floor and on both surfaces of wall and hollow-core precast concrete units.

A/D FIRE PROTECTION SYSTEMS INC — A/D FireBarrier Silicone S/L (for floors only) and A/D FireBarrier Silicone (for floors, hollow-core precast concrete units and walls).

(For bead at point contact location between concrete and through penetrant, A/D FireBarrier Silicone only.)

*Bearing the UL Classification Mark