



## XHEZC.SP759 Firestop Systems

[Page Bottom](#)

### Firestop Systems

[See General Information for Firestop Systems](#)


## System No. SP759

November 23, 2004

(For Horizontal or Vertical Separations)

**F and FH Ratings - 2 h**

**FT and FTH Ratings - 0 h**

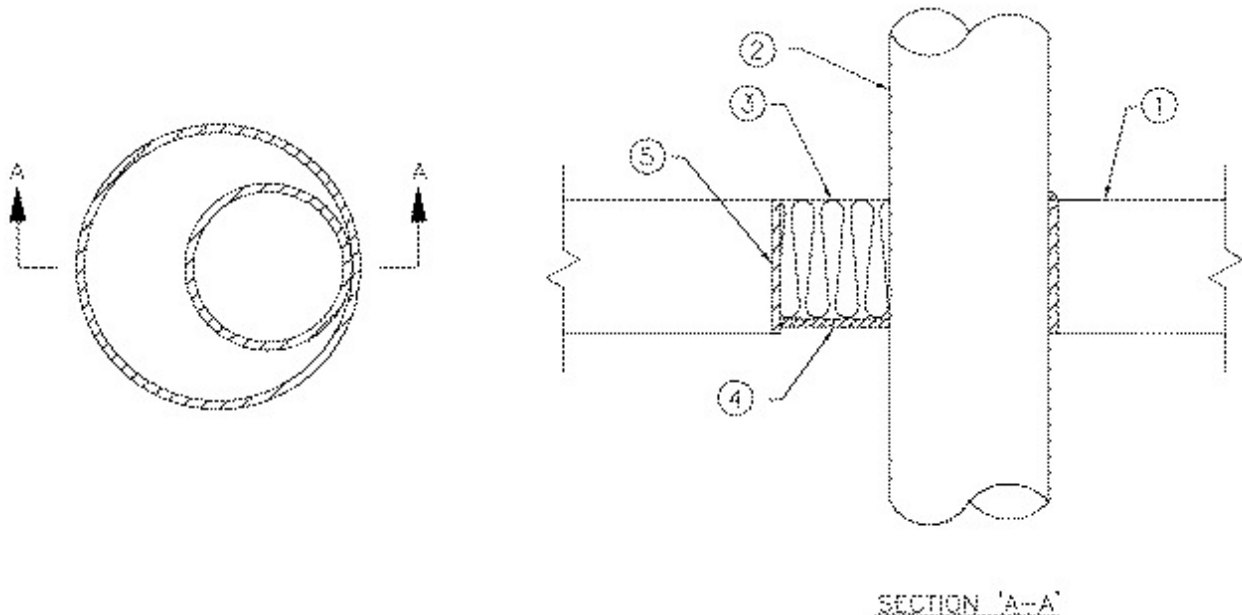

1. **Floor or Wall Assembly** — Minimum 115 mm thick reinforced concrete floor or all of normal-density concrete or precast hollow core floor and/or hollow precast concrete masonry units having a fire resistance equal to or greater than that of the assembly. Wall may also be constructed of nominal 200 mm thick concrete block laid up with mortar. Maximum size of opening is 305 mm diameter.

2. **Pipe** — Nominal 204 mm OD (or smaller), Schedule 40 (or heavier) steel pipe, or cast or ductile iron pipe, nominal 204 mm OD, reliably supported on both sides of opening. Pipe installed such that the annular space is 0 (point contact) to 85 mm maximum.

3. **Batts and Blankets** — Mineral wool insulation, Type "A/D FIREBARRIER Mineral Wool", compressed 33% and installed within the opening to a minimum depth of 100 mm and recessed 13 mm from bottom or top surface of slab or both sides of wall.

#### A/D FIRE PROTECTION SYSTEMS INC

4. **Firestop System Components** — (XHJZC). Type "A/D FIREBARRIER Seal NS" sealant applied to bottom or top of mineral wool insulation to a minimum wet thickness of 5 mm. Additional material installed to form a crown of 5 mm around the circumference of the pipe at the point contact where the pipe contacts the edge of opening. For vertical installations, sealant to be applied symmetrically on both sides of wall.

#### A/D FIRE PROTECTION SYSTEMS INC

5. **Pipe Sleeve** — (optional) - Nominal 305 mm OD, Schedule 40 (or heavier) steel pipe sleeve cast or grouted into floor or wall assembly flush with floor or wall surfaces.

Last Updated on 2004-11-23

---

[Questions?](#)

[Print this page](#)

[Terms of Use](#)

[Page Top](#)

Copyright © 2016 Underwriters Laboratories of Canada Inc.

When the UL Leaf Mark is on the product, or when the word "Environment" is included in the UL Mark, please search the [UL Environment database](#) for additional information regarding this product's certification.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under ULC's Follow-Up Service. Only those products bearing the ULC Mark should be considered to be Listed and covered under ULC's Follow-Up Service. Always look for the Mark on the product.

ULC permits the reproduction of the material contained in the ULC Online Directories subject to the following conditions: 1. The Guide Information, Designs and/or Listings (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the ULC Online Directories with permission from Underwriters Laboratories of Canada Inc." must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "Copyright © 2016 Underwriters Laboratories of Canada Inc."

An independent organization working for a safer world with integrity, precision and knowledge.

