



System No. W-J-5165 XHEZ.W-J-5165 Through-penetration Firestop Systems

[Page Bottom](#)

Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

XHEZ - Through-penetration Firestop Systems

XHEZ7 - Through-penetration Firestop Systems Certified for Canada


[See General Information for Through-penetration Firestop Systems](#)

[See General Information for Through-penetration Firestop Systems Certified for Canada](#)

System No. W-J-5165


June 02, 2016

ANSI/UL1479 (ASTM E814)	CAN/ULC S115
F Rating — 2 Hr	F Rating —2 Hr
T Ratingss — 0, 1/2 and 1 Hr (See Item 5)	FT Ratings —0, 1/2 and 1 Hr (See Item 5)
L Rating at Ambient — Less Than 1 CFm/sq ft	FH Rating —2 Hr
	FTH Ratings —0, 1/2 and 1 Hr (See Item 5)
	L Rating at Ambient —Less Than 1 CFm/sq ft

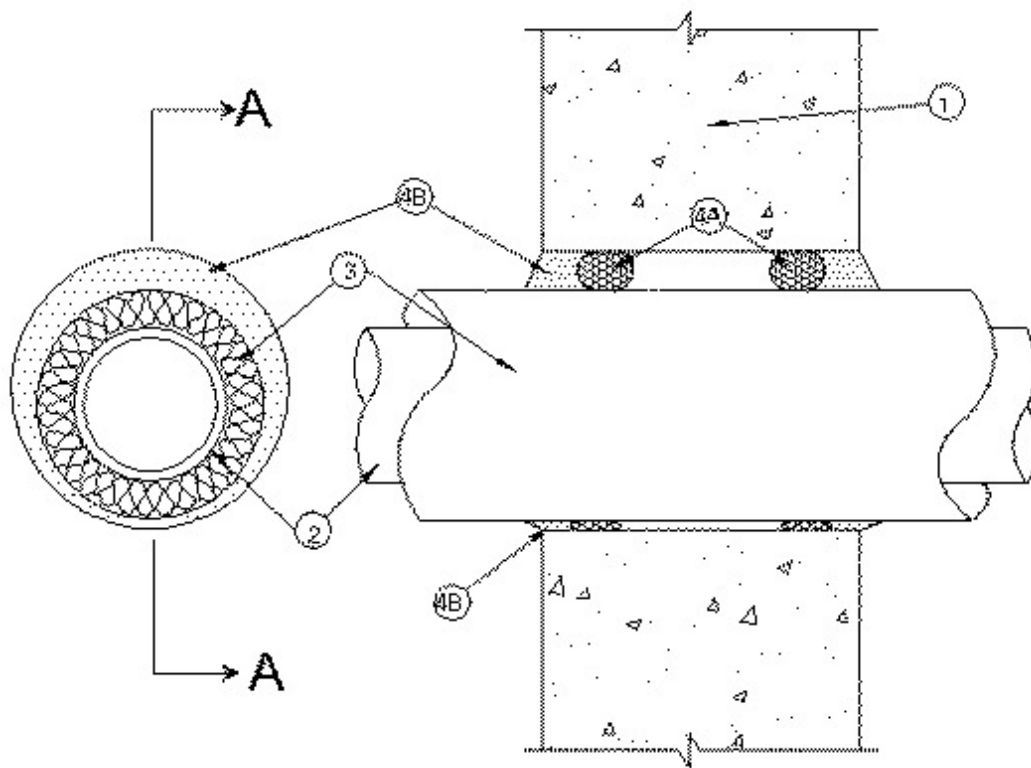

SECTION A-A

FIRESTOP CONFIGURATION A

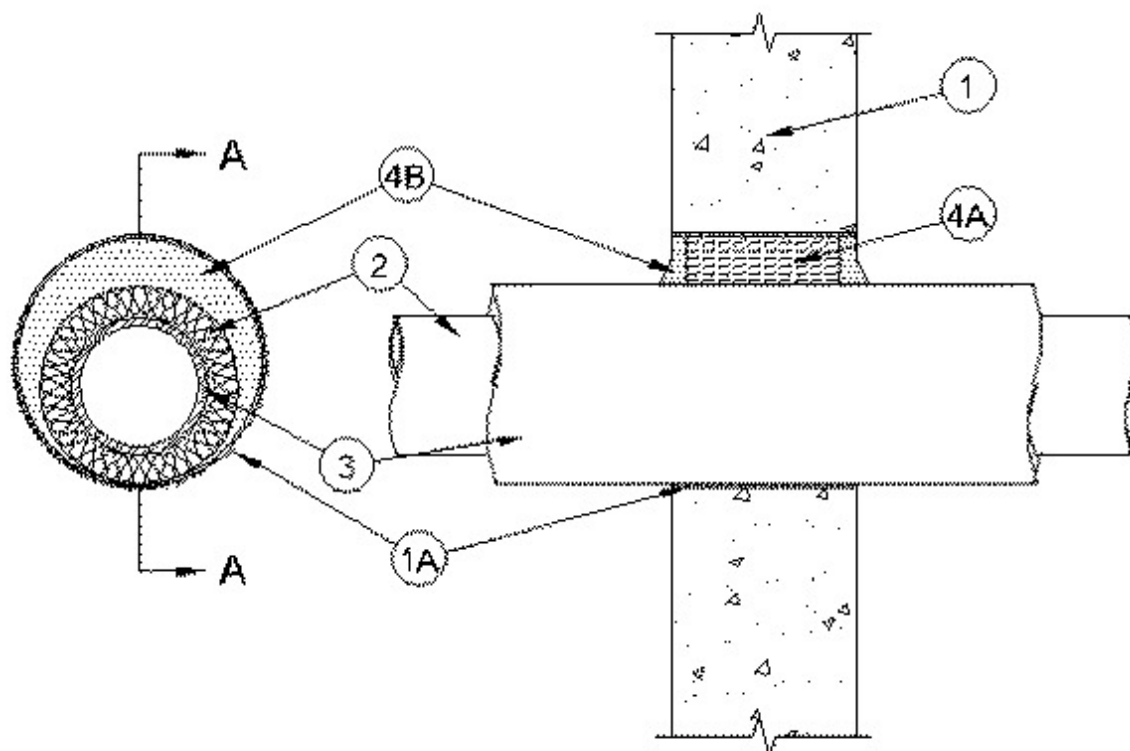

SECTION A-A

FIRESTOP CONFIGURATION B

1. **Wall Assembly** — Min 6 in. (152 mm) thick reinforced lightweight or normal weight (100-150 pcf (1600-2400 kg/m³) concrete. Wall may also be constructed of any UL Classified **Concrete Blocks***. Max diam of opening is 12 in. (305 mm).

See **Concrete Blocks** (CAZT) category in the Fire Resistance Directory for names of manufacturers.

1A. **Steel Sleeve** — (See Table in Item 4.) Nom. 8 in. (203 mm) diam (or smaller) Schedule 10 (or heavier) steel pipe sleeve friction fit in wall assembly, or max 12 in. (305 mm) diam cylindrical sleeve fabricated from min 0.013 in. (0.33 mm) to max 0.056 in. (1.4 mm) thick galv steel sheet and having a min 1 in. (25 mm) lap along the longitudinal seam. Length of sleeve flush with both walls. Cylindrical sleeve to be installed by coiling the sheet metal to a diam smaller than the through opening, inserting the coil through the opening and releasing the coil to let it uncoil against the circular cutout in the wall.

2. **Through Penetrants** — One metallic pipe or tubing to be installed either concentrically or eccentrically within the firestop system. Pipe or tubing to be rigidly supported on both sides of wall assembly. The following types and sizes of metallic pipes of tubing may be used:

- A. **Steel Pipe** — Nom 8 in. (203 mm) diam (or smaller) Schedule 10 (or heavier) steel pipe.
- B. **Iron Pipe** — Nom 8 in. (203 mm) diam (or smaller) cast or ductile iron pipe.
- C. **Copper Tubing** — Nom 4 in. (102 mm) diam (or smaller) Type L (or heavier) copper tubing.
- D. **Copper Pipe** — Nom 4 in. (102 mm) diam (or smaller) Regular (or heavier) copper pipe.

3. **Pipe Covering*** — Nom 1 in. (25 mm) thick hollow cylindrical heavy density (min 3.5 pcf or 56 kg/m³) glass fiber units jacketed on the outside with an all service jacket. Longitudinal joints sealed with metal fasteners or factory-applied self-sealing lap tape. Transverse joints secured with metal fasteners or with butt tape supplied with the product. See Table in Item 4 for annular space required between insulated penetrant and periphery of opening.

See **Pipe and Equipment Covering-Materials** (BRGU) category in the Building Materials Directory for names of manufacturers. Any pipe covering material meeting the above specifications and bearing the UL Classification Marking with a Flame Spread Index of 25 or less and a Smoke Developed Index of 50 or less may be used.

4. **Firestop System** — The firestop system shall consist of the following:

A. **Packing Material** — (Optional, See Table in Item 4) — Foam backer rod firmly packed into the opening as a permanent form. Packing material to be recessed from both surfaces of wall as required to accommodate the required thickness of fill material.

A1. **Packing Material** — (See Table in Item 4) Min 4 pcf (64 kg/m³) mineral wool batt insulation firmly packed into opening as a permanent form. Packing material to be recessed from both surfaces of wall as required to accommodate the required thickness of fill material.

B. **Fill, Void or Cavity Material* — Caulk** — Fill material applied within the annulus, flush with both surfaces of wall or overlapping min 1/4 in. onto wall surfaces when the steel sleeve is used. See Table below for min thickness of fill material. Additional fill material to be installed such that a min 3/8 in. (10 mm) crown is formed around the penetrating item.

A/D FIRE PROTECTION SYSTEMS INC — A/D FIREBARRIER Intumescent Sealant, A/D FIREBARRIER Intumescent SealantII

Sleeve	Packing Matl	Min Annular	Max Annular	Min Fill Matl Thick	T Rating
None	Opt Foam Backer	1/4 in. (6 mm)	1-1/4 in. (32 mm)	1 in. (25 mm)	1 hr
Sch 10	Mineral Wool	0 in. (point contact)	1-9/16 in. (40 mm)	1/2 in. (13 mm)	0 hr
Cylindrical	Mineral Wool	0 in. (point contact)	1-9/16 in. (40 mm)	1/2 in. (13 mm)	0 hr
Cylindrical	Opt Foam Backer	0 in. (point contact)	1-3/8 in. (35 mm)	5/8 in. (16 mm)	1/2 hr

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2017 UL LLC".