



**System No. FW-D-0076**  
**XHBN7.FW-D-0076**  
**Joint Systems Certified for Canada**

[Page Bottom](#)

**Design/System/Construction/Assembly Usage Disclaimer**

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

**XHBN - Joint Systems**

**XHBN7 - Joint Systems Certified for Canada**


[See General Information for Joint Systems](#)

[See General Information for Joint Systems Certified for Canada](#)

**System No. FW-D-0076**

June 06, 2016

ANSI/UL2079	CAN/ULC S115
Assembly Ratings — 4 Hr	F Rating — 4 Hr
Nominal Joint Width — 2 in.	FT Rating —4 Hr
Class II or III Movement Capabilities — 12.5% Compression and Extension	FH Rating —4 Hr
L Rating At Ambient — Less than 1 CFM/Lin. Ft.	FTH Rating —4 Hr
L Rating At 400°F — Less than 1 CFM/Lin Ft.	Nominal Joint Width —2 in.
	Class II or III Movement Capabilities —12.5% Compression and Extension
	L Rating At Ambient — Less than 1 CFM/Lin. Ft.
	L Rating At 400°F — Less than 1 CFM/Lin Ft.

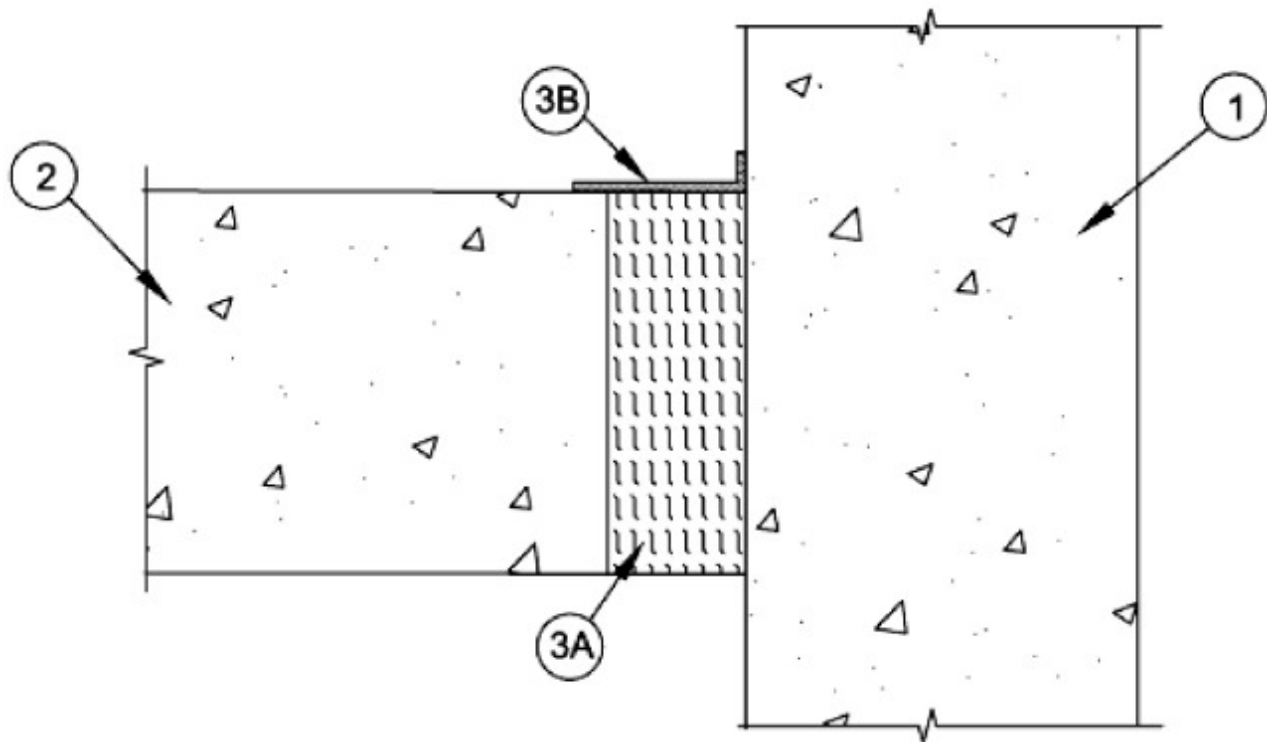

1. **Floor Assembly** — Min 5-1/2 in. (140 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/cu meter) concrete. Wall may also be constructed of any UL Classified **Concrete Blocks\***.

See **Concrete Blocks** (CAZT) category in the Fire Resistance Directory for names of manufacturers.

2. **Floor Assembly** — Min 5-1/2 in. (140 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m<sup>3</sup>) structural concrete.

3. **Joint System** — **Max width of joint (at time of installation of joint system) is 2 in. (51 mm). The joint system is designed to accommodate a max 12.5 percent compression or extension from its installed width.** The joint system shall consist of forming and fill materials, as follows:

A. **Forming Material\*** — Min 4 pcf (64 kg/m<sup>3</sup>) mineral wool batt insulation installed in joint opening as a permanent form. Pieces of batt cut to min 5-1/2 in. (140 mm) width and installed edge-first into joint opening, parallel with joint direction, such that batt sections are compressed min 50 percent in thickness and such that the compressed batt sections are installed flush with top surface of floor. Adjoining lengths of batt to be tightly butted with butted seams spaced min 36 in. (914 mm) apart along the length of the joint.

**ROCK WOOL MANUFACTURING CO** — Delta Safing Board

**THERMAFIBER INC** — SAF Mineral Wool

B. **Fill, Void or Cavity Material\* - Sealant** — Min 1/8 in. (3 mm) wet thickness (1/16 in. or 2 mm dry thickness) of fill material applied to completely cover surface of mineral wool and lap 1 in. (25 mm) onto concrete at both sides of joint at top surface of floor.

**A/D FIRE PROTECTION SYSTEMS INC** — A/D FIREBARRIER Spray Acrylic

**\* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

Last Updated on 2016-06-06

[Questions?](#)

[Print this page](#)

[Terms of Use](#)

[Page Top](#)

© 2016 UL LLC

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2016 UL LLC".