



## XHEZC.SP918 Firestop Systems

[Page Bottom](#)

### Firestop Systems

[See General Information for Firestop Systems](#)


## System No. SP918

October 04, 2005

(For Horizontal or Vertical Separations)

**F and FH Ratings — 3 h**

**FT and FTH Ratings — 1-1/2 h**

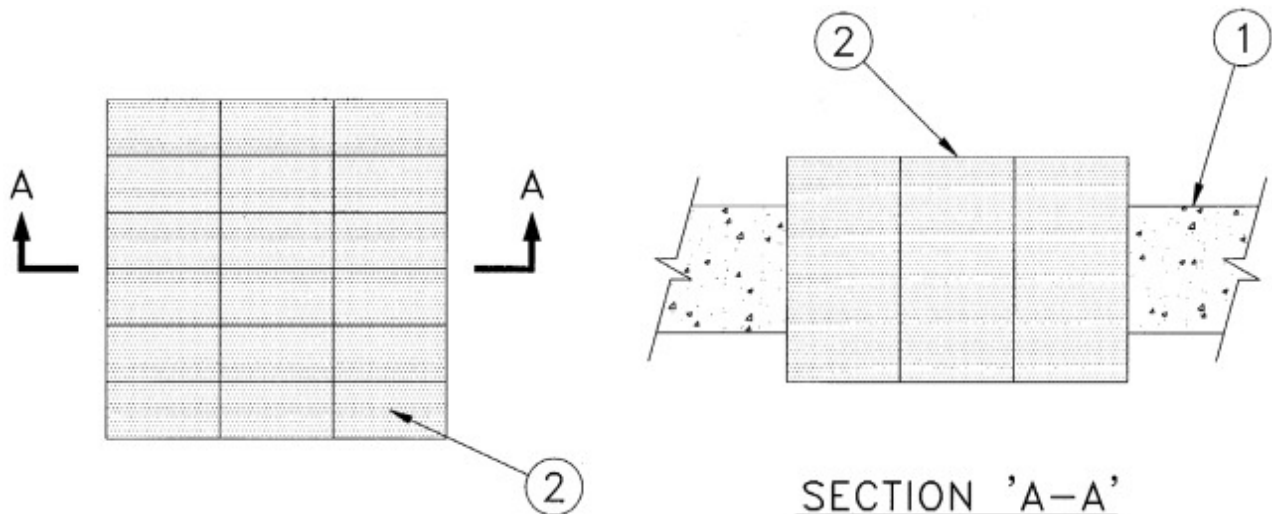

1. **Floor or Wall** — Min depth or thickness as necessary for required grade of fire separation but not less than 115 mm. Normal-density ( $2400 \pm 50 \text{ kg/m}^3$ ) concrete floor or wall, or nom 200 mm concrete block wall. Max size of opening 305 mm by 610 mm. For opening in concrete block wall, concrete or mortar shall be used to create a solid surround to the opening.

2. **Cable Tray** — Max 305 mm wide by 92 mm deep open ladder cable tray formed from 1.22 mm galvanized steel and with rungs 104 mm wide and spaced 254 mm OC. A max of one cable tray per opening with a min separation of 38 mm between cable tray and periphery of opening.

3. **Cables** — Max cable fill of 2-1/2%. The following type of cables may be used:

- (a) Max 4 bundles of 7 cables, each with 3 pair 24 AWG Type D, telephone cables.
- (b) Max 2 lengths of double stranded fibre optic cables, 3.0 mm by 6.1 mm.
- (c) Max 1 length of co-axial cable, 6.1 mm OD, 22 AWG solid copper conductor.
- (d) Max 1 length of E1189637, 24 AWG Type CMR or MPR, FT4 ABJI 289 861.

■ 4. **Firestop System Component** — (XHJZC). "A/D FIREBARRIER Pillows", tightly packed into the opening to a min compression of 25% and installed in accordance with manufacturer's instructions. Pillows to be installed vertically within the opening in floor and horizontally within the opening in wall. Pillows to be installed centered within floor or wall.

**A/D FIRE PROTECTION SYSTEMS INC**

[Last Updated](#) on 2005-10-04

When the UL Leaf Mark is on the product, or when the word "Environment" is included in the UL Mark, please search the [UL Environment database](#) for additional information regarding this product's certification.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under ULC's Follow-Up Service. Only those products bearing the ULC Mark should be considered to be Listed and covered under ULC's Follow-Up Service. Always look for the Mark on the product.

ULC permits the reproduction of the material contained in the ULC Online Directories subject to the following conditions: 1. The Guide Information, Designs and/or Listings (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the ULC Online Directories with permission from Underwriters Laboratories of Canada Inc." must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "Copyright © 2016 Underwriters Laboratories of Canada Inc."

An independent organization working for a safer world with integrity, precision and knowledge.

