



System No. W-J-2050 XHEZ.W-J-2050 Through-penetration Firestop Systems

[Page Bottom](#)

Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

XHEZ - Through-penetration Firestop Systems


[See General Information for Through-penetration Firestop Systems](#)

System No. W-J-2050

November 05, 1998

F Rating — 2 Hr

T Rating — 1 Hr

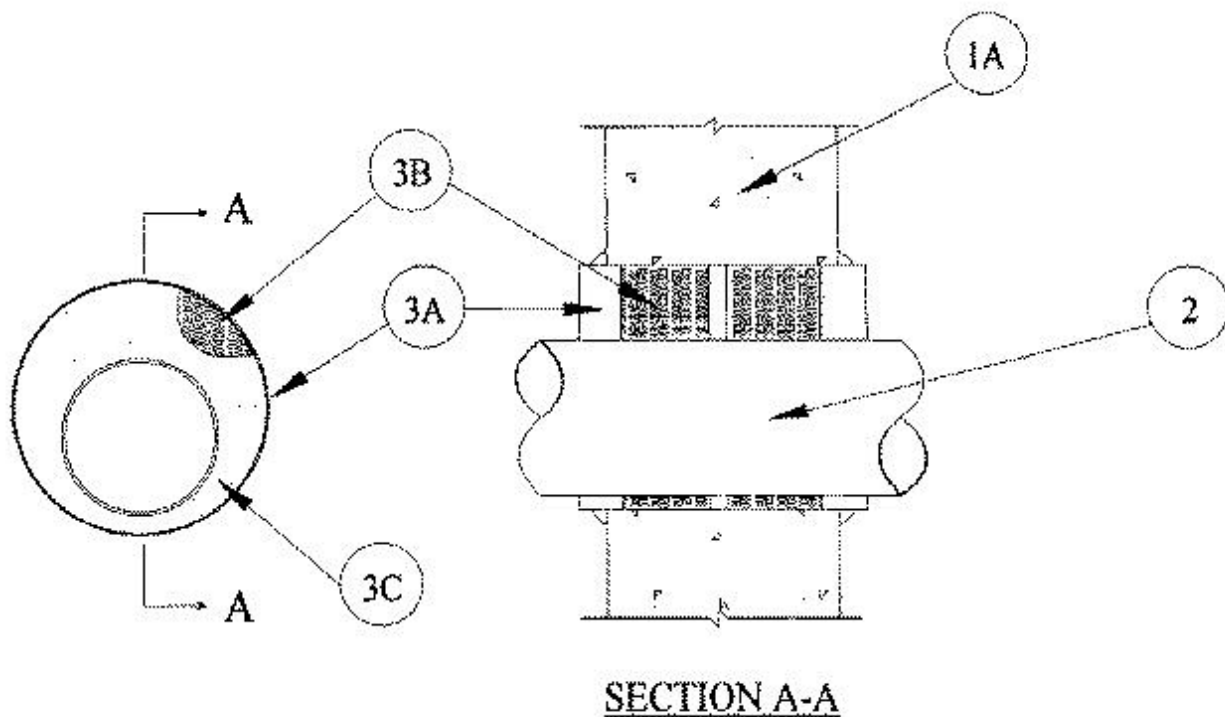

1. **Wall Assembly** — Min 6 in. thick reinforced lightweight or normal weight (100-150 pcf) concrete. Wall may also be constructed of any UL Classified **Concrete Blocks***. Max diam of opening is 4 in.

See **Concrete Block** (CAZT) category in the Fire Resistance Directory for names of manufacturers.

2. **Through Penetrants** — One nonmetallic pipe or conduit to be installed either concentrically or eccentricity within the firestop system. The annular space between the pipe or conduit and the periphery of the opening shall be a min 1/2 in. to max 1-1/8 in. Pipe or conduit to be rigidly supported on both sides of wall. The following types and sizes of pipes or conduits may be used:

A. **Polyvinyl Chloride (PVC) Pipe** — Nom 2 in. diam (or smaller) Schedule 40 solid core PVC pipe for use in closed (process or supply) or vented (drain, waste, or vent) piping systems.

B. **Chlorinated Polyvinyl Chloride (CPVC) Pipe** — Nom 2 in. diam (or smaller) SDR 17 CPVC pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.

C. **Rigid Nonmetallic Conduit+** — Nom 2 in. diam (or smaller) Schedule 40 PVC conduit installed in accordance with Article 347 of the National Electrical Code, (NFPA No. 70).

3. **Firestop System** — The firestop system shall consist of the following:

A. **Steel Sleeve** — Cylindrical sleeve fabricated from 0.022 in. (No. 26 gauge) galv sheet steel and having a min 2 in. lap along the longitudinal seam. Length of steel sleeve to be equal to the thickness of the wall plus 1 in., such that when installed, the ends of the steel sleeve extend 1/2 in. beyond each surface of the wall. Sleeve installed by coiling the sheet steel to a diam smaller than the through opening, inserting the coil through the openings and releasing the coil to let it uncoil against the periphery of the opening.

B. **Packing Material** — Min 2 in. thickness of 4 pcf mineral wool batt insulation firmly packed into opening as a permanent form on each side of wall. Packing material to be recessed from each surface of wall to accommodate the required thickness of fill material.

C. **Fill, Void or Cavity Material* — Sealant** — Min 3/4 in. thickness of fill material applied within annulus, flush with both ends of steel sleeve. A min 1/2 in. bead of fill material shall be applied at the steel sleeve/concrete interface on both surfaces of wall.

A/D FIRE PROTECTION SYSTEMS INC — A/D FireBarrier Silicone

*Bearing the UL Classification Marking

+Bearing the UL Listing Mark

Last Updated on 1998-11-05

[Questions?](#)

[Print this page](#)

[Terms of Use](#)

[Page Top](#)

© 2017 UL LLC

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2017 UL LLC".