



XHEZC.HW68 Firestop Systems

[Page Bottom](#)

Firestop Systems

[See General Information for Firestop Systems](#)

System No. HW68

October 27, 2006


F Rating — 2 h

FT Rating — 3/4 h

FH and FTH Ratings — 0 h

Nominal Joint Width — 50 mm

Joint Not Evaluated For Movement Capability

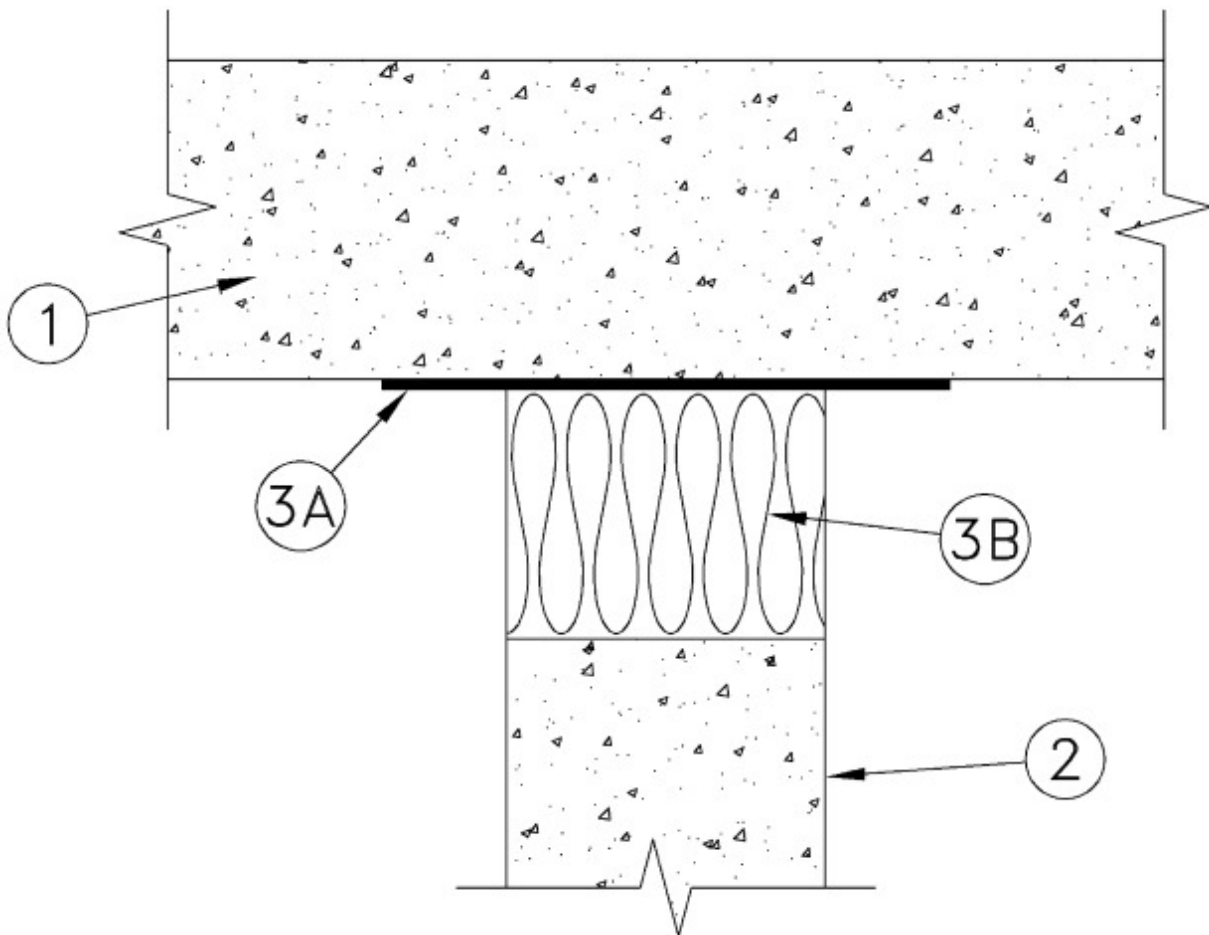

1. **Floor Assembly** — Minimum 64 mm thick reinforced low-density or normal-density (1600 to 2400 kg/m³) structural concrete.
2. **Wall Assembly** — Minimum 64 mm thick reinforced low-density or normal-density (1600 to 2400 kg/m³) structural concrete. Wall may also be constructed of nominal 200 mm thick concrete block.

3. **Joint System** — Maximum width (at time of installation of joint system) is 50 mm. The joint system shall consist of the following:

(a) **Membrane** — (Optional) -ULC Listed self-adhesive membrane designated Blueskin SA or SA-LT, cut to minimum 115 mm width and applied to either surface of joint. When membrane applied to bottom surface of floor, it shall extend a minimum of 25 mm beyond each face of joint. When membrane applied to wall, it shall overlap min 25 mm onto each surface of wall. Each adjoining length of membrane shall overlap previous length by 50 mm. Prior to application of membrane, Blueskin Primer applied to concrete surface at a minimum application rate of 0.2 kg/m².

■ (b) **Firestop System Components** — (XHJZC). Minimum 64 mm thickness of minimum 64 kg/m³"A/D FIREBARRIER Mineral Wool" batt insulation installed in joint opening as a permanent form. Pieces of batt cut into strips and installed edge-first into joint opening, parallel with joint direction, such that batt sections are compressed minimum 30% in thickness and that the compressed batt sections are flush with both surfaces of wall. Adjoining lengths of batt to be tightly-buttressed with butted seams spaced minimum 610 mm apart along the length of the joint.

A/D FIRE PROTECTION SYSTEMS INC

Last Updated on 2006-10-27

[Questions?](#)

[Print this page](#)

[Terms of Use](#)

[Page Top](#)

Copyright © 2016 Underwriters Laboratories of Canada Inc.

When the UL Leaf Mark is on the product, or when the word "Environment" is included in the UL Mark, please search the [UL Environment database](#) for additional information regarding this product's certification.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under ULC's Follow-Up Service. Only those products bearing the ULC Mark should be considered to be Listed and covered under ULC's Follow-Up Service. Always look for the Mark on the product.

ULC permits the reproduction of the material contained in the ULC Online Directories subject to the following conditions: 1. The Guide Information, Designs and/or Listings (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the ULC Online Directories with permission from Underwriters Laboratories of Canada Inc." must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "Copyright © 2016 Underwriters Laboratories of Canada Inc."

An independent organization working for a safer world with integrity, precision and knowledge.

