



XHEZC.SP916 Firestop Systems

[Page Bottom](#)

Firestop Systems

[See General Information for Firestop Systems](#)


System No. SP916

October 04, 2005

(For Horizontal or Vertical Separations)

F and FH Ratings — 2 h

FT and FTH Ratings — 0 h

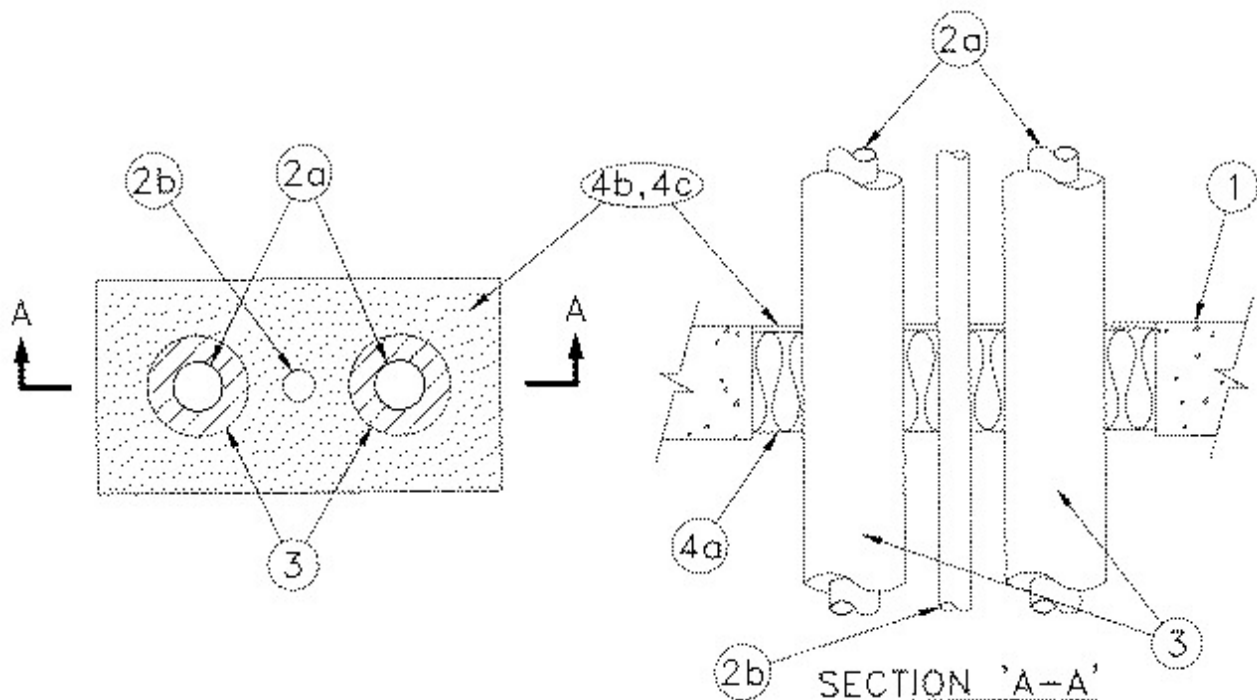

1. **Floor or Wall** — Min depth or thickness as necessary for required grade of fire separation but not less than 115 mm. Normal-density ($2400 \pm 50 \text{ kg/m}^3$) concrete floor or wall, or nom 200 mm concrete block wall. Max size of opening 216 mm by 406 mm. For opening in concrete block wall, concrete or mortar shall be used to create a solid surround to the opening.

2. **Pipes** — All pipes to be reliably supported above through-opening. A max of three pipes may be installed within the opening. Pipes to be installed min 38 mm apart and 50 mm from the edge of the opening.

(a) **Copper, Steel, or Iron Pipe or Steel Conduit** — 54 mm OD max and 1.5 mm min wall thickness..

(b) **Copper, Steel, or Iron Pipe or Steel Conduit** — 35 mm OD max and 1.0 mm min wall thickness.

3. **Pipe Insulation** — Copper pipe (Item 2a) to be wrapped with nom 25 mm thick, nom 56 kg/m^3 density, ULC labelled fibreglass pipe insulation. Longitudinal joints sealed with factory applied, self-sealing tape. Transverse joints secured with butt strip tape supplied with the product.

■ 4. **Firestop System Component** — (XHJZC).

(a) Type "A/D FIREBARRIER Mineral Wool Insulation" compressed to 33% into the opening to a depth of 102 mm and a min of 6.4 mm below surface of floor slab or recessed 6.4 mm from wall surfaces. Grain of insulation to be perpendicular to plane of floor or wall.

(b) Type "A/D FIREBARRIER Silicone Sealant", gungrade, applied over insulation (Item 4a) to a min depth of 6.4 mm. For vertical separations, apply to a min depth of 6.4 mm on both sides of the assembly.

(c) For horizontal separations only, Type "A/D FIREBARRIER Silicone Sealant SL" applied over insulation (Item 4a) to a min depth of 6.4 mm flush with the top surface of the slab.

A/D FIRE PROTECTION SYSTEMS INC

Last Updated on 2005-10-04

[Questions?](#)

[Print this page](#)

[Terms of Use](#)

[Page Top](#)

Copyright © 2016 Underwriters Laboratories of Canada Inc.

When the UL Leaf Mark is on the product, or when the word "Environment" is included in the UL Mark, please search the [UL Environment database](#) for additional information regarding this product's certification.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under ULC's Follow-Up Service. Only those products bearing the ULC Mark should be considered to be Listed and covered under ULC's Follow-Up Service. Always look for the Mark on the product.

ULC permits the reproduction of the material contained in the ULC Online Directories subject to the following conditions: 1. The Guide Information, Designs and/or Listings (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the ULC Online Directories with permission from Underwriters Laboratories of Canada Inc." must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "Copyright © 2016 Underwriters Laboratories of Canada Inc."

An independent organization working for a safer world with integrity, precision and knowledge.

