


AD/JFS 120-03  
(Formerly AD/PHV 120-02)  
Horizontal or Vertical (Floor/Ceiling or Wall)  
A/D Fire Protection Systems  
A/D FIREBARRIER Silicone  
CAN/ULC S115  
ASTM E814

	F-Rating <sup>**</sup>	T or FT Rating <sup>*</sup>	FTH – Rating <sup>*</sup>
ASTM –E814	2 hours	2 hours	NA
CAN/ULC-S115	2 hours	2 hours	2 hours

<sup>\*</sup>ASTM E814 ratings are listed as F and/or T only. CAN/ULC S115 ratings are listed as F, FT and FTH.

Test Furnace Internal Positive Pressure Differential-2.5 Pascal (0.01-in. H<sub>2</sub>O) Minimum

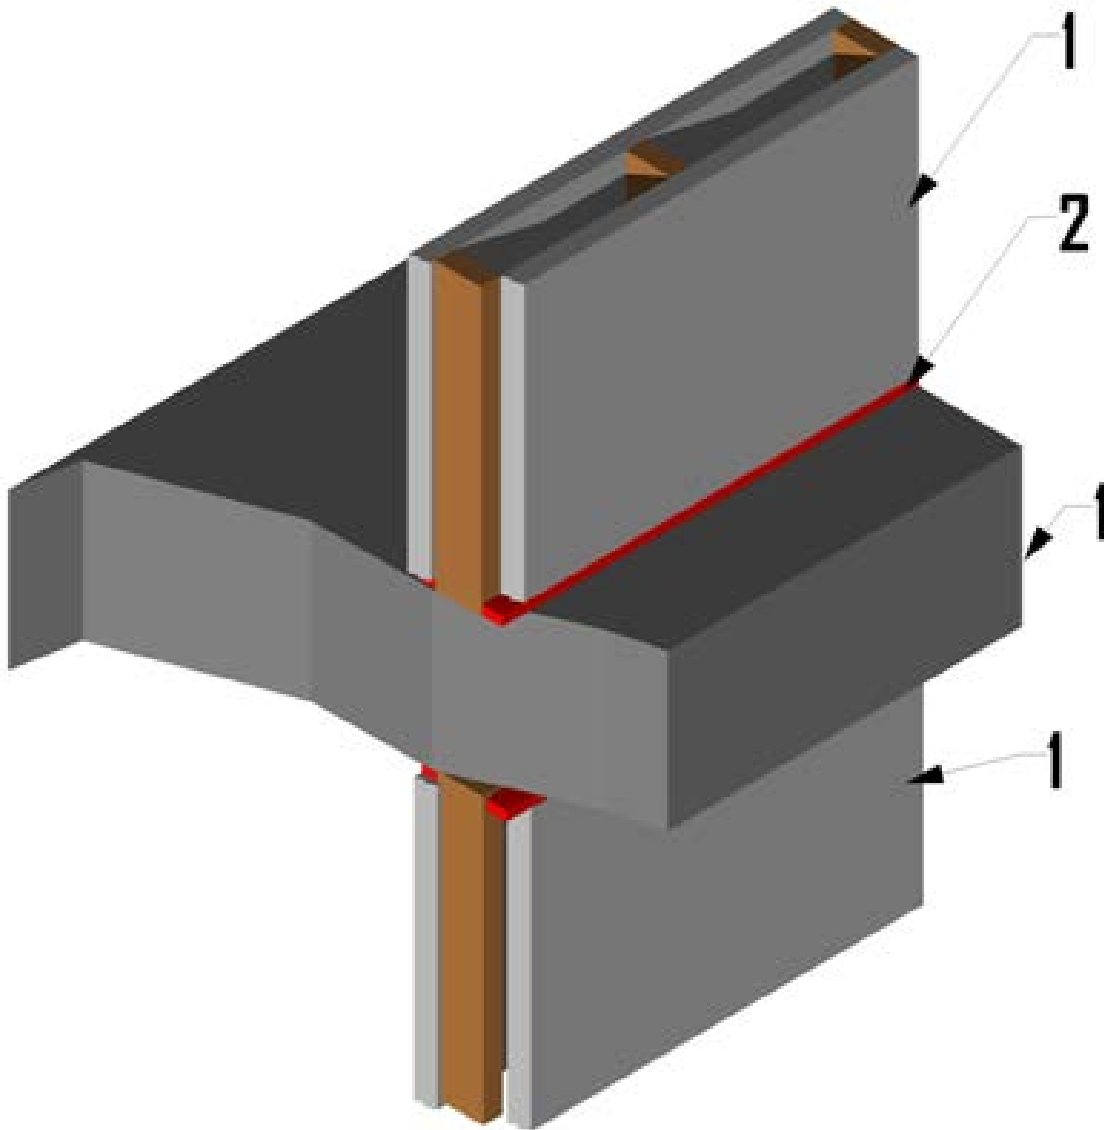

**Division 07 – Thermal and Moisture Protection**

**07 84 00 Fire Stopping**

**07 84 43 Joint Fire Stopping**

**2 of 2**

1. Floor/Ceiling or fire separations: 1, 2 hour rated ASTM E119 or CAN/ULC-S101 concrete floor assembly and metal or wood framed fire rated gypsum wall board wall assembly.

2. CERTIFIED MANUFACTURER: A/D Fire Protection Systems

CERTIFIED PRODUCT: Fire rated nonflammable acoustic/smoke seal firestop sealant

MODEL: A/D FIREBARRIER Silicone

Apply fire rated nonflammable acoustic/smoke seal firestop sealant at a minimum bead diameter of 3/8 in. (10 mm) into the joints where gypsum wall board meets a floor or ceiling assembly.