


AD/JFS 120-04
(Formerly AD/PHV 120-03)
Horizontal or Vertical (Floor/Ceiling or Wall)
A/D Fire Protection Systems
A/D FIREBARRIER Silicone
CAN/ULC S115
ASTM E814

	F-Rating	T or FT Rating*	FTH – Rating*
ASTM –E814	2 hours	2 hours	NA
CAN/ULC-S115	2 hours	2 hours	2 hours

*ASTM E814 ratings are listed as F and/or T only. CAN/ULC S115 ratings are listed as F, FT and FTH.

Test Furnace Internal Positive Pressure Differential-2.5 Pascal (0.01-in. H₂O) Minimum

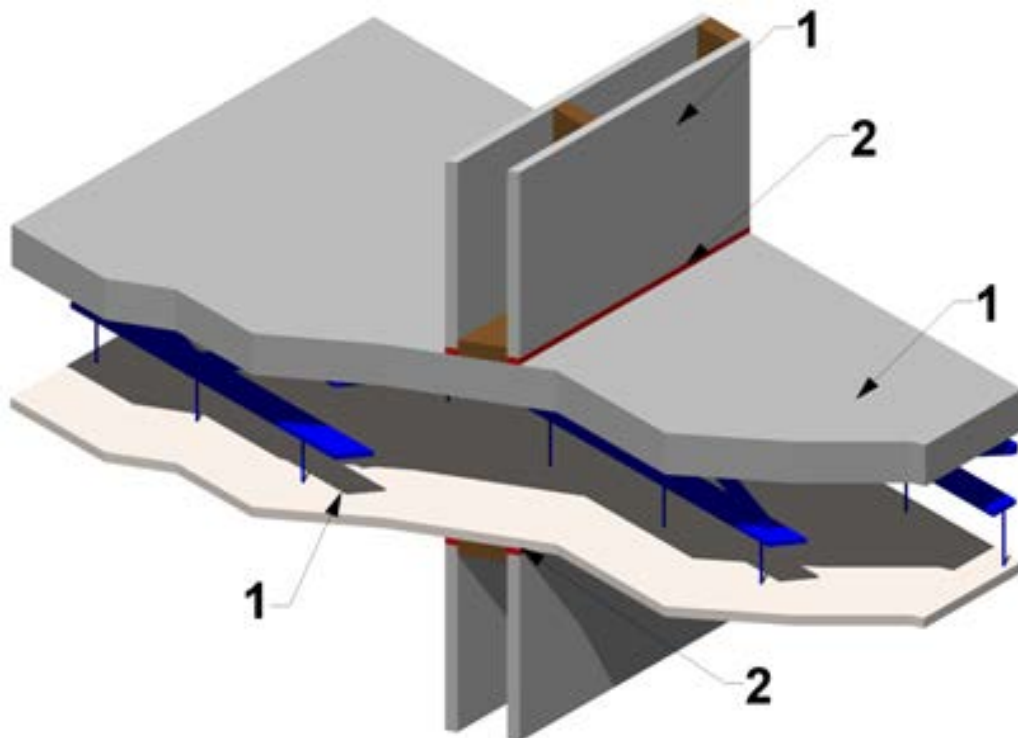

1. Floor/Ceiling or fire separations: 1, 2 hour rated ASTM E119 or CAN/ULC-S101 concrete floor, suspended ceiling assembly and metal or wood framed fire rated gypsum wall board wall assembly.
2. CERTIFIED MANUFACTURER: A/D Fire Protection Systems
3. CERTIFIED PRODUCT: Fire rated nonflammable acoustic/smoke seal firestop sealant

MODEL: A/D FIREBARRIER Silicone

Apply fire rated nonflammable acoustic/smoke seal firestop sealant at a minimum bead diameter of 3/8 in. (10 mm) into the joints where gypsum wall board meets a floor or ceiling assembly.