## XHEZC.SP987 Firestop Systems

Page Bottom

## **Firestop Systems**


See General Information for Firestop Systems

## System No. SP987

October 05, 2005

F Rating — 2 h

FT, FH and FTH Ratings — 0 h

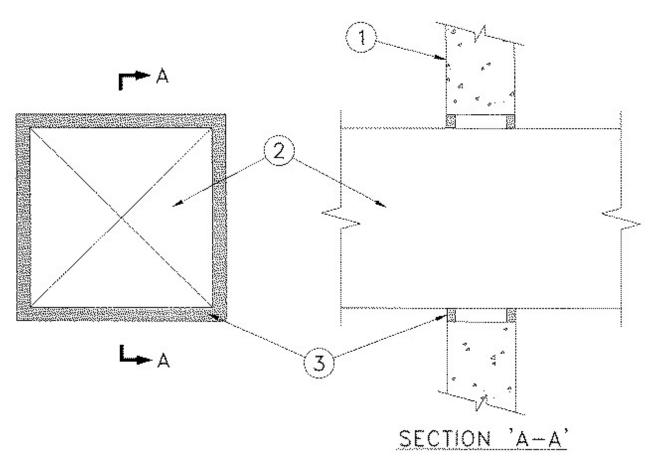

- 1. **Wall Assembly** Minimum 156 mm thick lightweight or normal-density concrete. Wall may be constructed of any nominal 200 mm thick concrete block. Maximum size of opening is 356 mm by 356 mm.
- 2. **Duct** Maximum 305 mm by 305 mm galvanized steel duct, 0.71 mm in thickness. Maximum separation of 25 mm between duct and periphery of opening. Duct to be rigidly supported on both sides of the wall.
- 3. **Firestop System Components** (XHJZC). Type "A/D FIREBARRIER Silicone Sealant" installed to fill the annular space to a minimum depth of 16 mm on both sides of the wall.

## A/D FIRE PROTECTION SYSTEMS INC

Last Updated on 2005-10-05

<u>Questions?</u> <u>Print this page</u> <u>Terms of Use</u> <u>Page Top</u>

Copyright © 2016 Underwriters Laboratories of Canada Inc.

When the UL Leaf Mark is on the product, or when the word "Environment" is included in the UL Mark, please search the <u>UL Environment</u> <u>database</u> for additional information regarding this product's certification.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under ULC's Follow-Up Service. Only those products bearing the ULC Mark should be considered to be Listed and covered under ULC's Follow-Up Service. Always look for the Mark on the product.

ULC permits the reproduction of the material contained in the ULC Online Directories subject to the following conditions: 1. The Guide Information, Designs and/or Listings (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the ULC Online Directories with permission from Underwriters Laboratories of Canada Inc." must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "Copyright © 2016 Underwriters Laboratories of Canada Inc."

An independent organization working for a safer world with integrity, precision and knowledge.

