



# REGULATION AND SAFETY

## *Station BlackOut - Safety Analysis*

Filippo Dalmonego

Tyler Ewald

Riccardo Fasano

Francesco Qualizza

Supervisor:

Jordi Freixa

April 3, 2026

## Contents

---

|                                         |          |
|-----------------------------------------|----------|
| <b>Introduction</b>                     | <b>1</b> |
| <b>Methodology</b>                      | <b>1</b> |
| <b>1 Steady State Analysis</b>          | <b>2</b> |
| 1.1 Steady State Verification . . . . . | 3        |
| <b>2 Base Case Analysis</b>             | <b>4</b> |
| 2.1 First Analysis . . . . .            | 5        |
| 2.1.1 Reactor Coolant System . . . . .  | 5        |
| 2.2 Secondary System . . . . .          | 7        |
| <b>3 Preliminary Conclusions</b>        | <b>7</b> |

## Introduction

---

The aim of this report is to present the first part of the Station Black-Out (SBO) project developed with RELAP5 as a system code. The main purpose of this first delivery is to study the reference model before any new safety-system design is introduced. In particular, the work is divided in two tasks: first, the verification of the steady-state conditions of the plant model and second the analysis of the SBO base case transient. The steady-state analysis is used to check that the model starts from physically consistent and stable operating conditions. The main thermal-hydraulic parameters are compared with the target values provided in the project statement, and their time evolution is checked in order to confirm that the initial condition is sufficiently stable for the transient calculations. After the steady-state verification, the SBO base case is analyzed. This case represents the reference accident scenario and is used as the starting point for the following parts of the project. The objective is to understand the sequence of events, the system response and the main thermal-hydraulic trends during the transient.

## Methodology

---

The reference plant selected for this analysis is the Zion Nuclear Power Station (United States), which was decommissioned in 1998. Although the real plant originally had four primary loops, the RELAP model used in this project is simplified into two equivalent loops only. One loop represents the broken loop and keeps the dimensions of a single loop, while the other represents the intact side and groups the remaining three loops into one single equivalent loop.

Figure 1 shows the nodalization used in order to represent in the best way possible the Zion nuclear power plant.

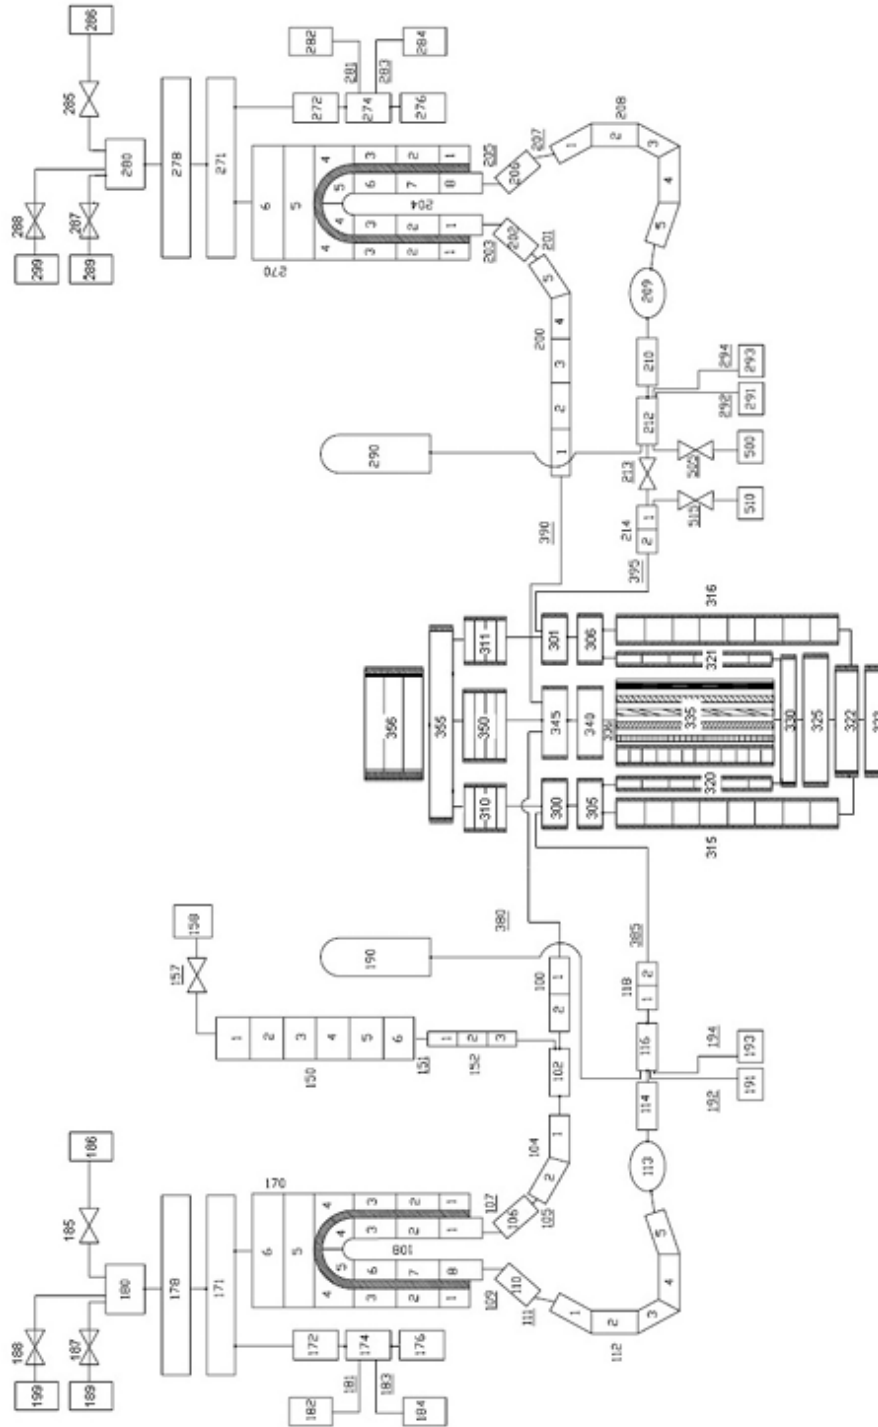


Figure 1: RELAP5 nodalization of the Zion Nuclear Power Plant model.

## 1 Steady State Analysis

Before starting the accident analysis, it is necessary to verify that the model is in a stable and realistic initial condition. A correct steady state is important because the transient results strongly depend on the quality of the initial condition. The steady-state run is checked by comparing the calculated values with the reference values and by observing the time evolution of the main parameters. If the variables remain approximately constant and the deviations from

the target values are acceptable, the initial condition can be considered suitable for the transient simulation.

| Parameter                             | Expected value | Steady State Results |
|---------------------------------------|----------------|----------------------|
| Power (MW)                            | 3250           | 3250.0               |
| Primary pressure in the hot leg (MPa) | 15.5           | 15.5                 |
| Secondary pressure (MPa)              | 6.7            | 6.71                 |
| Pressurizer level (m)                 | 8.8            | 8.86                 |
| Broken Steam Generators DC level (m)  | 12.2           | 12.2                 |
| Intact Steam Generators DC level (m)  | 12.2           | 12.2                 |
| Core outlet temperature (K)           | 603            | 603.4                |
| Core inlet temperature (K)            | 571            | 570.8                |
| Broken Main feedwater flow (kg/s)     | 459            | 455.8                |
| Intact Main feedwater flow (kg/s)     | 1325           | 1324.4               |
| Intact loop flow (kg/s)               | 12865          | 12436                |
| Broken loop flow (kg/s)               | 4351           | 4356                 |

Table I: Expected vs Simulation results for Steady State Values

Table I shows the main variables that must be checked in the steady-state calculation. The steady-state calculation shows that the main plant variables are close to the reference values; small deviations may appear because of nodalization choices, control-system settings, and numerical approximations. However, the overall agreement is sufficient to accept the initial condition for the SBO transient analysis.

### 1.1 Steady State Verification

In this section some plots regarding the steady state case are provided. The purpose is only to ensure that the calculations done with RELAP are coherent with the steady state conditions the plant should be operating at.

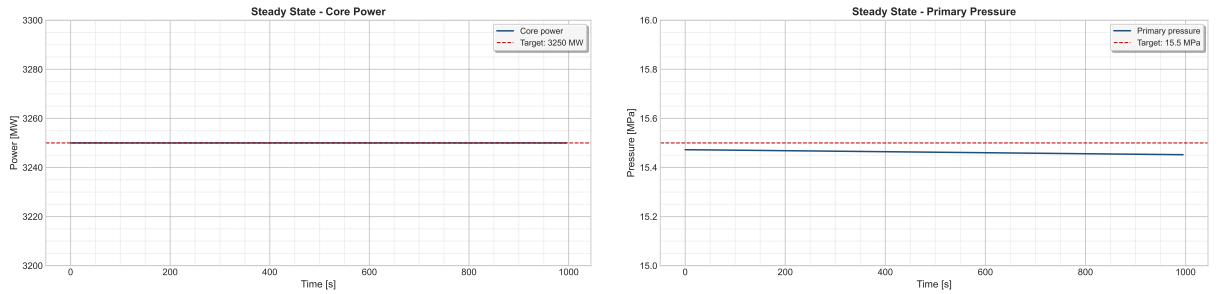


Figure 2: Core Power (on the left) and primary pressure (on the right).

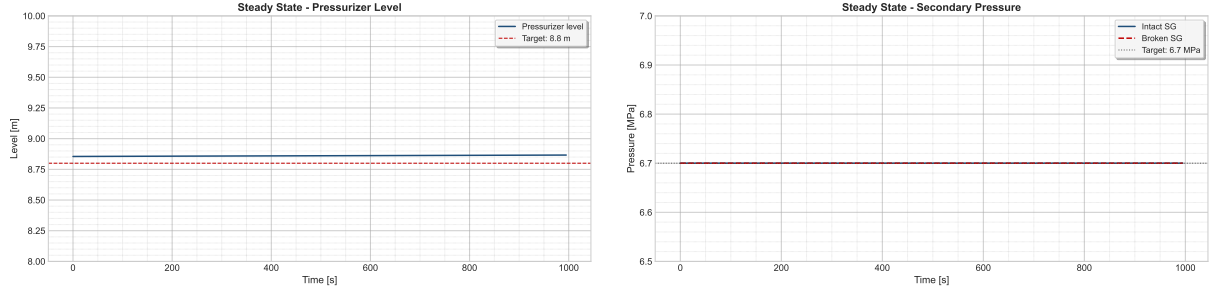


Figure 3: Pressurizer Level (on the left) and Secondary Pressure (on the right).

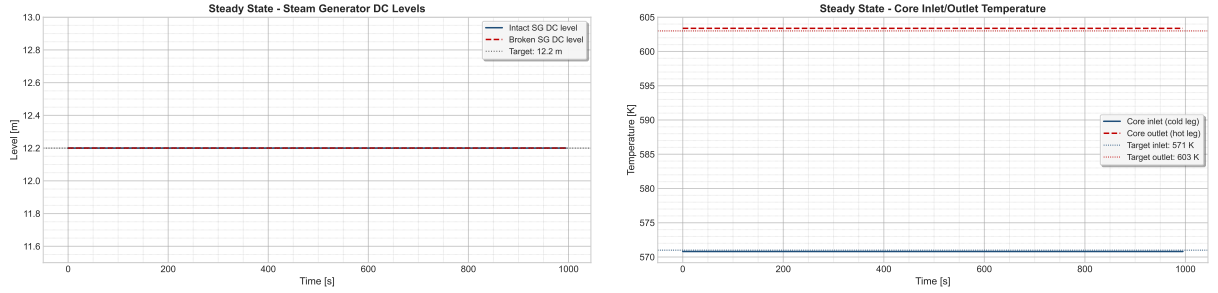


Figure 4: SG levels (on the left) and RCS temperatures (on the right).

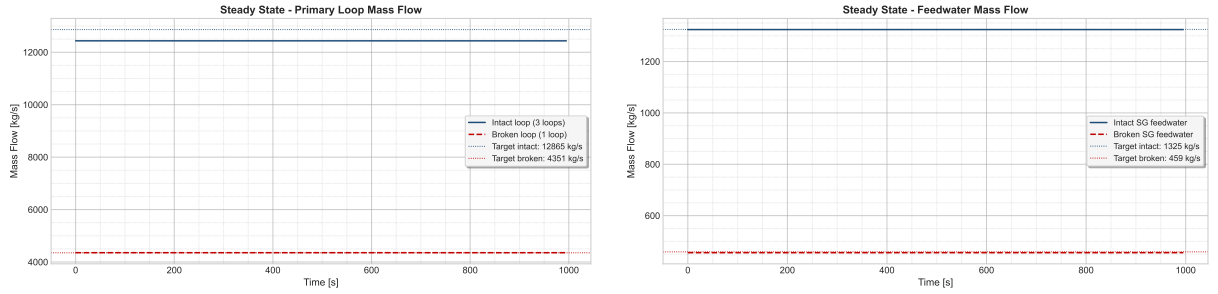


Figure 5: Primary Mass Flow (on the left) and FW Mass Flow (on the right).

As we can see, all the variables analyzed are stable and do not change over the time. Some of them present little uncertainties that are probably due to numerical errors and the complexity of the phenomena involved.

## 2 Base Case Analysis

After the steady-state verification, the SBO base case is studied. The Station Black-Out is assumed to begin at  $t = 0$  s with aggravated conditions. Under these conditions, every system that depends on electrical power is considered unavailable. As a result, the reactor coolant pumps trip, the control rods are inserted, and other relevant functions, such as the cooling of the pump seals, are lost. The general assumptions that are common to all the considered accident sequences are summarized in Table II below.

Table II: Main events to be included in the SBO base case description.

| Event / action                  | Short description                                                           |
|---------------------------------|-----------------------------------------------------------------------------|
| SBO initiation                  | Loss of off-site and on-site AC power according to project assumptions      |
| Reactor scram                   | Automatic shutdown following the transient logic                            |
| RCP trip                        | Reactor coolant pumps stop after loss of power                              |
| FW / AFW behavior               | Feedwater and auxiliary feedwater response according to the base-case logic |
| Pressurizer systems             | Heater and control-system behavior during SBO                               |
| Safety injection unavailability | HPSI and LPSI unavailable during the transient                              |
| Steam line / relief actions     | Valve actions according to the project assumptions                          |
| Additional operator actions     | To be completed based on the adopted base-case procedure                    |

In order to simulate all the accidental sequence, some actions that could be performed from the operators have been taken into account. These are listed below.

| Action / Event                 | Description                                                                                                                                            |
|--------------------------------|--------------------------------------------------------------------------------------------------------------------------------------------------------|
| RCP Seal Leak                  | Starts 10 minutes after SBO initiation with a leak size of 0.00001 m <sup>2</sup> per pump[cite: 63, 64].                                              |
| Leak area increase             | The leak area increases 4x when saturation takes place at the RCP[cite: 66, 67].                                                                       |
| TDP AFW Injection              | Auxiliary feed water is provided by a turbo-driven pump (TDP) which is controlled manually and requires batteries[cite: 68].                           |
| TDP battery depletion          | Batteries last for 5h, after which the TDP becomes uncontrolled, injecting water until the separator is flooded and the TDP stops[cite: 69, 70].       |
| Cooldown strategy (EOP)        | Operators follow a strategy to cool down the SG at a rate of 55 K/h until 15 bar[cite: 72, 73].                                                        |
| Primary depressurization (EOP) | Operators fully open the Pressurizer relief valves to depressurize the primary system if the Core Exit Temperature is higher than 923 K[cite: 75, 76]. |
| AC power recovery              | Recovery of AC power occurs after 12h, which recovers AFW, HPIS, and LPIS[cite: 77].                                                                   |

Table III: Configurable actions and conditions for the SBO sequences in the Zion model

## 2.1 First Analysis

The first analysis was performed considering that all the EOPs listed in Table III have taken place. We are going to analyze the transient in order to verify the situation of the plant after the SBO has occurred.

### 2.1.1 Reactor Coolant System

Right after the SBO event, the SCRAM immediately shuts down the reactor by inserting the control rods, leading to a rapid decrease in power, that is plotted in Figure 6. The residual value

present in the graph is due to the decay heat, which represents the main issue in this types of scenarios. Moreover, the loss of AC power causes the immediate trip of the pumps.

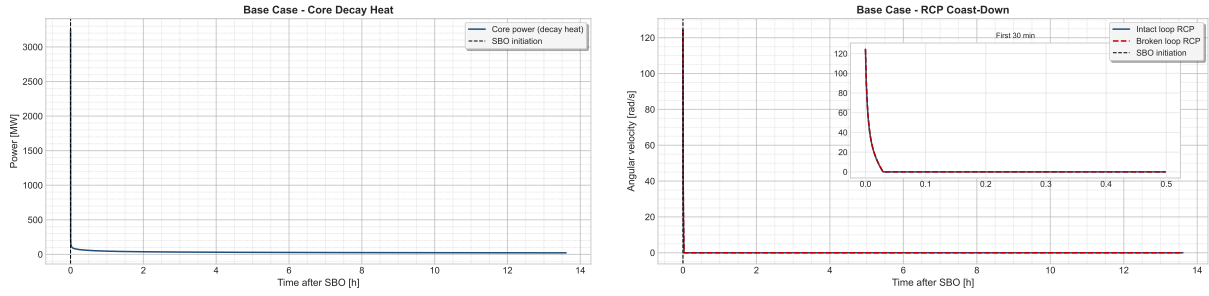


Figure 6: Core Power (on the left) and RCP velocities (on the right).

The sudden power decrease causes a contraction within the coolant, which lowers the level inside the pressurizer, as it is shown in Figure 7. The level reaches zero and it starts to increase again after 12 hours, when the AC power is recovered and water is introduced again by the means of HPIS, LPIS and the pumps. The loss of level is also enhanced by the loss of inventory, as the seal injection system is not available during a SBO. This leads to some leaks from the pumps, which contributes to the decrease. However, an empty pressurizer does not imply that the core is uncovered. This situation is properly described in Figure 7.

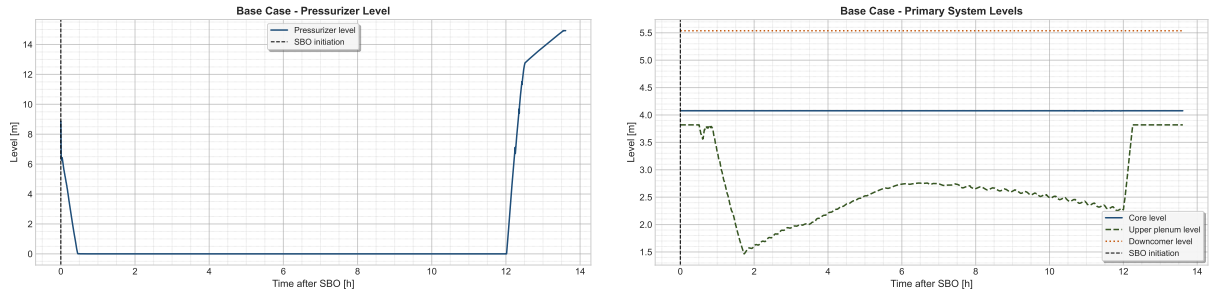


Figure 7: Pressurizer Level (on the left) and Core Levels (on the right).

In the next picture the pumps' leaks are shown.

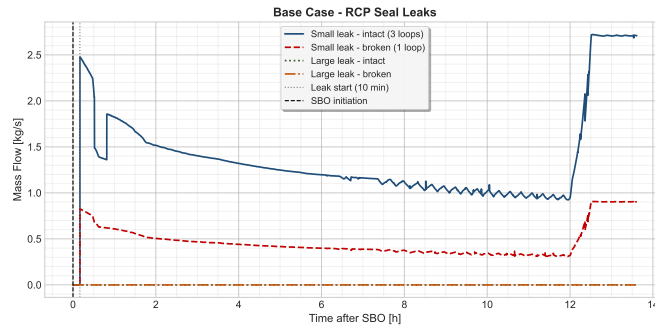


Figure 8: RCP Seals Leaks. Notice that the intact loop represents 3 loops.

According to EOPs, if the outlet temperature from the core is higher than 923 K, the operators should depressurize the primary system using the PRZ valves. In our case, this procedure has not been necessary, as the core exit temperature does not overcome 923 K. Figure 9 shows the main parameters related to the temperatures of the core.



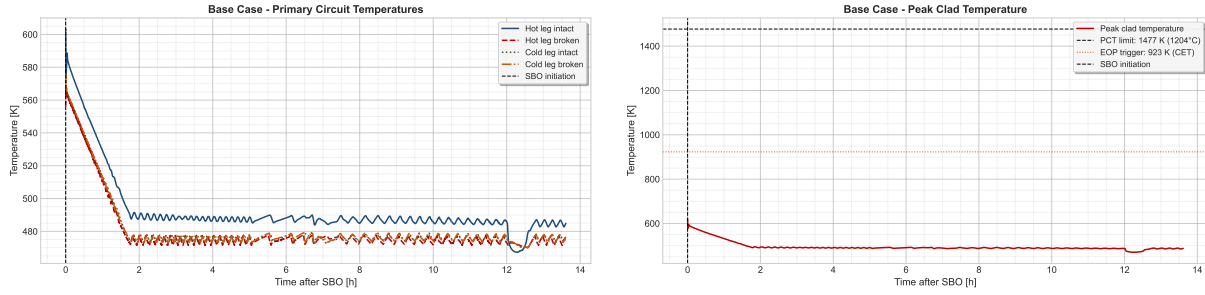


Figure 9: Core Temperatures (on the left) and Cladding Temperature (on the right).

The primary temperatures are lower than the threshold limit established for the operator, as well as the peak cladding temperature. It remains lower than the safety limit, preventing damages to the cladding. It also indicates that DNBR is prevented and the core is covered. The constant behaviour can be explained as a consequence of some natural circulation phenomena that could have taken place inside the primary, due to the pressure difference between primary and secondary. Figure 10 shows that a little flow inside the RCS is present, even if the pumps are tripped. The natural circulation guarantees the heat exchange between the core and the SGs.

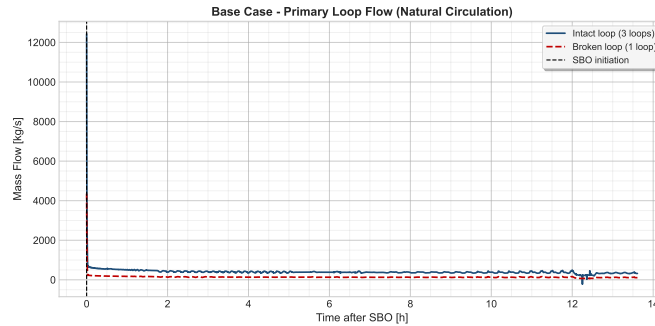


Figure 10: Primary Mass Flow

## 2.2 Secondary System

## 3 Preliminary Conclusions

From the first analyses, the system code RELAP5 can be used as the model basis for the next stages of the project. The steady-state calculation is first checked against the target values, and the SBO base case is then used to observe the main thermal-hydraulic response of the plant under blackout conditions.

At this stage, the report is intended as a structured first draft. The final discussion will be completed after adding the detailed numerical results, the transient plots, and the comparison with the additional scenarios required in the following stages of the project.

## CRediT Author Statement

---

- **Filippo Dalmonego:**
- **Tyler Ewald:**
- **Riccardo Fasano:**
- **Francesco Qualizza:** Methodology, Supervision, Writing - Original Draft, Review & Editing.