



Single-actuator PI test — phi1 controls u — 222520_single-axis-pid-phi1_phi1-authority-0


Fast one-V λ calibration

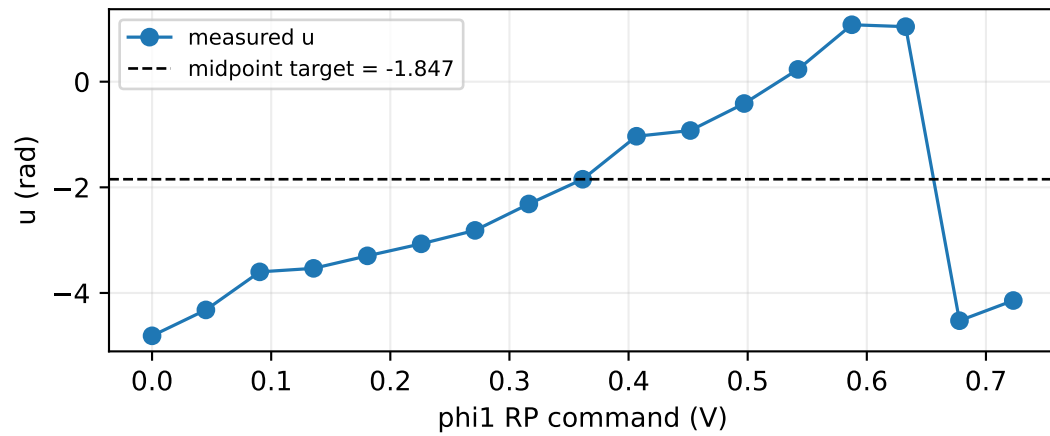


Only commanded actuator

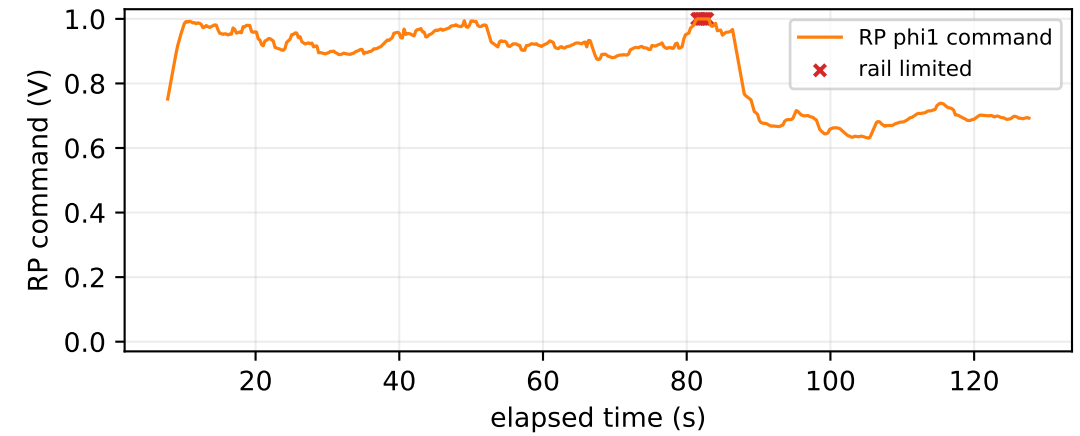


Controlled coordinate: phi1 $\rightarrow$ u

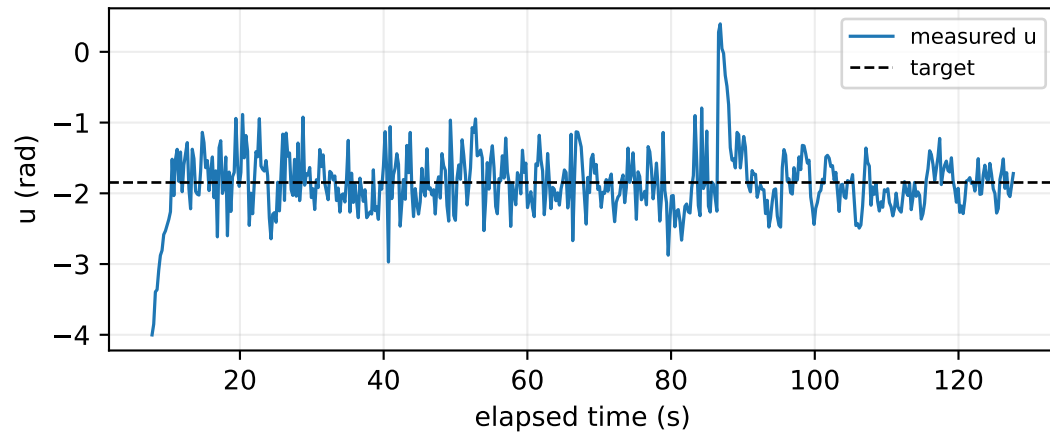


Uncontrolled coordinate: v

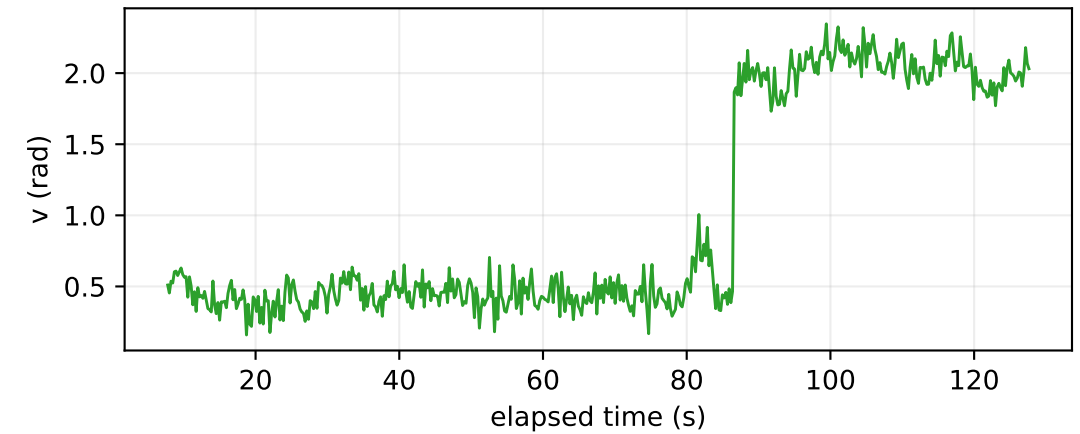

Controlled-coordinate error

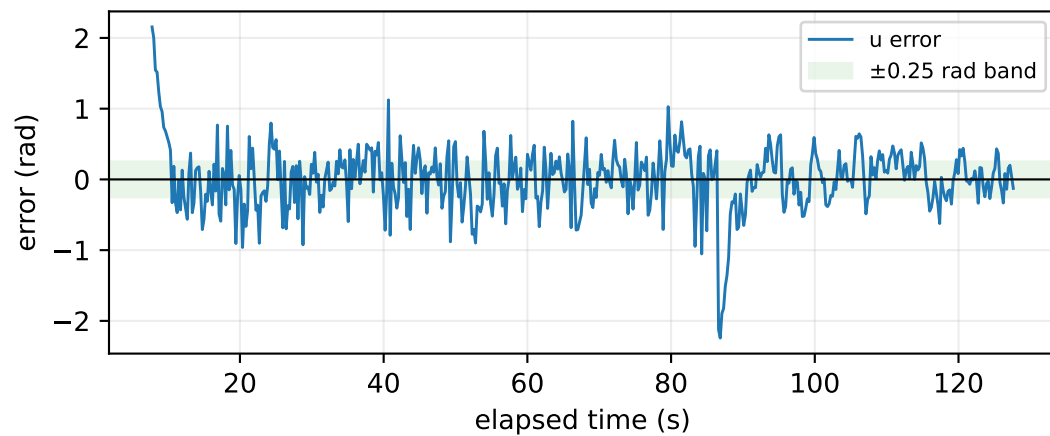

PI state and incremental command

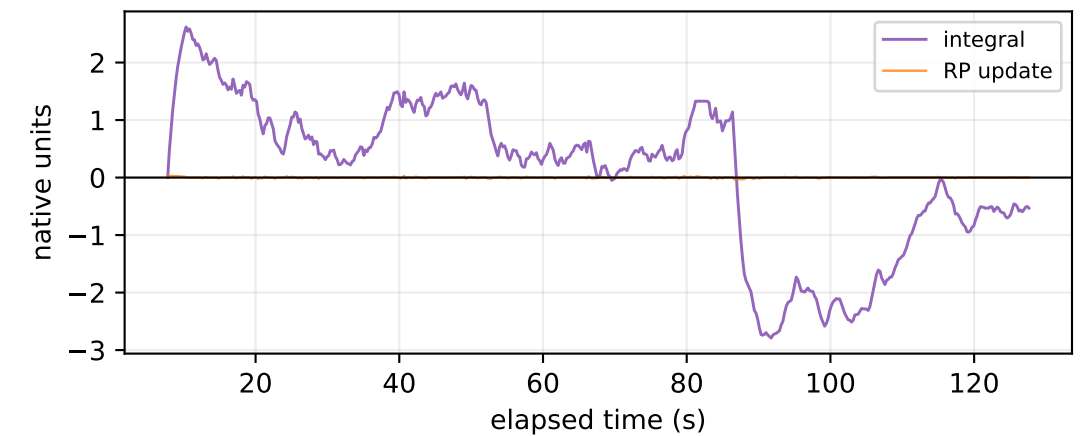

Target u: -1.8470 rad Duration: 119.9 s Median |error|: 0.254 rad (full), 0.204 rad (late)
Controlled-coordinate σ : 0.448 rad Uncontrolled v excursion (5-95%): 1.847 rad Rail-limited samples: 7/515