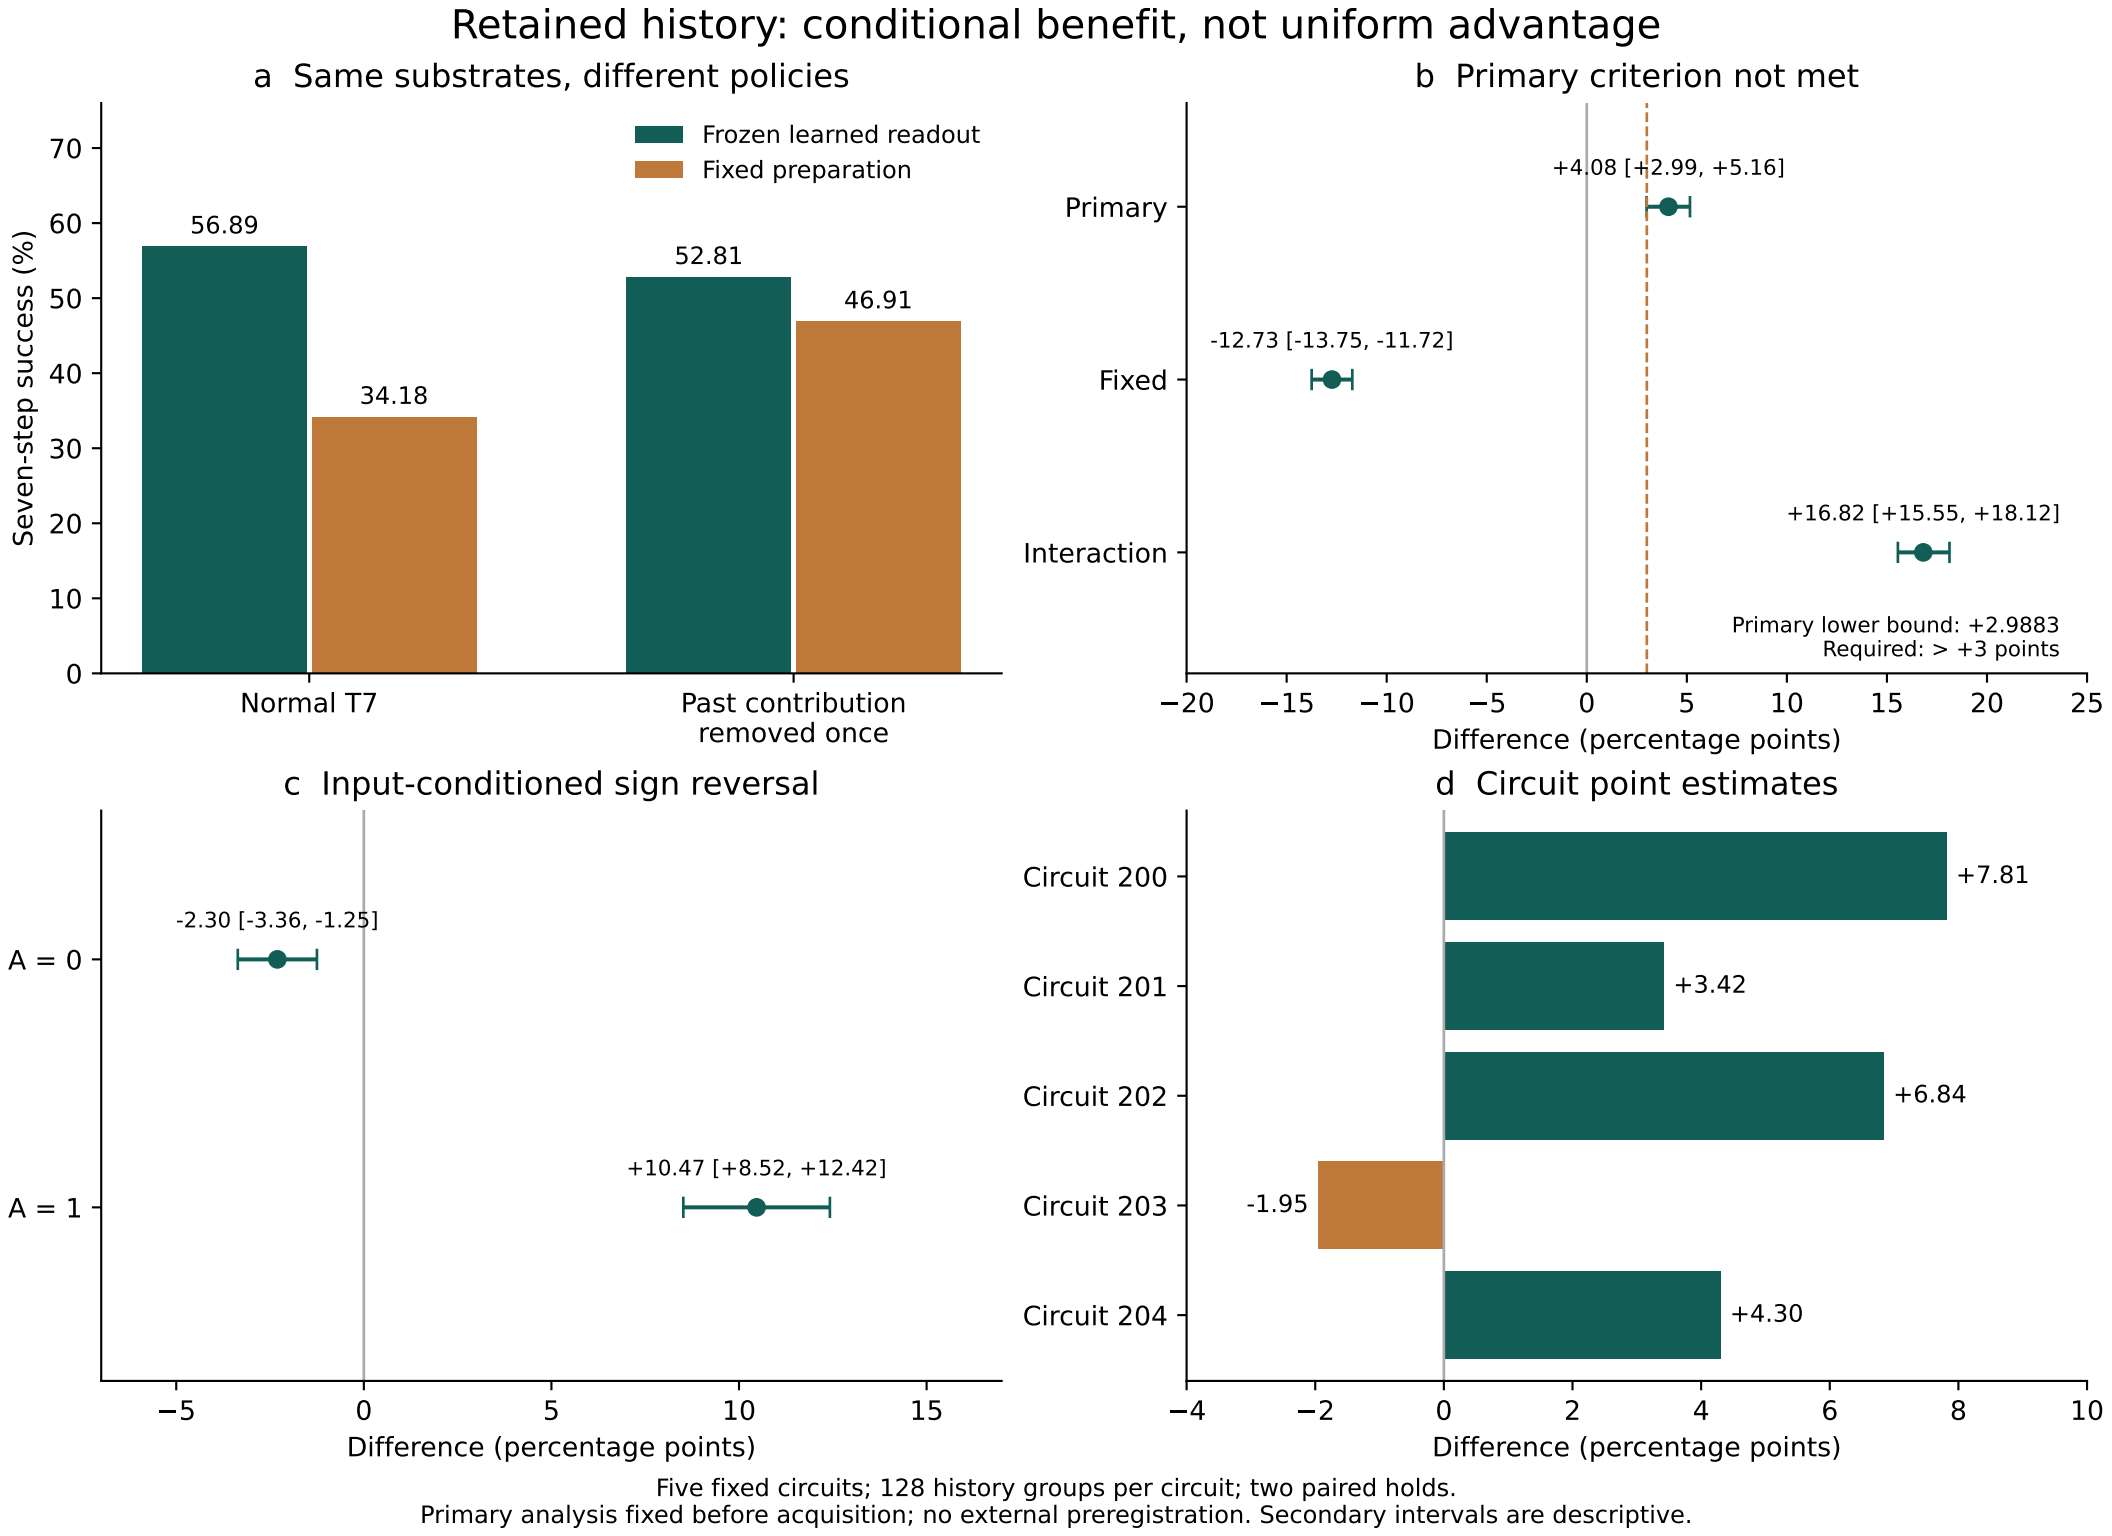

Five fixed circuits; 128 history groups per circuit; two paired holds.
Primary analysis fixed before acquisition; no external preregistration. Secondary intervals are descriptive.