

Water Production & Distribution Operations

Great Lakes Water Authority | Regional Treatment & Distribution System

Refreshed: Jun 2025 • Source: SCADA / Historian

Period: Jan 2024 - Jun 2025

Facility: All (6)

Measure: MGD

System: Water

TOTAL TREATED (JUN)

805.9 MGD

▲ 6.2% vs May

NON-REVENUE WATER

16.9%

▲ 1.1 pts vs target (15%)

AVG CHLORINE RESIDUAL

0.74 mg/L

Within compliance band


PUMP ENERGY (JUN)

847 MWh

1,051 kWh / MG

Total Treated Water

MGD by month

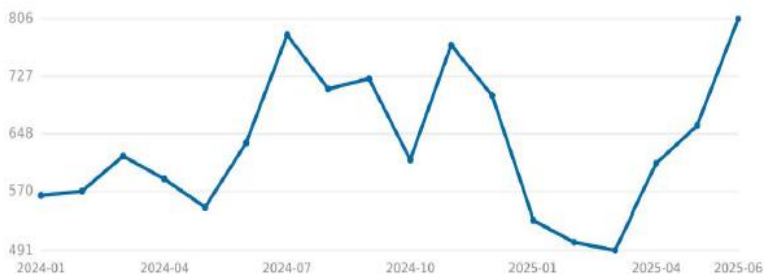


Non-Revenue Water %

system avg vs 15% target



Treated Volume by Facility

Jun 2025, MGD

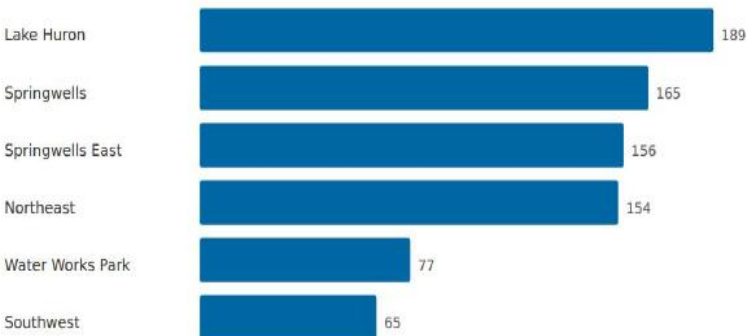

Water Quality — Facility Compliance

latest readings

FACILITY	TURBIDITY (NTU)	CL ₂ (MG/L)	STATUS
Lake Huron	0.12	0.55	Compliant
Springwells	0.19	0.64	Compliant
Springwells East	0.26	0.73	Compliant
Northeast	0.33	0.82	Compliant
Water Works Park	0.00	0.91	Compliant
Southwest	0.07	0.01	Compliant

Revenue, Billing & Collections

Great Lakes Water Authority | Member Partner Wholesale Billing

FY2025 YTD • Source: Billing / GL

Fiscal Year: 2025 YTD

Member Partner: All (10)

Service: Water + Sewer

TOTAL BILLED (YTD)

\$314.7M

▲ 4.8% vs PY

TOTAL COLLECTED

\$296.0M

On pace to budget

COLLECTION RATE

94.1%

▼ 0.9 pts vs target 95%


OUTSTANDING A/R

\$18.7M

Across 10 partners

Billed vs Collected

\$M by month

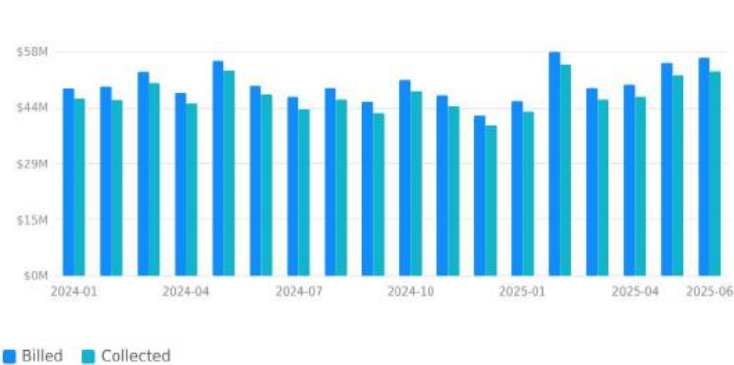

Collection Rate by Member Partner

YTD %



Revenue by Member Partner

YTD billed, \$M

MEMBER PARTNER	BILLED	COLLECTED %	
Romulus	\$35.0M	96.3%	
Wayne County	\$34.5M	93.7%	
Southfield	\$33.4M	92.7%	
Troy	\$32.6M	93.5%	
Livonia	\$32.0M	94.9%	
Warren	\$32.0M	94.0%	
Sterling Heights	\$29.1M	94.9%	
Farmington Hills	\$28.8M	92.6%	
Detroit	\$28.8M	95.2%	
Dearborn	\$28.4M	92.4%	

Aging Summary

outstanding A/R

BUCKET	AMOUNT	% OF A/R
0-30 days	\$9.2M	49%
31-60 days	\$5.1M	27%
61-90 days	\$2.6M	14%
90+ days	\$1.8M	10%



Capital Projects & Asset Management

Great Lakes Water Authority | Capital Improvement Program (CIP)

FY2025 • Source: Project / ERP

Program: CIP FY24-26

Category: All (8)

Status: Active + Complete

TOTAL CIP BUDGET

\$119.5M

10 active projects

ACTUAL SPEND

\$78.2M

65.4% of budget

BUDGET REMAINING

\$41.3M

Within plan

AT-RISK / DELAYED

7

Require attention


Project Portfolio

budget vs actual & status

ID	PROJECT	CAT	BUDGET	SPENT	%	STATUS
CIP-2201	Water Main Replacement - NW Di	Distribution	\$5.0M	\$4.8M	90%	On Track
CIP-2202	Springwells Filter Rehabilitat	Treatment	\$18.0M	\$10.9M	60%	At Risk
CIP-2203	Lake Huron Intake Upgrade	Treatment	\$2.5M	\$1.7M	75%	Delayed
CIP-2204	SCADA Modernization	Technology	\$18.0M	\$5.5M	30%	On Track
CIP-2205	Reservoir Structural Repair	Storage	\$5.0M	\$2.5M	45%	At Risk
CIP-2206	Pump Station 7 Electrical	Pumping	\$2.5M	\$2.1M	90%	Delayed
CIP-2207	Sewer Interceptor Lining	Collection	\$12.0M	\$2.0M	15%	At Risk
CIP-2208	Meter Infrastructure (AMI) Rol	Metering	\$2.5M	\$1.3M	60%	At Risk
CIP-2209	Northeast Plant Roof & HVAC	Facilities	\$12.0M	\$7.8M	75%	At Risk
CIP-2210	Cybersecurity Hardening	Technology	\$42.0M	\$39.6M	100%	Complete

Budget by Category

\$M

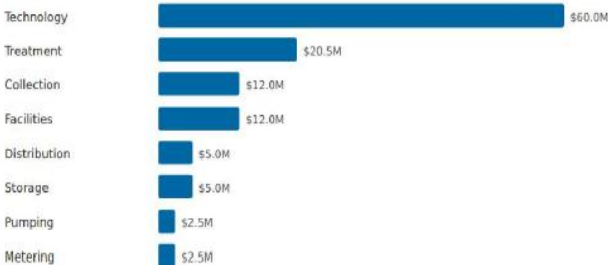

Overall Program Completion

weighted % complete



Spend Variance Flags

actual vs planned curve

PROJECT	VARIANCE	FLAG
Springwells Filter Rehab	+8.4%	Over
SCADA Modernization	-3.1%	Under
AMI Meter Rollout	+12.2%	Over
Reservoir Repair	-1.0%	On Plan
Lake Huron Intake	+2.5%	On Plan