

PROJECT CONCEPT NOTE



CARBON OFFSET UNIT (CoU) PROJECT

**Title: 33 MW Bagasse based Co-generation by M/s Sahakar Maharshi
Shankarrao Mohite-Patil Sahakari Sakhar Karkhana Ltd.
Shankarnagar-Akluj**

Version 1.0 Date 20-12-2022
First CoU Issuance Period: 10 Years
Crediting Period: 01-01-2013 to 31-12-2022

PROJECT CONCEPT NOTE

BASIC INFORMATION	
Title of the project activity	33 MW Bagasse based Co-generation by M/s Sahakar Maharshi Shankarrao Mohite-Patil Sahakari Sakhar Karkhana Ltd. Shankar nagar-Akluj
Scale of the project activity	Large Scale
Completion date of the PCN	20-12-2022
Project participants	Project Proponent: M/s Sahakar Maharshi Shankarrao Mohite-Patil Sahakari Sakhar Karkhana Ltd. Shankar nagar-Akluj Aggregator: Energy Advisory Services Pvt. Ltd.
Host Party	India
Applied methodologies and standardized baselines	CDM UNFCCC Methodology ACM0006: Electricity and heat generation from biomass (Ver. 16) & UCR Standard for Emission Factor
Sectoral scopes	01 Energy industries (Renewable/Non-Renewable Sources)
Estimated total amount of average GHG emission reductions per year	46,100tCO ₂ eq or 46,100 CoUs
Estimated total amount of average GHG emission reductions for the entire monitoring period	4,61,000 tCO ₂ eq or 4,61,000 CoUs

SECTION A. Description of project activity

A.1. Purpose and general description of Carbon offset Unit (CoU) project activity >>

The Project Titled “33 MW Bagasse based Co-generation by M/s Sahakar Maharshi Shankarrao Mohite-Patil Sahakari Sakhar Karkhana Ltd. Shankarnagar-Akluj” is a bagasse-based Co-Generation (co-gen) Power Project successfully commissioned by Maharashtra State Electricity Transmission Company Limited (MSETCL) and operational since 06-03-2011. The Project is owned by M/s Sahakar Maharshi Shankarrao Mohite-Patil Sahakari Sakhar Karkhana Ltd. Shankarnagar-Akluj (hereby to be called as Project Proponent, PP).


Purpose of the project activity:

The PP has set up an integrated new sugar mill with sugar crushing capacity of 10000 TCD and install new 33 MW Bagasse based Cogeneration power plant. This will remove the dependency of the sugar mill on the power supplied from the state grid. Power generated from this project activity will be used for meeting plant requirement. After fulfilling its captive energy requirement, remaining power will be sold to the state grid as per the Power Purchase Agreement.

The Cogen power project of 33 MW capacity will operate on bagasse only for 180 days during season days and 135 days during off-season. Actual number of mill operation days will be mentioned in the monitoring period. At designed level, the project will generate clean energy and after meeting the captive requirement export the surplus energy to Maharashtra State Electricity Transmission Company Limited (MSEDCL). All the steam and power requirements of the sugar mill and co-gen power plant will be met internally from the project itself.

The project activity employs 33 MW aggregated generators along with boilers, One 140 TPH boiler and One 50 TPH boiler with high pressure and temperature configuration (87 kg/cm² and 515 °C). During off-season only 50 TPH boiler will be operating and 10,000 MT of bagasse will be acquired from the neighboring area.



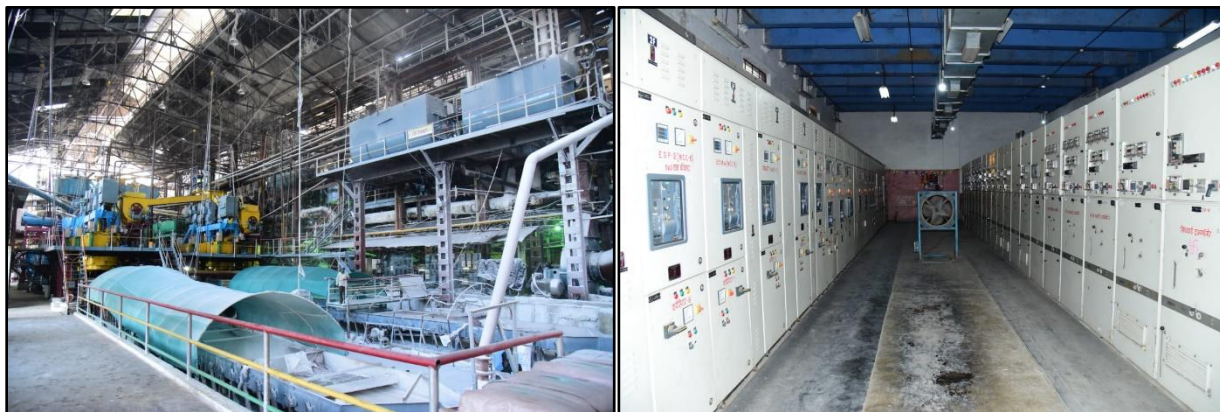

The project activity is the construction and operation of a power plant/unit that uses renewable energysources and supplies electricity to the grid as well as generate heat for the captive consumption at 10000 TCD sugar mill. Earlier capacity of the sugar mill was 6000 TPH, which was later increased to 7500 TCD and in 2018 its capacity was further increased to 10000 TCD. The project activity is thus the displacement of electricity that would be provided to the grid by more-GHG-intensive means and provides long-term benefits to the mitigationof climate change.

A.2 Do no harm or Impact test of the project activity>>

There are social, environmental, economic and technological benefits which contribute to sustainable development.

Social benefits:

- The project activity contributes to employment generation in the local area for both skilled & unskilled people for operation and maintenance of the equipment. The project creates several permanent jobs, in addition to persons gaining indirect jobs through the supply of biomass to the plant. Apart from the direct and indirect employment generation, the project also encourages indirect employment by setting up other agro industries due to availability of power supply from the project. Under this project rural youth/women are identified and they can be trained for biomass collection, preparation, processing and transport.
- It has created steady higher value jobs and skilled workers at the facility. The project activity is contributing to the national energy security by reducing consumption of fossil fuels.
- The technology being used in the project is proven and safe for power generation. An increase in such kind of projects shall enable all the technology suppliers to continuously innovate and modernize on the technology front. The local people will know the technological advancement and will help in capacity building.

Environmental benefits:


- The project activity is a renewable energy project, which utilizes biomass as a fuel for power generation and heat, a move that is voluntary and not mandated under current environmental laws of India. Since this project activity generates green energy in the form of power and heat, it has positively contributed towards the reduction in (demand) use of finite natural resources like coal, gas and oil, minimizing depletion and in turn increasing its availability to other important purposes. Therefore, this project activity helps to environment sustainability by reducing GHG emission in the atmosphere.
- Avoids global and local environmental pollution, leading to reduction of GHG emissions.
- The bagasse generated in sugar mills in the region are generally in excess and hence get disposed in unplanned ways including dumping into nearby land or rivers. This will be reduced.

Economic benefits:

- The project activity creates employment opportunities during the project stage and operation and maintenance of the Cogen power plant.
- The project activity helps in conservation of fast depleting natural resources like coal and oil thereby contributing to the economic wellbeing of country as a whole.
- The increase in demand of bagasse exerted by the project has had a local effect on its price and generates additional revenue for the sugarcane farmers. The project activity results in saving the coal and allowing it to be diverted to other needy section of the economy.
- The various other benefits due to the project activity ensure that the project is contributing to the sustainable development of the region by bringing in green technologies and processes to a backward region. The technology is indigenous and by implementing such projects the country is showcasing its GHG mitigation actions in its efforts to combat climate change.


A.3. Location of project activity >>

Country : India
Village : Yashwantnagar
State : Maharashtra
Latitude : 17°51'51.7"N
Longitude : 75°00'23.2"E

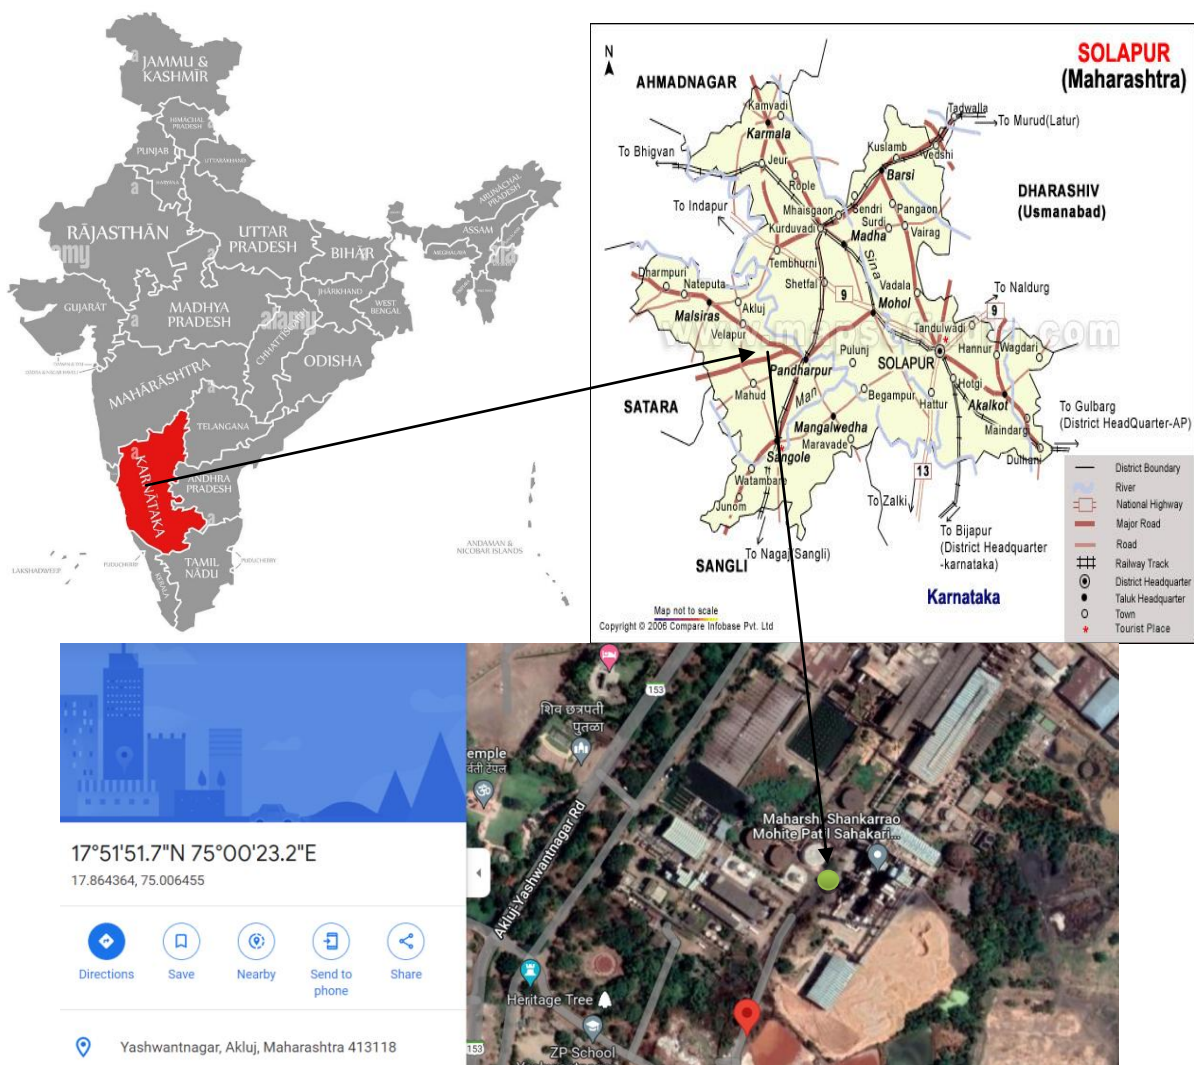

A.4. Technologies/measures >>

The project activity involves One 140 TPH boiler and One 50 TPH boiler with high pressure and temperature configuration (87 ata and 515 °C). The Project activity in a process flow diagram can be expressed as below:

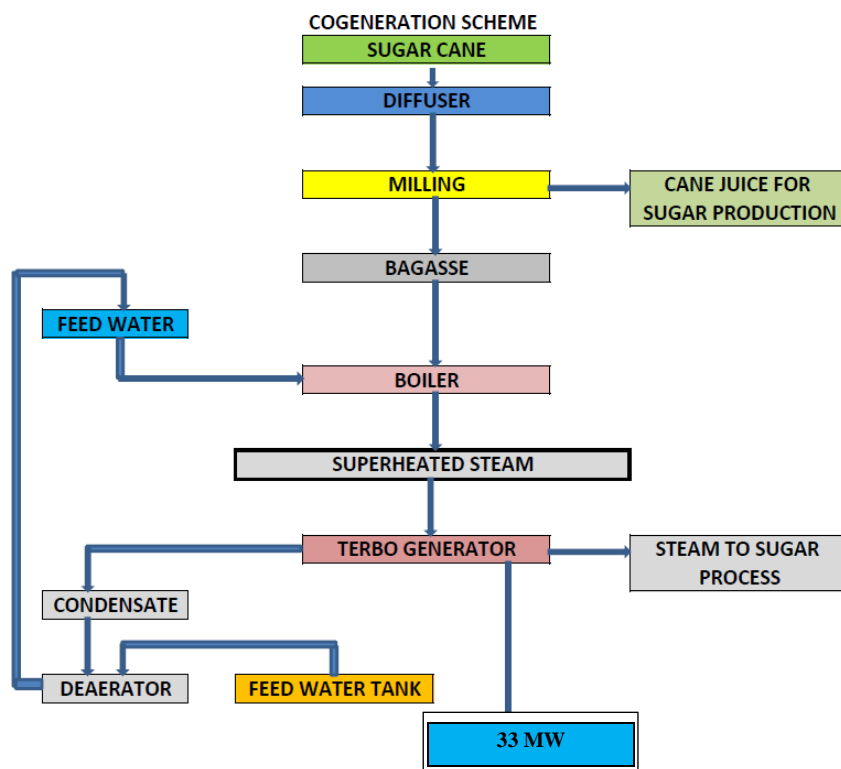

Some of the salient features of the project equipment can be found in the below mentioned table:

Parameters/Description	140 TPH	50 TPH
Boiler	1 No.	1 No
Steam Temperature (°C)	515°C	515°C
Rated Steam Pressure (kg/cm ²)	87 kg/cm ²	87 kg/cm ²
Feed Water Temperature (°C)	117°C	117°C
Registry No. of Boiler	MR/14935	MR/14986
Steam Flowmeter	Differential Pressure Transmitter	Differential Pressure Transmitter
Tag No	FT-202	FT-201
Serial No	01928993	01929313
Steam Pressure Transmitter		
Serial no	01929087	01939321
Range	0 to 150 Kg/cm ²	0 to 150 Kg/cm ²
Steam Pressure gauge		
Tag No	B2_PG-06	B1_PG-06
Range	0 to 160 Kg/cm ²	0 to 160 Kg/cm ²

Steam Temperature Gauge		
Tag no	B2_TG-02	B2_TG-02
Range	0 to 700 °C	0 to 700 °C

A.5. Parties and project participants >>


Project activity does not involve any public funding from Annex I Party, which leads to the diversion of the official development assistance.

Party (Host)	Participants/Aggregator
India	<p>Project Owner: M/s Sahakar Maharshi Shankarrao Mohite-Patil Sahakari Sakhar Karkhana Ltd. Shankarnagar at Akluj Tal. Malshiras, Dist. Solapur, Maharashtra- 413118.</p> <p>Project Aggregator: Energy Advisory Services Pvt Limited, Bangalore, Maharashtra. Email: manoj@easpl.co.in</p>

A.6. Baseline Emissions>>


BASELINE SCENARIO

Electricity and heat would be produced by more-carbon-intensive technologies based on fossil fuel or less-efficient biomass power and heat plants. Biomass could partly decay under anaerobic conditions, bringing about methane emissions.

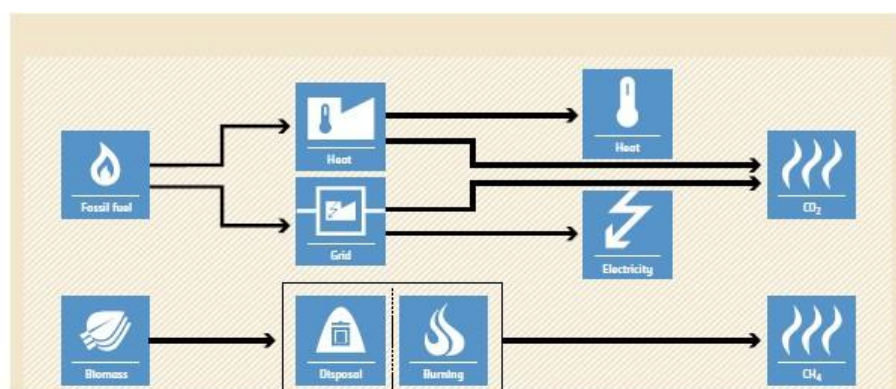

PROJECT SCENARIO

Use of biomass for power and heat generation instead of fossil fuel or increase of the efficiency of biomass-fuelled power and heat plants. Biomass is used as fuel and decay of biomass is avoided.

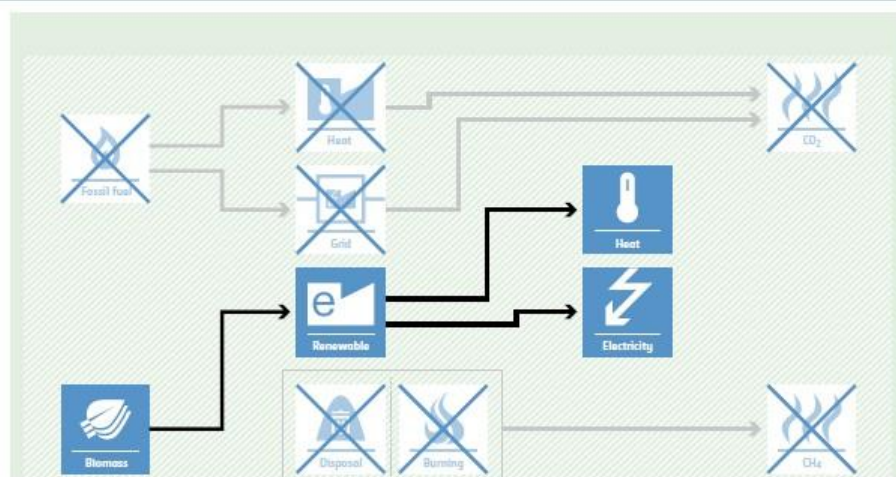

The proposed project activity uses bagasse as fuel for cogeneration unit. The bagasse being a renewable biomass fuel does not add any net carbon-dioxide to the atmosphere because of the carbon recycling during growth of sugar cane. Therefore, the project activity will lead to zero CO₂ on-site emissions associated with bagasse combustion.

The operation during crushing season is of 180 days during season days and 135 days during off-season. Actual number of mill operation days will be mentioned in the monitoring period. Without the project activity, total energy supplied from the boiler would have been taken-up by coal fired boiler, and energy transferred to the grid would have been imported from grid mix and emission of CO₂ would have occurred due to combustion of conventional fossil fuels. Considering the export of clean electricity to the fossil fuel dominated grid by the project activity there will be continuous GHG reductions, as it would avoid equivalent GHG emissions.

A.7. Debundling>>

This project is not a debundled component of a larger registered carbon offset project activity. There is no registered large-scale UCR project activity or a request for registration by another small-scale project activity:

- By the same project participants;
- In the same project category and technology/measure; and
- Whose project boundary is within 1 km of the project boundary of the proposed small-scale activity at the closest point.

SECTION B. Application of methodologies and standardized baselines

B.1. References to methodologies and standardized baselines >>

SECTORAL SCOPE - 01 Energy industries (Renewable/Non-renewable sources)

TYPE I - Renewable Energy Projects

CATEGORY- ACM0006: “Electricity and heat generation from biomass” Version 16.0

B.2. Applicability of methodologies and standardized baselines >>

This methodology is applicable to project activities that operate biomass (co-)fired power-and-heat plants. The cogen plant can be considered as per the below applicability:

Applicability Criteria	Project Condition
<p>The methodology is applicable under the following conditions:</p> <ul style="list-style-type: none">(a) Biomass used by the project plant is limited to biomass residues, biogas, RDF2 and/or biomass from dedicated plantations;(b) Fossil fuels may be co-fired in the project plant. However, the amount of fossil fuels co-fired does not exceed 80% of the total fuel fired on energy basis.(c) For projects that use biomass residues from a production process (e.g., production of sugar or wood panel boards), the implementation of the project does not result in an increase of the processing capacity of (the industrial facility generating the residues) raw input (e.g., sugar, rice, logs, etc.) or in other substantial changes (e.g. product change) in this process;(d) The biomass used by the project plant is not stored for more than one year;(e) The biomass used by the project plant is not processed chemically or biologically (e.g. through esterification, fermentation, hydrolysis, pyrolysis, bio- or chemical-degradation, etc.) prior to combustion. Drying and mechanical processing, such as shredding and pelletization, are allowed.	<p>The project is implemented to use 100% of the bagasse in the crushing season, during off season bagasse is imported from outside. hence the criteria points (c), (d) and (e) are applicable.</p>

<p>In the case of fuel switch project activities, the use of biomass or the increase in the use of biomass as compared to the baseline scenario is technically not possible at the project site without a capital investment in:</p> <ul style="list-style-type: none"> (a) The retrofit or replacement of existing heat generators/boilers; or (b) The installation of new heat generators/boilers; or (c) A new dedicated supply chain of biomass established for the purpose of the project (e.g., collecting and cleaning contaminated new sources of biomass residues that could otherwise not be used for energy purposes); or (d) Equipment for preparation and feeding of biomass. 	<p>The project is a new greenfield project and hence this criterion is not applicable.</p>
<p>If biogas is used for power and heat generation, the biogas must be generated by anaerobic digestion of wastewater, and:</p> <ul style="list-style-type: none"> (a) If the wastewater generation source is registered as a CDM project activity, the details of the wastewater project shall be included in the PDD, and emission reductions from biogas energy generation are claimed using this methodology; (b) If the wastewater source is not a CDM project, the amount of biogas does not exceed 50% of the total fuel fired on energy basis. 	<p>There is no production of biogas and hence this criterion is not applicable.</p>
<p>In the case biomass from dedicated plantations is used, the “TOOL16: Project and leakage emissions from biomass” shall apply to determine the relevant project and leakage emissions from cultivation of biomass and from the utilization of biomass residues.</p>	<p>The bagasse produced as a waste of the sugar mill is being used for the generation of steam, and during. and hence this criterion is also not applicable. During offseason biomass will be bought.</p>

B.3. Applicability of double counting emission reductions >>


The project is not registered in any other GHG mechanism. Hence, there will not be any double counting possibility.

B.4. Project boundary, sources and greenhouse gases (GHGs)>>

The spatial extent of the project boundary encompasses:

- All plants generating power and/or heat located at the project site, whether fired with biomass, fossil fuels or a combination of both.
- All power plants connected physically to the electricity system (grid) that the project plant is connected to.

- The means of transportation of biomass to the project site.
- If the feedstock is biomass residues, the site where the biomass residues would have been left for decay or dumped.

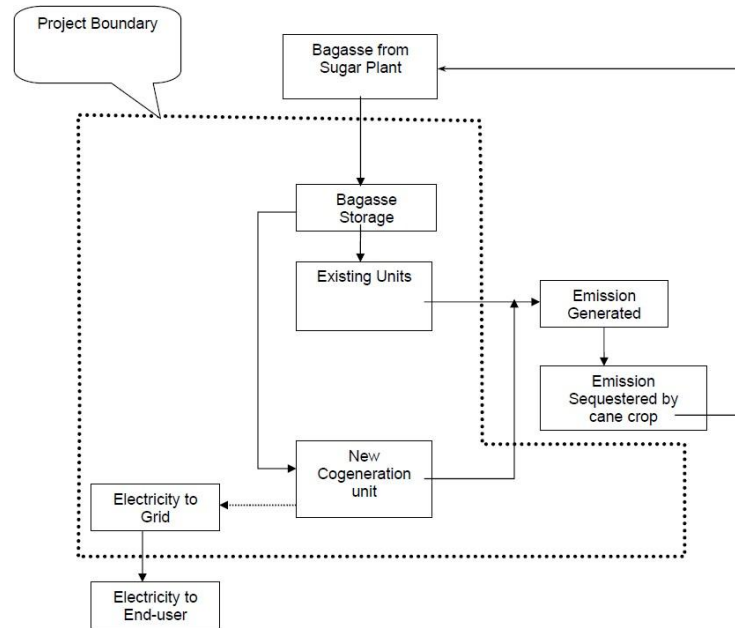

B.5. Establishment and description of baseline scenario >>

❖ Emission reductions are calculated as follows:

$$ER_y = BE_y - PE_y - LE_y \quad (\text{Eq. 1})$$

Where,

ER_y = Emissions reductions in year y (t CO₂)

BE_y = Baseline emissions in year y (t CO₂)

PE_y = Project emissions in year y (t CO₂)

LE_y = Leakage emissions in year y (t CO₂)

The baseline scenario identified at the PCN stage of the project activity is:

Renewable energy technologies that displace technologies using fossil fuels, wherein the simplified baseline is the fuel consumption of the technologies that would have been used in the absence of the project activity, times an emission factor for the fossil fuel displaced. The baseline emissions due to displacement of electricity are determined by net quantity of electricity generation as a result of the project activity (incremental to baseline generation) during the year y in MWh times the CO₂ emission factor for the electricity displaced due to the project activity during the year y in tons CO₂/MWh. Given that steam and electric power generation for internal consumption is part of the present project activity, emission reductions are only claimed from on-site incremental power generation that is injected to the grid. Therefore, the baseline scenario is the emission of GHG from the present energy grid. Emission Reductions (ER_y) The emission reduction due to the project activity is calculated as the difference between the baseline emissions and the sum of the project emissions and the leakage:

$$ER_y = BE_y - (PE_y + LE_y)$$

Equation-(1)

BE_y= Baseline emissions in year y (t CO₂e)

As mentioned in the methodology the baseline emissions are calculated as follows:

$$\mathbf{BE}_y = \mathbf{EG}_{\text{grid},y} * \mathbf{EF}_{\text{grid},y} \quad \text{Equation (2)}$$

Where:

EG_{grid,y} = Quantity of net electricity generation that is fed into the local grid as a result of the implementation of the project activity in year y (MWh)

EF_{grid,y} = The CO₂ emission factor for grid connected power generation in year y calculated using UCR Standard emission factor (0.9 tCO₂/MWh).

❖ Project Emissions is calculated as follow:

Eq 3

$$PE_y = PE_{Biomass,y} + PE_{FF,y} + PE_{GR1,y} + PE_{GR2,y} + PE_{CBR,y} + PE_{BG2,y}$$

Where,

PE_y	=	Project emissions in year y (t CO ₂)
$PE_{Biomass,y}$	=	Project emissions associated with the biomass and biomass residues in year y (t CO ₂)
$PE_{FF,y}$	=	Emissions during the year y due to fossil fuel consumption at the projectsite (t CO ₂)
$PE_{GR1,y}$	=	Emissions during the year y due to grid electricity imports to the projectsite (t CO ₂)
$PE_{GR2,y}$	=	Emissions due to a reduction in electricity generation at the project site in year y (t CO ₂)
$PE_{CBR,y}$	=	Emissions from the combustion of biomass during the year y (t CO ₂ e)
$PE_{BG2,y}$	=	Emissions from the production of biogas in year y (t CO ₂ e)

In this project activity electricity is imported from the grid ($PE_{GR1,y}$) which will count as project emissions. This amount will be deducted from the total value of emission reduction post-ante.

Therefore

$$PE_y = 0 \quad \text{(Eq. 4)}$$

❖ Leakage

It is an integrated Cogen plant. The biomass is the output of the sugar mill, which is being consumed by the power plant as a source of fuel. Therefore, there is no leakage due to cultivation of biomass in a dedicated plantation. As it is integrated Cogen power plant, there is no leakage due to transportation of biomass from outside of project activity.

Also, biomass is not processed outside of project boundary hence there is no leakage emissions being generated.

$$LE_y = 0 \quad \text{(Eq. 5)}$$

Estimated yearly MWh grid supply	=	51,222 MWh
Estimated yearly ERs	=	46,100CoUs

B.6. Prior History>>

The project has never applied for the GHG mechanism in the past.

B.7. Changes to start date of crediting period >>

The start date of crediting period is 01-01-2013.

B.8. Permanent changes from PCN monitoring plan, applied methodology or applied standardized baseline >>

There are no permanent changes from registered PCN monitoring plan and applied methodology.

B.9. Monitoring period number and duration>>

First Issuance Period	:	10 Years
Crediting Period	:	01-01-2013 to 31-12-2022
Monitoring Period	:	01-01-2013 to 31-12-2022

B.10. Monitoring Plan

Data and Parameters to be monitored

Data / Parameter	EF_{Gridy}
Data unit	tCO ₂ /MWh
Description	A "grid emission factor" refers to a CO ₂ emission factor (tCO ₂ /MWh) which will be associated with each unit of electricity provided by an electricity system. The UCR recommends an emission factor of 0.9 tCO ₂ /MWh for the 2013 - 2020 years as a fairly conservative estimate for Indian projects not previously verified under any GHG program. Hence, the same emission factor has been considered to calculate the emission reduction under conservative approach.
Source of data	https://a23e347601d72166dcd6-16da518ed3035d35cf0439f1cdf449c9.ssl.cf2.rackcdn.com/Documents/UCRC-oUStandardAug2022updatedVer6_090822220127104470.pdf
Value applied	0.9
Measurement methods and procedures	-
Monitoring frequency	Ex-ante fixed parameter
Purpose of Data	For the calculation of Emission Factor of the grid
Additional Comment	The combined margin emission factor as per CEA database (current version 16, Year 2021) results into higher emission factor. Hence for 2021 vintage UCR default emission factor remains conservative.

Data / Parameter	EG_y
Data unit	MWh/year

Description	Quantity of net electricity supplied to the grid as a result of the implementation of the project activity in year y (MWh)
Source of data	Energy Bills/invoices
Measurement procedures (if any):	<p>Data Type: Measured</p> <p>Monitoring equipment: Energy Meters are used for monitoring</p> <p>Recording Frequency: Continuous monitoring and Monthly recording from Energy Meters, Summarized Annually</p> <p>Archiving Policy: Paper & Electronic</p> <p>Calibration frequency: 5 years (as per CEA provision)</p> <p>Generally, the calculation is done by the Authority/Discom and the project proponent has no control over the authority for the calculation. Therefore, based on the joint meter reading certificates/credit notes, the project shall raise the invoice for monthly payments.</p> <p>$EL = E(\text{export}) - E(\text{import})$</p>
Measurement Frequency:	Monthly
Value applied:	To be applied as per actual data
QA/QC procedures applied:	<p>Calibration of the Main meters will be carried out once in five (5) years as per National Standards (as per the provision of CEA, India) and faulty meters will be duly replaced immediately as per the provision of power purchase agreement.</p> <p>Cross Checking:</p> <p>Quantity of net electricity supplied to the grid will be cross checked from the invoices raised by the project participant to the grid.</p>
Purpose of data:	The Data/Parameter is required to calculate the baseline emission.
Any comment:	All the data will be archived till a period of two years from the end of the crediting period.