

## Verification Report for

### UCR ID No. 299

DESCRIPTION	DATA
<b>Project Owner Name :</b>	<b>M/s. 18 MW Biomass Based Power Generation at GM Sugars and Energy Ltd by Energy Advisory Services Private Limited</b>
<b>Project Location :</b>	Village: Sangur
	Taluka – Haveri
	District Haveri – 581148
	State – Karnataka, India
<b>Project Aggregator:</b>	Energy Advisory Services Pvt Limited - Bangalore - Karnataka.
<b>Scale of the project activity</b>	Large Scale
<b>Date</b>	7 <sup>th</sup> July -2023

DESCRIPTION	DATA
<b>Verification Firm:</b>	<b>Limbaja Energy</b>
	2 Shrijinagar, Arihantnagar Road,
	Nr. Aashapura cottages,
	Bhuj-Kachchh-370001
	M : 9714253756
	limbajaenergy@gmail.com
<b>Team Details:</b>	Mr. Jayprakash Jethi

COVER PAGE	
Project Verification Report Form (VR)	
BASIC INFORMATION	
Name of approved UCR Project Verifier / Reference No.	Limbaja Energy
Type of Accreditation	<input type="checkbox"/> CDM or other GHG <input type="checkbox"/> Accreditation ISO 14065 Accreditation  <input checked="" type="checkbox"/> UCR Approved
Approved UCR Scopes and GHG Sectoral scopes for Project Verification	01 Energy industries (Renewable/Non-renewable sources)
Validity of UCR approval of Verifier	Aug-2022 onwards
Completion date of this VR	7 <sup>th</sup> July 2023
Title of the project activity	18 MW Biomass Based Power Generation at GM Sugars and Energy Ltd by Energy Advisory Services Private Limited

<b>Project reference no.</b> (as provided by UCR Program)	299
<b>Name of Entity requesting verification service</b> (can be Project Owners themselves or any Entity having authorization of Project Owners, example aggregator.)	Energy Advisory Services Pvt Limited - Bangalore - Karnataka.
<b>Contact details of the representative of the Entity, requesting verification service</b> (Focal Point assigned for all communications)	<b>Energy Advisory Services Pvt Limited - Bangalore - Karnataka.</b> <a href="mailto:nikhil@easpl.co.in">nikhil@easpl.co.in</a> 98673 67719
<b>Country where project is located</b>	India
<b>Applied methodologies</b> (approved methodologies by UCR Standard used)	ACM0006: "Electricity and heat generation from biomass" Version 16.0
<b>Project Verification Criteria:</b> Mandatory requirements to be assessed	<input checked="" type="checkbox"/> UCR Standard <input checked="" type="checkbox"/> Applicable Approved Methodology <input type="checkbox"/> Applicable Legal requirements /rules of host country <input checked="" type="checkbox"/> Eligibility of the Project Type <input checked="" type="checkbox"/> Start date of the Project activity <input checked="" type="checkbox"/> Meet applicability conditions in the applied methodology <input checked="" type="checkbox"/> Credible Baseline


	<input checked="" type="checkbox"/> Do No Harm Test <input checked="" type="checkbox"/> Emission Reduction calculations <input checked="" type="checkbox"/> Monitoring Report <input checked="" type="checkbox"/> No GHG Double Counting <input type="checkbox"/> Others (please mention below)
<b>Project Verification Criteria:</b>  Optional requirements to be assessed	<input checked="" type="checkbox"/> Environmental Safeguards Standard and do-no-harm criteria  <input type="checkbox"/> Social Safeguards Standard do- no-harm criteria
<b>Project Verifier's Confirmation:</b>  The <i>UCR Project Verifier</i> has verified the UCR project activity and therefore confirms the following:	The UCR Project Verifier <b>Limbaja Energy</b> certifies the following with respect to the UCR Project Activity “18 MW Biomass Based Power Generation at GM Sugars and Energy Ltd by Energy Advisory Services Private Limited “  <input checked="" type="checkbox"/> The Project Owner has correctly described the Project Activity in the Project Concept Note Version 2.0 (dated 5 <sup>th</sup> July 2023) including the applicability of the approved methodology <b>ACM0006</b> : Electricity and heat generation from biomass (Ver. 16) & UCR Standard for

**Jayprakash Jethi**

Energy Auditor

+91 97142 53756

	<p>Emission Factor and meets the methodology applicability conditions and has achieved the estimated GHG emission reductions, complies with the monitoring methodology and has calculated emission reductions estimates correctly and conservatively.</p> <p><input checked="" type="checkbox"/> The Project Activity is likely to generate GHG emission reductions amounting to the estimated <b>[2,88,517]</b> TCO<sub>2</sub>e, as indicated in the PCN, which are additional to the reductions that are likely to occur in absence of the Project Activity and complies with all applicable UCR rules, including ISO 14064-2 and ISO 14064-3.</p> <p><input checked="" type="checkbox"/> The Project Activity is not likely to cause any net-harm to the environment and/or society</p> <p><input checked="" type="checkbox"/> The Project Activity complies with all the applicable UCR rules<sup>1</sup></p>
--	--

	and therefore, recommends UCR Program to register the Project activity with above mentioned labels.
<b>Project Verification Report, reference number and date of approval</b>	Verification Report UCR Project ID: 299
<b>Name of the authorised personnel of UCR Project Verifier and his/her signature with date</b>	<p>Limbaja Energy</p> <div>  <p>Jethi J.P.</p> <p>07/07/2023</p> </div>



**PROJECT VERIFICATION REPORT****A. Executive Summary**

The verification work has been contracted by project aggregator Energy Advisory Services Pvt. Ltd. to perform an independent verification of its UCR project titled **“18 MW Biomass Based Power Generation at GM Sugars and Energy Ltd by Energy Advisory Services Private Limited” UCR approved project ID:299**, to establish number of CoUs generated by project over the crediting period from 01/04/2013 to 31/12/2022 (both days included).

**Verification for the period: 01/04/2013 to 31/12/2022**

In my opinion, the total GHG emission reductions over the crediting / verification period stated in the Monitoring Report (MR), submitted to me is found to be correct and in line with the UCR guidelines.

The GHG emission reductions were calculated on the basis of **ACM0006**: Electricity and heat generation from biomass (Ver. 16) & UCR Standard for Emission Factor

The verification was done remotely by way of video calls, phone calls and submission of documents for verification through emails as per UCR guidelines.

I am able to certify that the emission reductions from the **18 MW Biomass Based Power Generation at GM Sugars and Energy Ltd by Energy Advisory Services Private Limited** (UCR ID – 299) for the period 01/04/2013 to 31/12/2022 amounts to 2,88,517 CoUs (2,88,517 tCO<sub>2</sub>e).

### A.1 Scope of Verification

The scope of the verification is the independent, objective review and ex-post determination of the monitored reductions in GHG emission by the project activity.

- 1) The quality of data management and records of underlying data;
- 2) Completeness and accuracy of calculations and baseline emission reports;
- 3) Proper inclusion and documentation of all project locations,
- 4) Correct application of offset rules for filling Baseline Period data gaps;
- 5) Other data, methods and procedures deemed necessary to establish the accuracy of emission reductions.
- 6) Agreement stating Assurance to avoid double accounting for the project to be verified, along with required proof.

The project is assessed against the requirements of the UCR programme verification Guidance Document, UCR Standard, UCR Programme Manual and related rules and guidelines. Due professional care has been exercised and ethical conduct has been followed by the assessment team during the verification process. The verification report is a fair presentation of the verification activity. The validation of project is not part of present assignment and projects deemed validated post registration by UCR.

### A.2 Description of the Project

As described in the Project Concept Note (PCN) Version 2.0, the project activity involves Biomass Cogeneration project of installed aggregated capacity of 18 MW Biomass Based Power Generation at GM Sugars and Energy Ltd by Energy Advisory Services Private Limited at District: Haveri, Village: Sangur, Tehsil: Haveri, State: Karnataka 581148 Country: India



**Jayprakash Jethi**

Energy Auditor

**+91 97142 53756**

Latitude: 14.77593°N i.e. 14°46'33.348"N, Longitude: 75.31219°E i.e. 75°18'43.884"E. The details of the project activity are verified with the project report copy submitted for verification.

As mentioned in the Monitoring Report and Emission Reduction Calculation sheet submitted for the verification, This project activity involves generation of grid connected electricity from the construction and operation of a new cogeneration power-based project for selling it to National and Regional grid. The project activity has installed capacity of 18 MW which will qualify for a large-scale project activity under Type-I of the Large-Scale methodology. The project status is corresponding to the methodology ACM0006, Version 16.

Verified total emission reductions achieved through the project activity during the monitoring period is summarised below:

Summary of the Project Activity	
Start date of this Monitoring Period	01/04/2013
Carbon credits claimed up to	31/12/2022
Total Carbon Credit (tCO <sub>2</sub> eq)	2,88,517
Project Emission	0
Leakage Emission	0

**Jayprakash Jethi**

Energy Auditor

+91 97142 53756

## B. Project Verification team, technical reviewer and approver

SN	Role	Last name	First name	Affiliation	Involvement in		
					Document review	Off-Site inspection	Interviews
1	Lead Verifier and Energy Auditor	Jethi	Jayprakash	Limbaja Energy (UCR authorised)	Yes	No	Yes

## **C. Means of Project Verification**

### **C.1 Desk/document review**

The project documents submitted to UCR approved verifier Limbaja Energy was reviewed and validated by the lead verifier. The documents reviewed includes verification of legal status of individual project owner for consistency, project related documents like installation and commissioning of equipment used in project activity, environmental clearances from state or Central Pollution Control Board (CPCB), monitoring related parameters including measuring instruments and their calibration records for the crediting period etc.

The PCN Version 2.0 is made available to verifier post approval by UCR which is considered as validated documents and the content of validated PCN Version 2.0 are considered as record wherever required. Further the communication agreement made between project owner and project aggregator is document of UCR registry hence the project aggregator is treated as authorized representative of project owner. All the documents submitted by project aggregator to verifier is treated as documents submission on behalf of project owner.

The list of submitted document is available in subsequent section of this verification report under section “Document reviewed or referenced”.

**Jayprakash Jethi**

Energy Auditor

+91 97142 53756

## C.2 Off-site inspection: Not Applicable

Date of off site inspection: DD/MM/YYYY to DD/MM/YYYY

No.	Activity performed Off-Site	Site location	Date
1.			
...			

## C.3 Interviews

No.	Interview			Date	Subject
	Last name	First name	Affiliation		
1.	H	Hanumanthappa	DGM (Co-Gen)	06/07/2023	Meter calibration, Double Counting and project overview

## C.4 Sampling approach: Not Applicable

## C.5 Clarification request (CLs), corrective action request (CARs) and forward action request (FARs) raised

SN	Areas of Project Verification findings	No. of CL	No. of CAR	No. of FAR
<b>Green House Gas (GHG)</b>				
1	Identification and Eligibility of project type	Nil	Nil	Nil
2	General description of project activity	Nil	Nil	Nil
3	Application and selection of methodologies and standardized baselines	-	-	-
	i) Application of methodologies and standardized baselines		Nil	Nil
	ii) Deviation from methodology and/or methodological tool	Nil	Nil	Nil
	iii) Clarification on applicability of methodology, tool and/or standardized baseline	Nil	Nil	Nil
	iv) Project boundary, sources and GHGs	Nil	Nil	Nil
	v) Baseline scenario	Nil	Nil	Nil
	vi) Estimation of emission reductions or net anthropogenic removals	Nil	Nil	Nil
	vii) Monitoring Report	Nil	Nil	Nil
4	Start date, crediting period and duration	Nil	Nil	Nil
5	Environmental impacts	Nil	Nil	Nil
6	Project Owner- Identification and communication	Nil	Nil	Nil
7	Others (please specify)	Nil	Nil	Nil
	<b>Total</b>	Nil	Nil	Nil

## D Project Finding

### D.1 Identification and eligibility of project type

SN	Particular	Remarks
1	<b>Means of Project Verification</b>	This Project is taken reference of CDM Methodology ACM0006: “Electricity and heat generation from biomass” Version 16.0 Biomass Cogeneration Energy Projects.
2	<b>Findings</b>	1) Project activity is described through UCR approved PCN. 2) UCR project communication agreement clearly defines the Project Proponent and Project Aggregator.
3	<b>Conclusion</b>	<p>The UCR approved format is used for description and project meets the requirement of UCR verification standard and UCR project standard. UCR project communication agreement submitted to verifier and the same has been verified. Methodology referenced and applied appropriately describing the project type. The eligibility of project aggregator is verified using UCR communication agreement, Project correctly applies the verification standard, UCR project standard and UCR regulations.</p> <p>The project activity is overall meeting the requirements of UCR Verification standard and UCR project standard.</p>



## D.2 General description of project activity

SN	Particular	Remarks
1	<b>Means of Project Verification</b>	The project activity involves the setting up of a Biomass based co-generation. The commissioning certificate is referred. The project capacity was verified through purchase order invoices of turbine. The power evacuation at the Substation is confirmed by electricity generation sheet.
2	<b>Findings</b>	1. Project Commissioning date is mentioned in the commissioning certificate. 2. Turbine Capacity is same as mentioned technical specifications. 3. Project implementation and sale of energy abide the power purchase agreement.
3	<b>Conclusion</b>	The description of the project activity is verified to be true based on the review of PCN Version 2.0, MR, Commissioning Certificate, Purchase Order Copies and Technical Specification sheet.

**Jayprakash Jethi**

Energy Auditor

+91 97142 53756

## D.3 Application and selection of methodologies and standardized baselines

### D.3.1 Application of methodology and standardized baselines

SN	Particular	Remarks
1	<b>Means of Project Verification</b>	This Project is taken reference of CDM Methodology ACM0006: “Electricity and heat generation from biomass” Version 16.0. For the applicability mentioned in the PCN and MR, Commissioning certificate, Detailed Project Report and PPA documents were referred.
2	<b>Findings</b>	The methodology applied is applicable for the project activity.
3	<b>Conclusion</b>	Methodology application is appropriate meeting the requirements of UCR and its standardized baseline. The methodology version is correct and valid. Referenced methodology is applicable to project activity.

**Jayprakash Jethi**

Energy Auditor

+91 97142 53756

## D.3.2 Clarification on applicability of methodology, tool and/or standardized baseline

SN	Particular	Remarks
1	<b>Means of Project Verification</b>	The documents reviewed CDM Methodology ACM0006: “Electricity and heat generation from biomass” Version 16.0. UCR Program standard, and UCR Verification Standard.
2	<b>Findings</b>	Emission factor calculated using the methodology is higher than UCR standard recommends.
3	<b>Conclusion</b>	The emission factor considered for the calculation of the emission reductions is verified with the UCR Program Standard. The total installed electrical energy generation capacity of the project equipment does exceed 15 MW thus meeting the requirement of Large-scale project.

### D.3.3 Project boundary, sources and GHGs

SN	Particular	Remarks
1	<b>Means of Project Verification</b>	Letter from Karnataka State Pollution Control Board dated 11/10/2022 Consent No: Format AW-333796
2	<b>Findings</b>	Project boundary is appropriately defined in PCN version 2.0 which is physical and geographical site of power house.
3	<b>Conclusion</b>	Project boundary is correctly defined in PCN version 2.0. GHG source correctly identified and reported. The project meets the requirements of UCR project standard, Verification standard and methodology requirements for boundary, GHG source.

### D.3.4 Baseline scenario


SN	Particular	Remarks
1	<b>Means of Project Verification</b>	PCN Section B.5 and General Project Eligibility Criteria and Guidance, UCR Standard.
2	<b>Findings</b>	Declared information is correct and verified.
3	<b>Conclusion</b>	Baseline scenario is appropriately described. The conservative value for emission considered. The baseline scenario is in accordance with UCR project verification standard and UCR project standard.

## D.3.5 Estimation of emission reductions or net anthropogenic removal

SN	Particular	Remarks
1	<b>Means of Project Verification</b>	Export and Import Meter Reading Reports, and General Project Eligibility Criteria and Guidance, UCR Standard
2	<b>Findings</b>	None
3	<b>Conclusion</b>	Emission reductions are correctly calculated. The instruments are calibrated and hence the emission reduction is reported correctly and meets the requirements of UCR verification standard and UCR project standard.

## D.3.6 Monitoring Report

SN	Particular	Remarks						
1	Means of Project Verification	Meter Calibration reports, Export and Import Meter Reading Reports, and General Project Eligibility Criteria and Guidance, UCR Standard,						
2	Findings	None						
3	Conclusion	<div>Meter testing reports are provided</div> <div>Meter details are mentioned below.</div> <div>Energy meters installed at the site:</div> <div>Main Meter</div> <table><tr><td>Make</td><td>L &amp; T</td></tr><tr><td>Serial No.</td><td>11071845</td></tr><tr><td>Calibration Date</td><td>20-Oct-22</td></tr></table>	Make	L & T	Serial No.	11071845	Calibration Date	20-Oct-22
Make	L & T							
Serial No.	11071845							
Calibration Date	20-Oct-22							

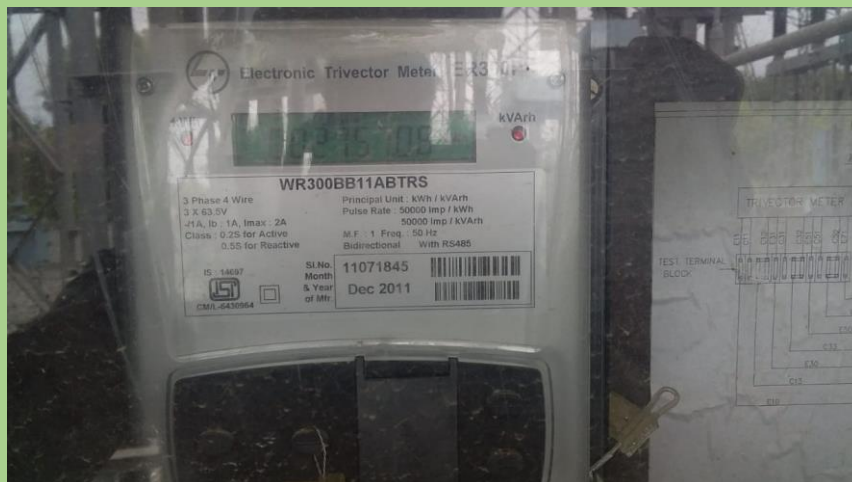

As per Central Electricity Authority (Installation and Operation of Meters) (Amendment) Regulations, 2019 clause 14 (i)-b “All Interface Meters shall be tested on-site using accredited test laboratory for routine accuracy testing at least once in five years and recalibrated if required.

The Calibration reports are verified with available serial number of meters. The errors are within permissible limits.

Monitoring parameter as reported through MR adequately represents the parameters relevant to emission reduction calculation. The number of CoUs generation is calculated based on this accurately reported data. The calculation was done using excel sheet where all the parameters reported. The emission factor for electricity is as per UCR standard for. Monitoring and emission reduction calculations are correctly calculated and reported. The monitoring report meets the requirements of UCR project verification requirements



## D.4 Start date, crediting period and duration

SN	Particular	Remarks
1	<b>Means of Project Verification</b>	PCN Version 2.0 and MR, Commissioning certificate, Detailed Project Report and PPA documents were referred.
2	<b>Findings</b>	None
3	<b>Conclusion</b>	The start date, crediting period and project duration reported correctly and this meets the requirements of UCR verification standard and UCR project standard.

## D.5 Positive Environmental impacts

SN	Particular	Remarks
1	<b>Means of Project Verification</b>	PCN Version 2.0
2	<b>Findings</b>	Declared information is correct and verified.
3	<b>Conclusion</b>	The positive environmental impact meets the requirement of UCR verification standard and UCR project standard

## D.6 Project Owner- Identification and communication

SN	Particular	Remarks
1	<b>Means of Project Verification</b>	PCN Version 2.0, Communication Agreement, MR, Commissioning certificate, Power Purchase Agreement.
2	<b>Findings</b>	Declared information is correct and verified.
3	<b>Conclusion</b>	Project owner identified through communication agreement signed between PP and PA. Equipment purchase order and commission verified. Also, legal document like Power Purchase Agreement clearly establishes the project owner. The identification and communication correctly meet the requirement of project verification and UCR project standard.

## D.7 Positive Social Impact

SN	Particular	Remarks
1	<b>Means of Project Verification</b>	Project has provided temporary employment to local people during its installation and commissioning. Also post commissioning some of people have employed permanently and local people were engaged leading to social financial benefit to surrounding. Overall social impact of project implementation is positive on the surrounding area.
2	<b>Findings</b>	None
3	<b>Conclusion</b>	Project has overall positive social impact.

## D.8 Sustainable development aspects (if any)

SN	Particular	Remarks
1	<b>Means of Project Verification</b>	PCN Version 2.0 were referred.
2	<b>Findings</b>	Declared information is correct and verified.
3	<b>Conclusion</b>	The Project addresses SDG 7 Affordable, SDG 8 Decent work and Economic Growth, SDG 13 Climate Action

## **E. Internal quality control:**

- ✚ Due professional care has been taken while reviewing the submitted document.
- ✚ There is no conflict of interest as the verifier has no other engagement with either aggregator or project owner directly or indirectly.
- ✚ Verification team consists of experience personnel.
- ✚ Technical review is performed by experienced and independent person

## **F. Project Verification Opinion**

Considering the above-mentioned verification conducted on the basis of UCR Protocol, which draws reference from UCR Protocol Standard Baseline, ACM0006: Electricity and heat generation from biomass (Ver. 16) & UCR Standard for Emission Factor the documents submitted during the verification including the data, Project Concept Note (PCN) Version 2.0 / Monitoring Report (MR), I am able to certify that the emission reductions from the 18 MW Biomass Based Power Generation at GM Sugars and Energy Ltd by Energy Advisory Services Private Limited (UCR ID – 299) for the period 01/04/2013 to 31/12/2022 amounts to 2,88,517 CoUs (2,88,517 tCO<sub>2</sub>e).

## Appendix 1. Abbreviations

SN	Abbreviations	Full texts
1	UCR	Universal Carbon Registry
2	CPCB	Central Pollution Control Board
3	KPCB	Karnataka Pollution Control Board
4	PGCIL	Power Grid Corporation of India Ltd.
5	KPTCL	Karnataka Power Transmission Corporation Limited
6	BESCOM	Bangalore Electricity Supply Company Limited
7	HESCOM	Hubli Electricity Supply Company Limited
8	MESCL	Mangalore Electricity Supply Company Ltd
9	GESCL	Gulbarga Electricity Supply Company Ltd
10	IEX	Indian Energy Exchange Limited
11	APPL	Abja Power Private Limited
12	MR	Monitoring report
13	PCN	Project Concept Note
14	VR	Verification Report
15	VS	Verification Statement
16	DAA	Avoidance of Double Accounting Agreement
17	COD	Commercial Operation Date
18	PP/PO	Project Proponent / Project Owner
19	PA	Project Aggregator
20	PPA	Power Purchase Agreement
21	ER	Emission Reduction
22	COUs	Carbon offset Units.
23	tCO <sub>2</sub> e	Tons of Carbon Dioxide Equivalent
24	kWh	Kilo-Watt Hour
25	mWh	Mega-Watt Hour

**Jayprakash Jethi**

Energy Auditor

+91 97142 53756

SN	Abbreviations	Full texts
26	kW	Kilo-Watt
27	mWh	Mega-Watt
28	CDM	Clean Development Mechanism
29	SDG	Sustainable Development Goal
30	CAR	Corrective Action Request
31	CR	Clarification Request
32	FAR	Forward Action Request
33	GHG	Green House Gas

## Appendix 2. Competence of team members and technical reviewers

SN	Last name	First name	Affiliation	Technical Experience
1	Jethi	Jayprakash	Lead Verifier and Energy Auditor at Limbaja Energy	Mr. Jayprakash Jethi is post graduate having more than 7 years of experience in the field of Energy Audit, Energy conservation and emission study.

## Appendix 3. Document reviewed or referenced

SN	Author	Title	Provider
1	UCR	Communication Agreement	PA
2	Energy Advisory Services Pvt. Ltd.	Project Concept Note	PA
3	Energy Advisory Services Pvt. Ltd.	Monitoring Report	PA
4	Energy Advisory Services Pvt. Ltd.	Avoidance of double accounting	PA
5	Energy Advisory Services Pvt. Ltd.	Emission Reduction Excel	PA

**Jayprakash Jethi**

Energy Auditor

+91 97142 53756

SN	Author	Title	Provider
6	KPTCL	Meter Calibration	PA
7	KPTCL	Electricity Export Bill	PA
8	KPTCL	Electricity Import Bill	PA
9	APPL	Sale Agreement	PA
10	KPTCL	Commissioning Certificate	PA



## Appendix 4. Clarification requests, corrective action requests and forward action requests

Table 1. CLs from this Project Verification

CL ID	xx	Section no.	Date: DD/MM/YYYY
Description of CL			
Project Owner's response			Date: DD/MM/YYYY
Documentation provided by Project Owner			
UCR Project Verifier assessment			Date: DD/MM/YYYY

Table 2. CARs from this Project Verification

CAR ID	xx	Section no.	Date: DD/MM/YYYY
Description of CAR			
Project Owner's response			Date: DD/MM/YYYY
Documentation provided by Project Owner			
UCR Project Verifier assessment			Date: DD/MM/YYYY

Table 3. FARs from this Project Verification


FAR ID	xx	Section no.	Date: DD/MM/YYYY
Description of FAR			
Project Owner's response			Date: DD/MM/YYYY
Documentation provided by Project Owner			
UCR Project Verifier assessment			Date: DD/MM/YYYY

**Jayprakash Jethi**

Energy Auditor

+91 97142 53756

### Annexure 1: Photographs of the Co-generation power plant

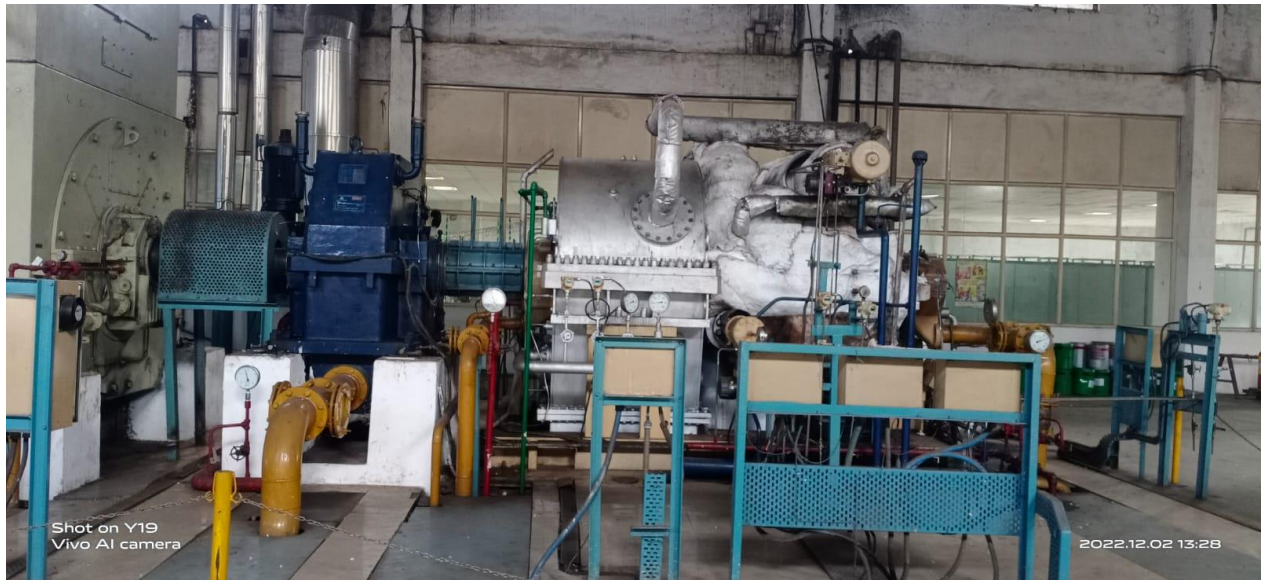



**Jayprakash Jethi**

Energy Auditor

+91 97142 53756



**Jayprakash Jethi**

Energy Auditor


+91 97142 53756

## Annexure 2: Date of Commissioning

**ಕರ್ನಾಟಕ ವಿದ್ಯುತ್ ಪ್ರಸಾರಣ ನಿಗಮ ನಿಯಮಿತ** *BCK-927486*

**KARNATAKA POWER TRANSMISSION CORPORATION LIMITED.**  
Corporate Identity Number (CIN) : U40109KA1999SGC025521.  
Registered office of the Company : Kaveri Bhavan, K.G. Road, Bengaluru-560001

Phone : 08375-235642  
Fax : 08375-235534  
Web Site : www.kptcl.com  
E-mail: eekptcl@yahoo.co.in



Office of the,  
The Executive Engineer(EI),  
TL & SS Division, KPTCL, Near G.H.  
College, P.B. Road, Haveri-581110.

---

ಸಂ:- 936/ಕಾನಿಇಂ/ಪ್ರಮಾಣೀಕರಣ/ಸ/ಕ-61 /17-18/ 147-49 ದಿನಾಂಕ 23 FEB 2018

ಗೆ,  
ಎ.ಜಿ.ಎಂ (ಕೋ-ಜೆನ್)  
ಮೆ|| ಜಿ. ಎಂ. ಶುಗರ್ & ಎನರ್ಜಿ ಅಮಿಟೆಡ್,  
ಸಂಗೂರ ತಾ|| ಜ|| ಹಾವೇರಿ.


ಮಾನ್ಯರೇ,  
ವಿಷಯ: ಮೆ|| ಜಿ. ಎಂ. ಶುಗರ್ & ಎನರ್ಜಿ ಅಮಿಟೆಡ್, ಸಂಗೂರ ರವರ 18 MW Co-Generation Plant ನ  
ಕಾರ್ಯಾರಂಭ ಪ್ರಮಾಣ ಪತ್ರ (Commissioning Certificate) ನೀಡುವ ಕುರಿತು,  
ಉಲ್ಲೇಖ: 1) ಎ.ಜಿ.ಎಂ (ಕೋ-ಜೆನ್) ಮೆ|| ಜಿ. ಎಂ. ಶುಗರ್ & ಎನರ್ಜಿ ಅಮಿಟೆಡ್, ಸಂಗೂರ ರವರ ವಿನಂತಿ  
ಪತ್ರದ ದಿನಾಂಕ:01-02-2018.  
2) ನೋಡಲ್ ಅಧಿಕಾರಿಗಳು, 220ಕೆವಿ, ಸ್ಟೇ ಕೇಂ ಹಾವೇರಿ ರವರ ಪತ್ರ ಸಂಖ್ಯೆ:  
AEE/220KV/HVR/2017-18/F-36/839 Dtd:21-02-2018.


\* \* \* \* \*

ಈ ಮೂಲಕ ದೃಢೀಕರಿಸುವುದೇನೆಂದರೆ, ನೋಡಲ್ ಅಧಿಕಾರಿಗಳು, 220ಕೆವಿ, ಸ್ಟೇ ಕೇಂ ಹಾವೇರಿ ರವರು ತಮ್ಮ ಉಲ್ಲೇಖಿತ  
ಪತ್ರದಲ್ಲಿ ತಿಳಿಸಿರುವಂತೆ ಮೆ|| ಜಿ. ಎಂ. ಶುಗರ್ & ಎನರ್ಜಿ ಅಮಿಟೆಡ್, ಸಂಗೂರ ರವರ 18 MW Co - Generation Plant ನ  
ಕಾರ್ಯಾರಂಭಗೊಂಡ ಮಾಹಿತಿ ಈ ಕೆಳಗಿನಂತಿರುತ್ತದೆ.

1) 18 MW Co -Generation Plant ನ್ನು 220ಕೆವಿ ವಿದ್ಯುತ್ ಸ್ಥಳೀಕರಣ ಕೇಂದ್ರದ 110ಕೆವಿ ಹಾವೇರಿ-ತಿಳುವಳ್ಳಿ  
ಮಾರ್ಗಕ್ಕೆ ಬ್ಯಾಕ್ ಮಾಡಿ ಕೆ.ವಿ.ಪ್ರ.ಸಿ.ಸಿ( KPTCL) ಗೆ ಹೊಂದಾಣಿಕೆಯನ್ನು (Synchronized) ದಿನಾಂಕ 28-01-2012  
19:50 ಘಂಟೆಗೆ ಕೈ ಮಾಡಲಾಯಿತು ನಂತರ,  
2) 220ಕೆವಿ ಸ್ಥಳೀಕರಣ ಕೇಂದ್ರ ಹಾವೇರಿಯಲ್ಲಿ 110ಕೆವಿ ಜಿ. ಎಂ. ಶುಗರ್ ಮಾರ್ಗಕ್ಕಾಗಿ ನಿರ್ಮಿಸಿದ್ದ 110ಕೆವಿ ಫೇ ಯನ್ನು  
ದಿನಾಂಕ 19-05-2012 20:35 ಘಂಟೆಗೆ ಕಾರ್ಯಾರಂಭ (Commissioning) ಮಾಡಲಾಗಿದೆ ಎಂದು ತಿಳಿದುಬಂದಿದೆ.

ATTESTED  
C. N. WODEYAR  
NOTARY HAVERI



ತಮ್ಮ ವಿಶ್ವಾಸಿ  
  
ಕಾರ್ಯನಿರ್ವಾಹಕ ಇಂಜಿನಿಯರ(ವಿ)  
ಪ್ರಸಾರಣ ಮಾರ್ಗ ಮತ್ತು ಉಪಕೇಂದ್ರ ವಿಭಾಗ  
ಕೆ.ವಿ.ಪ್ರ.ಸಿ.ಸಿ, ಹಾವೇರಿ.

**Jayprakash Jethi**

Energy Auditor

+91 97142 53756

## Annexure 3: Assurance to Avoid Double Counting

Unreliable Carbon Registry – Example to Averting Assurance, 2021  
Strictly private and confidential

To,  
Limbaja Energy  
2 Shrijinagar, Arihantnagar Road, Near Aashapura Cottages, Kutch,  
Bhuj-370001  
Gujarat, India  
Email: limbajaenergy@gmail.com  
Website: https://limbajaenergy.com/

### Sub: Assurance to avoid double counting by Project Owners

Dear Sir,

We declare the following given below:

- I, Nikhil Vedprakash, on behalf of Energy Advisory Services Private Limited, with details as provided in, incorporated in India, having registered office at Flat No. 15, 5th Floor, Sudha, 20 N.S. Road, Patel Compound, Mumbai 400036;
- I, NATARAJU. Y.S., on behalf of GM Sugars & Energy Ltd, having registered office at #22, Pamadi towers, 1st main road, Gandhi nagar Bangalore, Karnataka - 560006 identified above, hereby confirm that:

We intend to submit/have submitted the project 18 MW Biomass Based Power Generation at GM Sugars and Energy Ltd to Energy Advisory Services Private Limited (UCR PROJECT ID: 299) for registration with UCR Program which aims for issuance of CoUs (called as Carbon Offset Units) consequent to compliance with all the applicable requirements of UCR Program:

Authorised Actions. Energy Advisory Services Private Limited is authorised to act for the Project Proposer with respect to state the following:

- The project is not registered more than once with the UCR program
- The project is not registered under any other GHG program (voluntary or compliance)
- (If a project is registered with more than one program). That the offset credits are cancelled by (name of program) before offset credits are submitted for verification via the monitoring report to your agency. (please attach relevant links or documentation)
- Double counting with mandatory domestic targets is avoided and that host country will not use the project's emission reductions to track progress towards, or for demonstrating achievement of its nationally determined contributions (NDCs).

SIGNED for and on behalf of Energy Advisory Services Private Limited

By: 

Name: Nikhil Vedprakash

Title: Director

Date of execution: 05/06/2023

SIGNED for and on behalf of GM Sugars & Energy Ltd

By: 

Name: NATARAJU. Y.S.

Title: DIRECTOR

Date of execution: 05/06/2023