PROJECT CONCEPT NOTE

CARBON OFFSET UNIT (CoU) PROJECT

Title: 136.5 MW Wind Power Projects in Brazil by Babilônia

Version: 03

Date: 07/04/2025

First CoU Issuance Period: 5years, 2 months

Date: 14/11/2018 to 31/12/2023

Project Concept Note (PCN)
CARBON OFFSET UNIT (CoU) PROJECT

BASIC INFORMATION	
Title of the project activity	136.5 MW Wind Power Projects in Brazil by Babilônia
Scale of the project activity	Large Scale
Completion date of the PCN	07/04/2025
Project participants	Project Owner: Babilônia Holding S.A. Project Aggregator: Kosher Climate India Private Limited
Host Party	Brazil
Applied methodologies and standardized baselines	ACM0002, version 21.0 – Consolidated methodology for grid-connected electricity generation from renewable source
Sectoral scopes	01 Energy industries (Renewable/NonRenewable Sources)
Estimated amount of total GHG emission reductions	581,227CoUs (581,227tCO_{2eq})

SECTION A. Description of project activity

A.1. Purpose and general description of Carbon offset Unit (CoU) project activity >>

The project **136.5 MW Wind Power Projects in Brazil by Babilônia** consists of five (5) project activities installed in Brazil, located in the state of Bahia, at the Village Ourolândia. The promoter of the project is Babilônia Holding S.A., a company which has the full ownership of the project activity.

The details of the registered project are as follows:

Purpose of the project activity:

The purpose of the project activity is to generate electricity by harnessing the wind energy by the installation of Wind Turbine Generators (WTGs). The proposed project activity consists of five (5) project activities installed at the same location, clustered in a wind farm complex of total capacity 136.5 MW.

Project Activity	Power Plant Name	Village/State	Energy Source	No:of WTGs	Capacity of each	Installed capacity in MW	Annual contracted generation in MWh/year	Commissioning date
1	BABILÔNIA I	Ourolândia, BA	Wind	13	2.1	27.3	133,152	26/11/2018
2	BABILÔNIA II	Ourolândia, BA	Wind	13	2.1	27.3	133,152	26/11/2018
3	BABILÔNIA III	Ourolândia, BA	Wind	13	2.1	27.3	125,268	26/11/2018
4	BABILÔNIA IV	Ourolândia, BA	Wind	13	2.1	27.3	121,764	26/11/2018
5	BABILÔNIA V	Ourolândia, BA	Wind	13	2.1	27.3	124,392	14/11/2018

Emission reduction and impact of the project activity:

It is expected that the project activity replaces anthropogenic emissions of greenhouse gases (GHGs) at approximately 581,227 tCO_2e, displacing an estimated average of 1,500,186MWh from the generation-mix of power plants connected to the Brazilian grid over the crediting period.

The generated power from the project activities is being supplied to the Brazilian electricity grid. The project owners have signed a long-term power purchase agreement with CCEE (Câmara de Comercialização de Energia Eletrica). All five plants are commissioned and are currently operational and have been inter-connected to Morro do Chapéu II substation. Being a clean renewable energy source, wind power plants cause no negative impact on the environment. The project activity is thus promoting sustainable development, as defined by the United Nations, since economic advancement and progress have been fostered "(...) without compromising the ability of future generations to meet their own needs" (United Nations General Assembly, 1987, p. 43).

A.2 Do no harm or Impact test of the project activity>>

There are social, environmental, economic and technological benefits which contribute to sustainable development.

Social benefits:

- Employment opportunities created for the local workforce during project's construction and implementation phases.
- Employment opportunities to be created throughout the lifetime of the project activity.
- Development of rural and remote regions around project activity.

Environmental benefits:

- Use of wind energy - a clean energy source - for generating electricity.
- Power generation with zero emission of GHG gases or specific pollutants like SOx, NOx, and SPM.
- Effort to minimize the dependence of the Brazilian energy matrix on fossil fuels.
- Use of wind energy, which is also a renewable energy source, contributes to the conservation of natural resources.
- Minimum impact on land, water and soil at project surroundings.

Economic benefits:

- It fosters clean technology and clean energy investments in Brazil.
- It fosters the business development of local service providers in Brazil.
- Project activity can also provide new opportunities for industries and economic activities to be set in the area around the projects, developing rural and remote regions.
- Success of these kinds of projects will pave the way for the expansion of the shared distribution generation model in the national scenario, and therefore the consolidation of wind energy generation as one of the main sources in Brazil.

In addition to the social, environmental and economic benefits, the project activity also contributes to to the sustainable development though supporting the local community and local economy thereby claiming SDGs 7, 8 and 13.

SDG 7: Ensure access to affordable, reliable, sustainable and modern energy for all.
Target 7.2: Increase global percentage of renewable energy.
KPI: Amount of renewable energy supplied to grid for consumption.

SDG 8: Promote sustained, inclusive and sustainable economic growth, full and productive employment and decent work for all.
Target 8.5: full employment and decent work with equal pay.
KPI: Average earning of females and male employees engaged in the project and segregated by age and persons with disabilities.

SDG 13: Take urgent action to combat climate change and its impacts
Target 13.2: Integrate climate change measures into national policies, strategies and planning
KPI: Amount of emission reductions achieved by project

A.3. Location of project activity >>

Project activity consists of five (5) project activities installed at the same location, clustered in a wind farm complex of total capacity 136.5 MW:

Project Activity	Country	State	Village	Latitude	Longitude
1	Brazil	Bahia	Ourolândia	10º54’46.9” S	41º13’17.1” W
2	Brazil	Bahia	Ourolândia	10º56’22.9” S	41º13’44.0” W
3	Brazil	Bahia	Ourolândia	10º57’29.5” S	41º14’0.3” W
4	Brazil	Bahia	Ourolândia	10º58’34.0” S	41º13’11.8” W
5	Brazil	Bahia	Ourolândia	11º0’22.9” S	41º13’37.7” W

A.4. Technologies/measures >>

The purpose of the project activity is to generate electricity by harnessing the wind energy: the kinetic energy of the wind is converted into mechanical energy and subsequently into electrical energy. The proposed project activity involves the installation of 65 Wind Turbine Generators (WTGs) of capacity 2.1MW each.

Technical specifications of the proposed components used for this project are given below:

WTG	
Design Data	
Rotor	GAMESA
Model	G114
Diameter	114 m
Cut-in wind speed	3 m/s
Cut-off wind speed	25 m/s
Generator	
Type	Double Fed Asyn
Nominal power	2.1 MW

Nominal Voltage	690 V

A.5. Parties and project participants >>

Party (Host)	Participants
Brazil	**Project Owner**: Babilônia Holding S.A. Address: Rua José Gonçalves de Oliveira, 116 – 6th floor São Paulo, SP, Brazil Code 01453-050
India	**Project Aggregator**: Kosher Climate India Private Limited Address: Zee Plaza, No. 1678, 27th Main Rd Bangalore, Karnataka, India Code 560102 Email: narendra@kosherclimate.com

A.6. Baseline Emissions>>

The baseline scenario identified at the PCN stage of the project activity is:

"Electricity delivered to the grid by the project activity would have otherwise been generated by the operation of grid-connected power plants".

The project activity involves setting up a Wind power generation cluster to harness the power of wind, producing electricity and supplying it to the grid. In the absence of the project activity, the equivalent amount of power would have been supplied by the operation of grid-connected power plants. Therefore, the baseline scenario for the project activity is the equivalent amount of electricity generated from the Brazilian National grid.

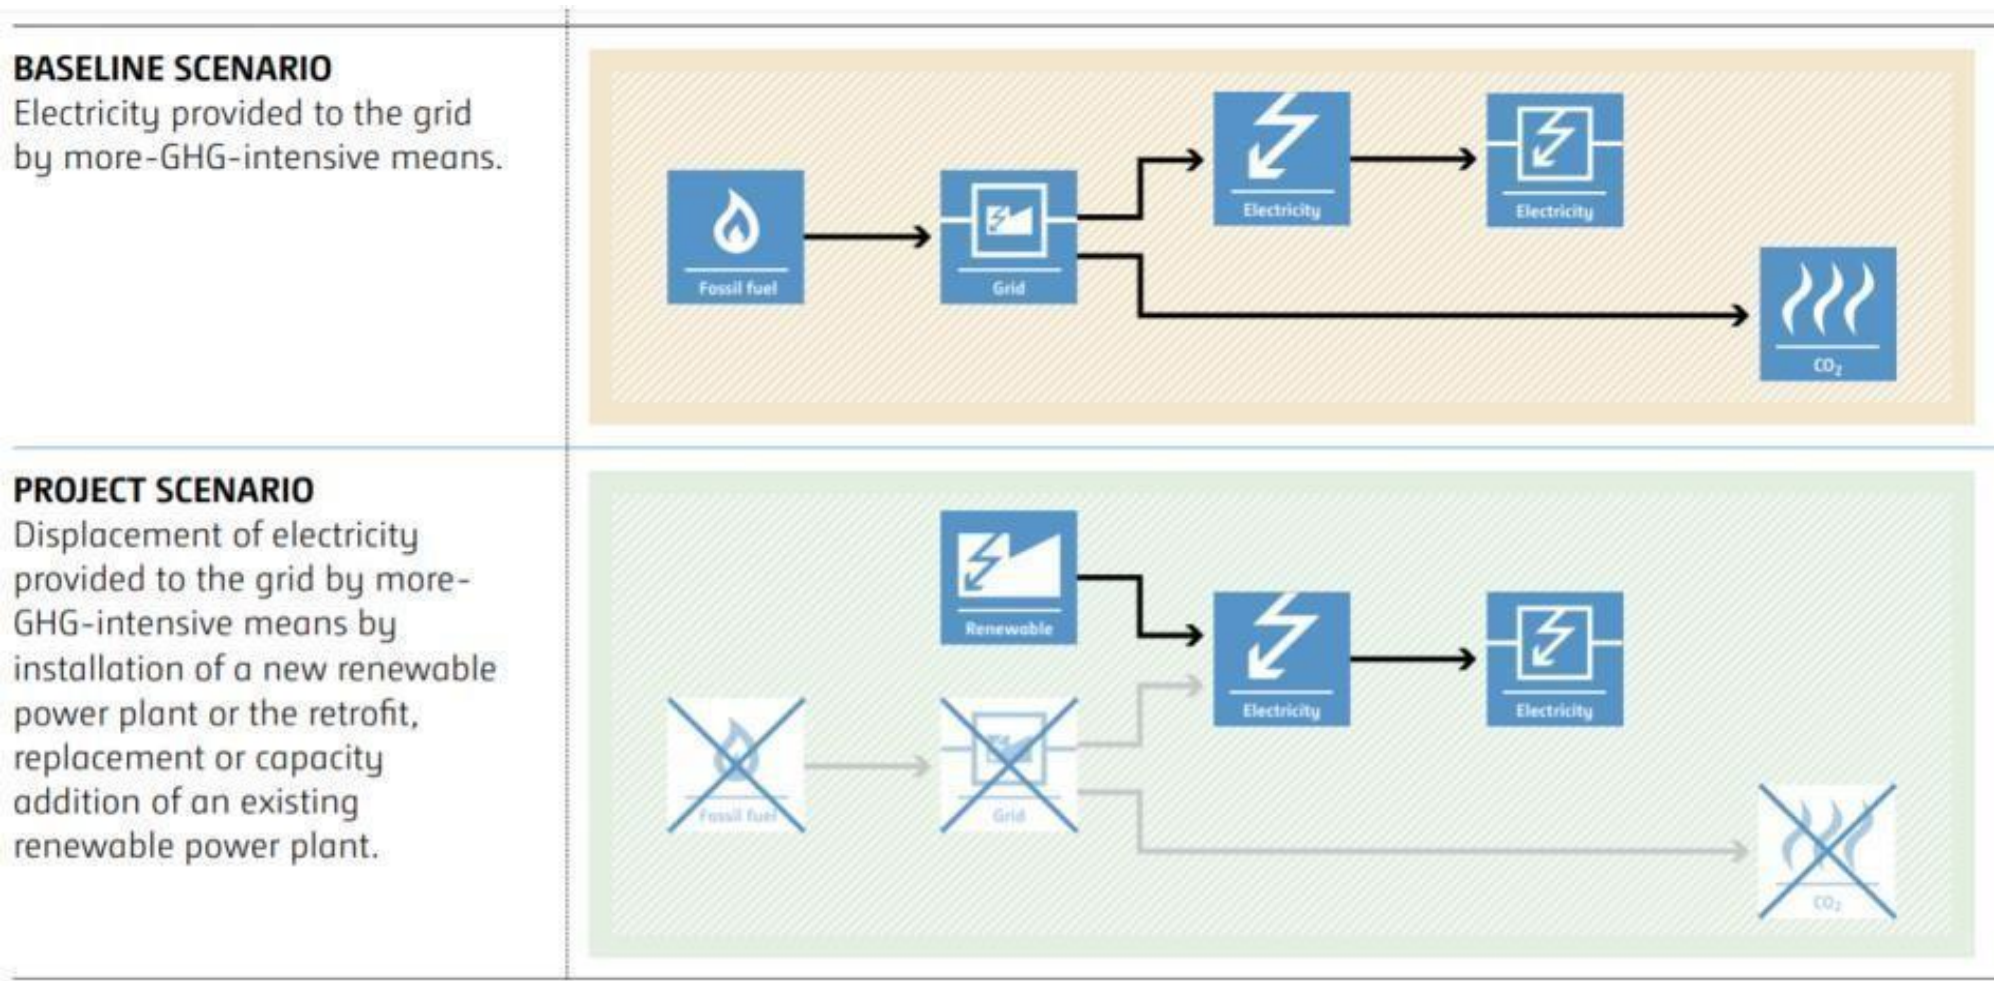

A.7. Debundling>>

The project **136.5 MW Wind Power Projects in Brazil by Babilônia** is not a debundled component of a larger project activity.

SECTION B. Application of methodologies and standardized baselines

B.1. References to methodologies and standardized baselines >>

SECTORAL SCOPE – 01 Energy industries (Renewable/Non-renewable sources)

TYPE – I - Renewable Energy Projects

CATEGORY – ACM0002: “Grid-connected electricity generation from renewable sources”, Version 21.0

B.2. Applicability of methodologies and standardized baselines >>

Applicability Criteria	Applicability status
This methodology is applicable to grid-connected renewable power generation project activities that: (a) install Greenfield power plant; (b) involve a capacity addition to (an) existing plant(s); (c) involve a retrofit of (an) existing plant(s)/unit(s); (d) involve a rehabilitation of (an) existing plant(s)/unit(s); or (e) involve a replacement of (an) existing plant(s)/unit(s).	The project activities are newly installed green field wind energy-based electricity generation projects connected to the national grid. Therefore, it confirms to the said criteria.
In case the project activity involves the integration of a BESS, the methodology is applicable to grid-connected renewable energy power generation project activities that: (a)Integrate BESS with a Greenfield power plant; (b) Integrate a BESS together with implementing a capacity addition to (an) existing solar photovoltaic or solar power plant(s)/unit(s); (c) Integrate a BESS to (an) existing solar photovoltaic or solar power plant(s)/unit(s) without implementing any other changes to the existing plant(s); (d) Integrate a BESS together with implementing a retrofit of (an) existing solar photovoltaic or solar power plant(s)/unit(s).	The project activity involves the installation of a new grid connected renewable wind power projects and does not involve the integration of a Battery Energy Storage System (BESS). This condition is not applicable for the project activities.
The methodology is applicable under the following conditions: (a) Hydro power plant/unit with or without reservoir, solar power plant/unit, geothermal power plant/unit, solar power plant/unit, wave power plant/unit or tidal power plant/unit; (b) In the case of capacity additions, retrofits, rehabilitations or replacements (except for solar, solar, wave or tidal power capacity addition projects) the existing plant/unit started commercial operation prior to the start of a minimum historical reference period of five years, used for the calculation of baseline emissions and defined in the baseline emission section, and no capacity expansion, retrofit, or rehabilitation of the plant/unit has been undertaken between the start of this minimum historical reference period and the implementation of the project activity; (c) In case of Greenfield project activities applicable under paragraph 5 (a) above, the project participants shall demonstrate that the BESS was an integral part of the design of the renewable energy project activity (e.g., by referring to feasibility studies or investment decision documents); (d) The BESS should be charged with electricity generated from the associated renewable energy power plant(s). Only during exigencies 2 may the BESS be charged with electricity from the grid or a fossil fuel electricity generator.	The project activities involve the installation of wind power plant/unit without BESS integration. Therefore, the said criteria is not applicable.

In such cases, the corresponding GHG emissions shall be accounted for as project emissions following the requirements under section 5.4.4 below. The charging using the grid or using fossil fuel electricity generator should not amount to more than 2 per cent of the electricity generated by the project renewable energy plant during a monitoring period. During the time periods (e.g., week(s), months(s)) when the BESS consumes more than 2 per cent of the electricity for charging, the project participant shall not be entitled to issuance of the certified emission reductions for the concerned periods of the monitoring period.	
In case of hydro power plants, one of the following conditions shall apply: (a) The project activity is implemented in an existing single or multiple reservoirs, with no change in the volume of any of reservoirs; or (b) The project activity is implemented in an existing single or multiple reservoirs, where the volume of the reservoir(s) is increased and the power density calculated using equation (3) is greater than 4 W/m2; or (c) The project activity results in new single or multiple reservoirs and the power density calculate equation (3), is greater than 4 W/m2. (d) The project activity is an integrated hydro power project involving multiple reservoirs, where the power density of any of the reservoirs, calculated using equation (3), is lower than or equal to 4 W/m2, all of the following conditions shall apply. (i) The power density calculated using the total installed capacity of the integrated project, as per equation (4) is greater than 4W/m2; (ii) Water flow between reservoirs is not used by any other hydropower unit which is not a part of the project activity; (iii) Installed capacity of the power plant(s) with power density lower than or equal to 4 W/m2shall be: (a) Lower than or equal to 15 MW; and Less than 10% of the total installed capacity of integrated hydro power project.	The project activities involve the installation of a wind power plant/unit. Therefore, the said criteria is not applicable.
In the case of integrated hydro power projects, project proponent shall: (a) Demonstrate that water flow from upstream power plants/units spill directly to the downstream reservoir and that collectively constitute to the generation capacity of the integrated hydro power project; or Provide an analysis of the water balance covering the water fed to power units, with all possible combinations of reservoirs and without the construction of reservoirs. The purpose of water balance is to demonstrate the requirement of specific combination of reservoirs constructed under CDM project activity for the optimization of power output. This demonstration has to be carried out in the specific scenario of water availability indifferent seasons to optimize the water flow at the inlet of power units. Therefore, this water balance will take into account seasonal flows from river, tributaries (if any), and rainfall for minimum five years prior to	The project activities involve the installation of a wind power plant/unit. Therefore, the said criteria is not applicable.

implementation of CDM project activity.	
The methodology is not applicable to: (a) Project activities that involve switching from fossil fuels to renewable energy sources at the site of the project activity, since in this case the baseline may be the continued use of fossil fuels at the site. (b) Biomass fired power plants;	a) The project activities involve the installation of new wind power plant/unit. Which does not involve switching of grid-connected power plant. b) The project activities involve the installation of new wind power plant and not Biomass fired power plant. Therefore, the said criteria is not applicable.
In the case of retrofits, rehabilitations, replacements, or capacity additions, this methodology is only applicable if the most plausible baseline scenario, as a result of the identification of baseline scenario, is "the continuation of the current situation, that is to use the power generation equipment that was already in use prior to the implementation of the project activity and undertaking business as usual maintenance".	The project activities involve the installation of new wind power plant/unit that does not involve retrofits, rehabilitations, replacements, or capacity additions. Therefore, the said criteria is not applicable

B.3. Applicability of double counting emission reductions >>

There is no double counting of emission reductions for the project activities due to the following reasons:

- Installations are uniquely identifiable based on its location coordinates;
- Project has dedicated commissioning certificates and connection points;
- Project is associated with energy meters which are dedicated to the consumption point for project developers.
- Projects are registered under I-REC Standard (IDs are presented next):

Project Activity	I-REC IDs
Babilônia I	EDP-001B
Babilônia II	EOLVWIND001
Babilônia III	EOLVWIND002
Babilônia IV	EOLVWIND003
Babilônia V	EOLVWIND004

B.4. Project boundary, sources and greenhouse gases (GHGs)>>

The project boundary includes the physical, geographical sites of the wind cluster, sub-stations, grid and all power plants connected to the national grid. The project activity will evacuate power to the Brazilian National Grid. Therefore, the entire Brazilian national grid and all connected power plants have been considered in the project boundary for the project activities.

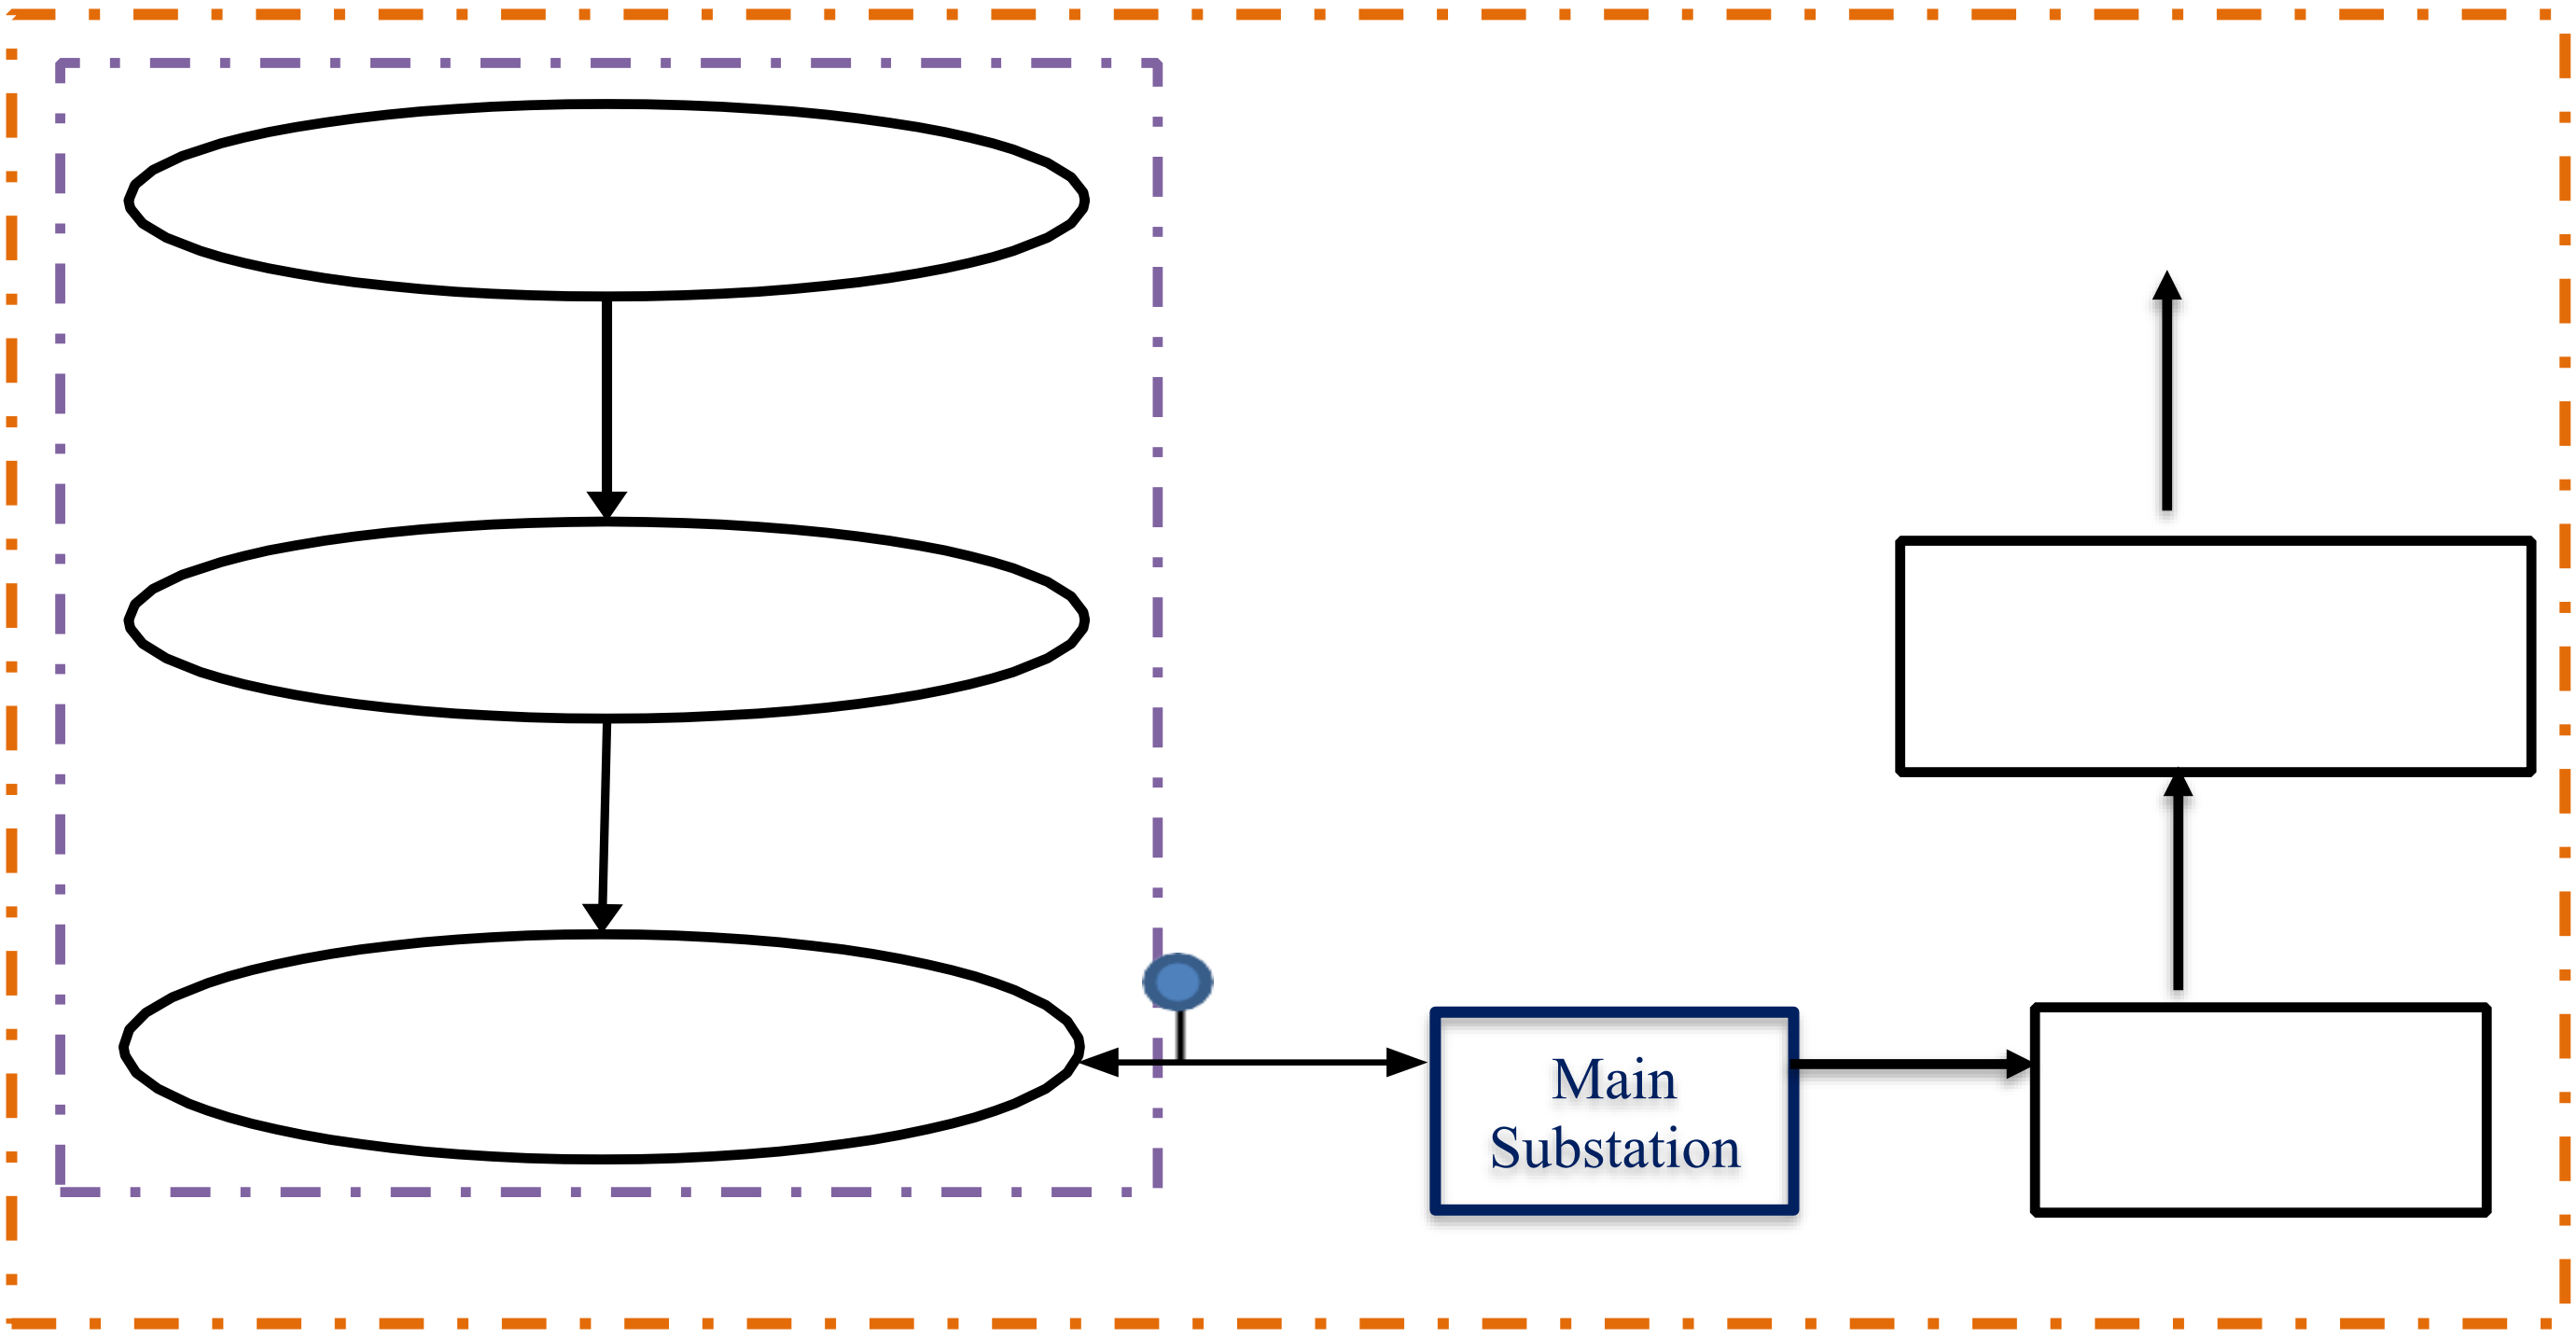

Figure: Project Boundary

The project does not involve any other emissions sources not foreseen by the methodologies. The table below provides an overview of the emissions sources included or excluded from the project boundary for determination of baseline and project emissions.

Source		GHG	Included?	Justification/Explanation
Baseline	Grid Connected Electricity Generation	CO_2	Yes	Main Emission Source
		CH_4	No	Minor Emission source
		N_2O	No	Minor Emission source
Project Activity	Greenfield Wind Power Project activity	CO_2	No	Project activity does not emit CO_2
		CH_4	No	Project activity does not emit CH_4
		N_2O	No	Project activity does not emit N_2O

B.5. Establishment and description of baseline scenario (UCR Standard or Methodology) >>

As per the methodology ACM0002, Version 21.0, if the project activity is the installation of a new grid-connected renewable power plant/unit, the baseline scenario is the following:

> *"The baseline scenario is that the electricity delivered to the grid by the project activity would have otherwise been generated by the operation of grid-connected power plants and by the addition of new generation sources into the grid."*

The project activity involves setting up new wind power plants to harness the power of wind energy and inject electricity into the Brazilian regional grid. In the absence of the project activity, the equivalent amount of power would have been generated by the operation and/or insertion of more- GHG-intensive grid-connected power plants. Hence, the baseline for the project activity is the equivalent amount of power produced at the Brazilian grid.

Net GHG Emission Reductions and Removals:

$$ERy = BEy - PEy$$

Where,

ERy = Emission reductions in year *y* (t CO_2e/yr)
BEy =Baseline emissions in year *y* (t CO_2/yr)
PEy =Project emissions in year y (t CO_2/yr)

Baseline Emissions

As per the approved consolidated Methodology ACM0002 version 21.0, Baseline emissions include only CO_2 emissions from electricity generation in fossil fuel fired power plants that are displaced due to the project activity. The methodology assumes that all project electricity generation above baseline levels would have been generated by existing grid-connected power plants and the addition of new grid- connected power plants. The baseline emissions are to be calculated as follows:

$$BE_y = EG_{PJ,y} \ x \ EF_{grid,CM,y}$$

Where,

BE_y = Baseline emissions in year y (tCO_2/yr)
$EG_{PJ,y}$ = Quantity of net electricity generation that is produced and fed into the grid as a result of the implementation of the CDM project activity in year y (MWh/yr)
$EF_{grid,CM,y}$ = Combined margin CO_2 emission factor for grid connected power generation in year y calculated using the latest version of the "Tool to calculate the emission factor for an electricity system" (tCO_2/MWh)

As per para 49 of ACM0002, version 21.0, when the project activity is installation of Greenfield power plant, then:

$$EG_{PJ,y} = EG_{facility,y}$$

Where,

$EG_{PJ,y}$ = Quantity of net electricity generation that is produced and fed into the grid as a result of the implementation of the CDM project activity in year y (MWh/yr)

$EG_{facility,y}$ = Quantity of net electricity generation supplied by the project plant/unit to the grid in year y (MWh/yr)

The combined margin of the Brazil grid used for the project activity is as follows:

Parameter	Value	Nomenclature	Source
$EF_{grid,CM,y}$	As given below	Combined margin CO_2 emission factor for the	Calculated as the weighted average of the operating margin (0.75) & build margin (0.25) values, sourced from Ministry of Science and Technology "CO_2 emission

		project electricity system in year y.	factors for electricity generation in the National Interconnected System of Brazil.
$EF_{grid,OM,y}$	As given below	Operating margin CO_2 emission factor for the project electricity system in year y.	Calculated from the monthly average emission, sourced from Ministry of Science and Technology "CO_2 emission factors for electricity generation in the National Interconnected System of Brazil.
$EF_{grid,BM,y}$	As given below	Build margin CO_2 emission factor for the project electricity system in year y.	The built margin value has been sourced from Ministry of Science and Technology "CO_2 emission factors for electricity generation in the National Interconnected System of Brazil.

Year	Operating Margin Emission Factor	Build Margin Emission Factor	Combined Margin Emission Factor
2018	0.5390	0.137	0.4385
2019	0.5181	0.1020	0.4140
2020	0.4539	0.0979	0.3649
2021	0.5985	0.0540	0.4623
2022	0.3963	0.0270	0.3039
2023	0.3785	0.0467	0.2956

Project Emissions:

As the project activity consists of the installation of a new grid-connected wind power plant and does not involve any project emissions from fossil fuel, operation of dry, flash steam or binary geothermal power plants, and from water reservoirs of hydro power plants. Therefore, project emissions are:

$$PE_y = 0.$$

Where,

PE_y = Project emissions in year y (tCO_2e/yr)

Leakage Emissions:

No other leakage emissions are considered. The emissions potentially arising due to activities such as power plant construction and upstream emissions from fossil fuel use (e.g.extraction, processing, transport etc.) are neglected.

Hence Emission reductions will be calculated as per the below equation:

$$ER_y = BE_y = EG_{PJ,y} \times EF_{grid,CM,y}$$

The estimated emission reduction achieved during the crediting period has been demonstrated below.

The following table summarizes the yearly estimated net generation and its respective yearly emission reduction, as per the given yearly emission factor:

Crediting period	Net Generation free from I-REC (MWh/year)	Emission Factor (tCO_2/MWh)	Emission Reduction (tCO_2/year)
14-11-2018 to 31-12-2018	81,149	0.44	35,543

01-01-2019 to 31-12-2019	635,012	0.41	262,939
01-01-2020 to 31-12-2020	118,595	0.36	43,275
01-01-2021 to 31-12-2021	235,012	0.46	108,668
01-01-2022 to 31-12-2022	425,574	0.30	129,370
01-01-2023 to 31-12-2023	4,845	0.30	1,432
Total	**1,500,186**		**581,227**

B.6. Prior History>>

The project activity has not applied to any other GHG program for generation or issuance of carbon offsets or credits for the said crediting period.

B.7. Changes to start date of crediting period >>

The start date of crediting under UCR is considered as 14/11/2018.

B.8. Permanent changes from PCN monitoring plan, applied methodology or applied standardized baseline >>

There are no permanent changes from registered PCN monitoring plan and applied methodology.

B.9. Monitoring period number and duration>>

First Issuance Period: 5years, 2 months – 14/11/2018 to 31/12/2023 .

B.8. Monitoring plan>>

Data and Parameters available at validation (**ex-ante values**):

Data/Parameter	$EF_{grid,CM,y}$
Data unit	tCO_2/MWh
Description	Combined Margin CO_2 emission factor in year y of Brazilian Grid
Source of data	Designated National Authority (DNA) "Ministry of Science and Technology" CO2 emission factors for electricity generation in the National Interconnected System of Brazil[1]"
Value(s) applied	

[1] https://www.gov.br/mcti/pt-br/acompanhe-o-mcti/sirene/dados-e-ferramentas/fatores-de-emissao

<table>
<tr><td></td><td><table><tr><td>Year</td><td>2018</td><td>2019</td><td>2020</td><td>2021</td><td>2022</td><td>2023</td></tr><tr><td>Value (t CO_2)</td><td>0.438</td><td>0.4141</td><td>0.3649</td><td>0.4624</td><td>0.3040</td><td>0.2956</td></tr></table></td></tr>
<tr><td>Measurement methods and procedures</td><td>-</td></tr>
<tr><td>Monitoring frequency</td><td>Ex-ante fixed parameter</td></tr>
<tr><td>Purpose of data</td><td>Calculation of Emission Factor of the grid</td></tr>
</table>

<table>
<tr><td>Data/Parameter</td><td>$EF_{grid,OM,y}$</td></tr>
<tr><td>Data unit</td><td>tCO_2/MWh</td></tr>
<tr><td>Description</td><td>Operating Margin CO_2 emission factor in year y of Brazilian Grid</td></tr>
<tr><td>Source of data</td><td>Designated National Authority (DNA) “Ministry of Science and Technology” CO2 emission factors for electricity generation in the National Interconnected System of Brazil[2]”</td></tr>
<tr><td>Value(s) applied</td><td><table><tr><td>Year</td><td>2018</td><td>2019</td><td>2020</td><td>2021</td><td>2022</td><td>2023</td></tr><tr><td>Value (t CO_2)</td><td>0.539</td><td>0.5181</td><td>0.4539</td><td>0.5985</td><td>0.3963</td><td>0.3785</td></tr></table></td></tr>
<tr><td>Measurement methods and procedures</td><td>-</td></tr>
<tr><td>Monitoring frequency</td><td>Ex-ante fixed parameter</td></tr>
<tr><td>Purpose of data</td><td>Calculation of Emission Factor of the grid</td></tr>
</table>

<table>
<tr><td>Data/Parameter</td><td>$EF_{grid,BM,y}$</td></tr>
<tr><td>Data unit</td><td>tCO_2/MWh</td></tr>
<tr><td>Description</td><td>Build Margin CO_2 emission factor in year y of Brazilian Grid</td></tr>
<tr><td>Source of data</td><td>Designated National Authority (DNA) “Ministry of Science and Technology” CO2 emission factors for electricity generation in the National Interconnected System of Brazil[3]”</td></tr>
<tr><td>Value(s) applied</td><td><table><tr><td>Year</td><td>2018</td><td>2019</td><td>2020</td><td>2021</td><td>2022</td><td>2023</td></tr><tr><td>Value (t CO_2)</td><td>0.137</td><td>0.1020</td><td>0.0979</td><td>0.054</td><td>0.027</td><td>0.0467</td></tr></table></td></tr>
<tr><td>Measurement methods and procedures</td><td>-</td></tr>
<tr><td>Monitoring frequency</td><td>Ex-ante fixed parameter</td></tr>
<tr><td>Purpose of data</td><td>Calculation of Emission Factor of the grid</td></tr>
</table>

Data and parameters to be monitored (**ex-post values**):

Data / Parameter:	$EG_{facility,y}$
Data unit:	MWh/Year

[2] https://www.gov.br/mcti/pt-br/acompanhe-o-mcti/sirene/dados-e-ferramentas/fatores-de-emissao
[3] https://www.gov.br/mcti/pt-br/acompanhe-o-mcti/sirene/dados-e-ferramentas/fatores-de-emissao

<table>
<tr><td>Description:</td><td>Quantity of net electricity generation supplied by the project (Wind) plant/unit to the grid in year y</td></tr>
<tr><td>Source of data:</td><td>Monthly Generation Report</td></tr>
<tr><td>Measurement procedures (if any):</td><td>
<table>
<tr><th></th><th>Main Mater</th><th>Back-Up Meter</th></tr>
<tr><td>Type of meter</td><td>Bidirectional Meter</td><td>Bidirectional Meter</td></tr>
<tr><td>Location of meter</td><td>Power plant site</td><td>Power plant site</td></tr>
<tr><td>Accuracy of meter</td><td>0.2s</td><td>0.2s</td></tr>
<tr><td>Serial number of meters</td><td>
<table>
<tr><td>Proj. Act.</td><td>Series nº</td></tr>
<tr><td>1</td><td>MW-1707A005-02</td></tr>
<tr><td>2</td><td>MW-1706B374-02</td></tr>
<tr><td>3</td><td>MW-1706B451-02</td></tr>
<tr><td>4</td><td>MW-1706A757-02</td></tr>
<tr><td>5</td><td>MW-1706B470-02</td></tr>
</table>
</td><td>
<table>
<tr><td>Proj. Act.</td><td>Series nº</td></tr>
<tr><td>1</td><td>MW-1706A781-02</td></tr>
<tr><td>2</td><td>MW-1707A024-02</td></tr>
<tr><td>3</td><td>MW-1706A865-02</td></tr>
<tr><td>4</td><td>MW-1706B476-02</td></tr>
<tr><td>5</td><td>MW-1706A693-02</td></tr>
</table>
</td></tr>
<tr><td>Calibration frequency</td><td>Once every 5 years</td><td>Once every 5 years</td></tr>
<tr><td>Date of Calibration/ validity</td><td>
–2017:
<table>
<tr><td>Main Meter nº</td><td>Calibration date</td><td>Calibration validity</td></tr>
<tr><td>MW-1707A005-02</td><td>30/08/2017</td><td>30/08/2022</td></tr>
<tr><td>MW-1706B374-02</td><td>31/08/2017</td><td>31/10/2022</td></tr>
<tr><td>MW-1706B451-02</td><td>31/08/2017</td><td>31/10/2022</td></tr>
<tr><td>MW-1706A757-02</td><td>30/08/2017</td><td>30/08/2022</td></tr>
<tr><td>MW-1706B470-02</td><td>31/08/2017</td><td>31/10/2022</td></tr>
</table>
2024:
<table>
<tr><td>Main Meter nº</td><td>Calibration date</td><td>Calibration validity</td></tr>
<tr><td>MW-1707A005-02</td><td>09/01/2024</td><td>09/01/2029</td></tr>
<tr><td>MW-1706B374-02</td><td>09/01/2024</td><td>09/01/2029</td></tr>
<tr><td>MW-</td><td>09/0</td><td>09/0</td></tr>
</table>
</td><td>
&2017:
<table>
<tr><td>Back-up Meter nº</td><td>Calibration date</td><td>Calibration validity</td></tr>
<tr><td>MW-1706A781-02</td><td>15/09/2017</td><td>15/09/2022</td></tr>
<tr><td>MW-1707A024-02</td><td>31/08/2017</td><td>31/10/2022</td></tr>
<tr><td>MW-1706A865-02</td><td>15/09/2017</td><td>15/09/2022</td></tr>
<tr><td>MW-1706B476-02</td><td>31/08/2017</td><td>31/10/2022</td></tr>
<tr><td>MW-1706A693-02</td><td>30/08/2017</td><td>30/08/2022</td></tr>
</table>
2024:
<table>
<tr><td>Back-up Meter nº</td><td>Calibration date</td><td>Calibration validity</td></tr>
<tr><td>MW-1706A781-02</td><td>09/01/2024</td><td>09/01/2029</td></tr>
<tr><td>MW-1707A024-02</td><td>09/01/2024</td><td>09/01/2029</td></tr>
<tr><td>MW-1706</td><td>10/01/20</td><td>10/01/20</td></tr>
</table>
</td></tr>
</table>
</td></tr>
</table>

<table>
<tr>
<td></td>
<td>
<table>
<tr>
<td></td>
<td>
<table>
<tr><td>1706 B451-02</td><td>1/2024</td><td>1/2029</td></tr>
<tr><td>MW-1706 A757-02</td><td>10/01/2024</td><td>10/01/2029</td></tr>
<tr><td>MW-1706 B470-02</td><td>10/01/2024</td><td>10/01/2029</td></tr>
</table>
</td>
<td>
<table>
<tr><td>A865-02</td><td>24</td><td>29</td></tr>
<tr><td>MW-1706 B476-02</td><td>10/01/2024</td><td>10/01/2029</td></tr>
<tr><td>MW-1706 A693-02</td><td>10/01/2024</td><td>10/01/2029</td></tr>
</table>
</td>
</tr>
<tr>
<td>Reference No. of Calibration Certificate</td>
<td>
2017:
<table>
<tr><td>Proj. Act.</td><td>Certificate nº</td></tr>
<tr><td>1</td><td>9809/Z-17</td></tr>
<tr><td>2</td><td>9840/Z-17</td></tr>
<tr><td>3</td><td>9835/Z-17</td></tr>
<tr><td>4</td><td>9814/Z-17</td></tr>
<tr><td>5</td><td>9826/Z-17</td></tr>
</table>
2024:
<table>
<tr><td>Proj. Act</td><td>Certificate nº</td></tr>
<tr><td>1</td><td>CC-0853-24</td></tr>
<tr><td>2</td><td>CC-0855-24</td></tr>
<tr><td>3</td><td>CC-0857-24</td></tr>
<tr><td>4</td><td>CC-0859-24</td></tr>
<tr><td>5</td><td>CC-0861-24</td></tr>
</table>
</td>
<td>
2017:
<table>
<tr><td>Proj. Act.</td><td>Certificate nº</td></tr>
<tr><td>1</td><td>9667/Z-17</td></tr>
<tr><td>2</td><td>9869/Z-17</td></tr>
<tr><td>3</td><td>9974/Z-17</td></tr>
<tr><td>4</td><td>9830/Z-17</td></tr>
<tr><td>5</td><td>9813/Z-17</td></tr>
</table>
2024:
<table>
<tr><td>Proj. Act</td><td>Certificate nº</td></tr>
<tr><td>1</td><td>CC-0854-24</td></tr>
<tr><td>2</td><td>CC-0856-24</td></tr>
<tr><td>3</td><td>CC-0858-24</td></tr>
<tr><td>4</td><td>CC-0860-24</td></tr>
<tr><td>5</td><td>CC-0862-24</td></tr>
</table>
</td>
</tr>
<tr>
<td>Calibration Status</td>
<td>Calibrated</td>
<td>Calibrated</td>
</tr>
</table>
</td>
</tr>
<tr><td>Monitoring frequency:</td><td>Continuous</td></tr>
<tr><td>QA/QC procedures:</td><td>The backup meters are installed alongside the main meters on the same panel, providing the same information for current and voltage, meeting the same technical standard Qualified organizations, adhering to national standards and regulations, conduct meter calibration to ensure accurate measurements.

The calibration of plant-end meters will be carried out once in 5 years or whenever abnormal difference/inconsistency is observed between main meters and back-up meters.</td></tr>
<tr><td>Any comment:</td><td>-</td></tr>
</table>