



TCN19-270 (single exponential fit, with background subtracted, normalized to monitor detector, 0s excluded)

UCN-count-to-monitor ratio

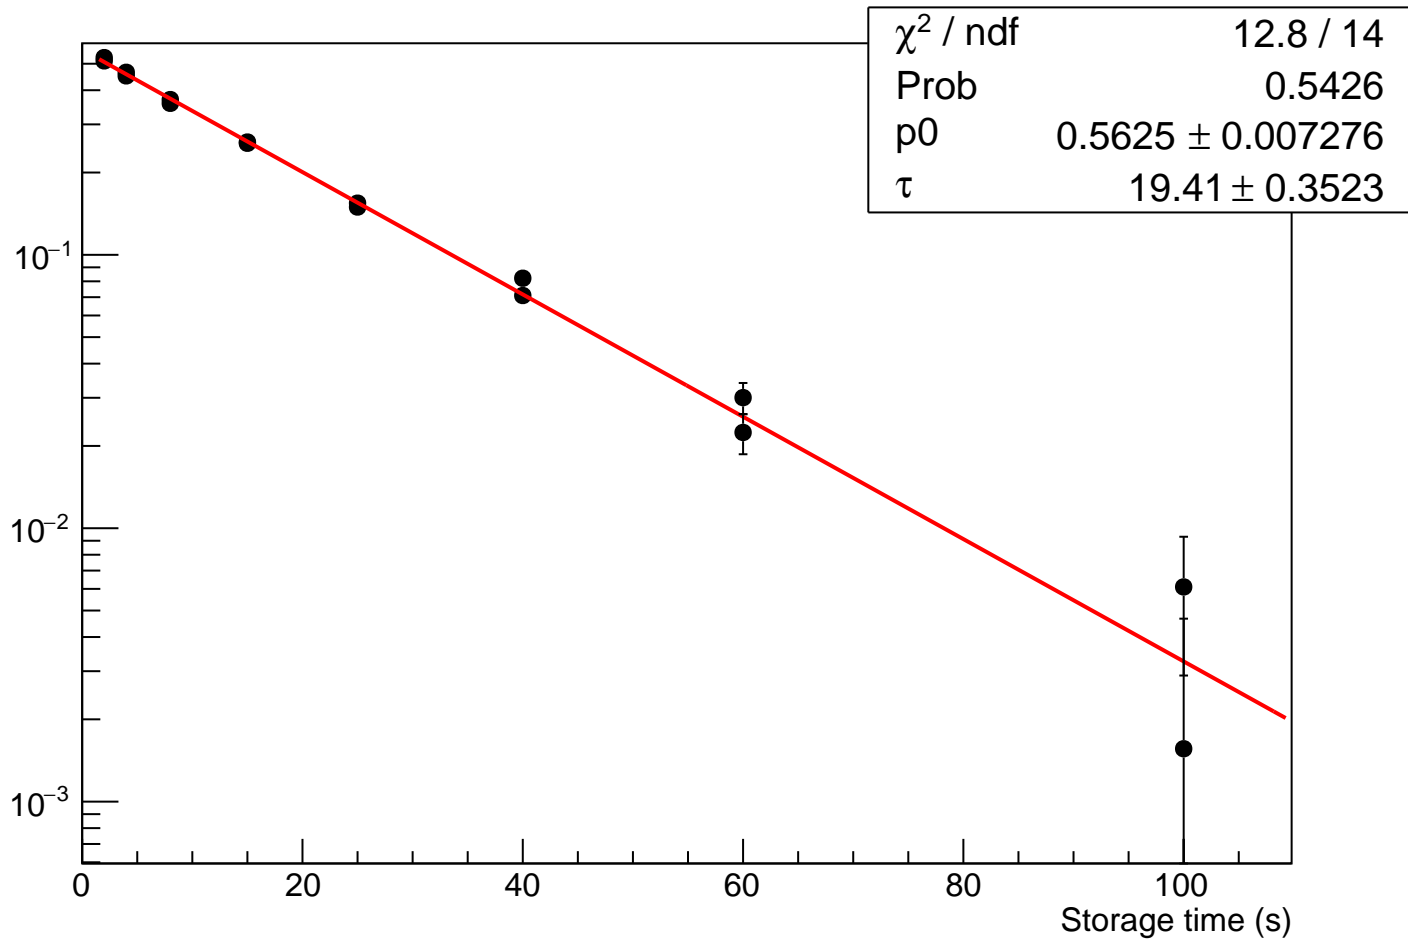


TCN19-270 (double exponential fit, with background subtracted, normalized to monitor detector, 0s excluded)


UCN-count-to-monitor ratio

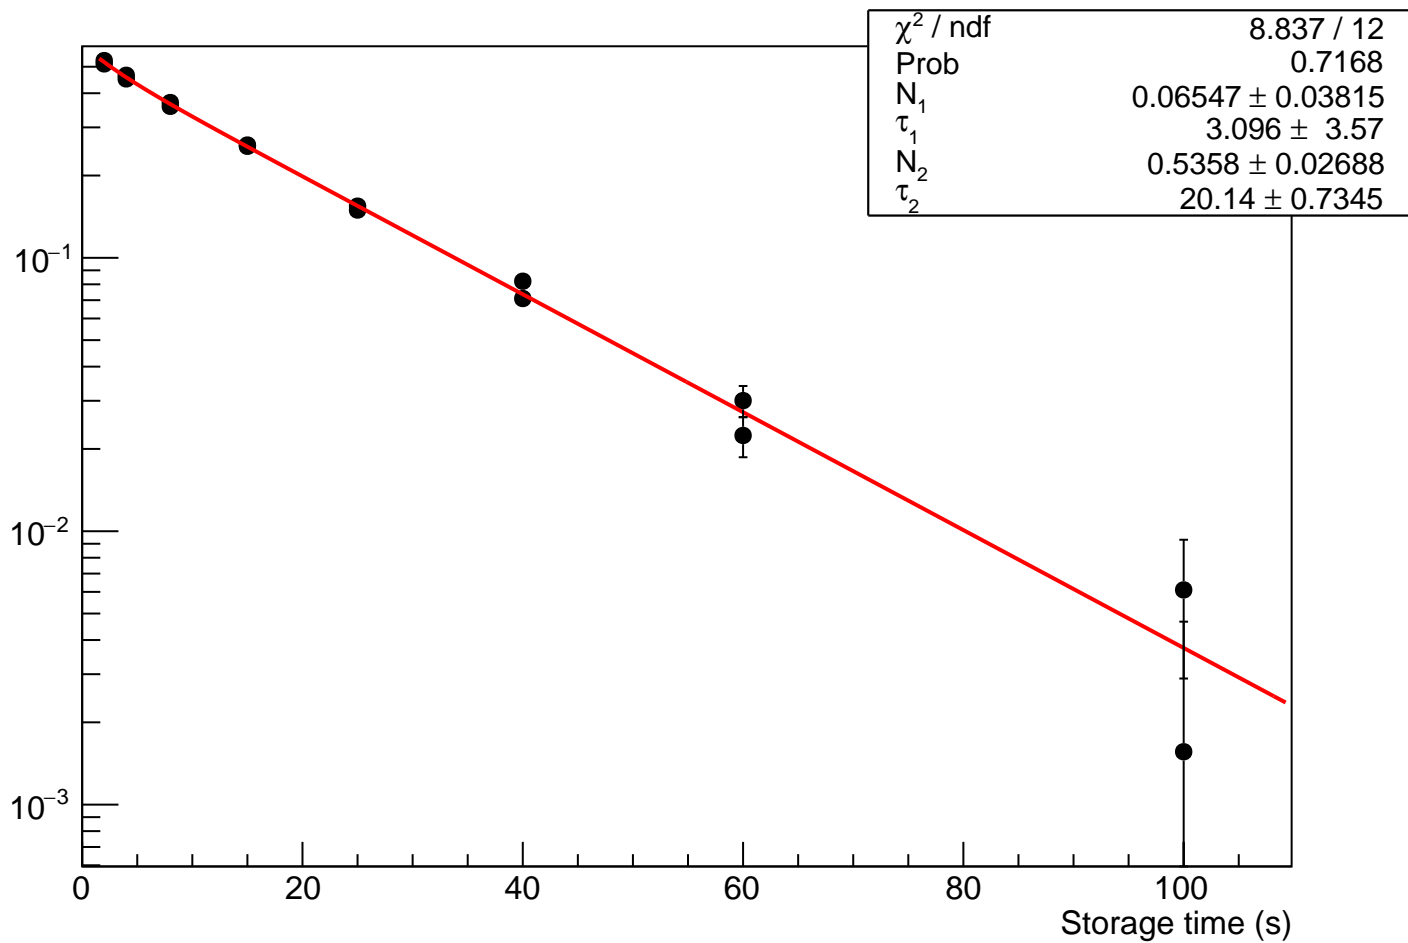


Graph

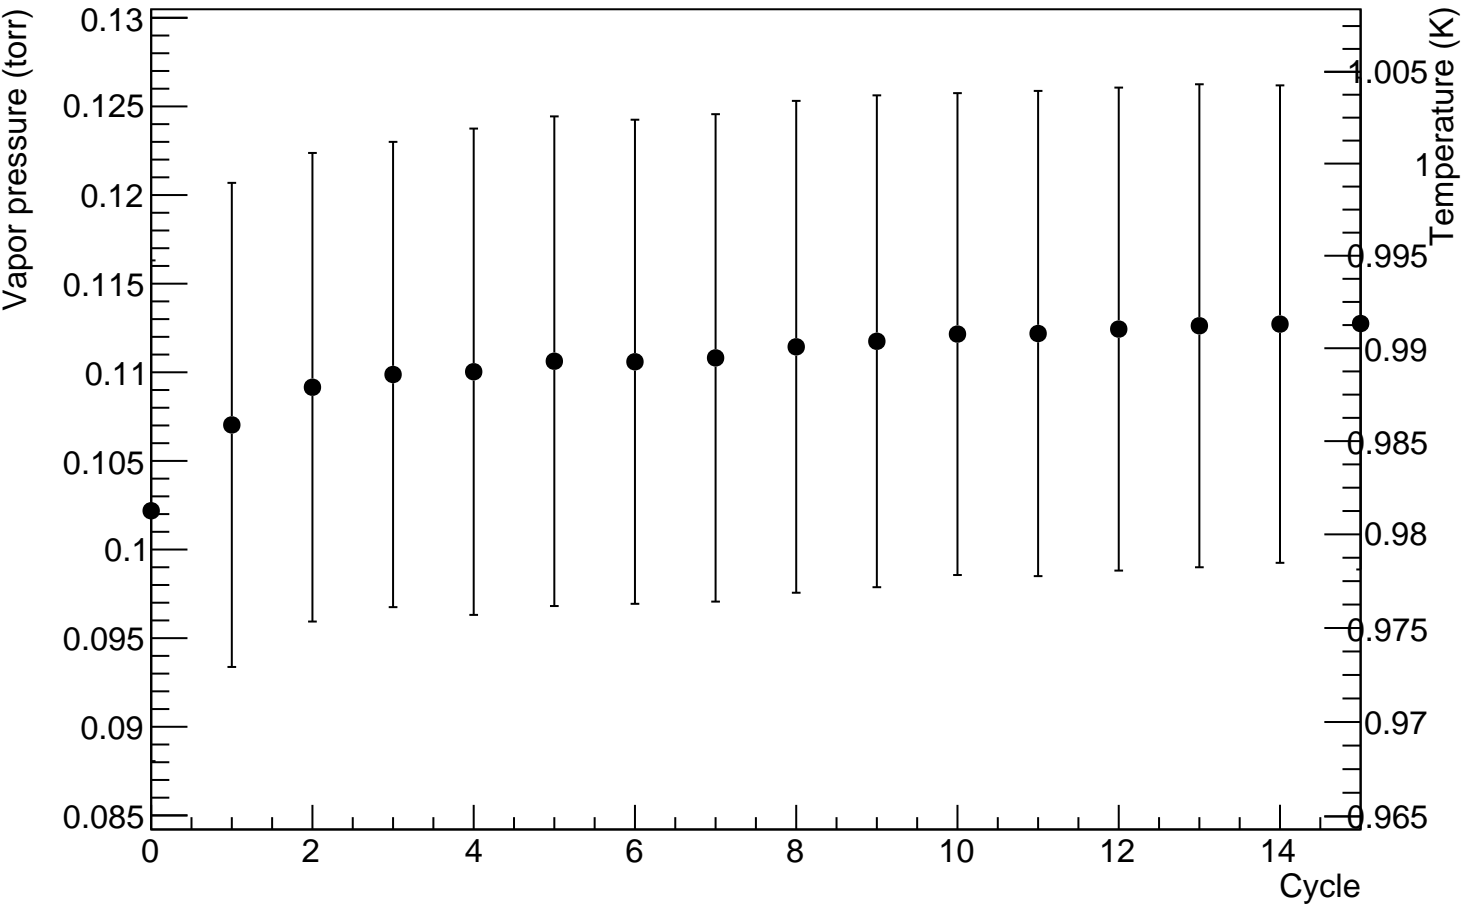


TCN19-270 (Li6 rate)

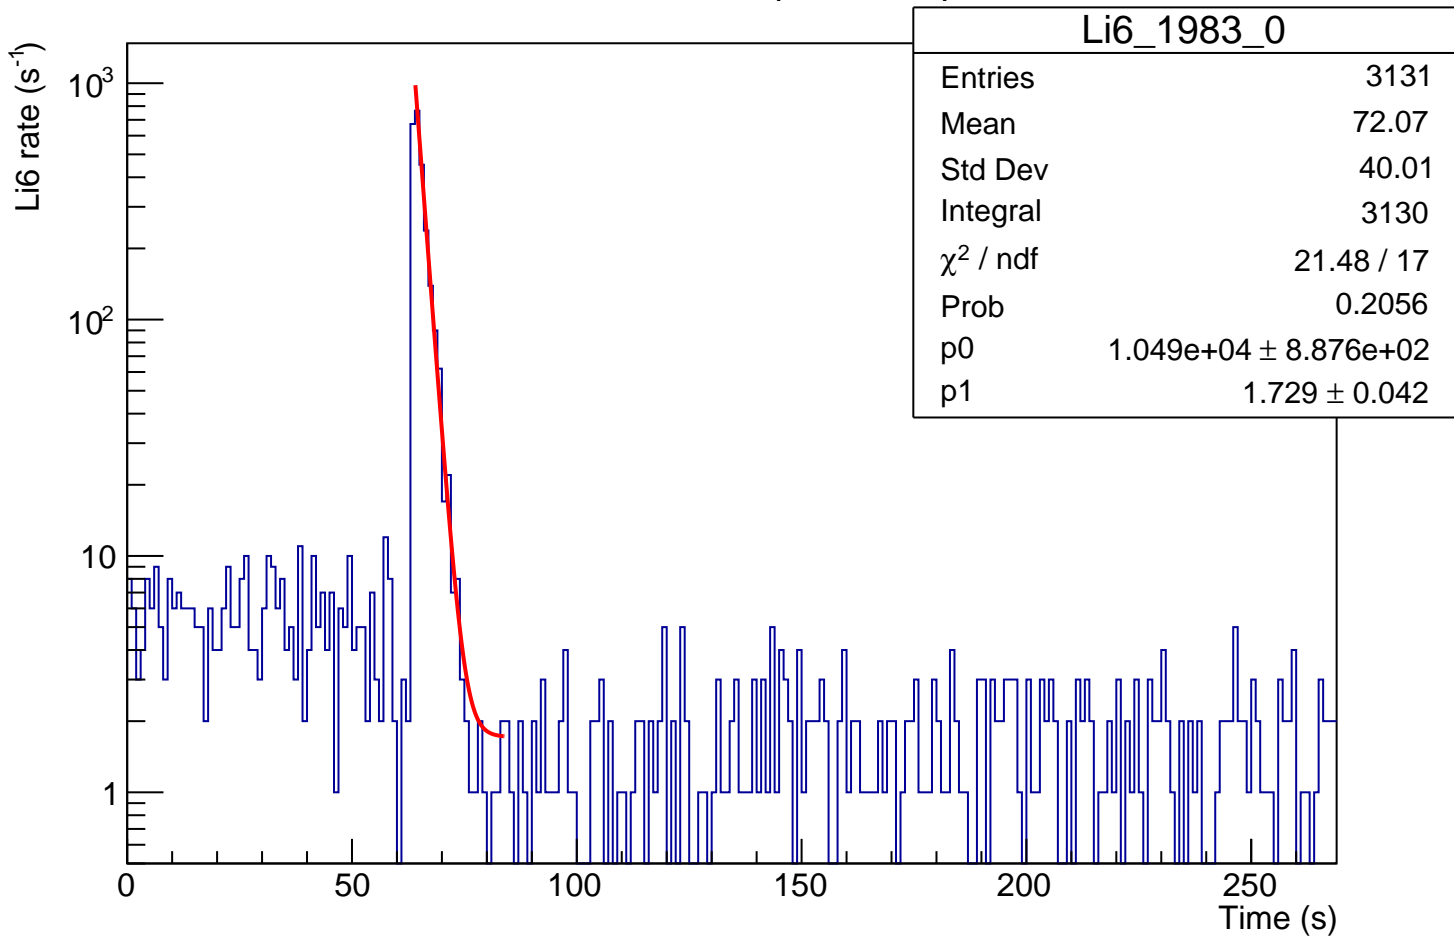

TCN19-270 (Li6 rate)

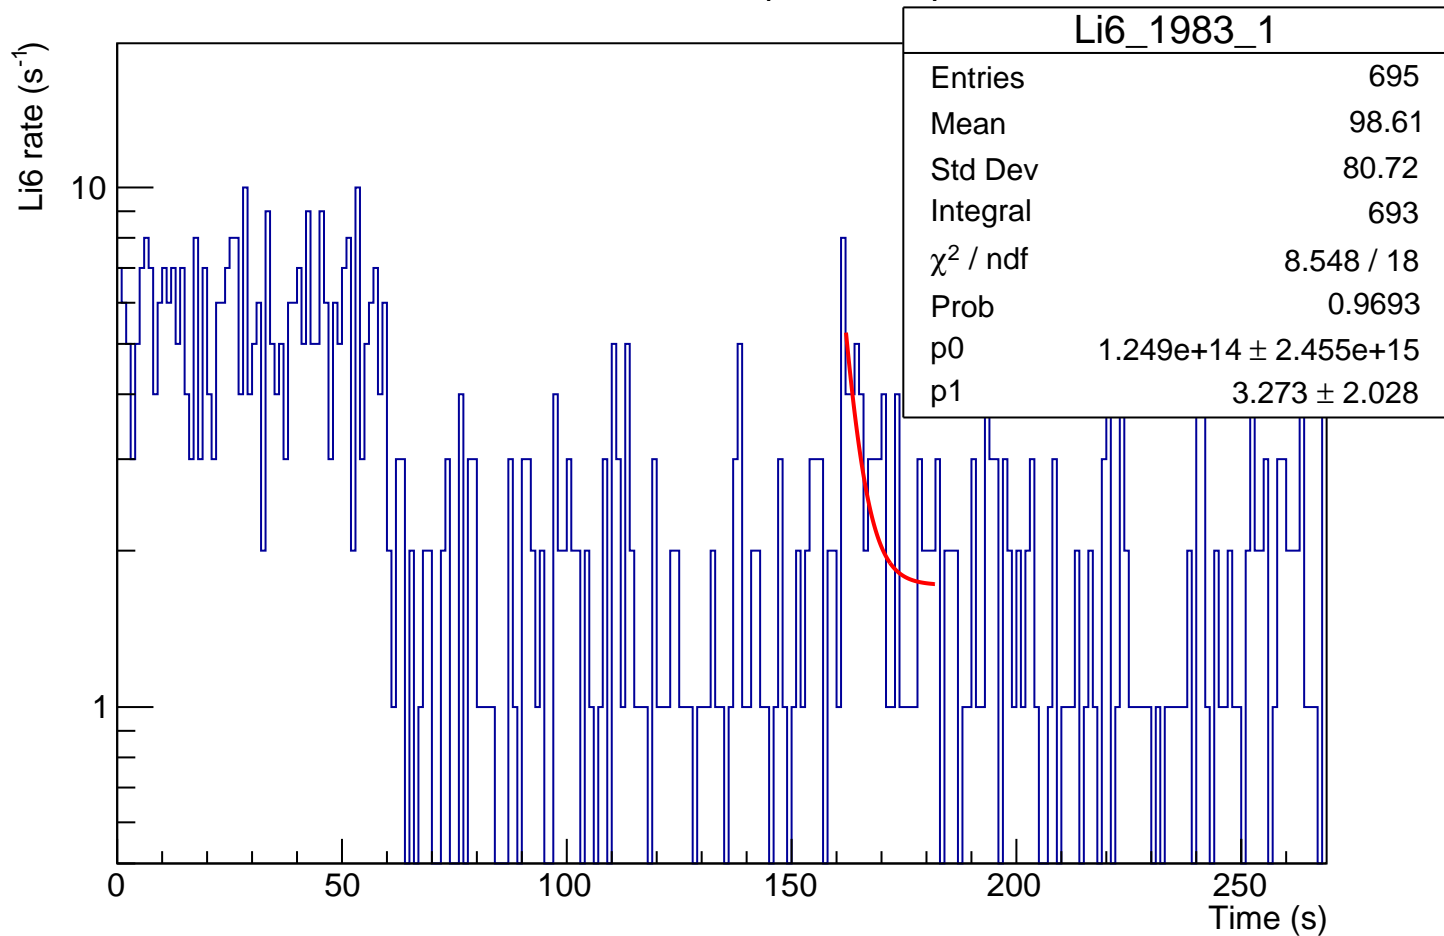

TCN19-270 (Li6 rate)

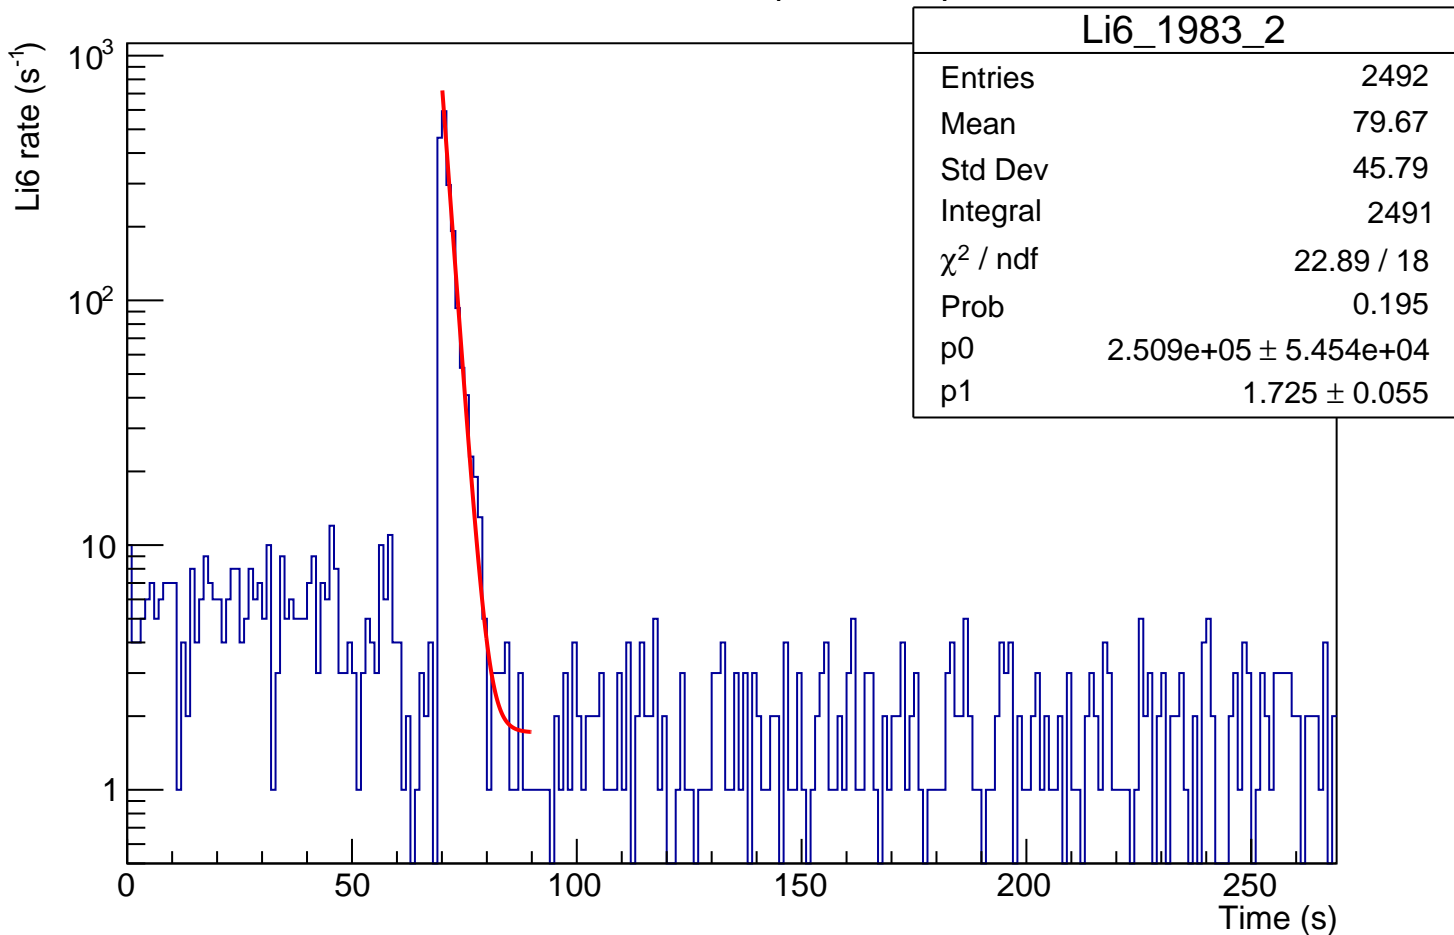

TCN19-270 (Li6 rate)

Li6 rate (s⁻¹)

10

1

0

50

100

150

200


250

Time (s)


Li6_1983_3

Entries	862
Mean	100.9
Std Dev	73.41
Integral	862
χ^2 / ndf	8.31 / 16
Prob	0.9391
p0	$2.281\text{e}+17 \pm 1.259\text{e}+18$
p1	1.729 ± 0.260


TCN19-270 (Li6 rate)

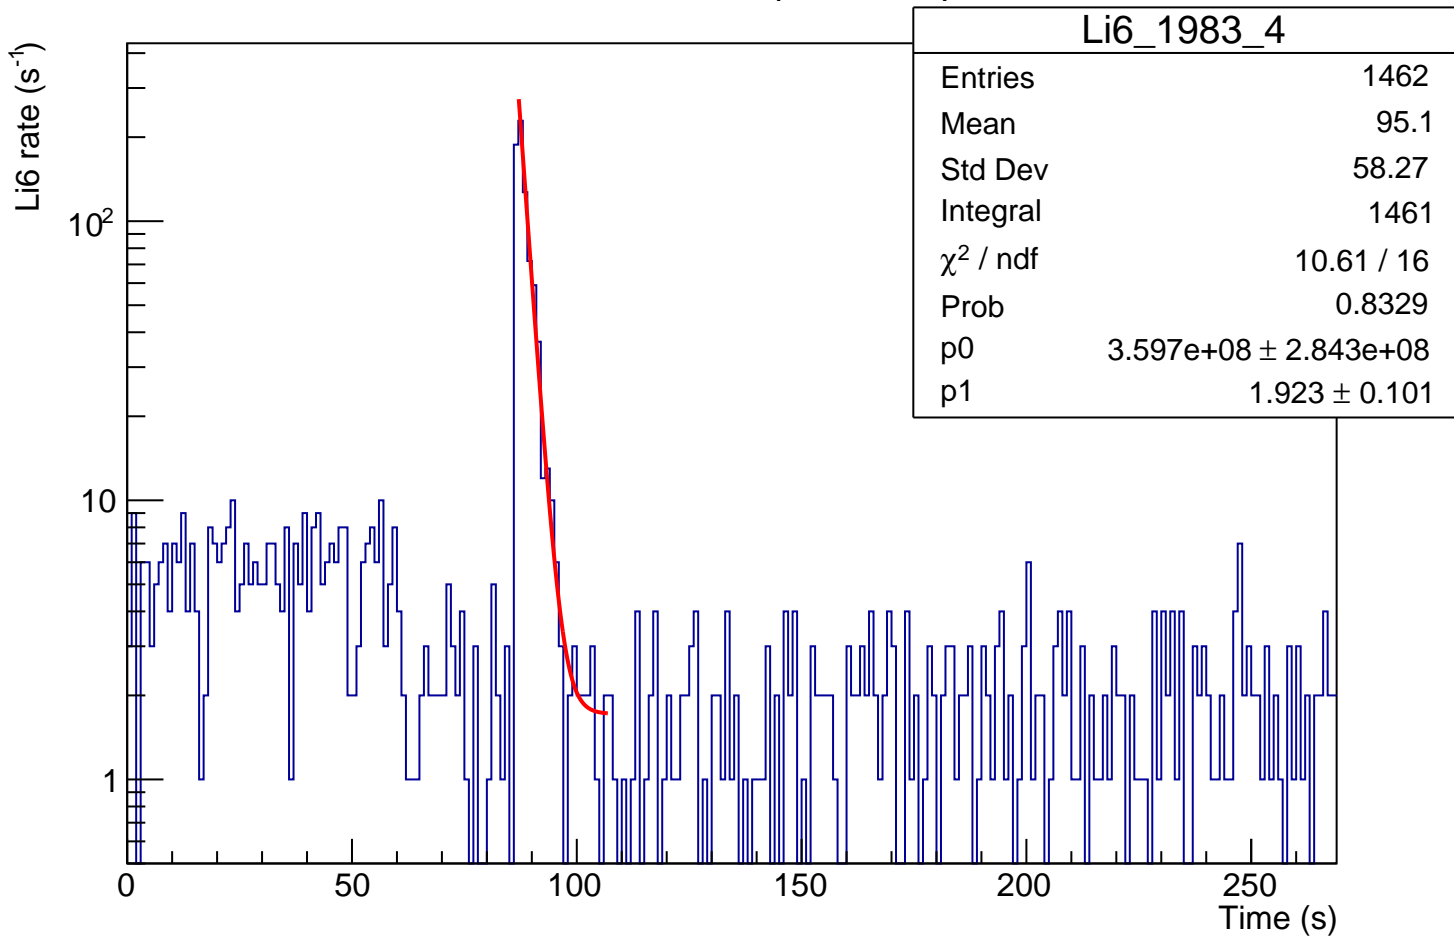


TCN19-270 (Li6 rate)

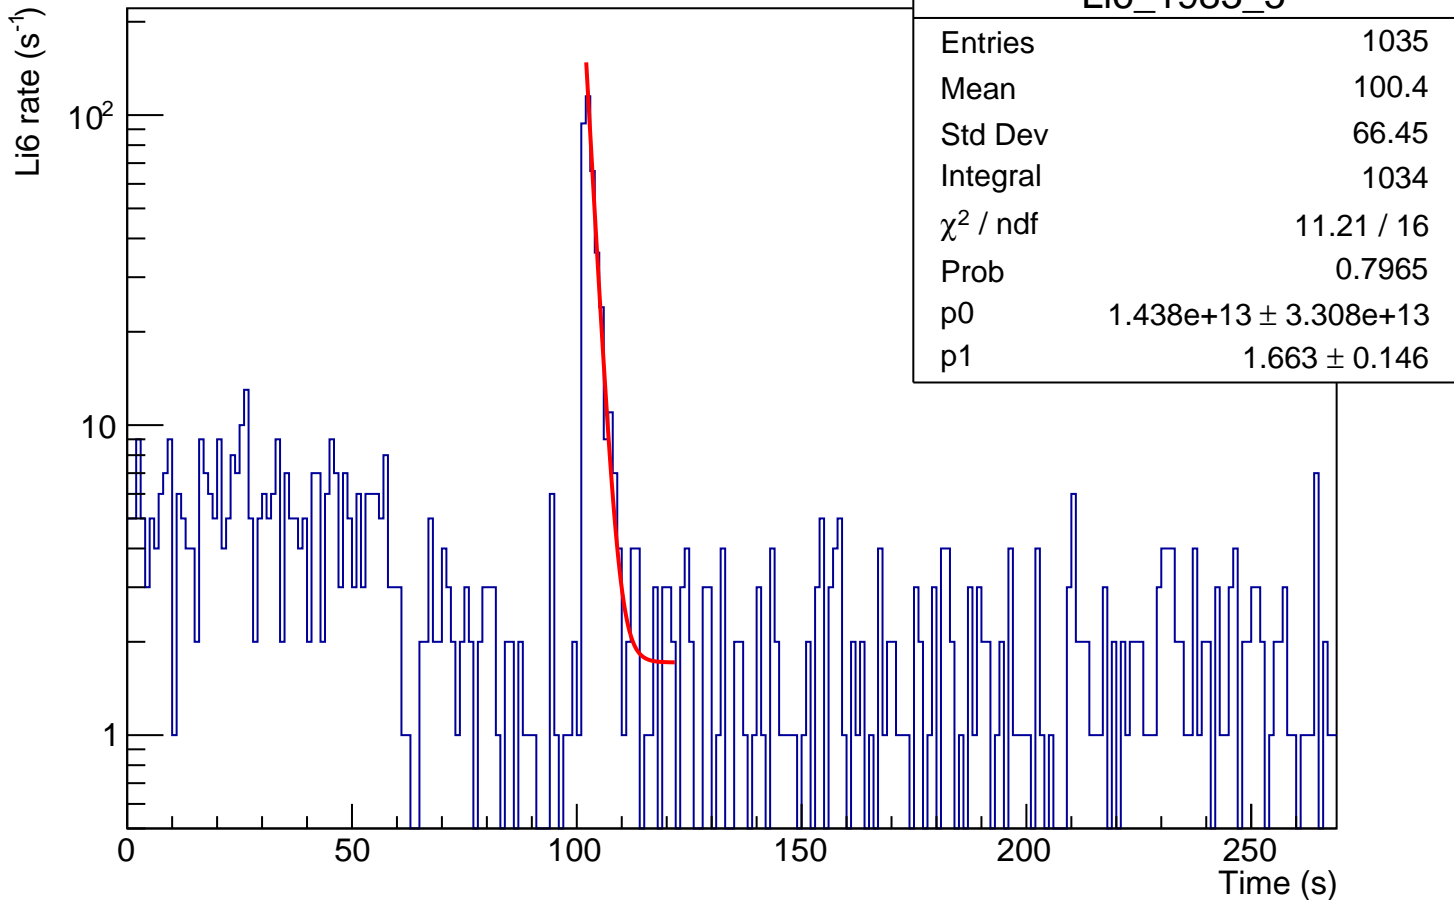


TCN19-270 (Li6 rate)

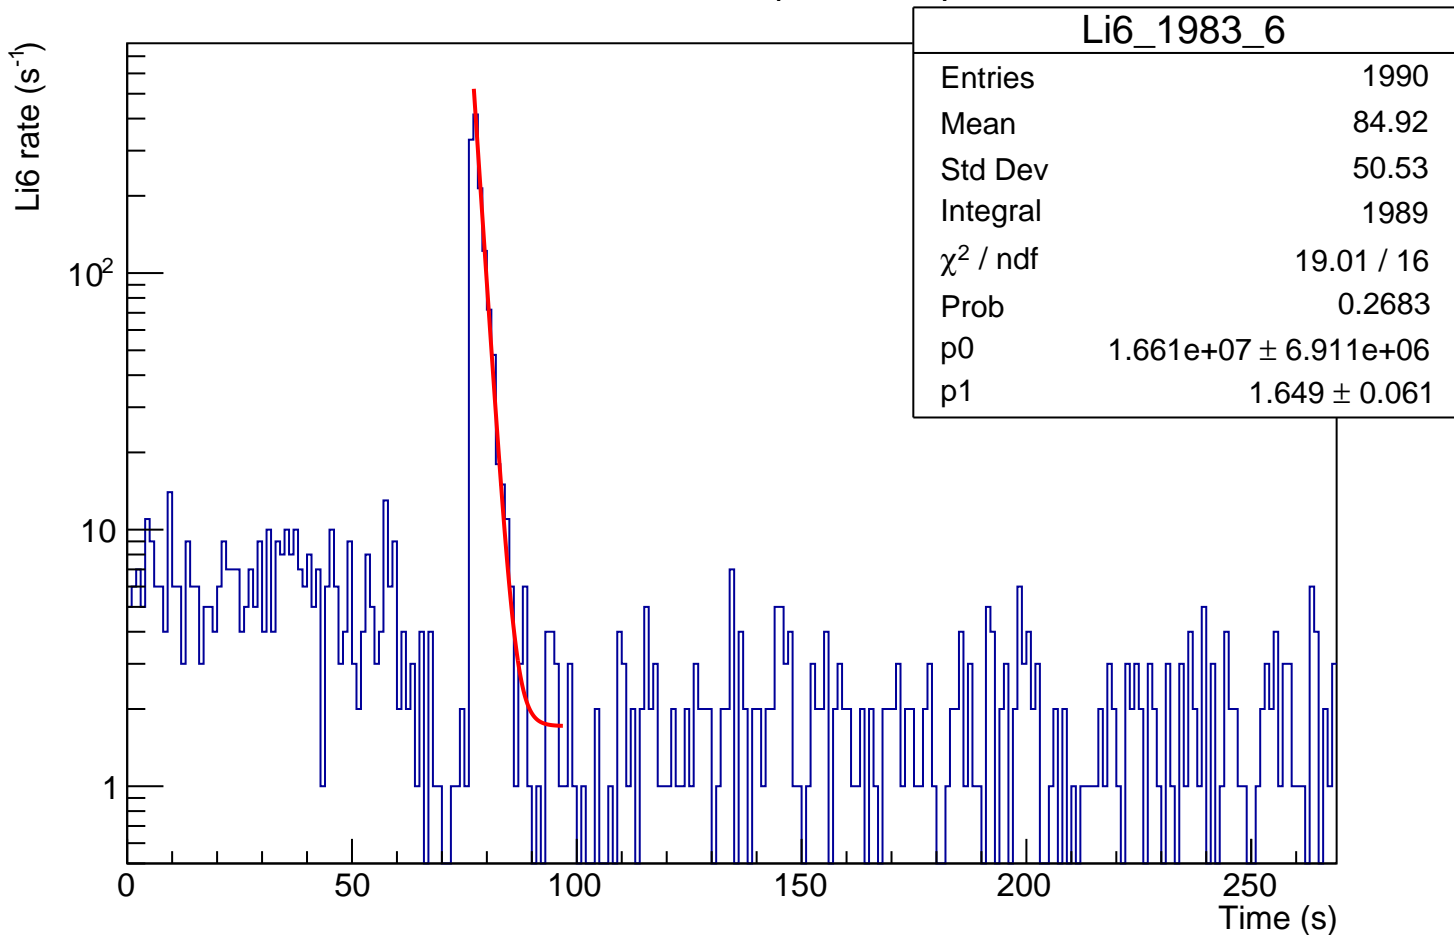


TCN19-270 (Li6 rate)

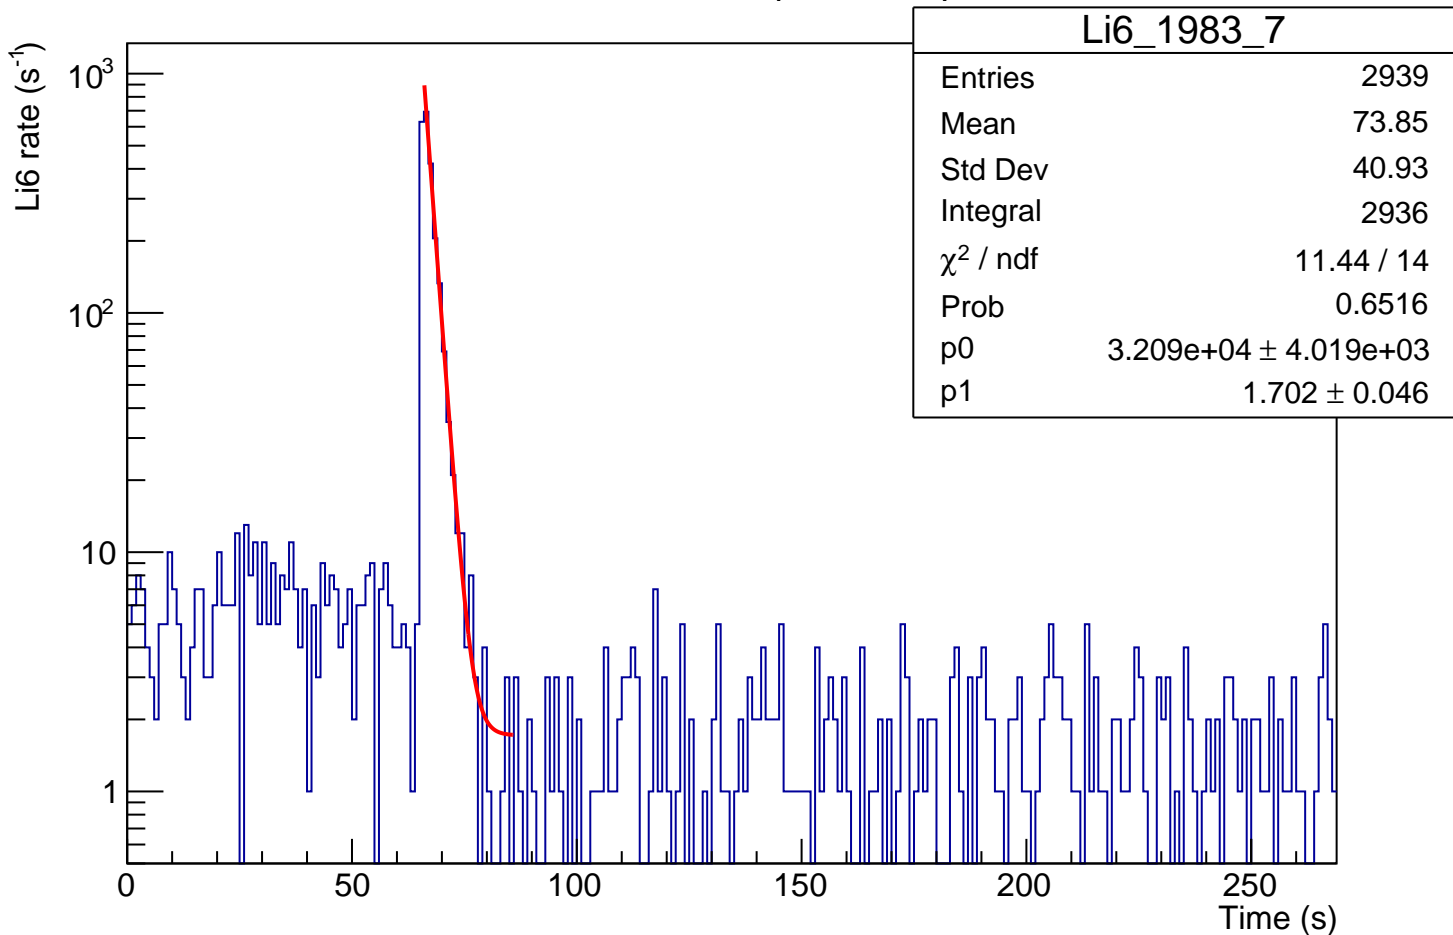


TCN19-270 (Li6 rate)

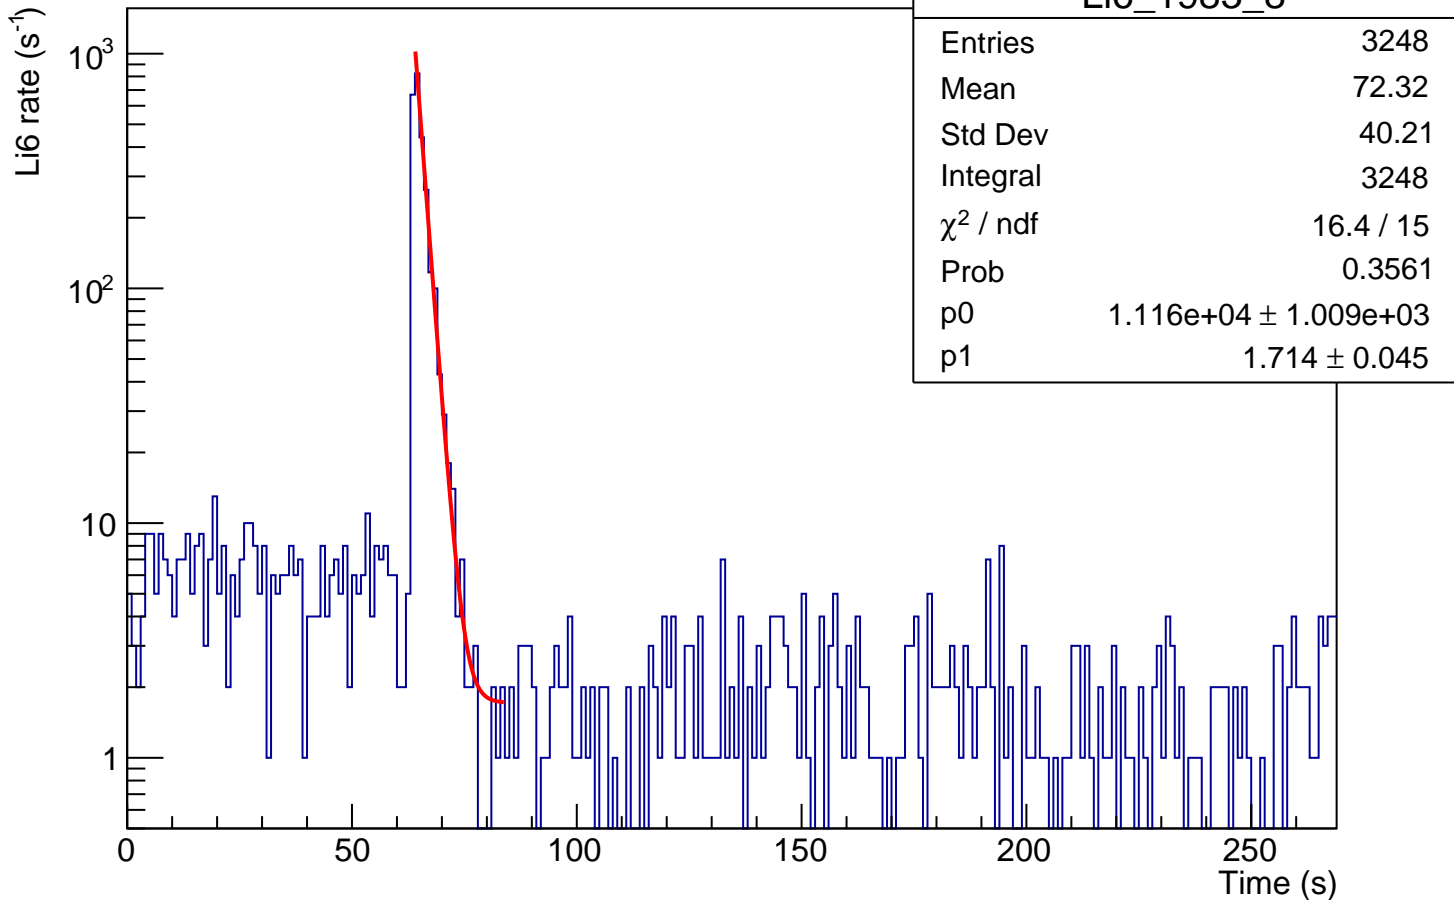


TCN19-270 (Li6 rate)

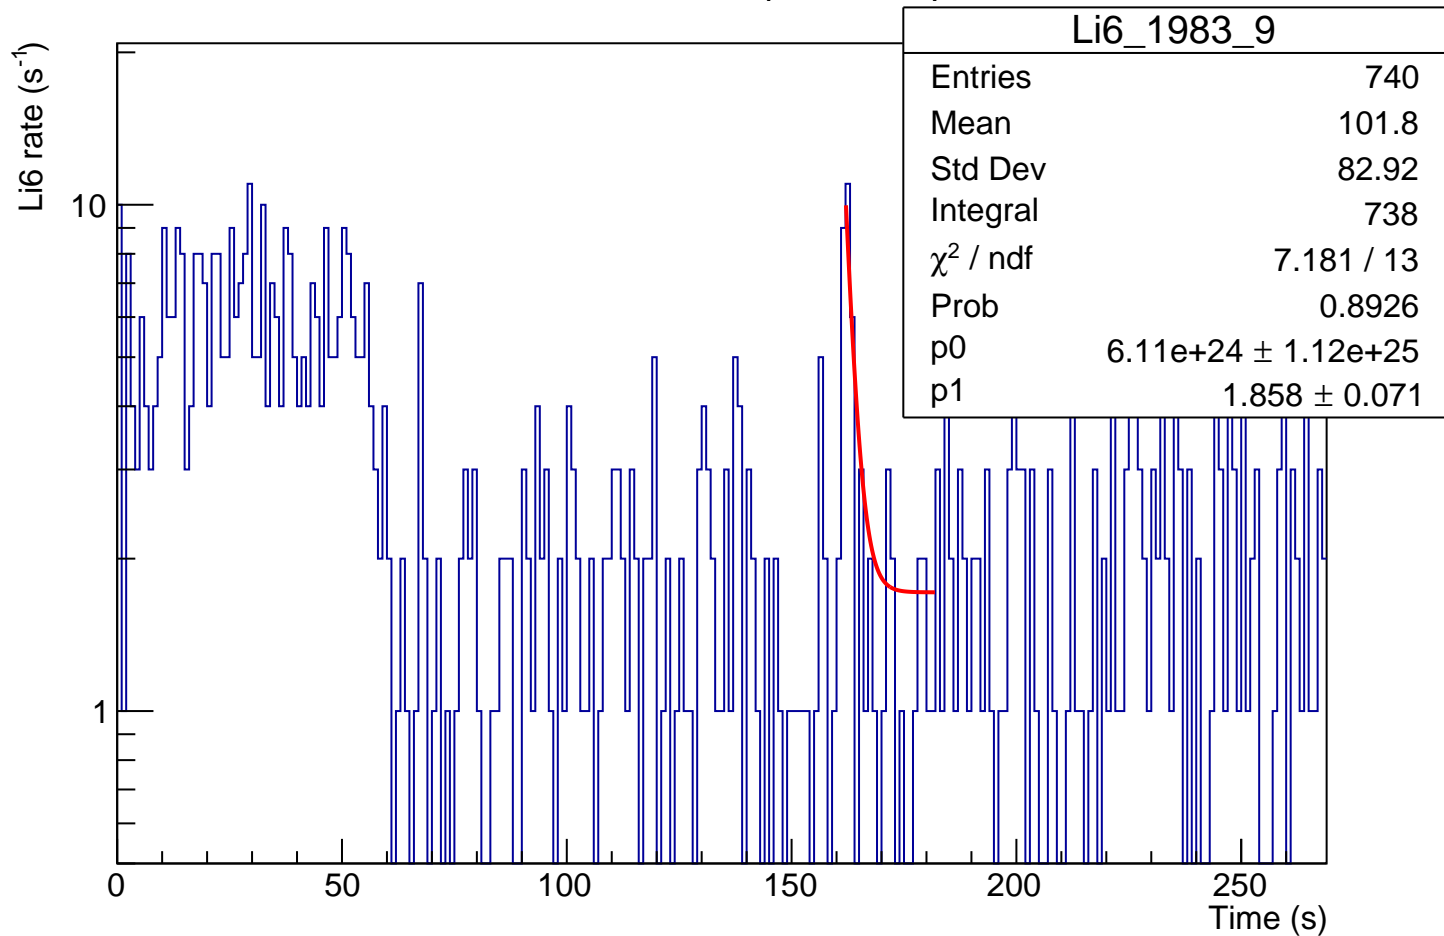


TCN19-270 (Li6 rate)

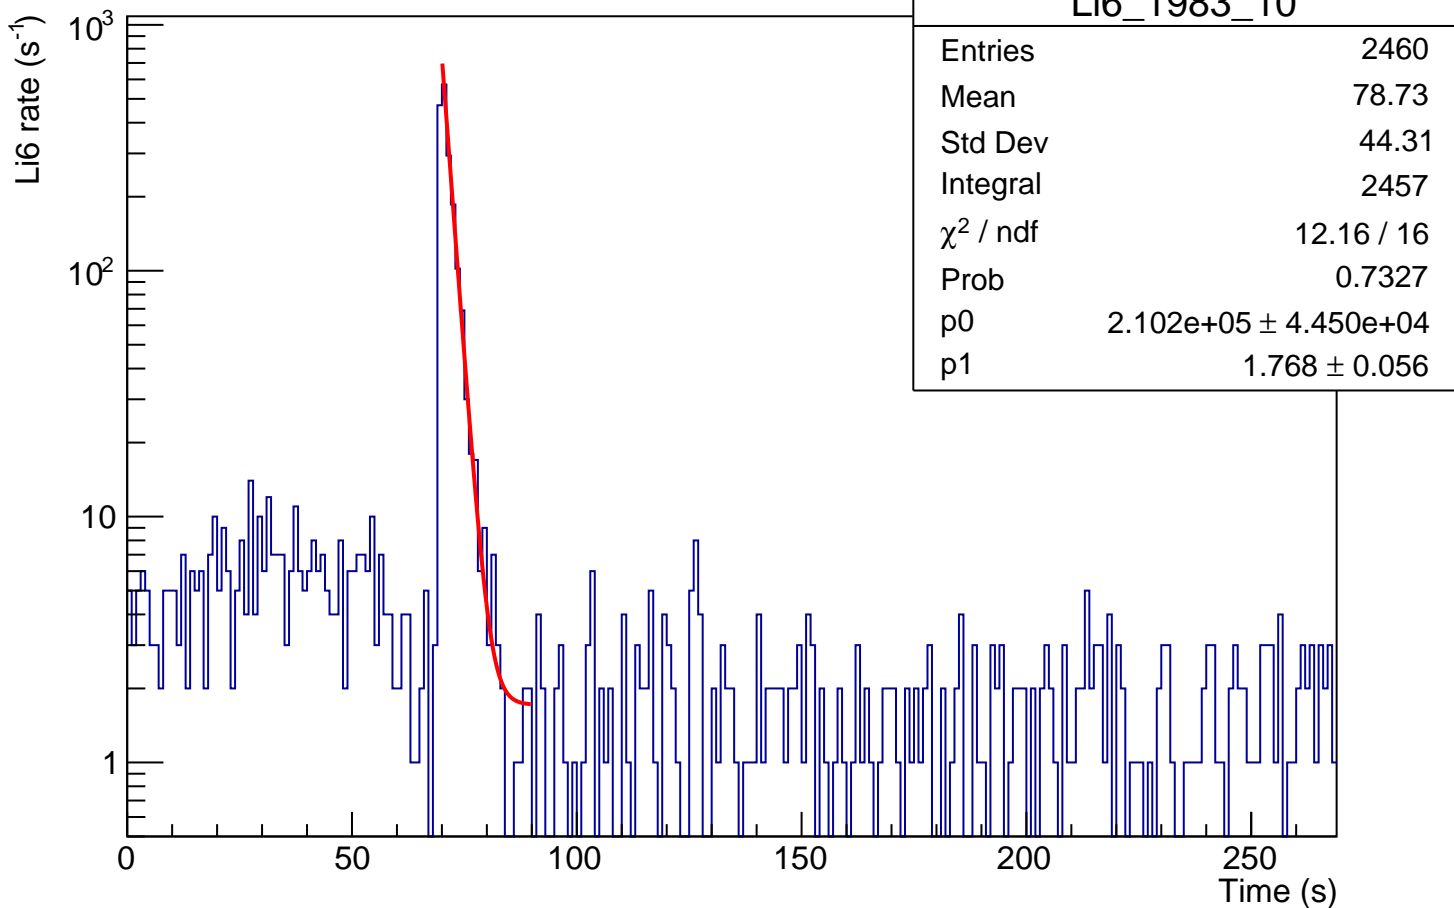


TCN19-270 (Li6 rate)

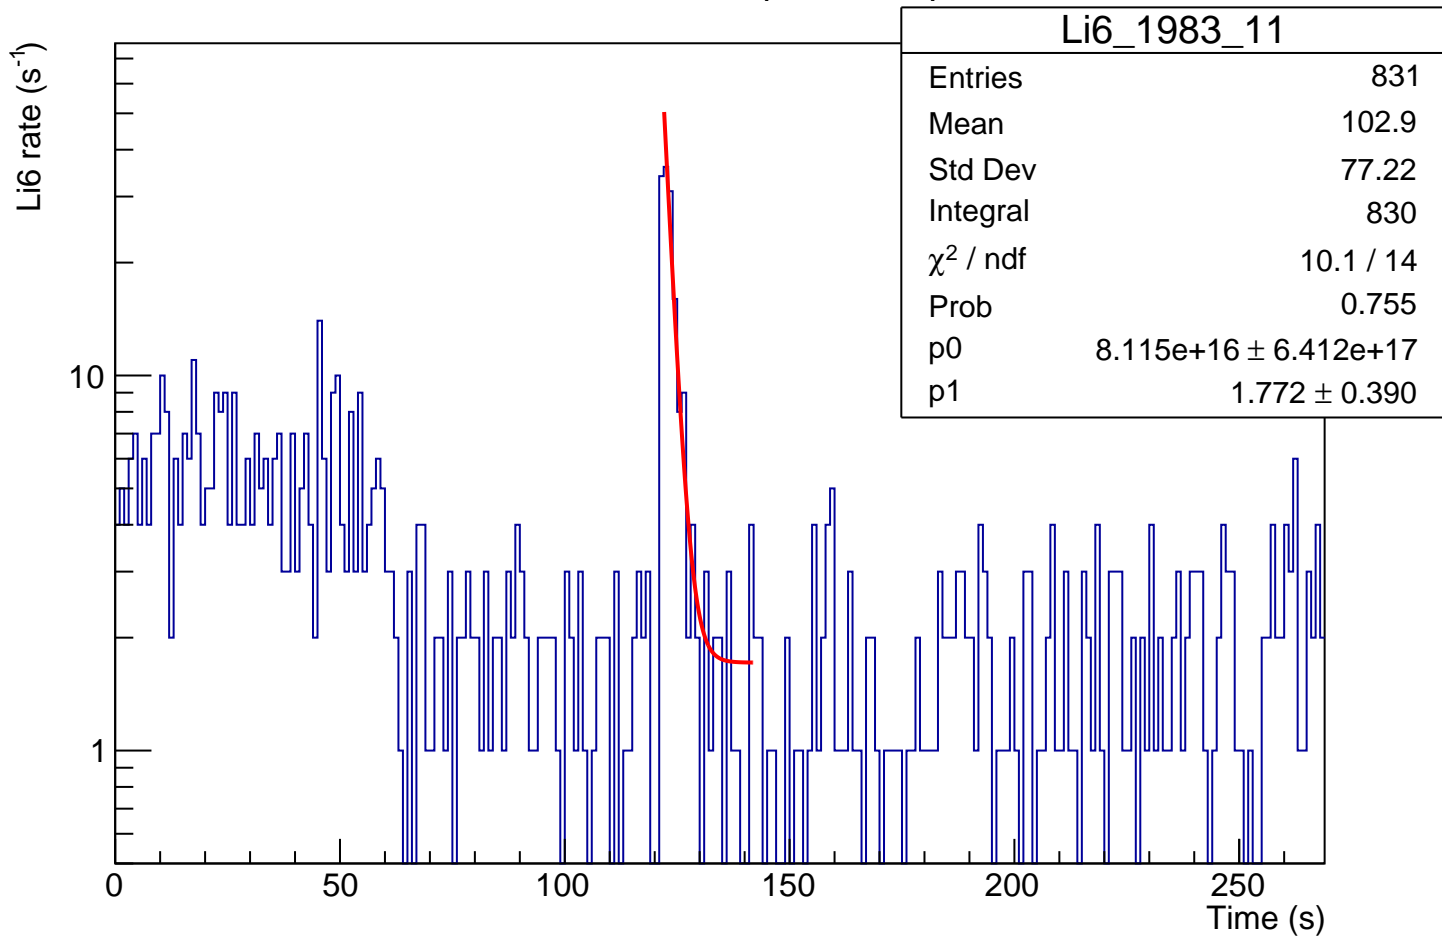


TCN19-270 (Li6 rate)

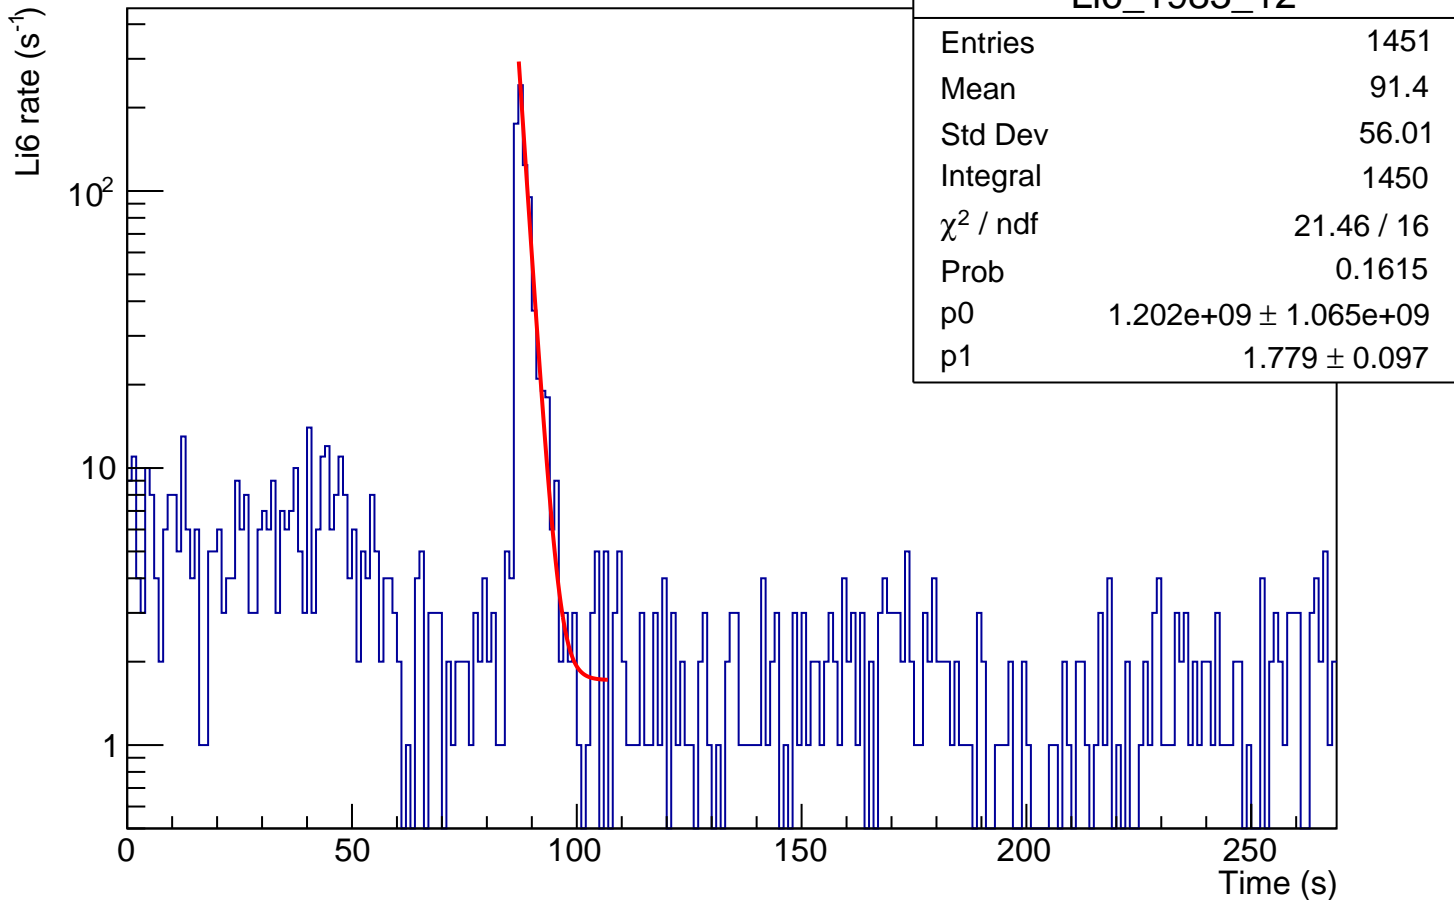


TCN19-270 (Li6 rate)

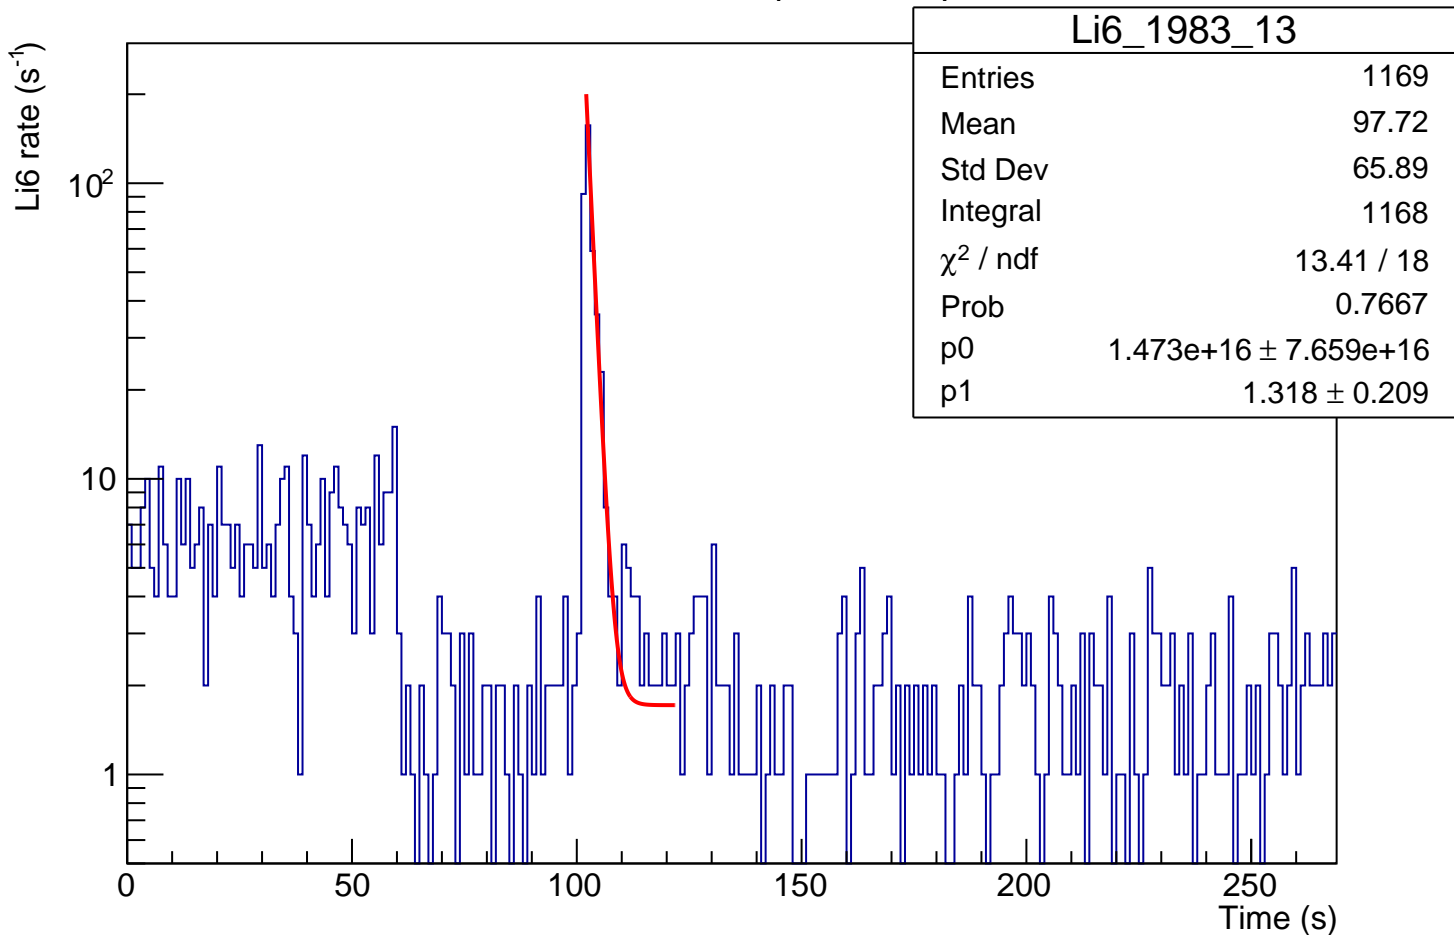


TCN19-270 (Li6 rate)

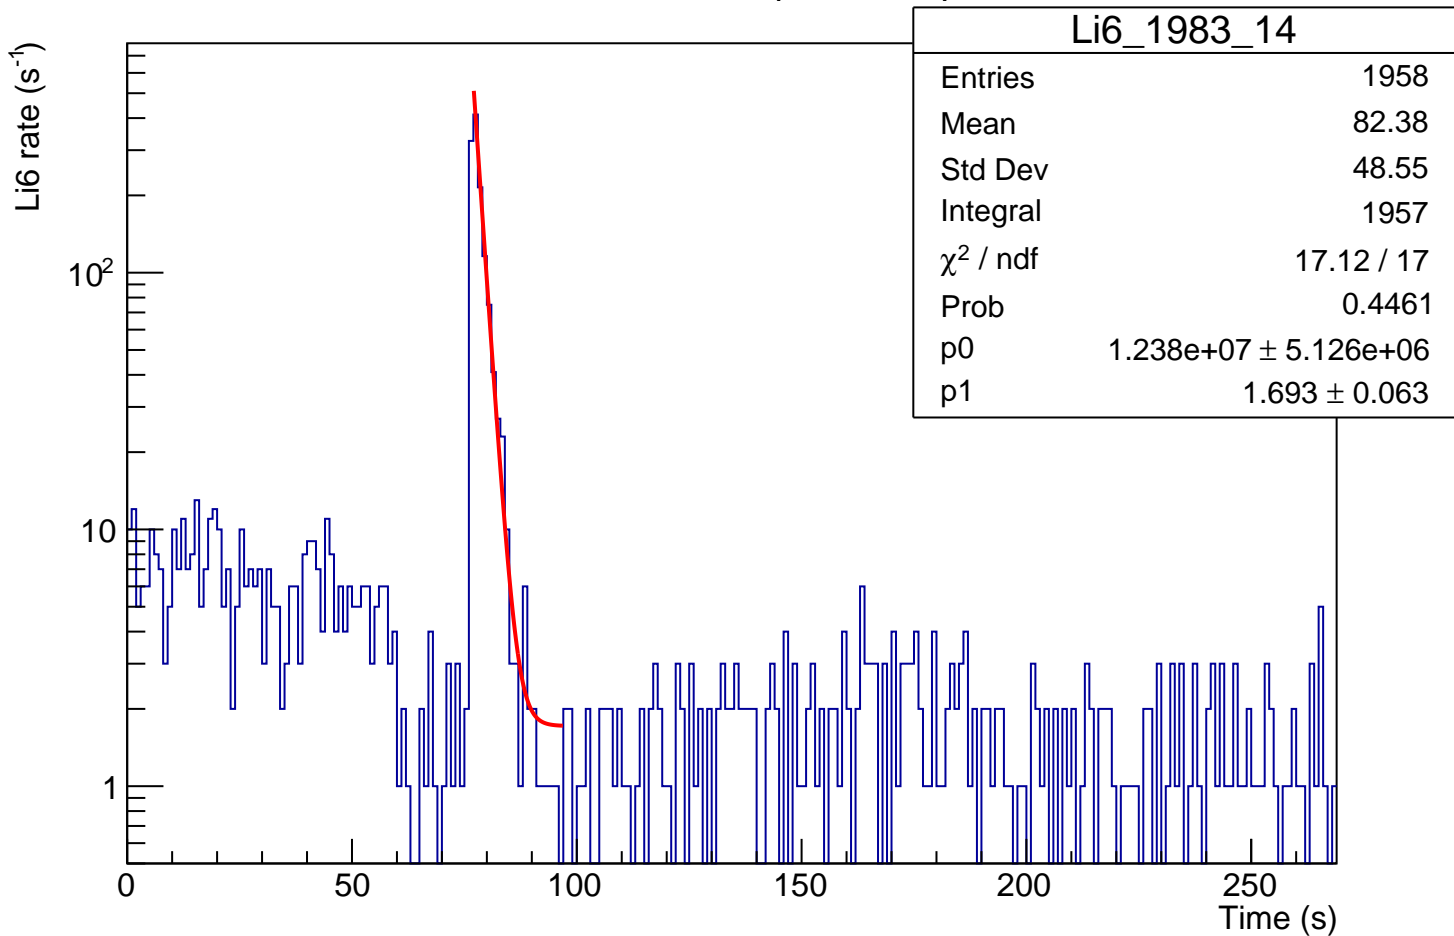


TCN19-270 (Li6 rate)

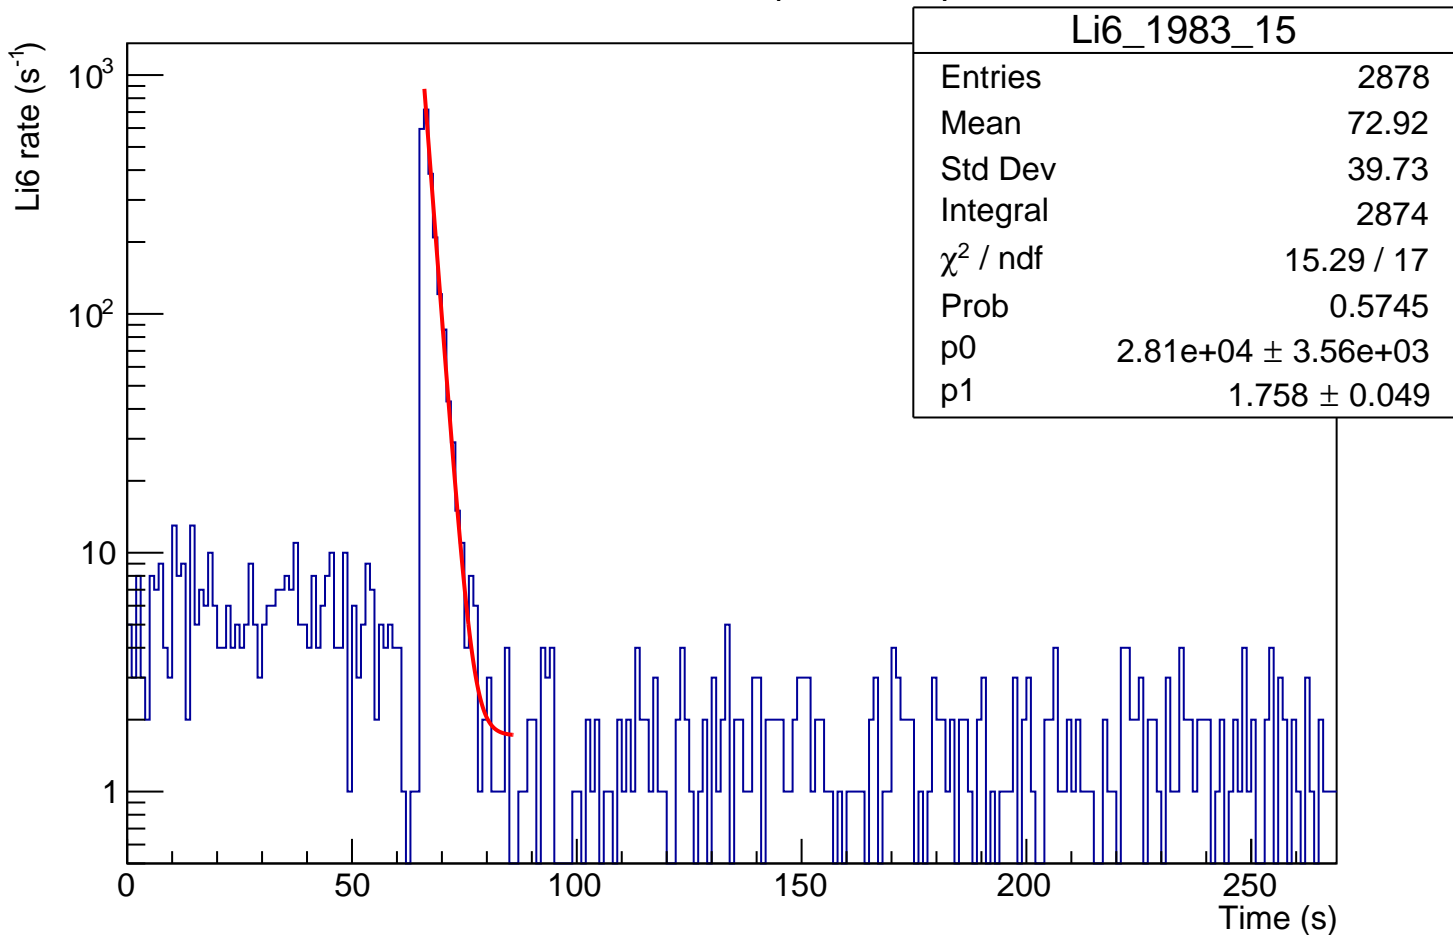


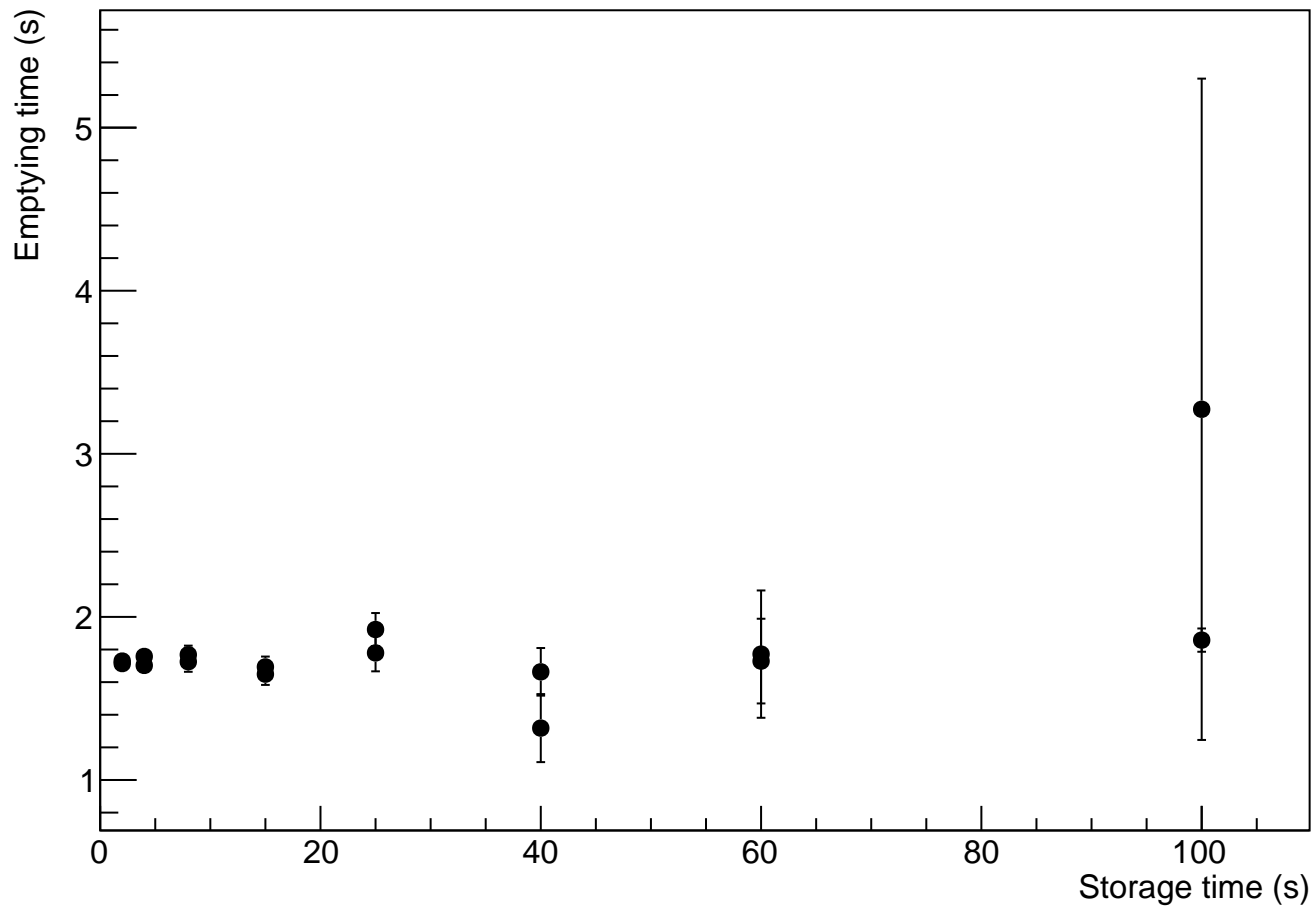


TCN19-270 (He3 rate)

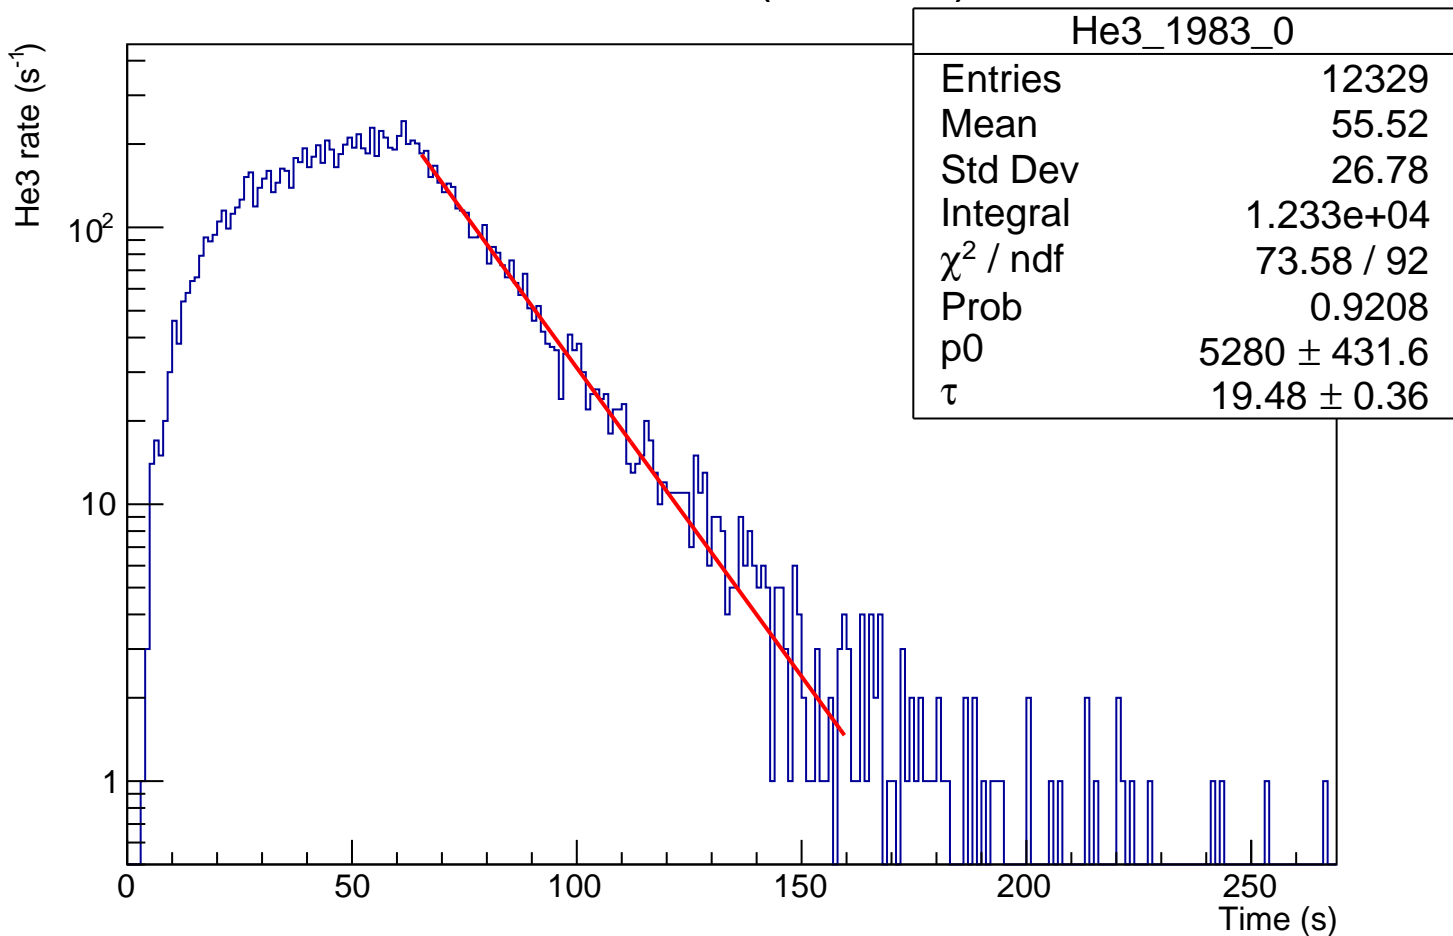


TCN19-270 (He3 rate)

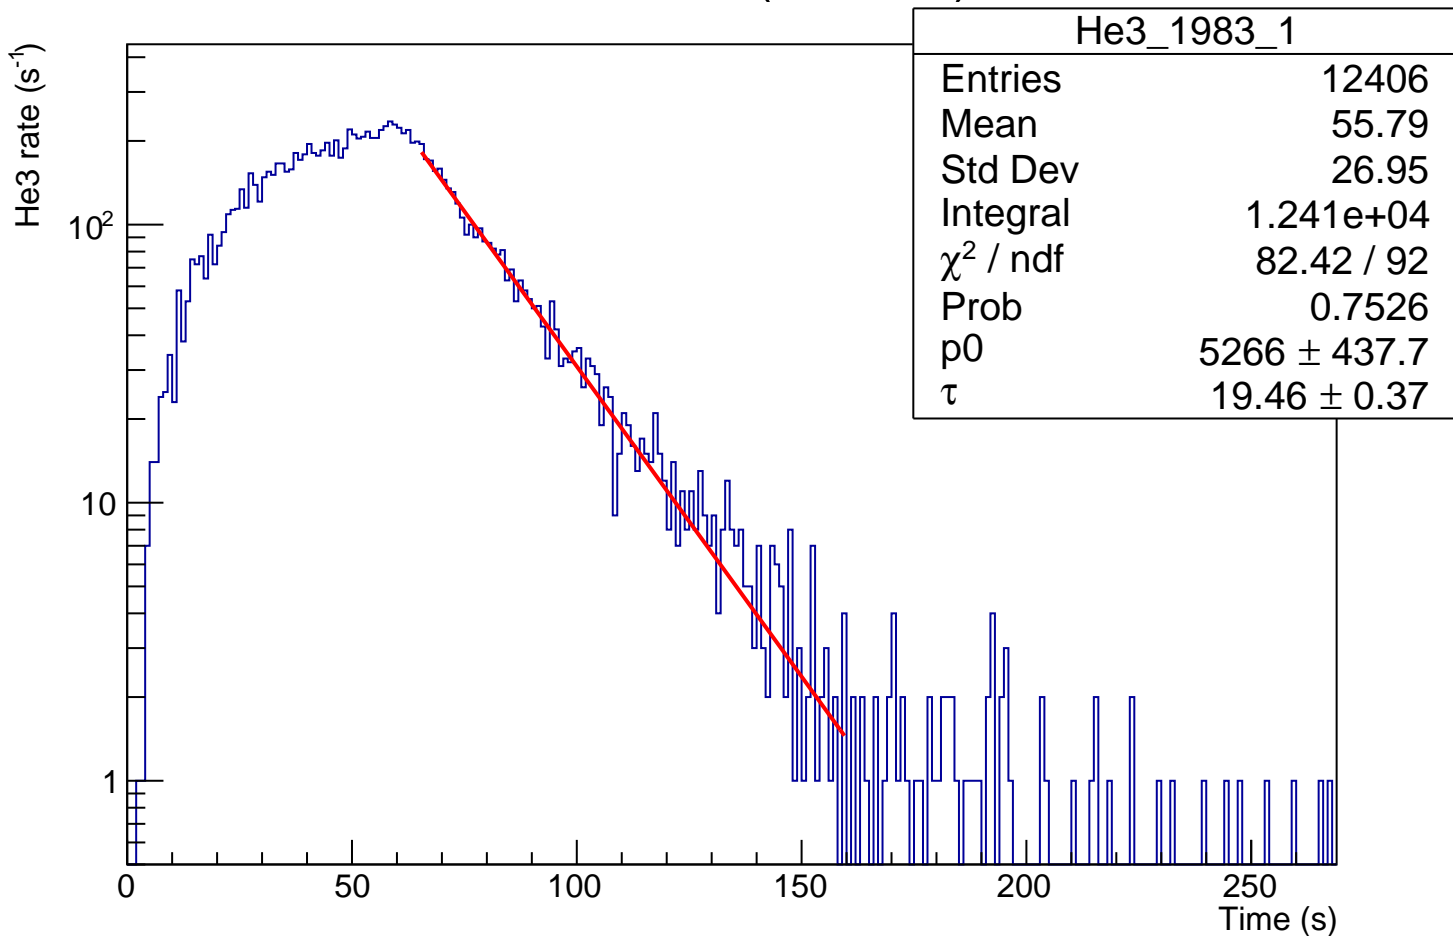


TCN19-270 (He3 rate)

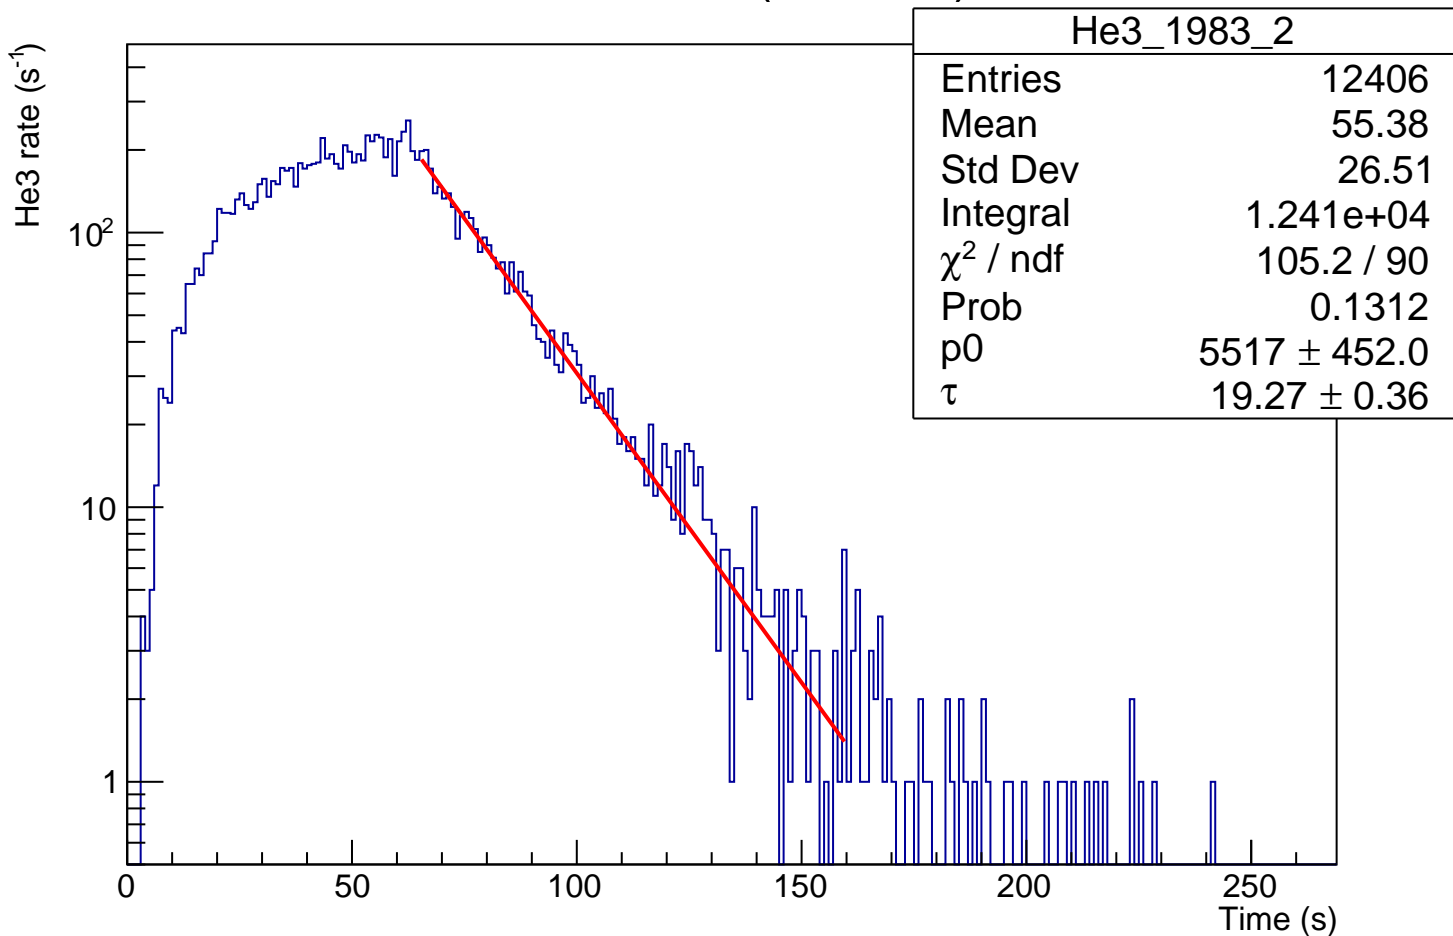


TCN19-270 (He3 rate)

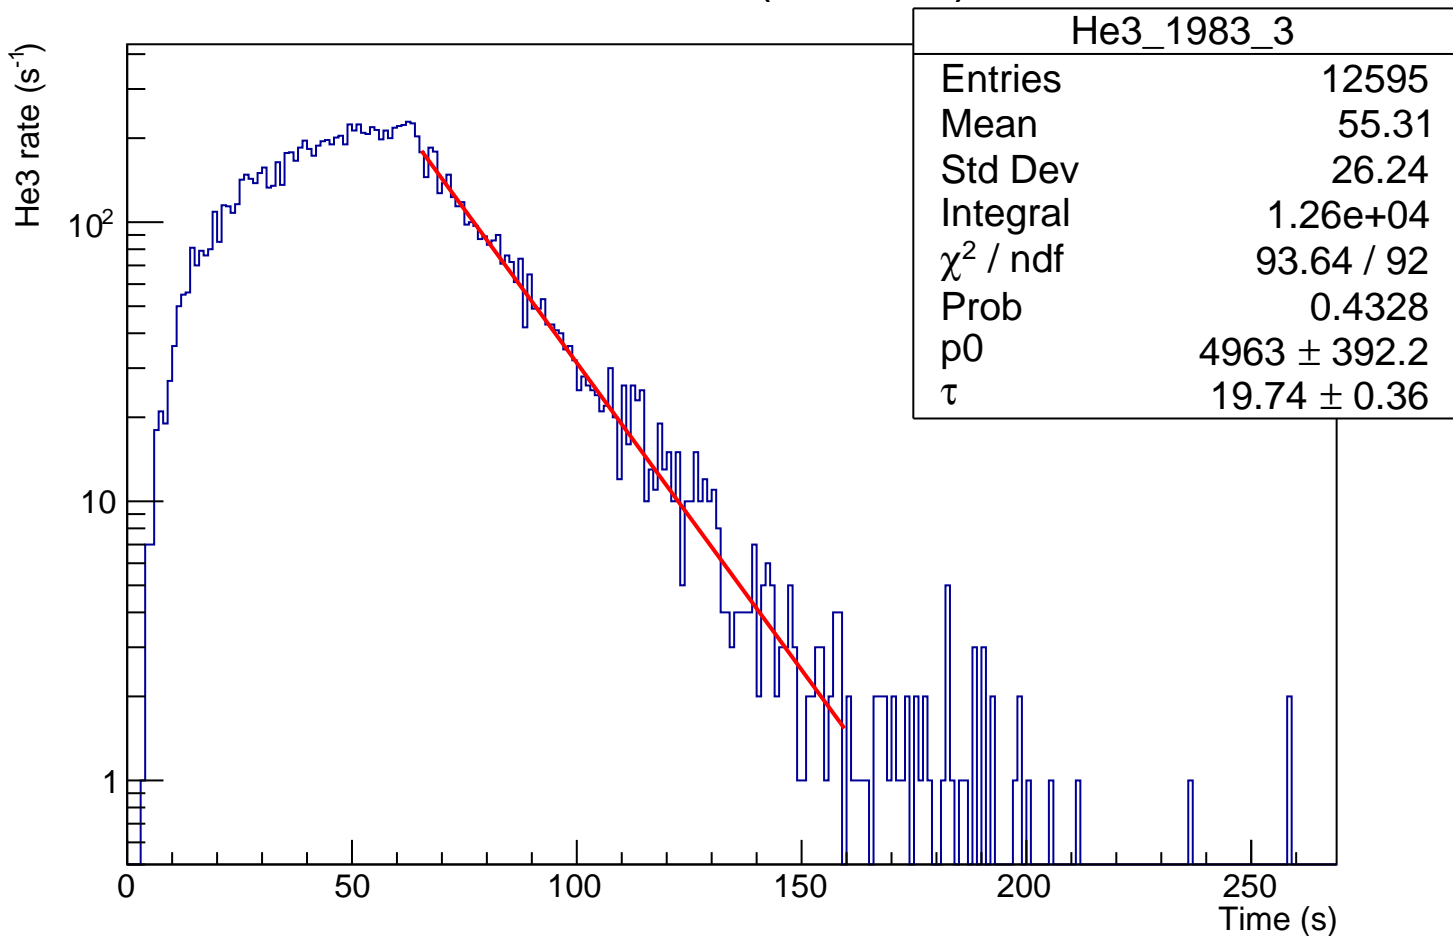


TCN19-270 (He3 rate)

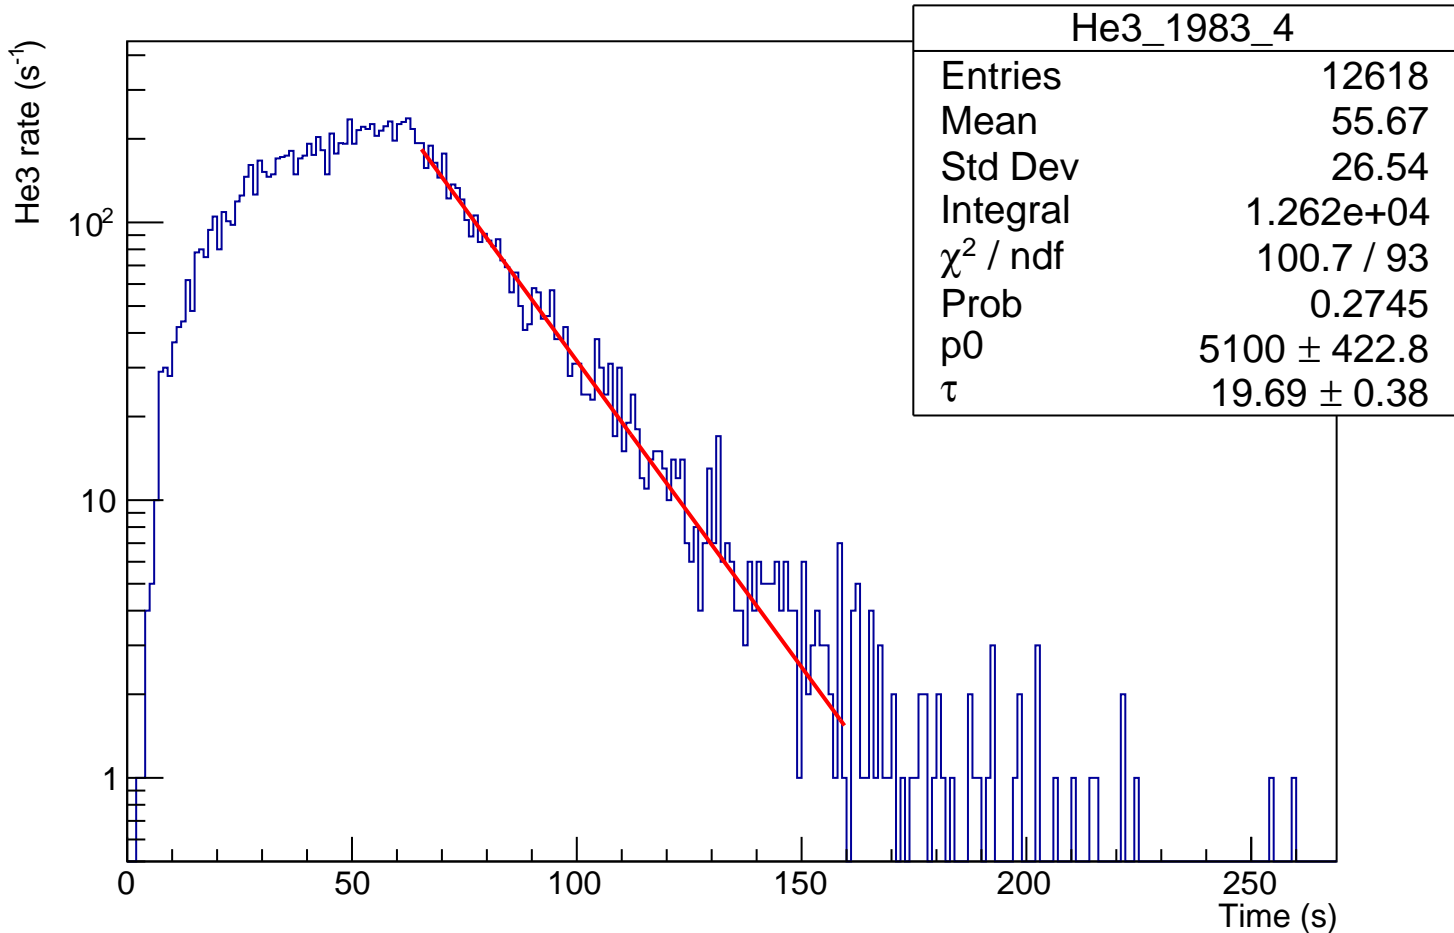


TCN19-270 (He3 rate)

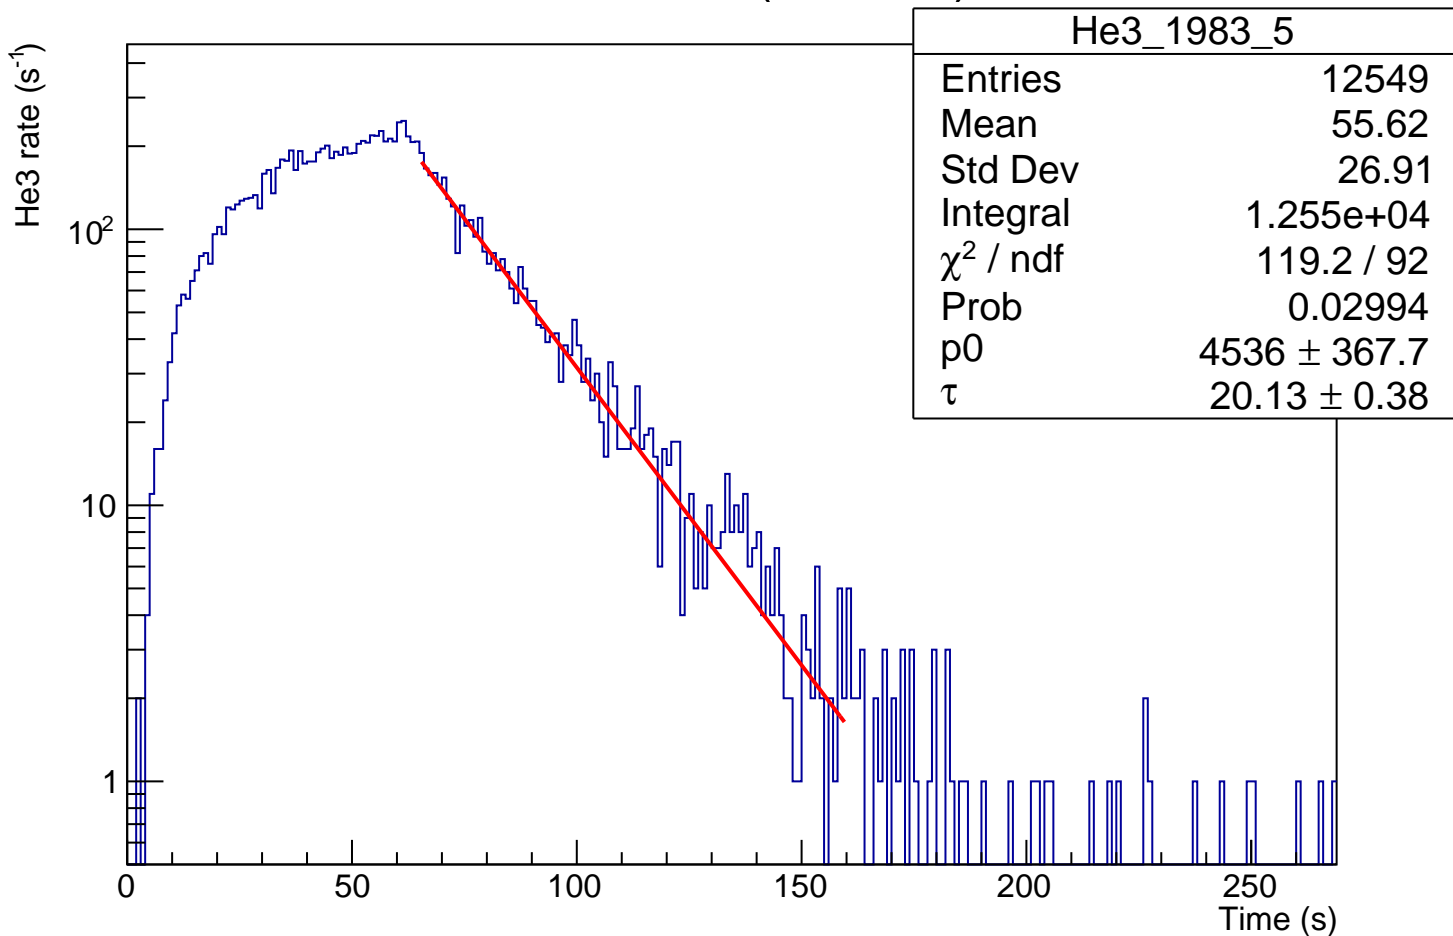


TCN19-270 (He3 rate)

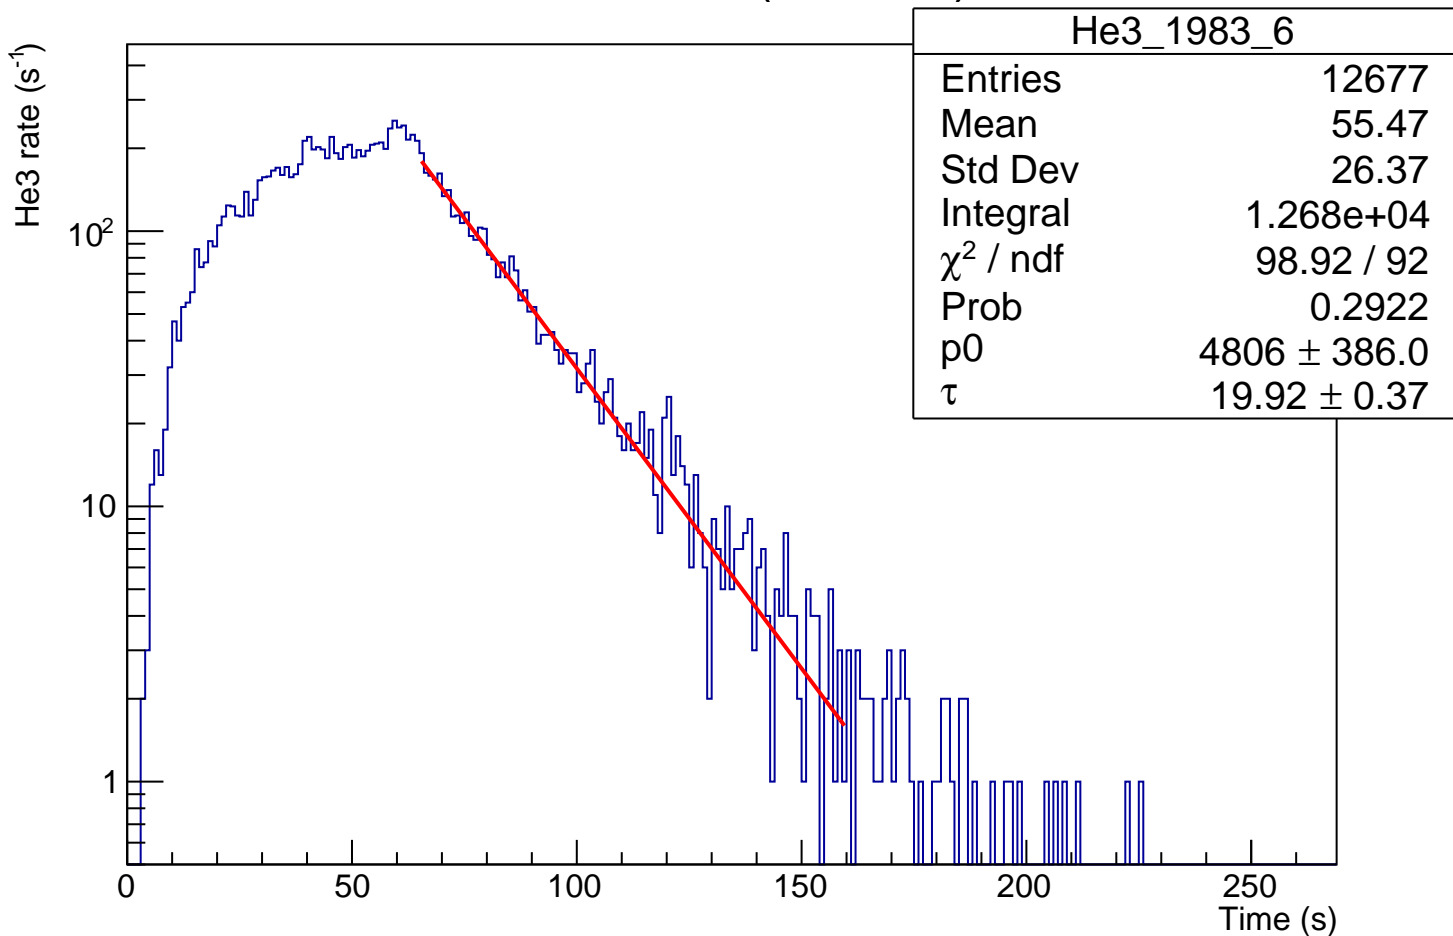


TCN19-270 (He3 rate)

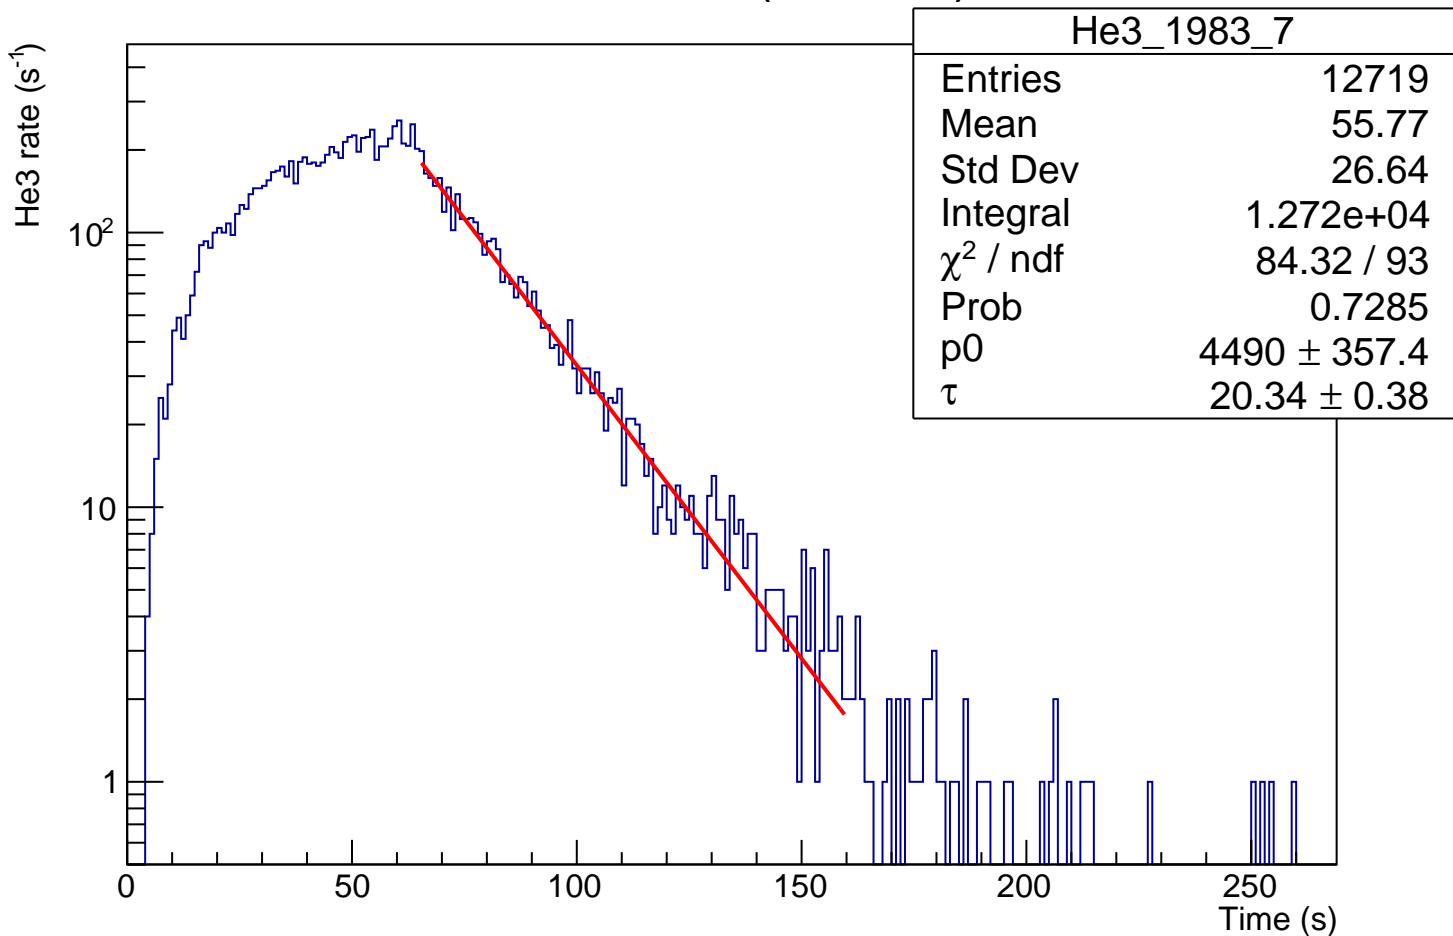


TCN19-270 (He3 rate)

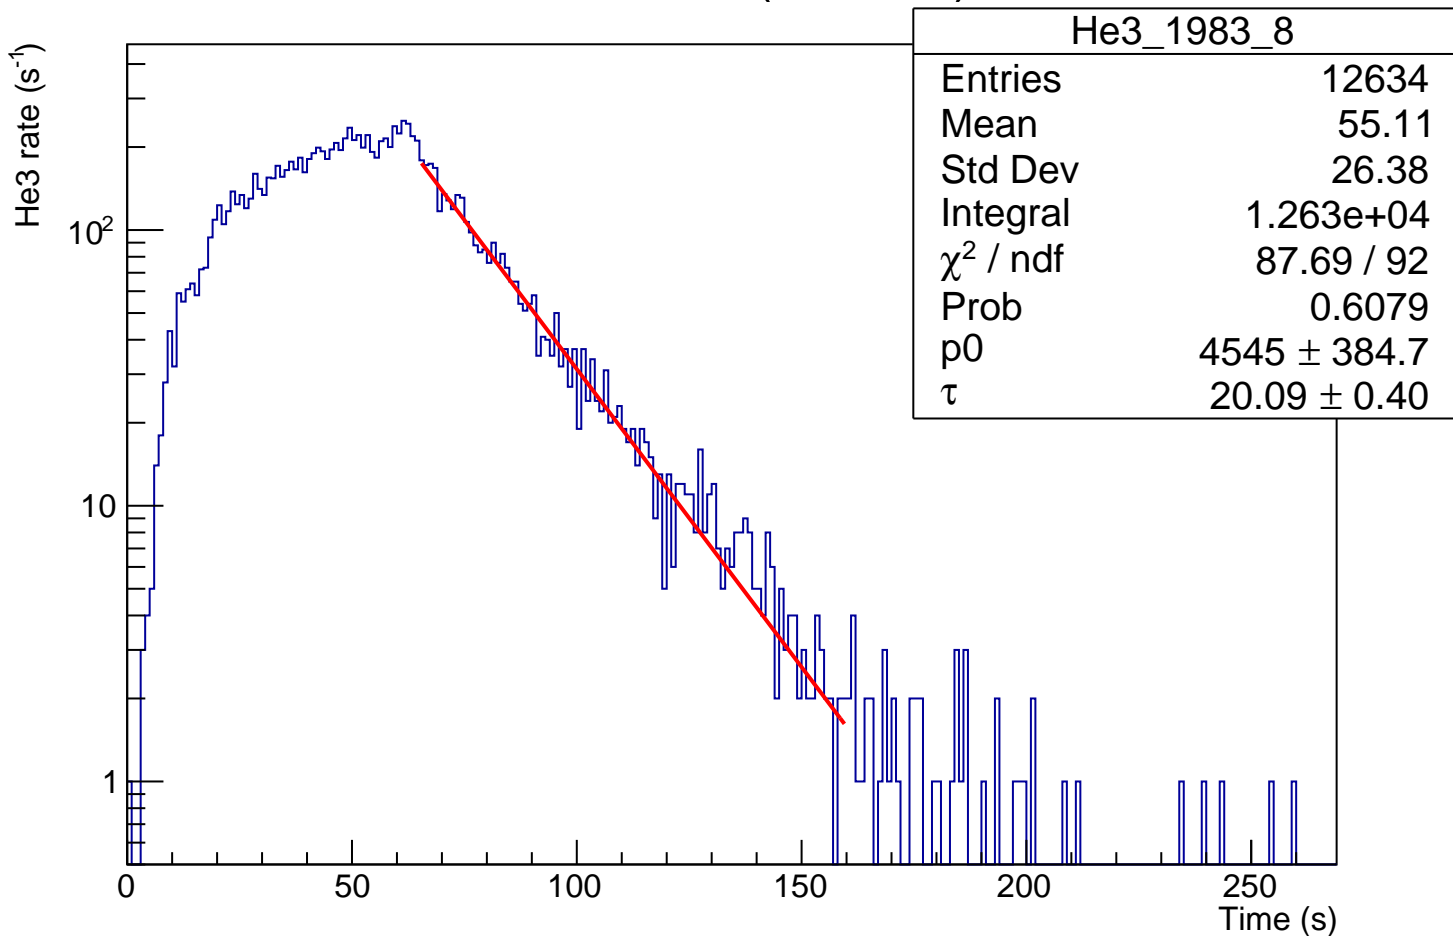


TCN19-270 (He3 rate)

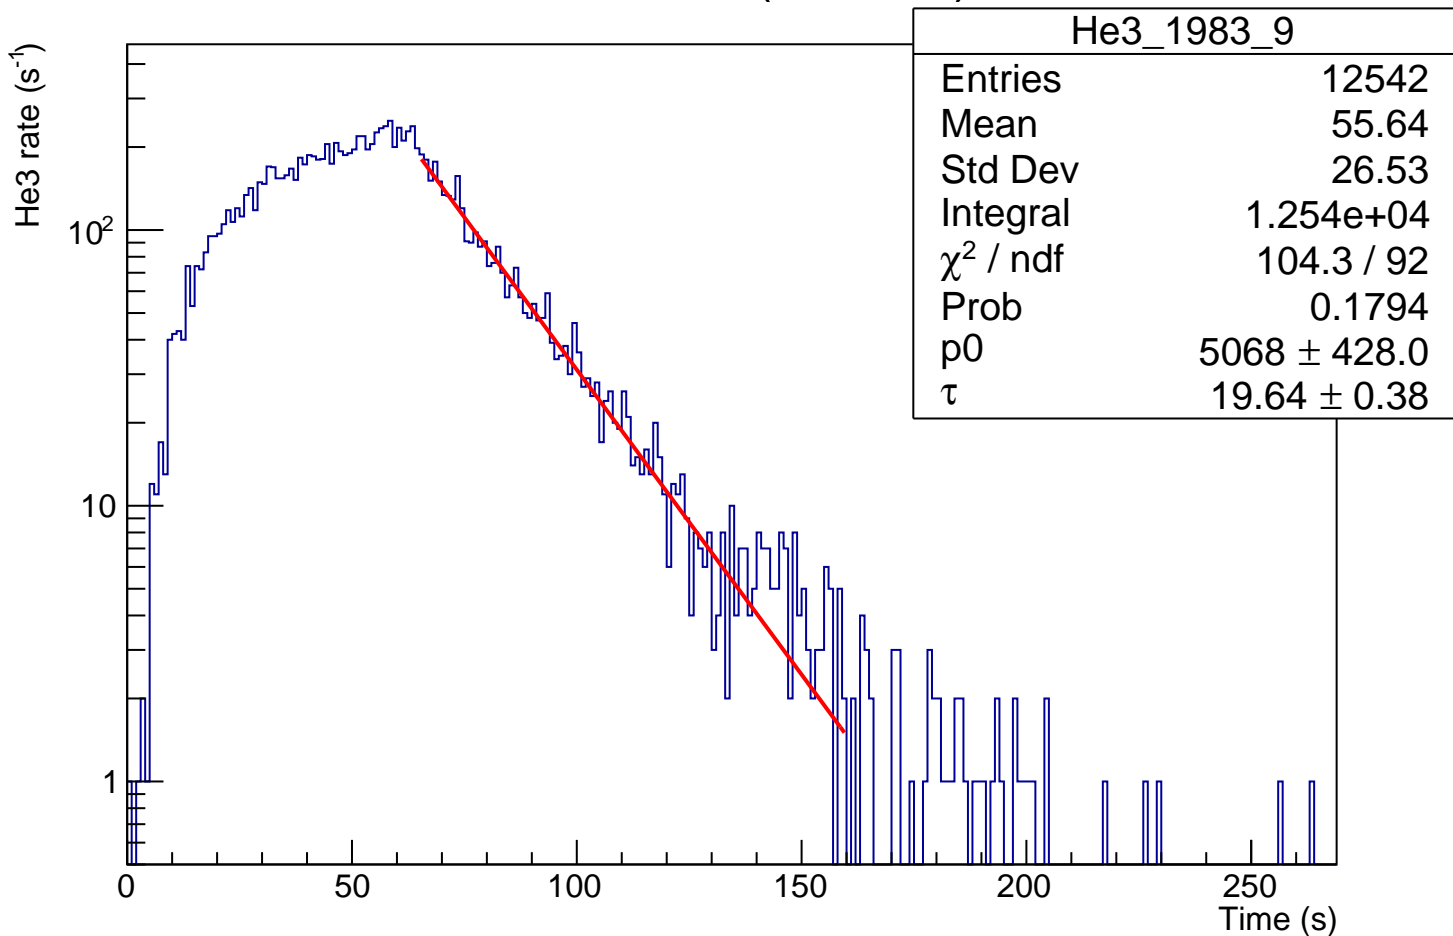


TCN19-270 (He3 rate)

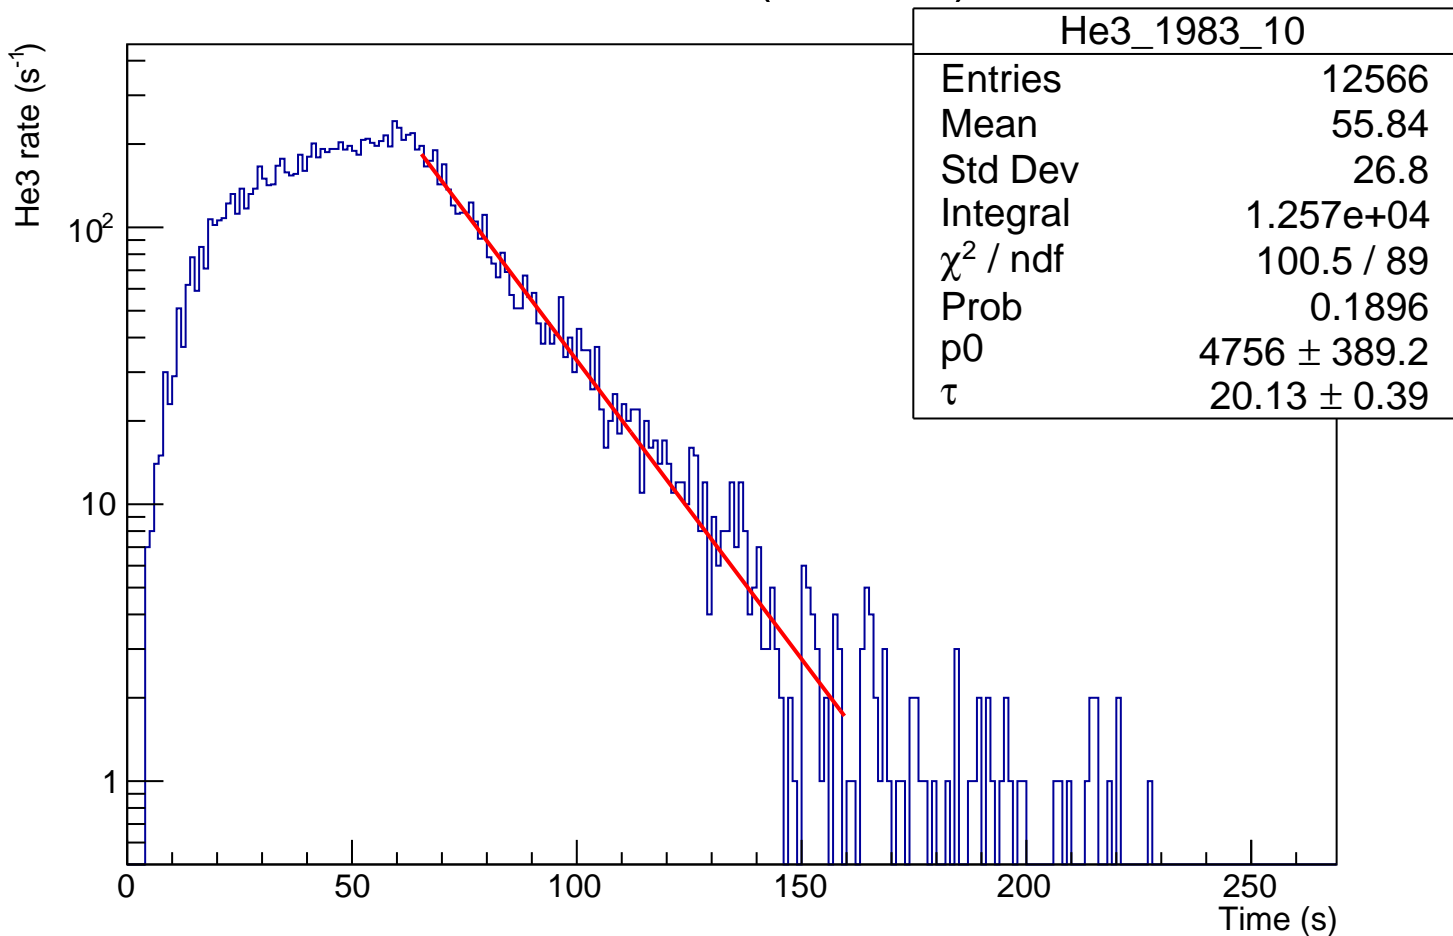


TCN19-270 (He3 rate)

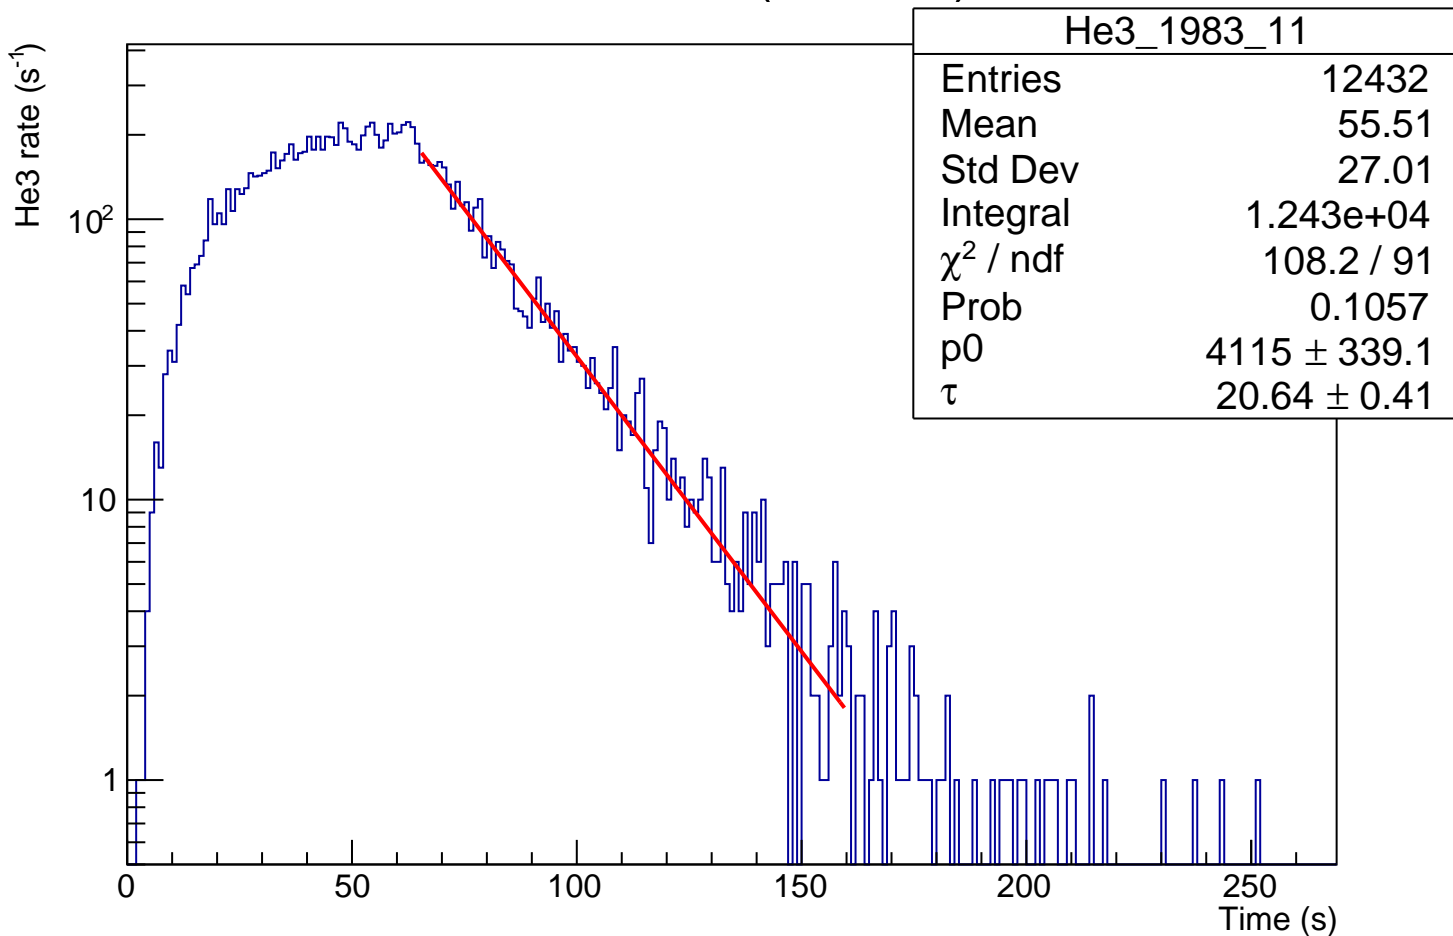


TCN19-270 (He3 rate)

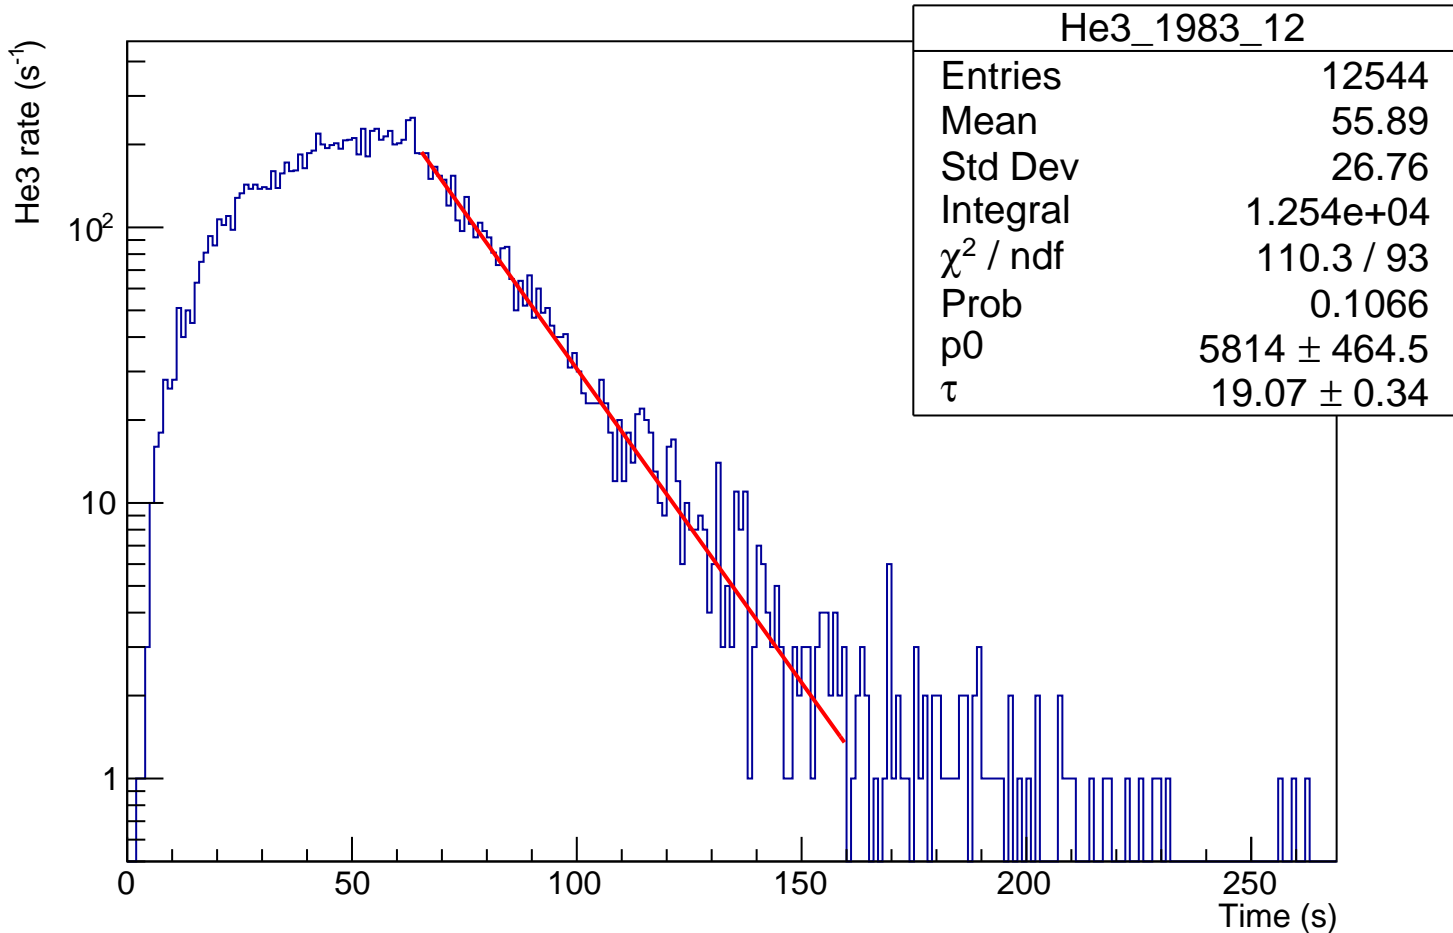


TCN19-270 (He3 rate)

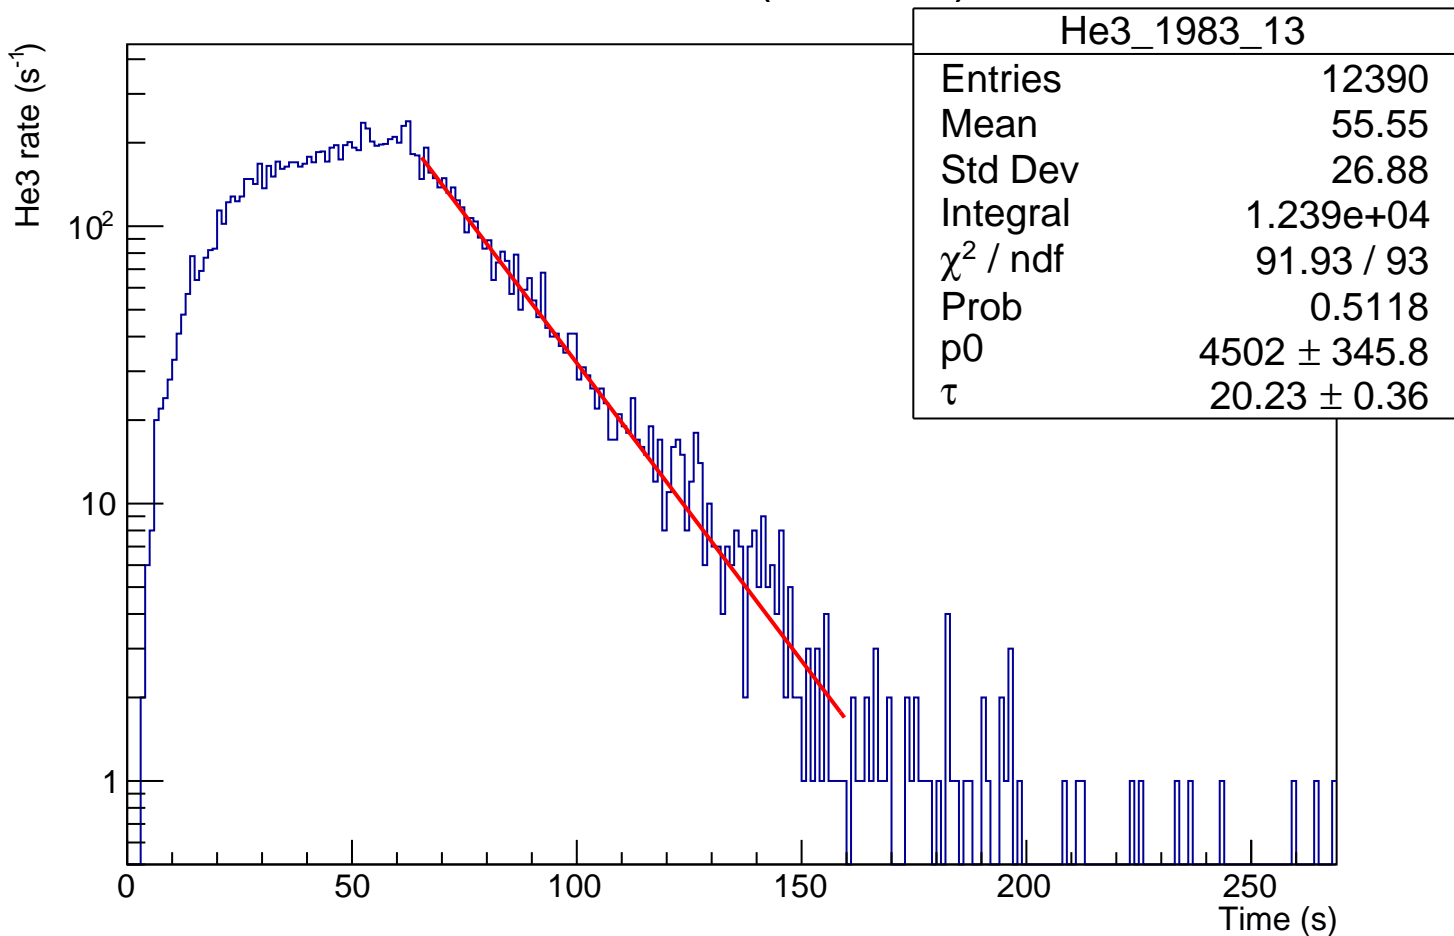


TCN19-270 (He3 rate)

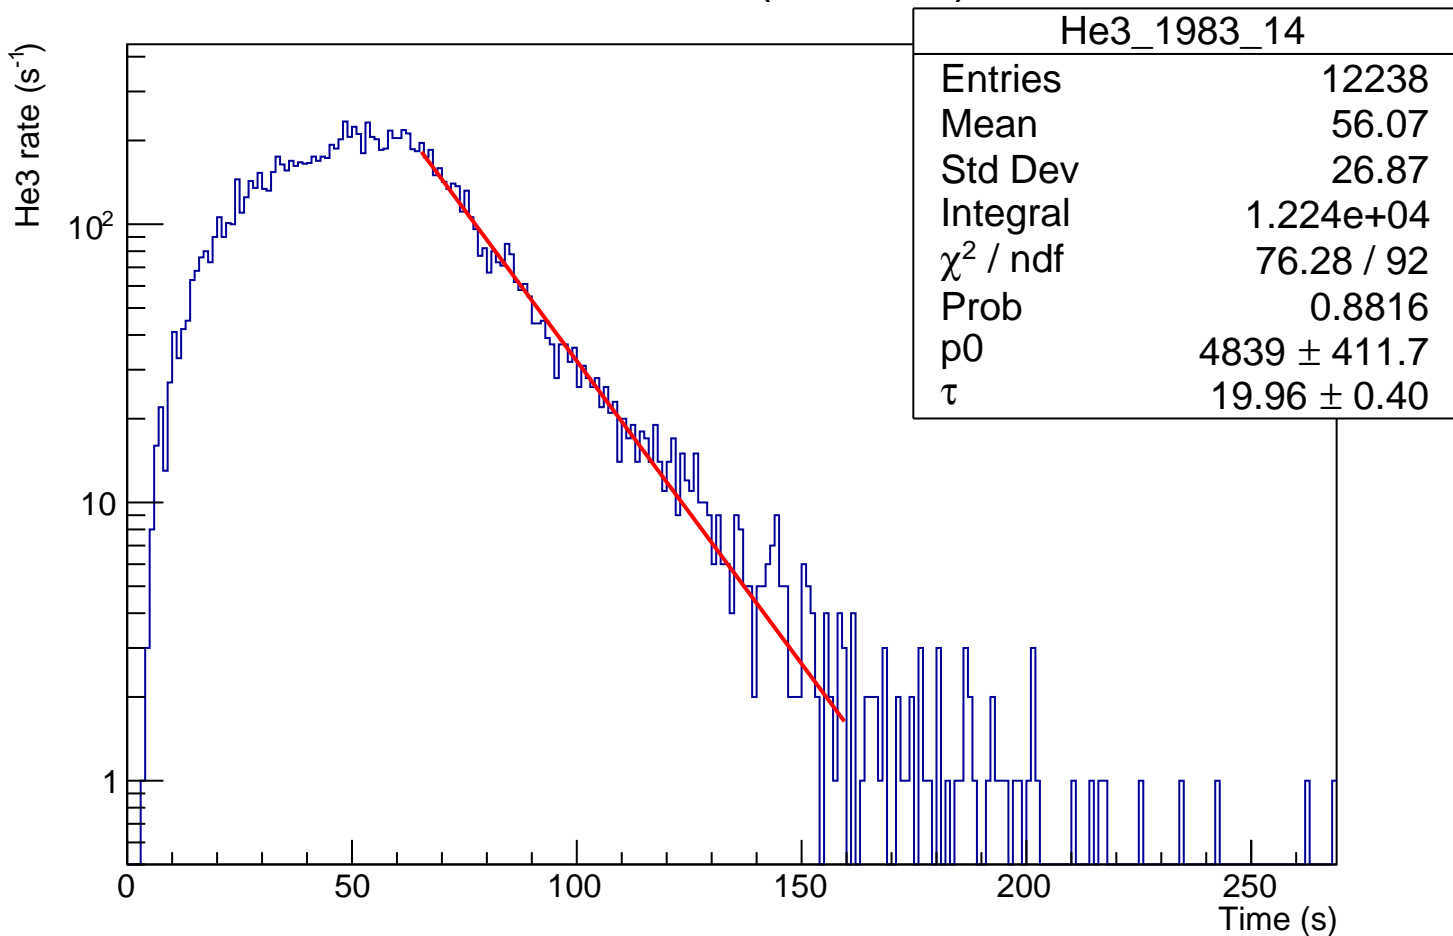


TCN19-270 (He3 rate)

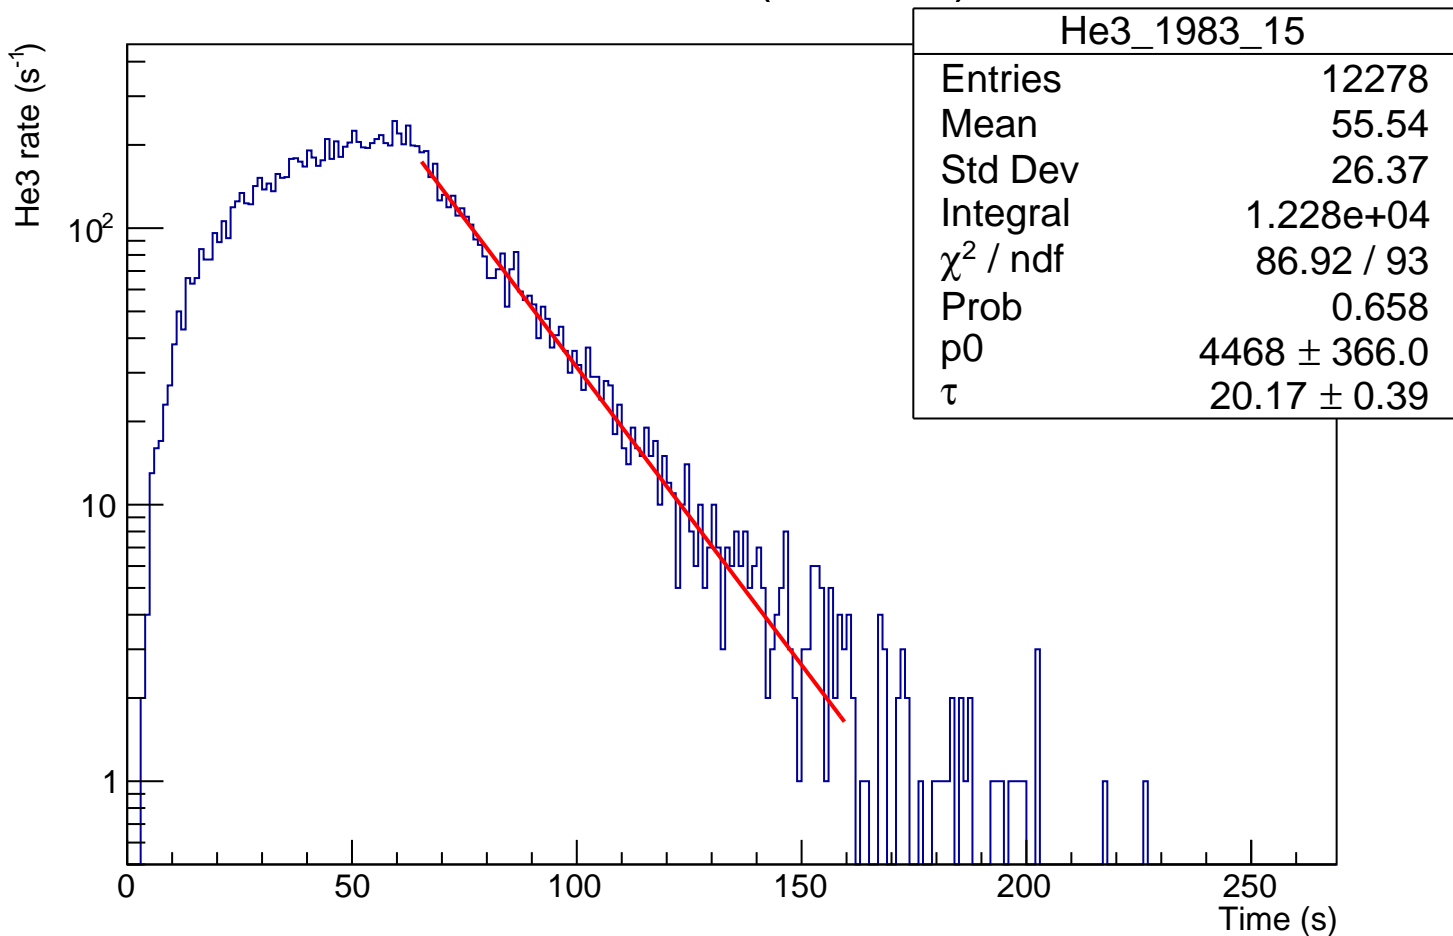

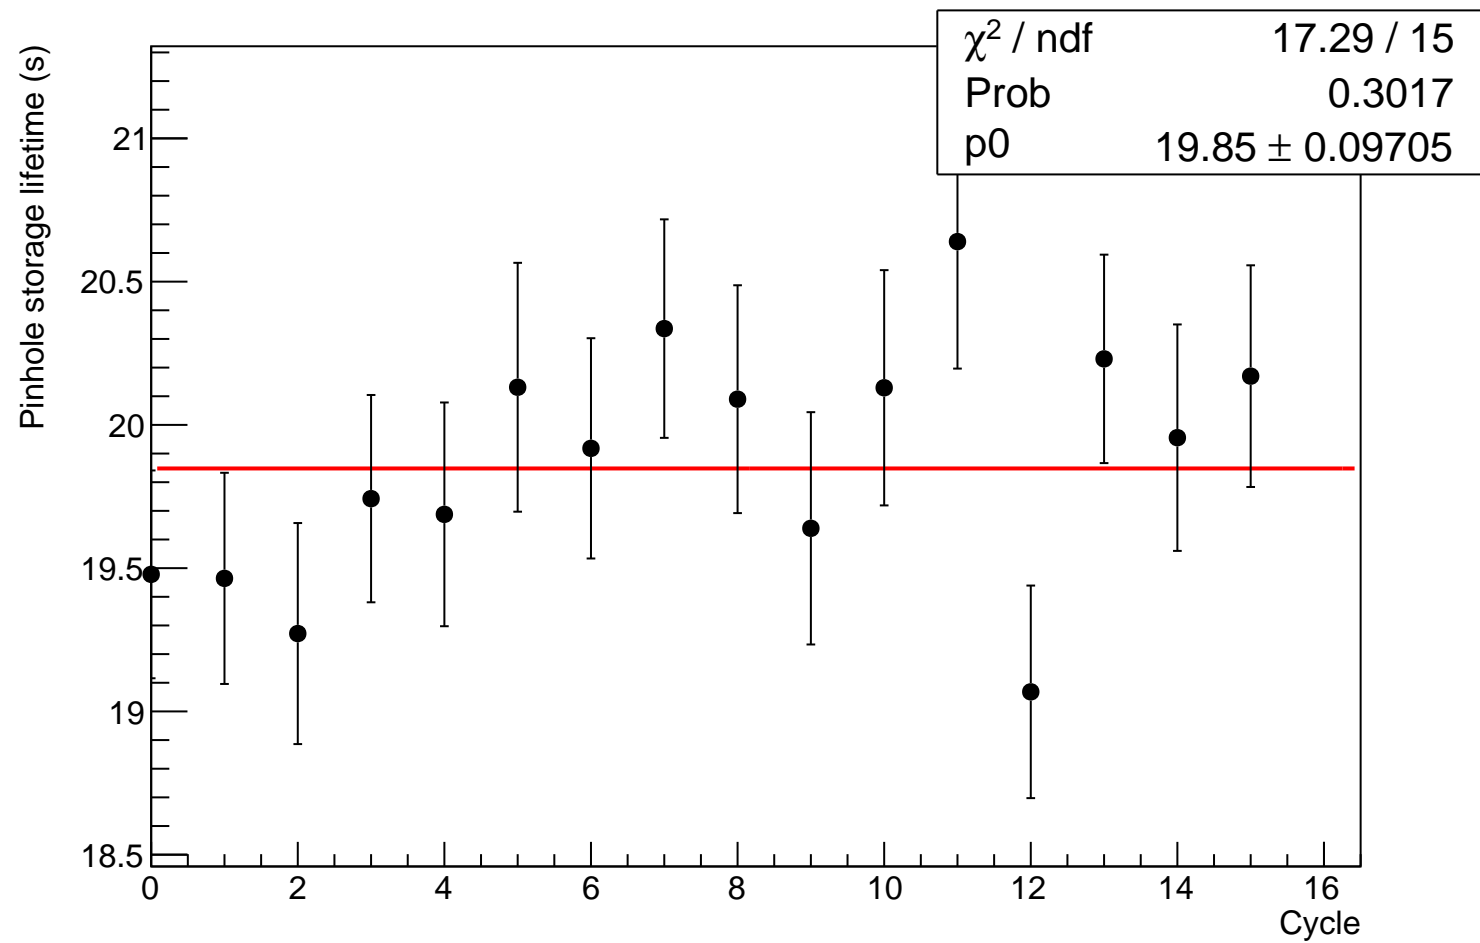

TCN19-270

Count

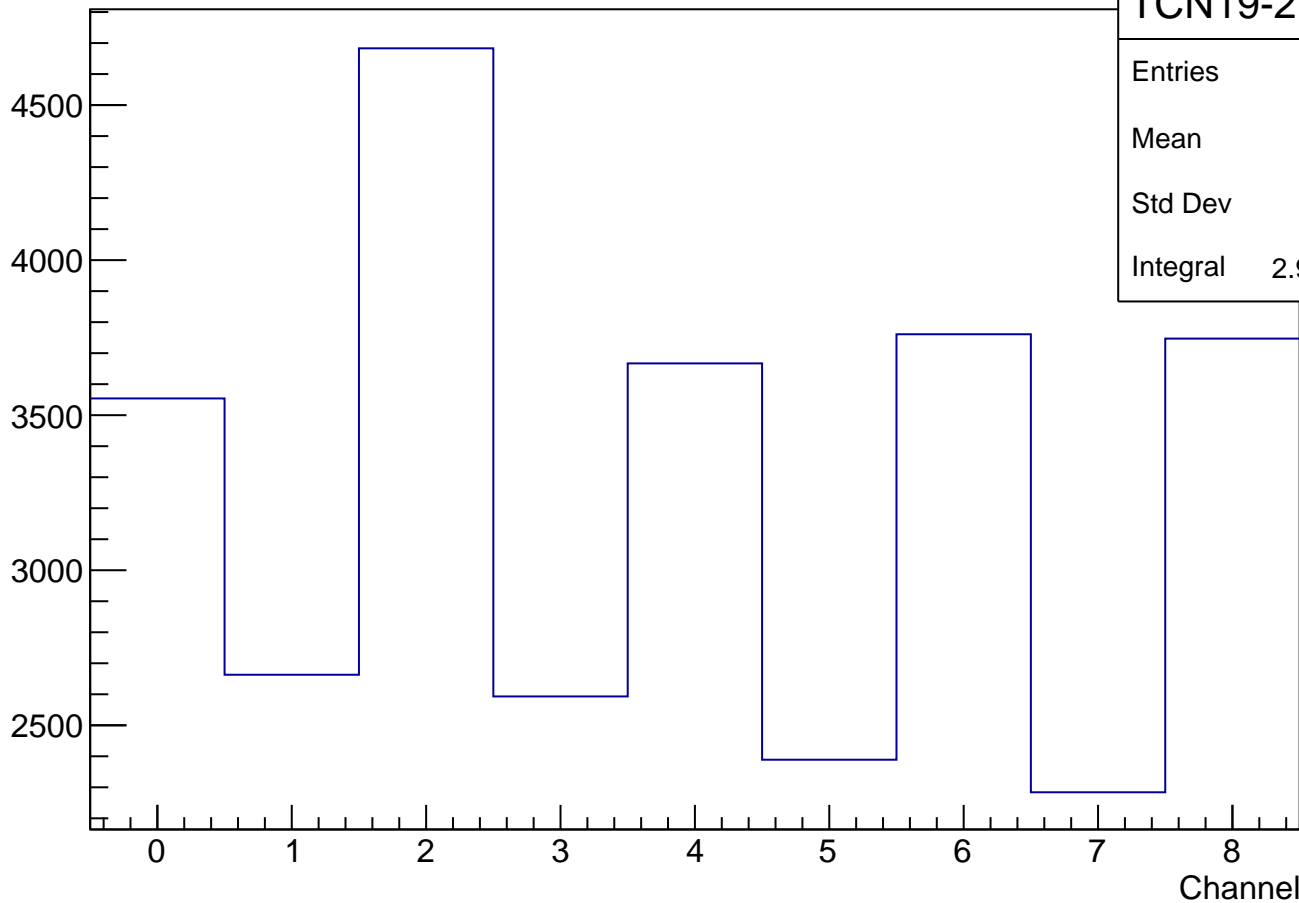

TCN19-270_ch

Entries 29341

Mean 3.918

Std Dev 2.61

Integral 2.934e+04