


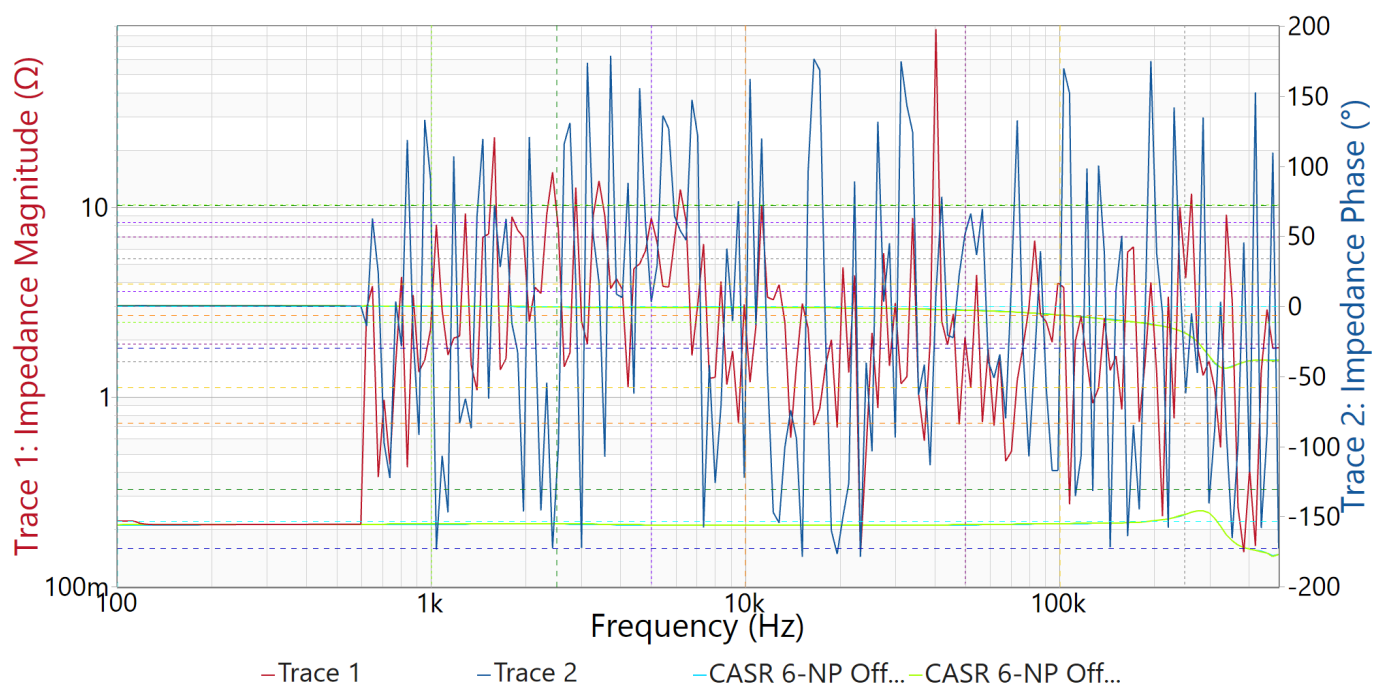

	Cursor 5	Cursor 7	Cursor 1
Frequency	100 Hz	1 kHz	2,5 kHz
Trace 1 Magnitude	221,423 mΩ	2,471 Ω	10,21 Ω
Trace 2 Phase (°)	221,038 m°	72,633 °	-130,511 °

	Cursor 6	Cursor 2	Cursor 3
Frequency	5 kHz	10 kHz	50 kHz
Trace 1 Magnitude	8,268 Ω	2,695 Ω	1,908 Ω
Trace 2 Phase (°)	10,848 °	-83,039 °	49,413 °

	Cursor 4	Cursor 8	Cursor 9
Frequency	100 kHz	250 kHz	500 kHz
Trace 1 Magnitude	3,932 Ω	5,358 Ω	1,813 Ω
Trace 2 Phase (°)	-57,744 °	-39,229 °	-172,863 °

Hardware configuration	
Receiver bandwidth	300 Hz
Source level	10 dBm
DUT settling time	0 s
Sweep time	0 s

Termination	Channel 1	Channel 2
Impedance	1 MΩ	1 MΩ

Receiver switch	Receiver 1	Receiver 2
Impedance/Reflection	External	External

Attenuator setting	Receiver 1	Receiver 2
Impedance/Reflection	20 dB	0 dB

Device configuration	
Device type	Bode500
Serial number	102509528
Last internal calibration	-

Sweep configuration	
Start frequency	100 Hz
Stop frequency	500 kHz
Center frequency	250,05 kHz
Span frequency	499,9 kHz
Sweep mode	Logarithmic
Number of points	201

Calibration/Correction	Full-Range	User-Range
Impedance	-	-

Measurement: Voltage / Current



Shaped level	
Level	Constant