


Measurement: Voltage / Current

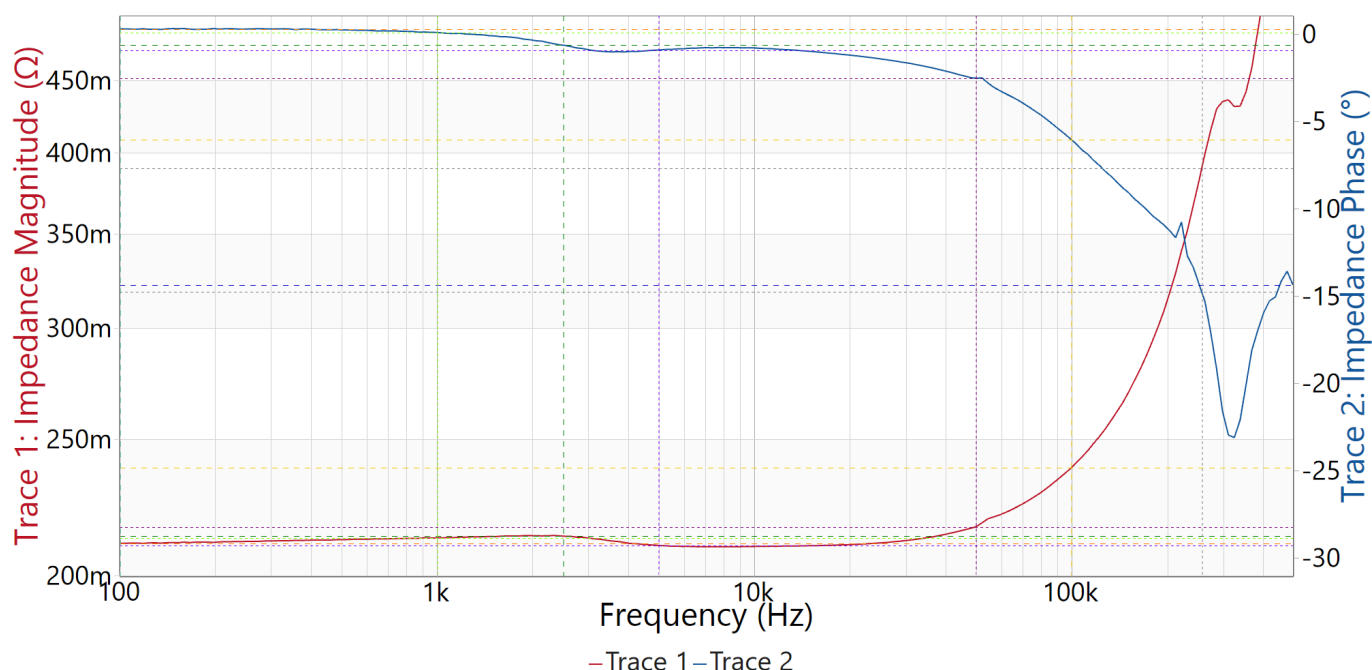

	Cursor 5	Cursor 7	Cursor 1
Frequency	100 Hz	1 kHz	2,5 kHz
Trace 1 Magnitude	210,822 mΩ	212,711 mΩ	213,342 mΩ
Trace 2 Phase (°)	272,49 m°	73,809 m°	-654,311 m°

	Cursor 6	Cursor 2	Cursor 3
Frequency	5 kHz	100 Hz	50 kHz
Trace 1 Magnitude	210,084 mΩ	210,822 mΩ	216,609 mΩ
Trace 2 Phase (°)	-931,905 m°	272,49 m°	-2,548 °

	Cursor 4	Cursor 8	Cursor 9
Frequency	100 kHz	257,843 kHz	500 kHz
Trace 1 Magnitude	238,621 mΩ	389,654 mΩ	717,925 mΩ
Trace 2 Phase (°)	-6,051 °	-14,778 °	-14,375 °

Hardware configuration	
Receiver bandwidth	300 Hz
Source level	0 dBm
DUT settling time	0 s
Sweep time	2,65 s

Device configuration	
Device type	Bode500
Serial number	102509528
Last internal calibration	-

Termination	Channel 1	Channel 2
Impedance	1 MΩ	1 MΩ

Sweep configuration	
Start frequency	100 Hz
Stop frequency	500 kHz
Center frequency	250,05 kHz
Span frequency	499,9 kHz
Sweep mode	Logarithmic
Number of points	201

Receiver switch	Receiver 1	Receiver 2
Impedance/Reflection	External	External

Attenuator setting	Receiver 1	Receiver 2
Impedance/Reflection	20 dB	0 dB

Calibration/Correction	Full-Range	User-Range
Impedance	-	-

Measurement: Voltage / Current



Shaped level	
Level	Constant