


132kV / 33kV SUBSTATION SINGLE-LINE DIAGRAM (SLD)

Drawing No: E-SLD-100MW-001-REV2 | Facility: HyperScale Infrastructure LLC

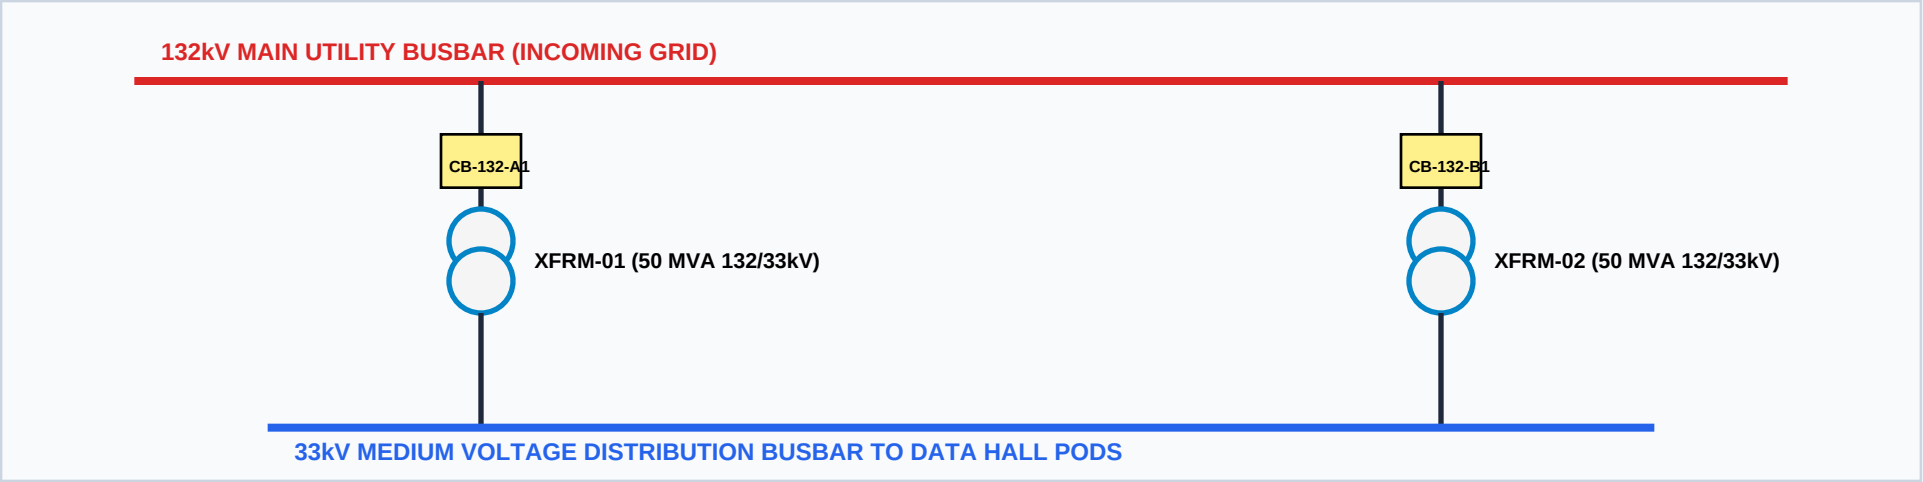

Substation Major Equipment Schedule & Protection Ratings

Equipment Tag	Description / Function	Rating / Capacity	Fault Current (kA)	Protection Relay
XFRM-01	Primary Step-Down Transformer	50 MVA, 132kV/33kV	40 kA (1 sec)	SEL-787 Differential
XFRM-02	Secondary Redundant Transformer	50 MVA, 132kV/33kV	40 kA (1 sec)	SEL-787 Differential
CB-132-A1	SF6 Gas Circuit Breaker	2000A Continuous	50 kA Interrupting	SEL-751 Overcurrent
CB-132-B1	SF6 Gas Circuit Breaker	2000A Continuous	50 kA Interrupting	SEL-751 Overcurrent
33kV-SWG-01	Air-Insulated Switchgear Bus	3150A Main Bus	25 kA Bus Rating	Arc Flash Optical Sensor