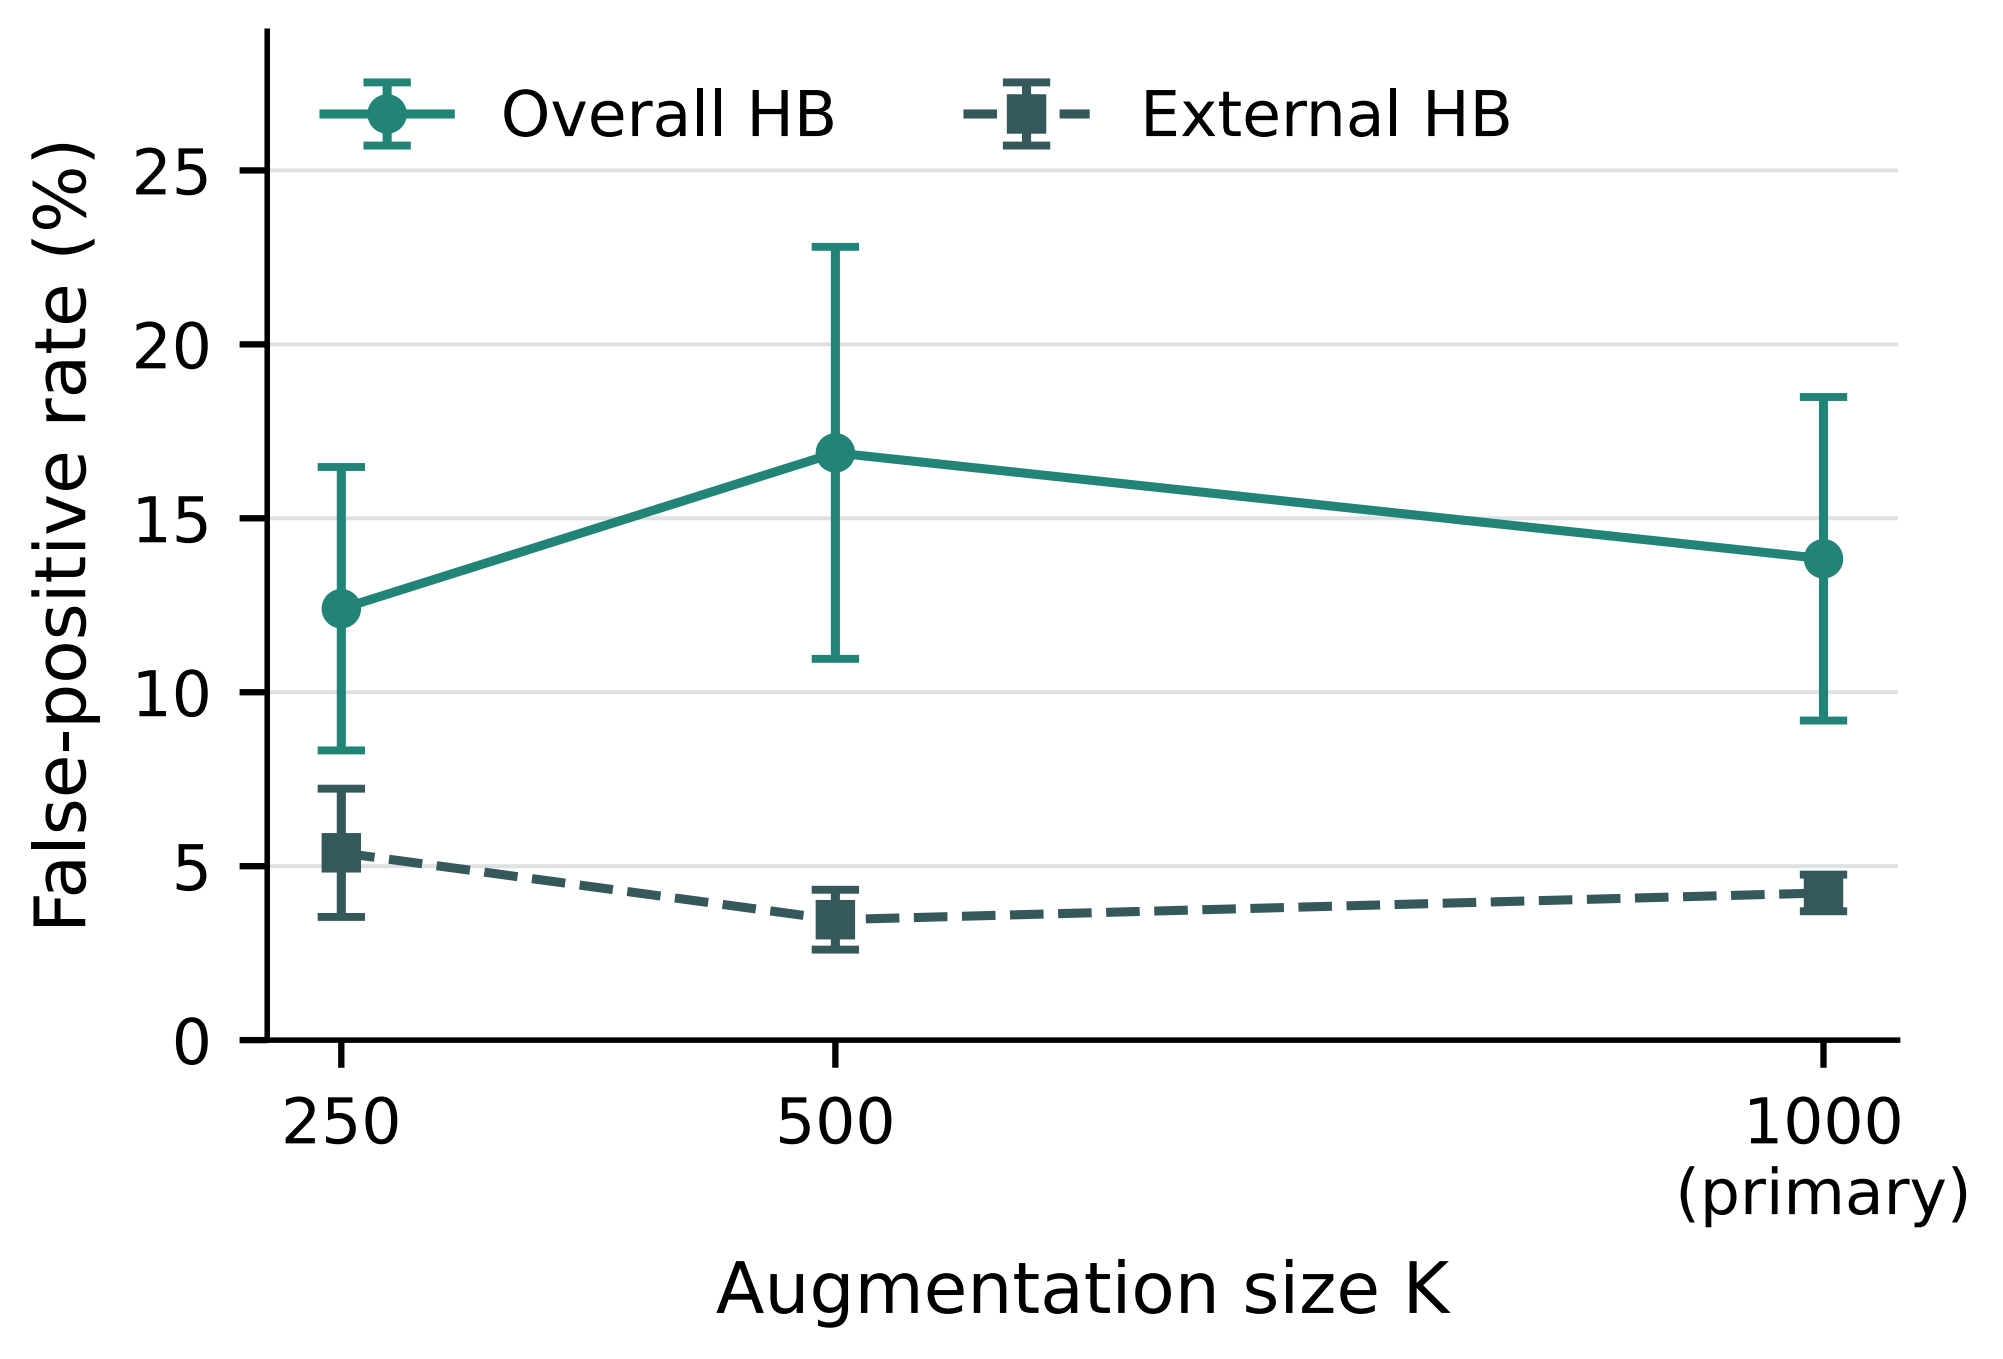
Overall HB
External HB
False-positive rate (%)
25
20
15
10
5
0
250
500
1000
(primary)
Augmentation size K