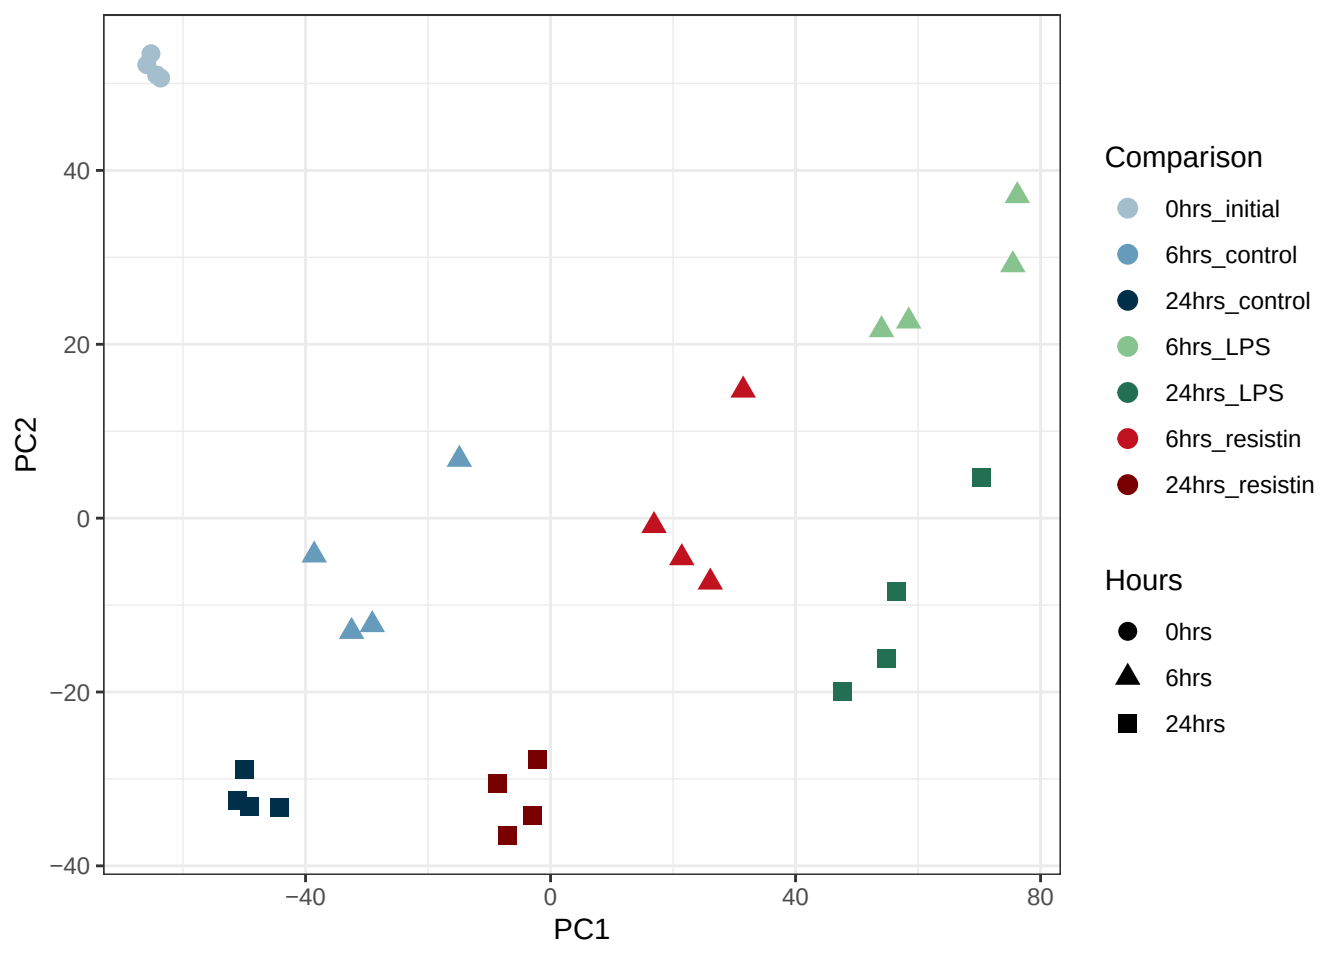
PC2
PC1
40
20
0
−20
−40
−40
0
40
80
Comparison
0hrs_initial
6hrs_control
24hrs_control
6hrs_LPS
24hrs_LPS
6hrs_resistin
24hrs_resistin
Hours
0hrs
6hrs
24hrs