

30 July 2019

12:00 AM

ID. 22766


Ref Number: Jhanvi\_PVD\_30Jul19

Jhanvi\_PVD\_30Jul19

A Jhanvi Vadi

### **REFRESH JOBS**

## Current History

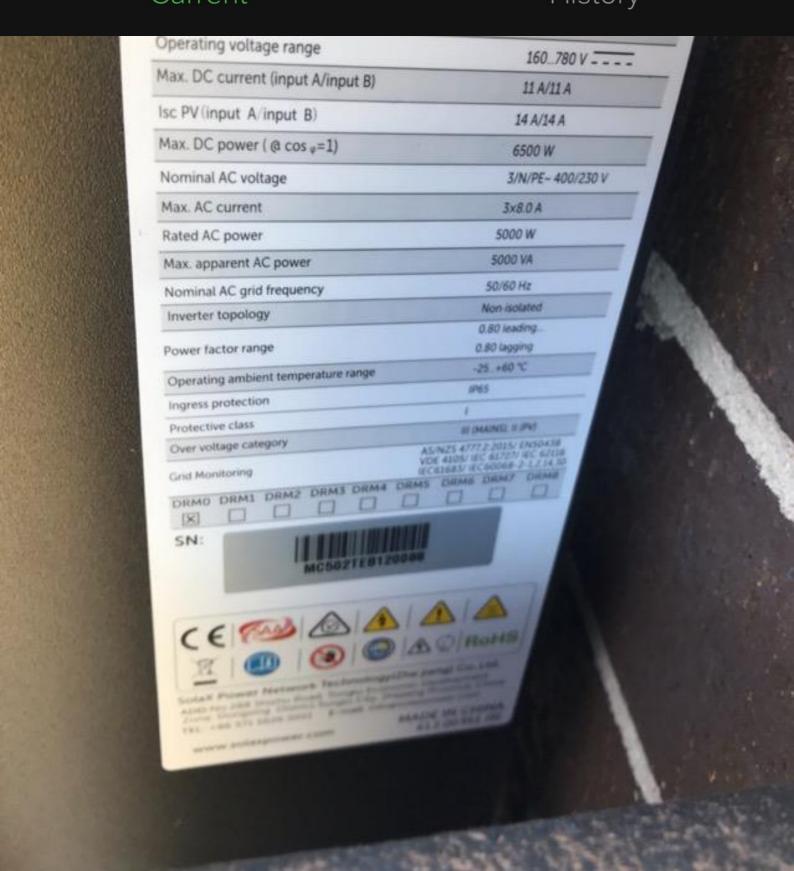










# GRID-CONNECTED PHOTOVOLTAIC INVERTER

### Model:X3-5.0-T-N

	7
SOLA	Ÿ.
PONE	192

nodel: X3-5.0-T-N	
ax. DC voltage	
ated input voltage	800 V
	600 V
perating voltage range	160_780 V ==
Max. DC current (input A/input B)	11 A/11 A
sc PV (input A/input B)	14 A/14 A
Max. DC power (@ cos <sub>e</sub> =1)	6500 W
Nominal AC voltage	3/N/PE~ 400/230 V
Max. AC current	3×8.0 A
Rated AC power	5000 W
Max. apparent AC power	5000 VA
Nominal AC grid frequency	50/60 Hz
Inverter topology	Non-isolated
Power factor range	0.80 leading 0.80 lagging
Operating ambient temperature range	-25. +60 ℃
Ingress protection	JP65
Protective class	HOMING HIPS
Over voltage category	AS:N2S 47772 2015: ENSOATA VOC 4105: IEC 61727/ IEC 6218 IEC 61685: IEC 60066-3-1.214-35 RMS DRMS DRMT DRMR
MC602TE 01200  MC602T	



#### **SCHEDULE**



Search by ref, name, address, phone...



OPEN

Visit ID: 190510001

24 April 2024

Ref Number: rushi-pvd-24april2019 rushi-pvd-24april2019

12:00 AM

Rushi Parikh

ID: 61821

5 Pinkcity Access

S-ID: 59088

**MOUNT VICTORIA NSW 2786** 

JobType Listed: Solar PVD, SWH edit

**OPEN** 



Visit ID: 190807001

05 August 2019

Ref Number: Jhanvi\_PVD\_05Aug19

12:00 AM

Jhanvi\_PVD\_05Aug19

ID: 85283

A HP Solar & Electrical | Jhanvi Vadi

S-ID: 81715

CROWS NEST QLD 4355

**OPEN** 



Visit ID: 190801001

01 August 2019 Ref Number: Jhanvi\_PVD\_01Aug19

12:00 AM

Jhanvi\_PVD\_01Aug19

ID: 83360

NORTH COAST POWER & WATER |

Jhanvi Vadi

S-ID: 79026

(°) RSD 555

HAWKS NEST STATION SA 5330

OPEN



Visit ID: 190807001