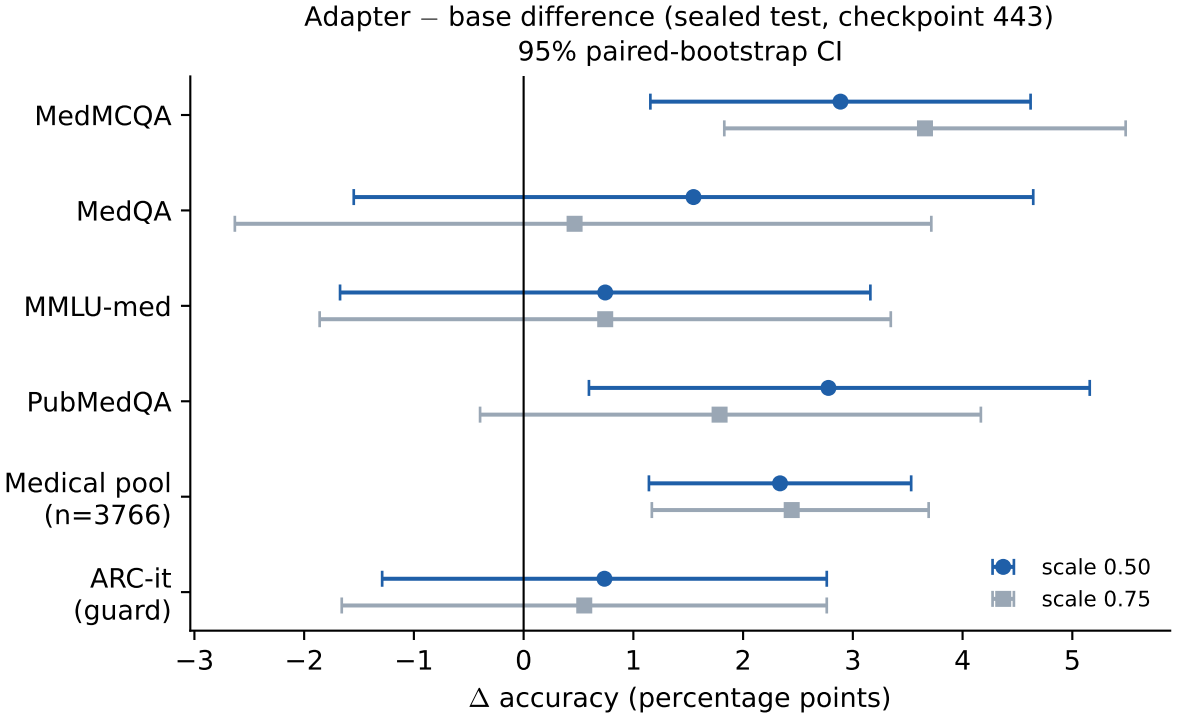
Adapter − base difference (sealed test, checkpoint 443)
95% paired-bootstrap CI
MedMCQA
MedQA
MMLU-med
PubMedQA
Medical pool
(n=3766)
ARC-it
(guard)
scale 0.50
scale 0.75
−3
−2
−1
0
1
2
3
4
5
Δ accuracy (percentage points)