

Automated Emergency Light Testing


Affordable Fire Compliance, Simplified.

HEXMODAL

Hexmodal.com | 401 556 0800 | 32 Mallard Cove Way, Barrington, RI

What are Emergency lights?

Battery-powered lights that turn on during power outages

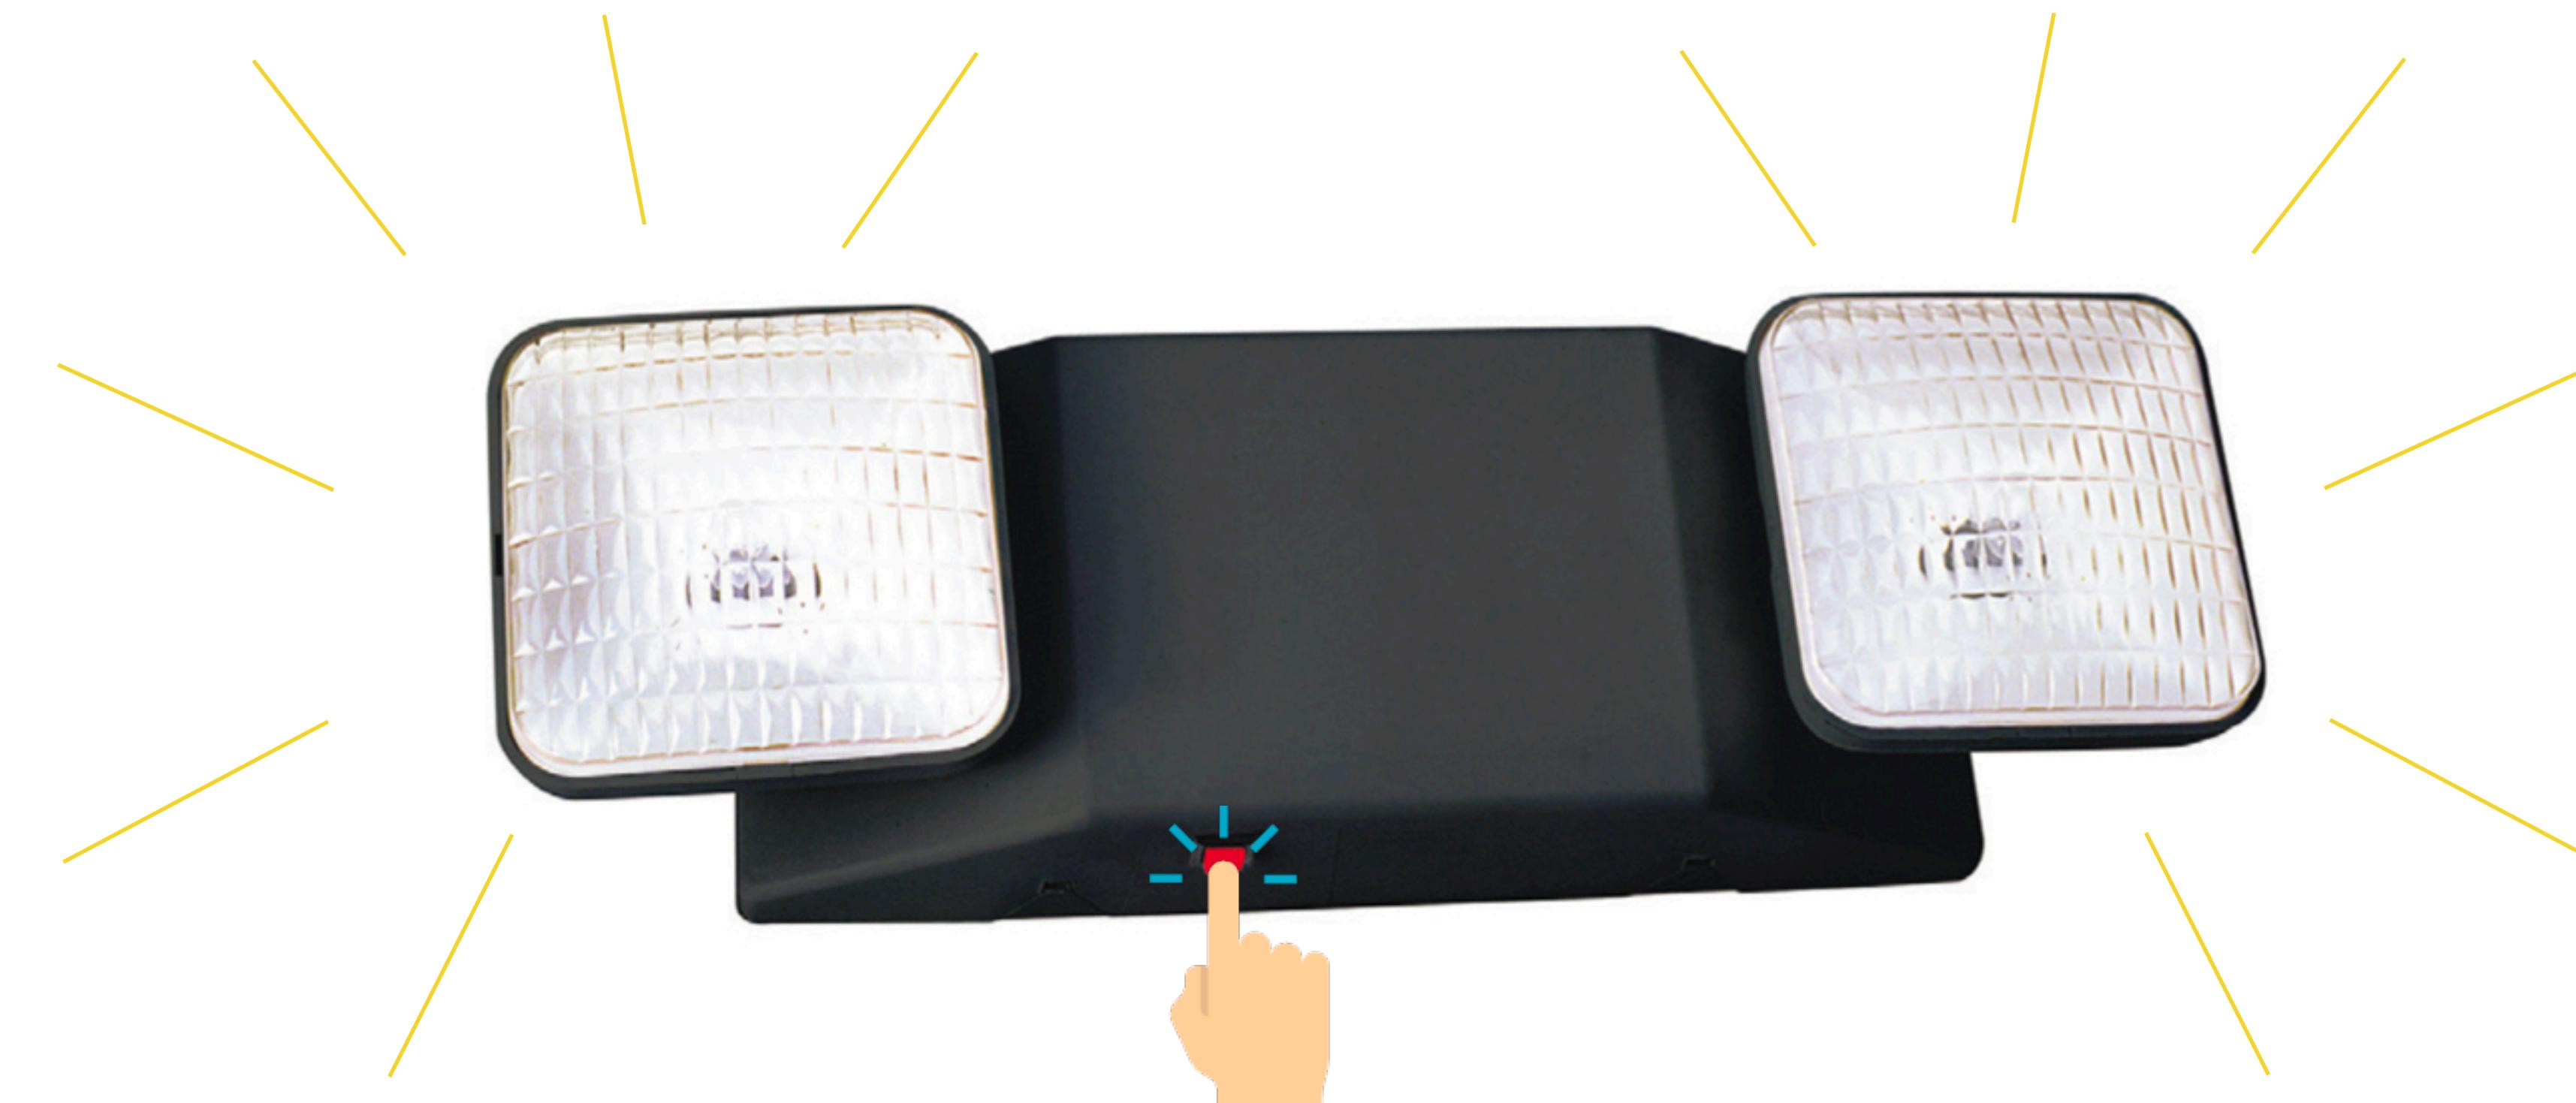

Fire Code Test Requirements: Yearly: 90min, Monthly: 30sec

Problems with Manual Testing:



Unreliable
Non-compliant
Testing



Costly
Expensive Labor
Costs



Distracting
Disrupts Working
Hours

What We Offer: "Automatic Testing & Wireless Reporting."

Hexmodal Emergency Light



- 1 Replace Existing Lights
- 2 Automatic Testing & Wireless Reporting
- 3 Digital Records & Alerts

Hexmodal Retrofit Device




- 1 Retrofit Existing Lights
- 2 Automatic Testing & Wireless Reporting
- 3 Digital Records & Alerts


Advantages of Automatic Testing & Reporting:



Compliance
Automatically
Meet Fire Code

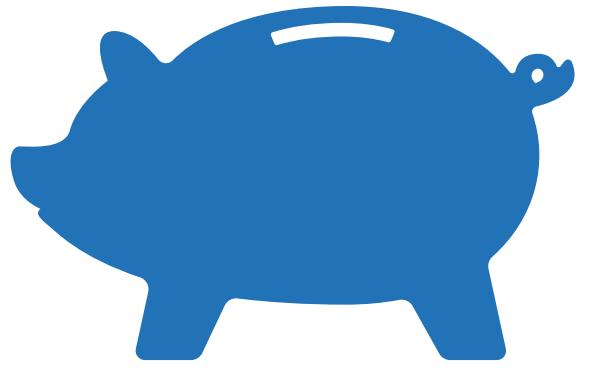


Cost Reduction
Lower Your
Testing Costs

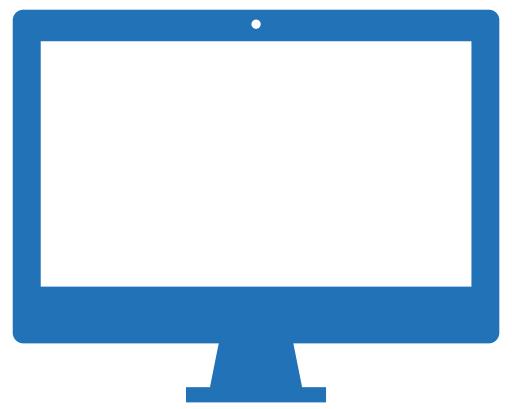

Ease of Use
Manage Lights
Completely Online

How It Works

Get new Hexmodal emergency lights OR upgrade your own

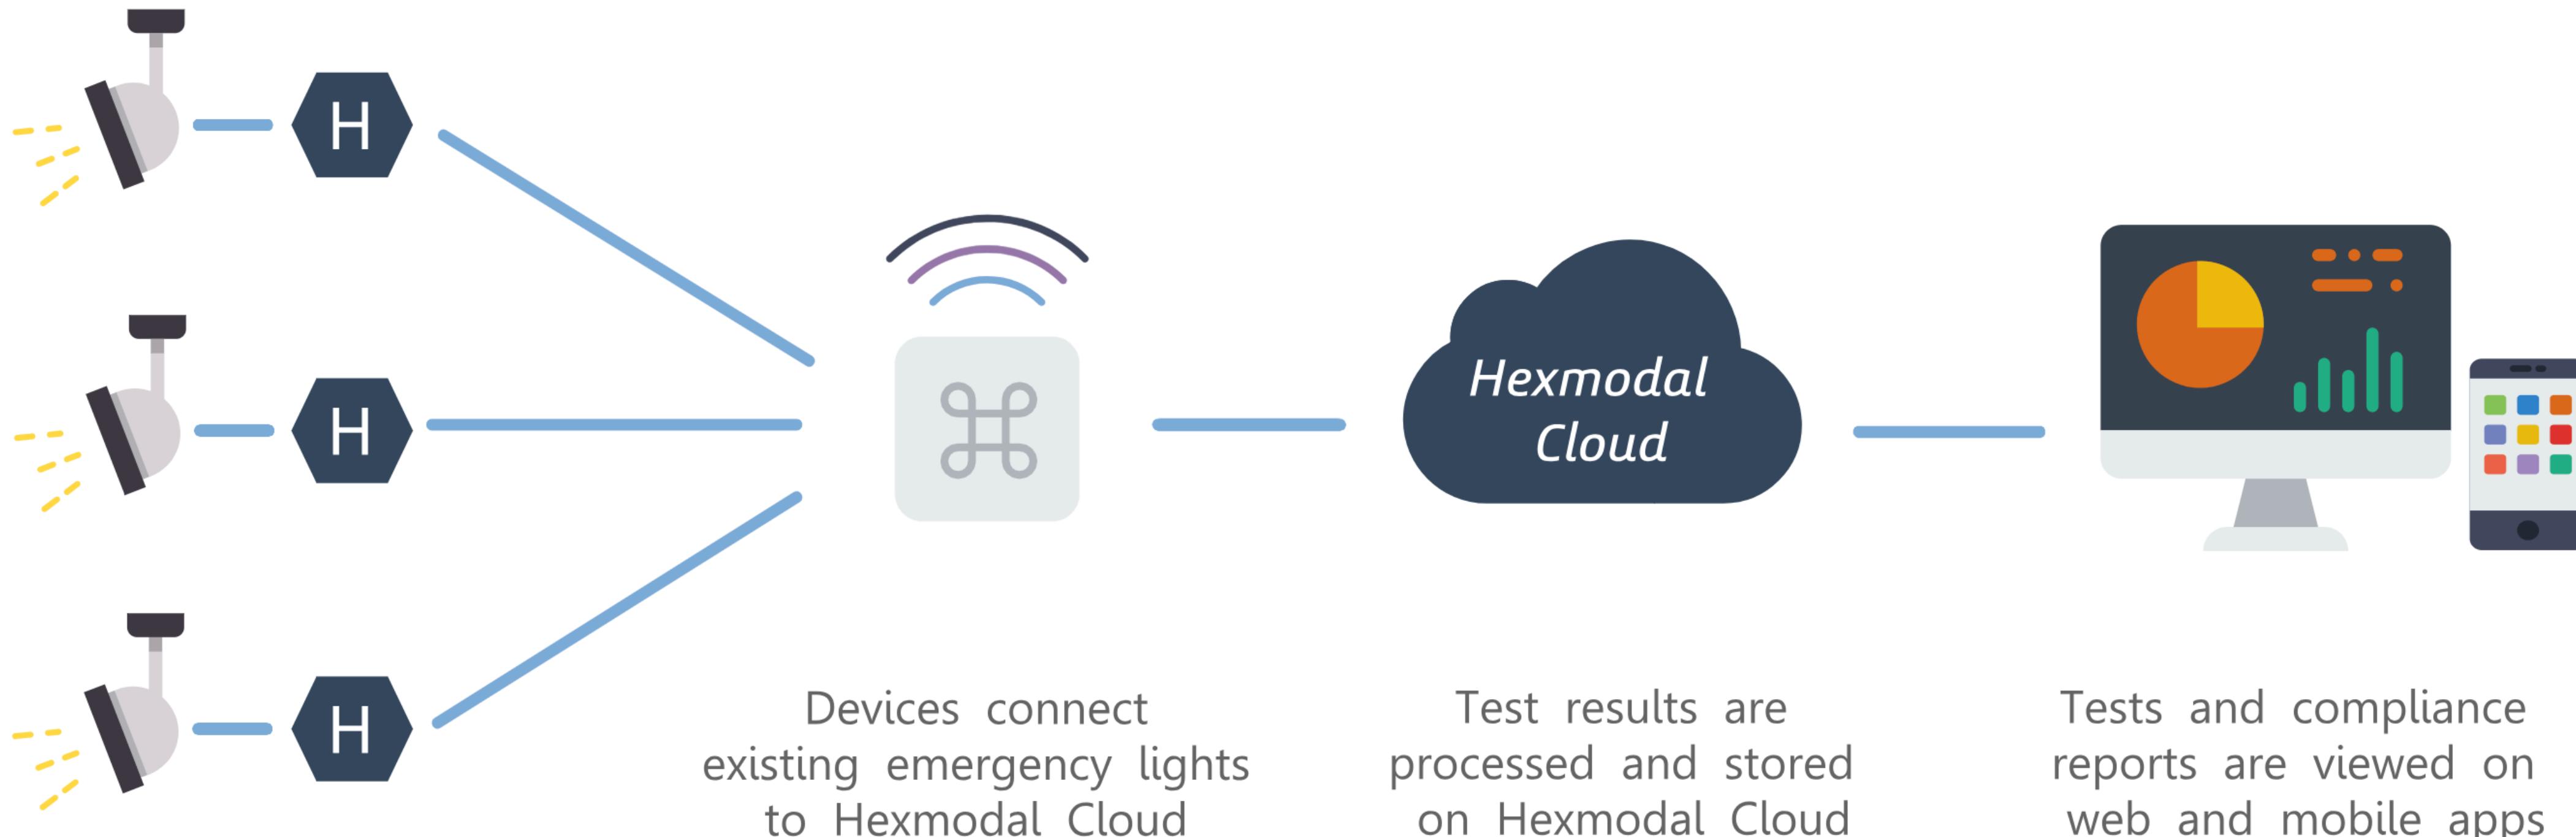


No IT Needed: Simple, Independent, Secure



We don't use your
internet



Encrypted
Communication

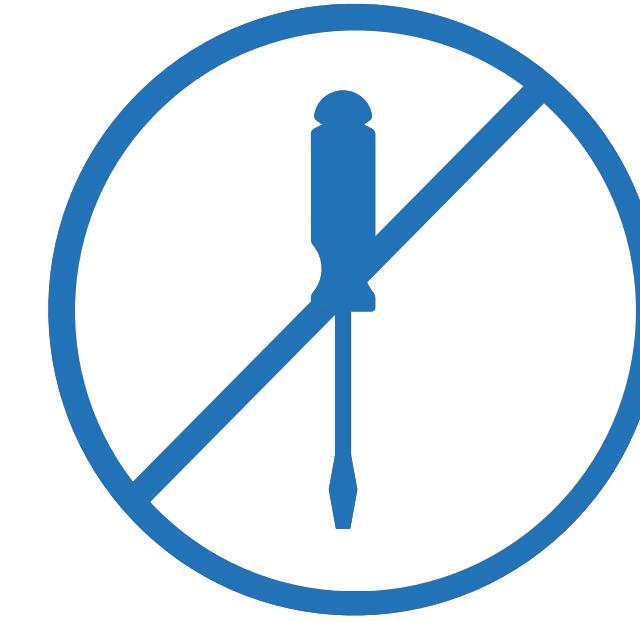

No set up
or management

Testing Control Panel Utkarsh

file:///Users/ushah/Desktop/startbootstrap-sb-admin-2-gh-pages/pages/index.html

Dashboard

7922 Total Lights

[View Details](#)

7132 Successful Tests

[View Details](#)

868 Failing Tests

[View Details](#)

124 Upcoming Maintenance

[View Details](#)

Map

[Actions](#)

Emergency Light Locations

Map data ©2018 Google Terms 200 ft

Notifications Panel

Light Test Failed	4 minutes ago
Needs Battery Replacement	12 minutes ago
Light Test Failed	27 minutes ago
Light Test Failed	43 minutes ago
Needs Bulb Replacement	11:32 AM
Light Test Failed	11:13 AM
Needs Battery Replacement	10:57 AM

[View All Alerts](#)

HEXMODAL Hexmodal.com

Hexmodal Automated Testing

Emergency Light Failure Alert

The following issues were discovered while testing in July 2018:

Device ID #	Test Date	Test Type	Test Result	Issue Details	Learn More
1183	1/30/2018	Short	Fail	Lamp #2 did not illuminate during test	More Info
1211	1/29/2018	Long	Fail	Lamps did not maintain illumination for duration of test	More Info
2379	1/30/2018	Short	Fail	Lamps did not illuminate during test	More Info
TOTAL FAILURES				3	

Full Test Results Available Online

[See All Results](#)

Test Results

Most Recent Test Results

[Export](#) [Test All](#)

Device ID	Test Status	Last Test Date	Location	Installation Date	Model Number	Manufacturer	Cut Sheet	Battery Replacement Date	Test
1727	Pass	1/9/2018	Barn A, 382 W St.Rd(New Bolton Center)	2/20/2008	K5U-9H2-KCB-YR6	The Exit Light Company	Link Here	2/17/2018	<button>Run Test</button>
1183	Fail	1/30/2018	Annenberg Communication Center, 3620 Walnut St.	8/20/2007	KEM-TCH-HFW-2FD	Lithonia Lighting	Link Here	8/17/2017	<button>Run Test</button>
1282	Pass	1/12/2018	Anatomy-Chemistry Building, 3620 Hamilton Walk	11/18/2008	YU2-OTX-YZ7-PA6	The Exit Light Company	Link Here	11/16/2018	<button>Run Test</button>
1224	Pass	1/8/2018	Alpha Chi Rho, 219 S 36th St.	12/10/2008	6RM-70I-TC7-OLZ	Lithonia Lighting	Link Here	12/8/2018	<button>Run Test</button>
1345	Pass	1/1/2018	Administration Bl, 382 W St.Rd(New Bolton Center)	6/12/2005	2WR-REC-KR7-RQB	Lithonia Lighting	Link Here	6/10/2015	<button>Run Test</button>
1684	Fail	1/6/2018	Charles Addams Fine Arts Hall, 200 South 36th St	7/1/2010	HDB-G1X-PIF-L05	The Exit Light Company	Link Here	6/28/2020	<button>Run Test</button>
1968	Pass	1/7/2018	Alexander House, 382 W St.Rd(New Bolton Center)	11/14/2005	E7E-AF5-61C-5DF	The Exit Light Company	Link Here	11/12/2015	<button>Run Test</button>

Why We're Best:

more reliable, convenient & cost effective testing

	HEXMODAL	3rd Party	In-House
Testing Cost/Light(Monthly)	\$	\$\$\$	\$\$\$
Guaranteed Compliance	✓	✓	✗
Management-Free Testing	✓	✗	✗
Digital Records & Alerts	✓	✗	✗
Predictive Maintenance	✓	✗	✗