



FATE MONTHLY REPORT

Doc.No : FATE-001
Version : 1.0
Date : 10-08-2023



FORECAST SYSTEM FOR ATMOSPHERE AND TURBULENCE at the VERY LARGE TELESCOPE

Performance assessment
August 2023



PO102958/ESO/20/95952/FLAB

Contents

1	Title for Night 1	2
1.1	Title for Figures of Night 1	3
1.2	Title for Statistics of Night 1	7
1.3	Title for Contingency tables of Night 1	9
1.4	Title for PODs tables of Night 1	15
2	Title for Day 1	18
2.1	Title for Figures of Day 1	19
2.2	Title for Statistics of Day 1	23
2.3	Title for Contingency tables of Day 1	24
2.4	Title for PODs tables of Day 1	26
3	Title for Night 2	28
3.1	Title for Figures of Night 2	29
3.2	Title for Statistics of Night 2	33
3.3	Title for Contingency tables of Night 2	34
3.4	Title for PODs tables of Night 2	38
4	Title for Day 2	41
4.1	Title for Figures of Day 2	42
4.2	Title for Statistics of Day 2	46
4.3	Title for Contingency tables of Day 2	47
4.4	Title for PODs tables of Day 2	49
5	Title for Night 3	51
5.1	Title for Figures of Night 3	52
5.2	Title for Statistics of Night 3	56
5.3	Title for Contingency tables of Night 3	57
5.4	Title for PODs tables of Night 3	61

6	Title for Day 3	64
6.1	Title for Figures of Day 3	65
6.2	Title for Statistics of Day 3	69
6.3	Title for Contingency tables of Day 3	70
6.4	Title for PODs tables of Day 3	72

1 Title for Night 1

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

1.1 Title for Figures of Night 1

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

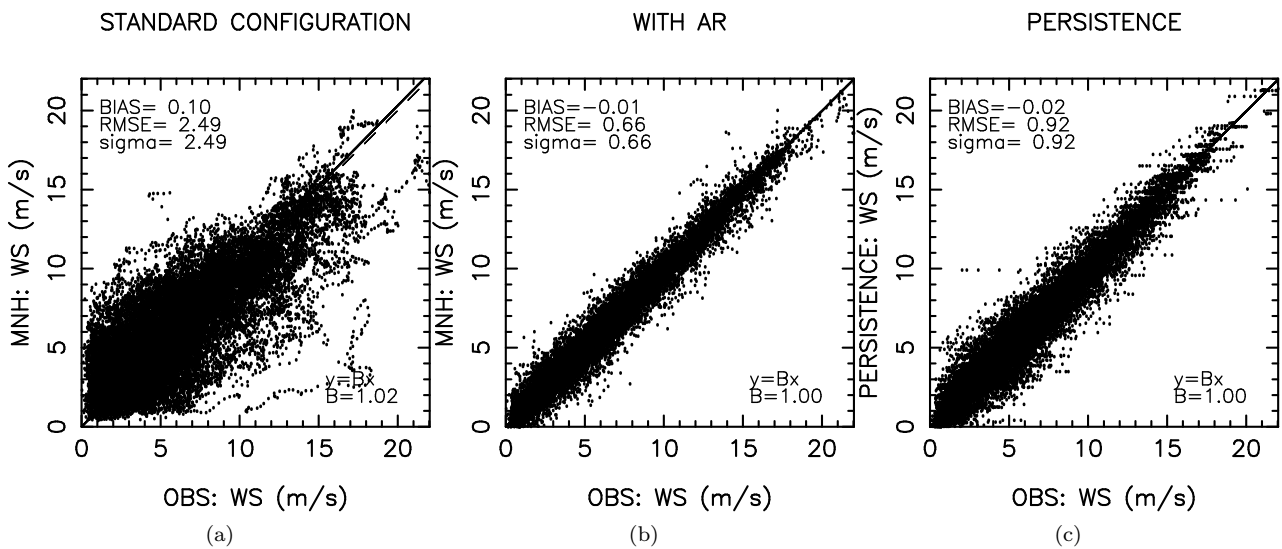


Figure 1: wind speed (ms^{-1}): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

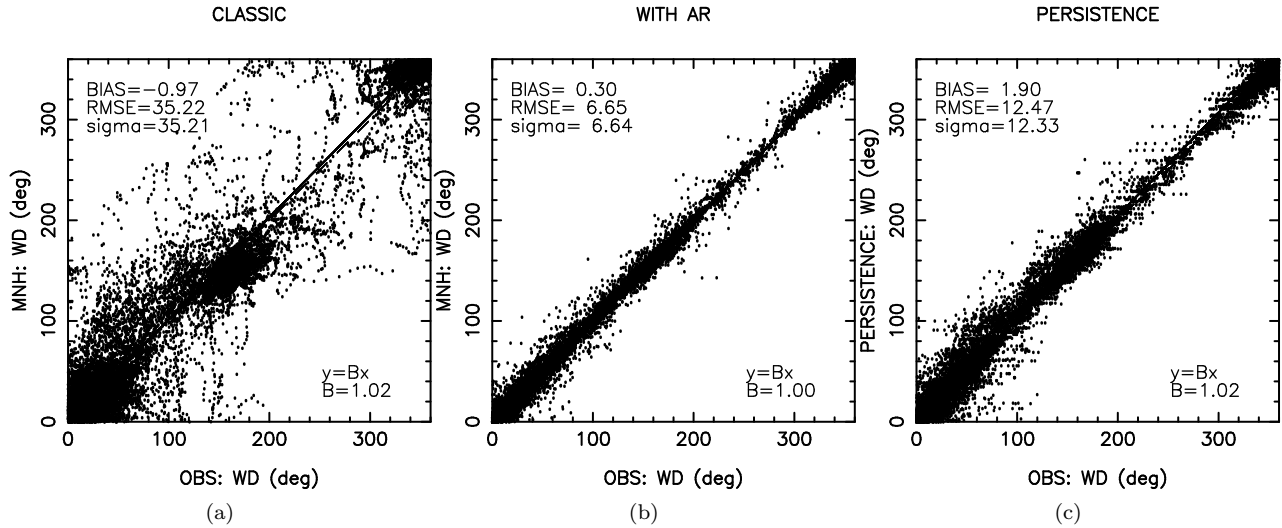
FATE - Monthly Report

Figure 2: wind direction (degree): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

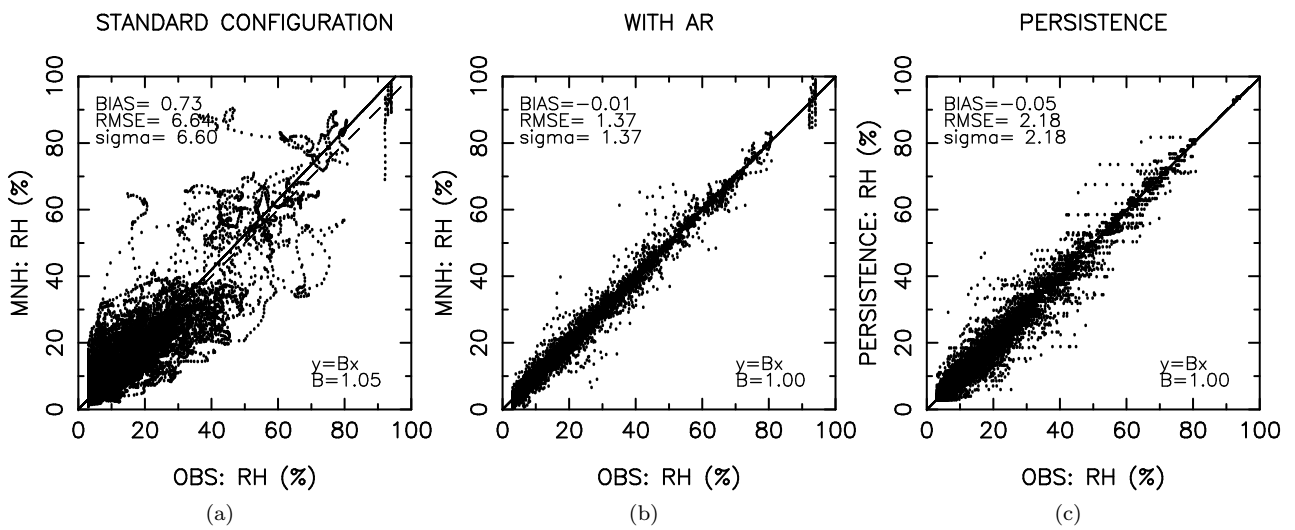


Figure 3: relative humidity (percent): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

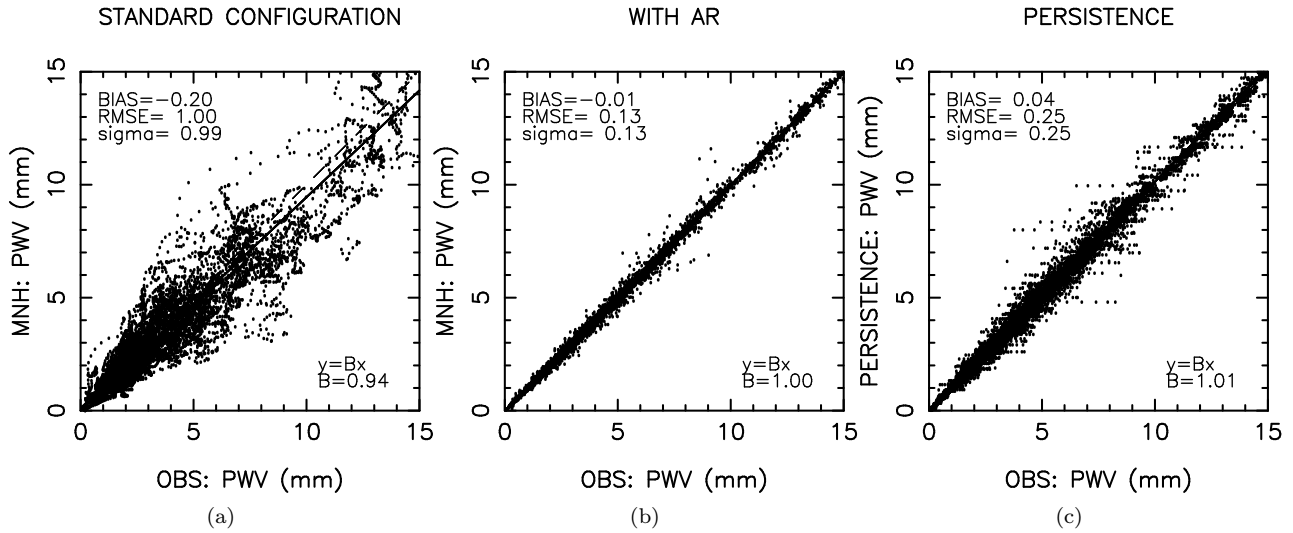


Figure 4: precipitable water vapor (mm): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

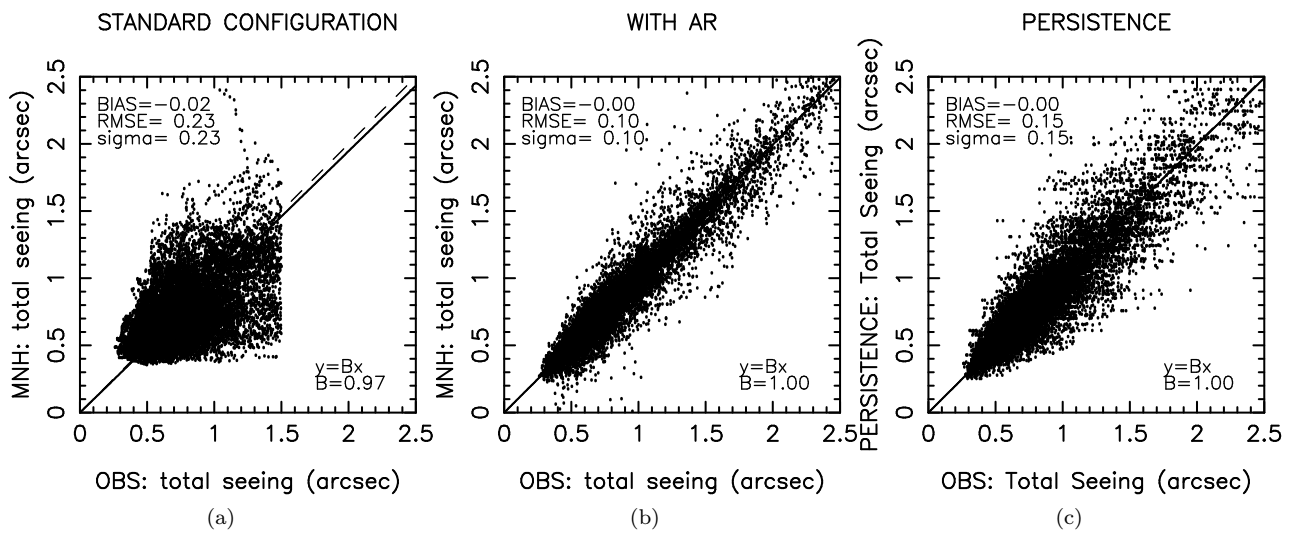


Figure 5: total seeing (arcsec): (a) STANDARD CONFIGURATION ($< 1.5''$), (b) WITH AR (1H), (c) PERSISTENCE (1H).

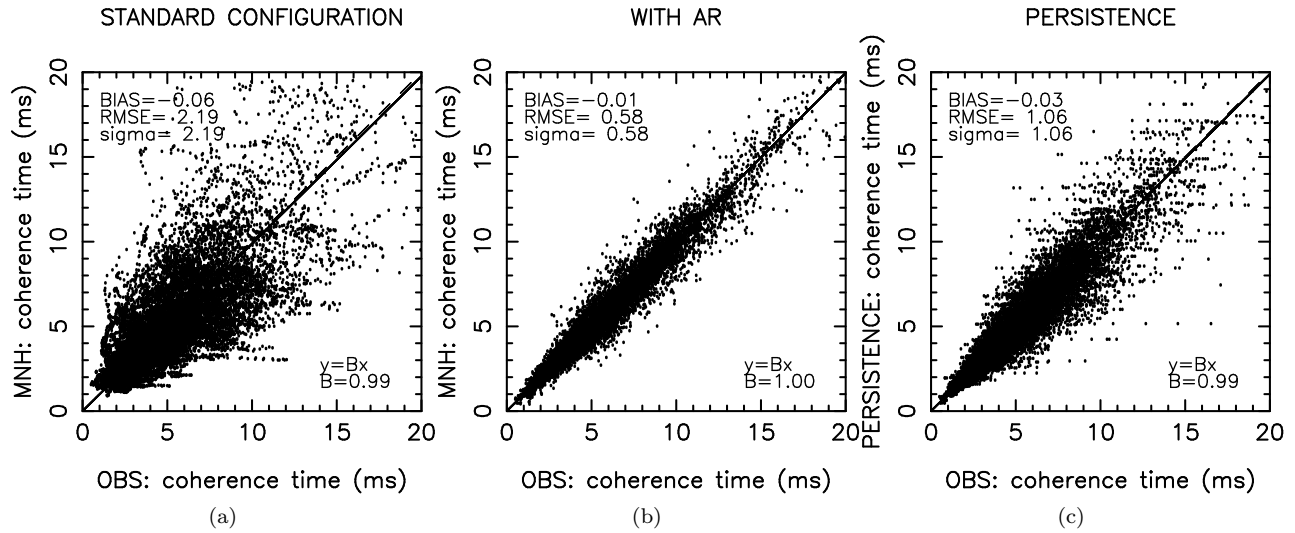


Figure 6: coherence time (ms): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

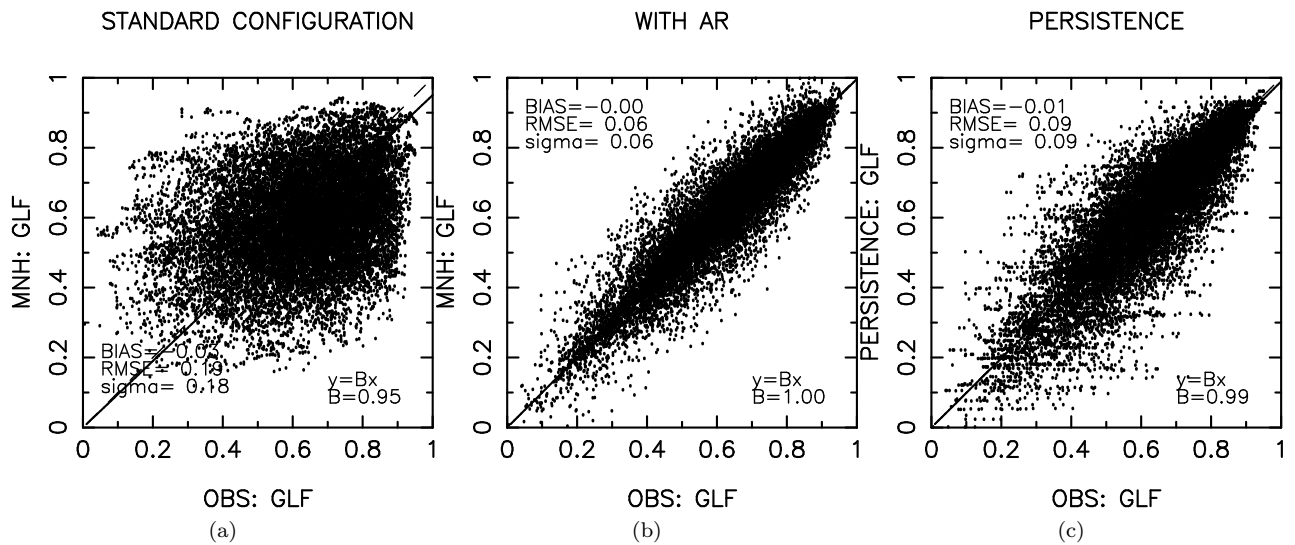


Figure 7: ground layer fraction (dimensionless): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H)

1.2 Title for Statistics of Night 1

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

VARIABLE	BIAS (inc. month)	RMSE (inc. month)	SD (inc. month)	BIAS (last month)	RMSE (last month)	SD (last month)
WS (m·s ⁻¹)	0.10	2.49	2.49	-0.61	2.60	2.53
WD (degree)	-0.97	35.22	35.21	1.64	33.85	33.81
RH (percent)	0.73	6.64	6.60	0.76	6.84	6.79
PWV (mm)	-0.20	1.00	0.99	-0.35	1.00	0.94
SEE (arcsec)	-0.02	0.23	0.23	-0.02	0.22	0.21
TAU (ms)	-0.06	2.19	2.19	-0.63	2.32	2.24
GLF (dimensionless)	-0.03	0.19	0.18	-0.01	0.16	0.16

Table 1: Statistics for variables in standard configuration: incremental month (i.e., since the beginning of service) *vs* last month (July-2023)

FATE - Monthly Report

VARIABLE	BIAS AR (1H)	RMSE AR (1H)	SD AR (1H)		RMSE persistence (1H)	SD persistence (1H)
WS ($m \cdot s^{-1}$)	-0.04	0.72	0.72		0.82	0.82
WD (degree)	0.52	5.82	5.80		10.50	10.46
RH (percent)	-0.11	1.07	1.07		0.91	0.91
PWV (mm)	0.02	0.23	0.23		0.31	0.31
SEE (arcsec)	0.00	0.12	0.12		0.17	0.17
TAU (ms)	-0.02	0.54	0.54		0.83	0.82
GLF (dimensionless)	-0.00	0.06	0.06		0.09	0.09

Table 2: Last month (July-2023): statistics for variables with AR (1H) *vs* persistence (1H)

VARIABLE	BIAS AR (1H)	RMSE AR (1H)	SD AR (1H)		RMSE persistence (1H)	SD persistence (1H)
WS ($m \cdot s^{-1}$)	-0.01	0.66	0.66		0.92	0.92
WD (degree)	0.30	6.65	6.64		12.47	12.33
RH (percent)	-0.01	1.37	1.37		2.18	2.18
PWV (mm)	-0.01	0.13	0.13		0.25	0.25
SEE (arcsec)	-0.00	0.10	0.10		0.15	0.15
TAU (ms)	-0.01	0.58	0.58		1.06	1.06
GLF (dimensionless)	-0.00	0.06	0.06		0.09	0.09

Table 3: Incremental month (i.e., since the beginning of service): statistics for variables with AR (1H) *vs* persistence (1H)

1.3 Title for Contingency tables of Night 1

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

wind speed ms^{-1}	Observations		
	ws < 4.2	4.2 < ws < 7.5	ws > 7.5
Model data	ws < 4.2	4541	2127
	4.2 < ws < 7.5	3034	3970
	ws > 7.5	430	1908
Sample size: 38880; PC=62.1%; EBD=2.8%; POD1=56.7%; POD2=49.6%; POD3=80.1%			

Table 4: Contingency table for wind speed (ms^{-1}) in standard configuration

wind speed ms^{-1}	Observations		
	ws < 4.2	4.2 < ws < 7.5	ws > 7.5
Model data	ws < 4.2	7377	623
	4.2 < ws < 7.5	628	6950
	ws > 7.5	0	432
Sample size: 38880; PC=91.4%; EBD=0.0%; POD1=92.2%; POD2=86.8%; POD3=95.2%			

Table 5: Contingency table for variable wind speed (ms^{-1}) processed with AR (1H)

FATE - Monthly Report

wind direction degree	Observations			
	North	East	South	West
Model data	North	9401	1028	107
	East	1002	1832	560
	South	99	508	3567
	West	202	89	63
Sample size: 38880; PC=78.6%; EBD=1.5%; POD1=87.8%; POD2=53.0%; POD3=83.0%; POD4=31.9%				

Table 6: Contingency table for wind direction (degree) in standard configuration

wind direction degree	Observations			
	North	East	South	West
Model data	North	10453	222	0
	East	217	3151	40
	South	0	84	4236
	West	34	0	21
Sample size: 38880; PC=96.4%; EBD=0.0%; POD1=97.7%; POD2=91.1%; POD3=98.6%; POD4=89.6%				

Table 7: Contingency table for wind direction (degree) in standard configuration

FATE - Monthly Report

relative humidity percent		Observations		
		rh < 7.1	7.1 < rh < 15.3	rh > 15.3
Model data	rh < 7.1	4755	1095	27
	7.1 < rh < 15.3	2696	5193	1357
	rh > 15.3	379	1539	6443
Sample size: 38232; PC=69.8%; EBD=1.7%; POD1=60.7%; POD2=66.3%; POD3=82.3%				

Table 8: Contingency table for variable relative humidity (percent) in standard configuration

relative humidity percent		Observations		
		rh < 7.1	7.1 < rh < 15.3	rh > 15.3
Model data	rh < 7.1	7408	328	1
	7.1 < rh < 15.3	422	7294	248
	rh > 15.3	0	205	7578
Sample size: 38232; PC=94.9%; EBD=0.0%; POD1=94.6%; POD2=93.2%; POD3=96.8%				

Table 9: Contingency table for variable relative humidity (percent) processed with AR (1H)

precipitable water vapor mm		Observations		
		pwv < 1.9	1.9 < pwv < 3.5	pwv > 3.5
Model data	pwv < 1.9	3402	854	2
	1.9 < pwv < 3.5	443	2596	576
	pwv > 3.5	5	400	3271
Sample size: 18900; PC=80.3%; EBD=0.1%; POD1=88.4%; POD2=67.4%; POD3=85.0%				

Table 10: Contingency table for variable precipitable water vapor (mm) in standard configuration

precipitable water vapor mm		Observations		
		pwv < 1.9	1.9 < pwv < 3.5	pwv > 3.5
Model data	pwv < 1.9	3785	69	0
	1.9 < pwv < 3.5	65	3733	39
	pwv > 3.5	0	48	3810
Sample size: 18900; PC=98.1%; EBD=0.0%; POD1=98.3%; POD2=97.0%; POD3=99.0%				

Table 11: Contingency table for variable precipitable water vapor (mm) processed with AR (1H)

FATE - Monthly Report

total seeing arcsec	Observations		
	see < 0.6	0.6 < see < 0.8	see > 0.8
see < 0.6	3678	2340	841
Model data 0.6 < see < 0.8	1828	2382	1886
see > 0.8	520	1303	3298
Sample size: 37584; PC=51.8%; EBD=7.5%; POD1=61.0%; POD2=39.5%; POD3=54.7%			

Table 12: Contingency table for variable total seeing (arcsec) in standard configuration and accuracy 0.0

total seeing arcsec	Observations		
	see < 0.6	0.6 < see < 0.8	see > 0.8
see < 0.6	5707	835	23
Model data 0.6 < see < 0.8	725	4942	546
see > 0.8	14	669	5877
Sample size: 37584; PC=85.5%; EBD=0.2%; POD1=88.5%; POD2=76.7%; POD3=91.2%			

Table 13: Contingency table for variable total seeing (arcsec) processed with AR (1H) and accuracy 0.0

total seeing arcsec	Observations		
	see < 0.6	0.6 < see < 0.8	see > 0.8
see < 0.6	5603	0	597
Model data 0.6 < see < 0.8	0	5649	597
see > 0.8	423	376	5428
Sample size: 37584; PC=92.3%; EBD=5.6%; POD1=93.0%; POD2=93.8%; POD3=82.0%			

Table 14: Contingency table for variable total seeing (arcsec) in standard configuration and accuracy 0.24

total seeing arcsec	Observations		
	see < 0.6	0.6 < see < 0.8	see > 0.8
see < 0.6	6433	11	23
Model data 0.6 < see < 0.8	0	6404	18
see > 0.8	13	31	6423
Sample size: 37584; PC=99.6%; EBD=0.2%; POD1=99.8%; POD2=99.3%; POD3=99.4%			

Table 15: Contingency table for variable total seeing (arcsec) processed with AR (1H) and accuracy 0.24

FATE - Monthly Report

coherence time		Observations		
ms		$\tau < 3.4$	$3.4 < \tau < 5.8$	$\tau > 5.8$
Model data	$\tau < 3.4$	4336	1463	107
	$3.4 < \tau < 5.8$	1221	3060	1597
	$\tau > 5.8$	196	1230	4049
Sample size: 37476; PC=66.3%; EBD=1.8%; POD1=75.4%; POD2=53.2%; POD3=70.4%				

Table 16: Contingency table for variable coherence time (ms) in standard configuration and accuracy 0.0

coherence time		Observations		
ms		$\tau < 3.4$	$3.4 < \tau < 5.8$	$\tau > 5.8$
Model data	$\tau < 3.4$	5386	339	2
	$3.4 < \tau < 5.8$	366	5011	400
	$\tau > 5.8$	1	403	5351
Sample size: 37476; PC=91.2%; EBD=0.0%; POD1=93.6%; POD2=87.1%; POD3=93.0%				

Table 17: Contingency table for variable coherence time (ms) processed with AR (1H) and accuracy 0.0

coherence time		Observations		
ms		$\tau < 3.4$	$3.4 < \tau < 5.8$	$\tau > 5.8$
Model data	$\tau < 3.4$	5229	149	639
	$3.4 < \tau < 5.8$	328	4937	635
	$\tau > 5.8$	196	667	5114
Sample size: 37476; PC=88.5%; EBD=4.8%; POD1=90.9%; POD2=85.8%; POD3=80.1%				

Table 18: Contingency table for variable coherence time (ms) in standard configuration and accuracy 1.22

coherence time		Observations		
ms		$\tau < 3.4$	$3.4 < \tau < 5.8$	$\tau > 5.8$
Model data	$\tau < 3.4$	5745	0	33
	$3.4 < \tau < 5.8$	7	5725	33
	$\tau > 5.8$	1	28	5720
Sample size: 37476; PC=99.6%; EBD=0.2%; POD1=99.9%; POD2=99.5%; POD3=98.9%				

Table 19: Contingency table for variable coherence time (ms) processed with AR (1H) and accuracy 1.22

FATE - Monthly Report

ground layer fraction dimensionless	Observations		
	glf < 0.6	0.6 < glf < 0.7	glf > 0.7
Model data	glf < 0.6	3194	2361
	0.6 < glf < 0.7	1856	2275
	glf > 0.7	707	1121
Sample size: 37476; PC=41.3%; EBD=13.6%; POD1=55.5%; POD2=39.5%; POD3=28.9%			

Table 20: Contingency table for variable ground layer fraction (dimensionless) in standard configuration and accuracy 0.0

ground layer fraction dimensionless	Observations		
	glf < 0.6	0.6 < glf < 0.7	glf > 0.7
Model data	glf < 0.6	4991	837
	0.6 < glf < 0.7	726	4180
	glf > 0.7	40	740
Sample size: 37476; PC=81.4%; EBD=0.4%; POD1=86.7%; POD2=72.6%; POD3=84.9%			

Table 21: Contingency table for variable ground layer fraction (dimensionless) processed with AR (1H) and accuracy 0.0

ground layer fraction dimensionless	Observations		
	glf < 0.6	0.6 < glf < 0.7	glf > 0.7
Model data	glf < 0.6	4964	566
	0.6 < glf < 0.7	86	5104
	glf > 0.7	707	87
Sample size: 37476; PC=81.4%; EBD=14.3%; POD1=86.2%; POD2=88.7%; POD3=55.2%			

Table 22: Contingency table for variable ground layer fraction (dimensionless) in standard configuration and accuracy 0.14

ground layer fraction dimensionless	Observations		
	glf < 0.6	0.6 < glf < 0.7	glf > 0.7
Model data	glf < 0.6	5707	42
	0.6 < glf < 0.7	10	5694
	glf > 0.7	40	21
Sample size: 37476; PC=99.1%; EBD=0.4%; POD1=99.1%; POD2=98.9%; POD3=98.8%			

Table 23: Contingency table for variable ground layer fraction (dimensionless) processed with AR (1H) and accuracy 0.14

1.4 Title for PODs tables of Night 1

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

PARAMETER	STANDARD	WITH AR (1H)
POD1	56.7	92.2
POD2	49.6	86.8
POD3	80.1	95.2
PC	62.1	91.4
EBD	2.8	0.0

Table 24: PODs for wind speed (ms^{-1})

PARAMETER	STANDARD	WITH AR (1H)
POD1	87.8	97.7
POD2	53.0	91.1
POD3	83.0	98.6
POD4	31.9	89.6
PC	78.6	96.4
EBD	1.5	0.0

Table 25: PODs for wind direction (degree)

FATE - Monthly Report

PARAMETER	STANDARD	WITH AR (1H)
POD1	60.7	94.6
POD2	66.3	93.2
POD3	82.3	96.8
PC	69.8	94.9
EBD	1.7	0.0

Table 26: PODs for relative humidity (percent)

PARAMETER	STANDARD	WITH AR (1H)
POD1	88.4	98.3
POD2	67.4	97.0
POD3	85.0	99.0
PC	80.3	98.1
EBD	0.1	0.0

Table 27: PODs for precipitable water vapor (mm)

PARAMETER	STANDARD	WITH AR (1H)
POD1	61.0	88.5
POD2	39.5	76.7
POD3	54.7	91.2
PC	51.8	85.5
EBD	7.5	0.2

Table 28: PODs for total seeing (arcsec) and accuray 0.0

PARAMETER	STANDARD	WITH AR (1H)
POD1	93.0	99.8
POD2	93.8	99.3
POD3	82.0	99.4
PC	92.3	99.6
EBD	5.6	0.2

Table 29: PODs for total seeing (arcsec) and accuray 0.24

PARAMETER	STANDARD	WITH AR (1H)
POD1	75.4	93.6
POD2	53.2	87.1
POD3	70.4	93.0
PC	66.3	91.2
EBD	1.8	0.0

Table 30: PODs for coherence time (ms) and accuray 0.0

FATE - Monthly Report

PARAMETER	STANDARD	WITH AR (1H)
POD1	90.9	99.9
POD2	85.8	99.5
POD3	80.1	98.9
PC	88.5	99.6
EBD	4.8	0.2

Table 31: PODs for coherence time (ms) and accuray 1.22

PARAMETER	STANDARD	WITH AR (1H)
POD1	55.5	86.7
POD2	39.5	72.6
POD3	28.9	84.9
PC	41.3	81.4
EBD	13.6	0.4

Table 32: PODs for ground layer fraction (dimensionless) and accuray 0.0

PARAMETER	STANDARD	WITH AR (1H)
POD1	86.2	99.1
POD2	88.7	98.9
POD3	55.2	98.8
PC	81.4	99.1
EBD	14.3	0.4

Table 33: PODs for ground layer fraction (dimensionless) and accuray 0.14

2 Title for Day 1

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

2.1 Title for Figures of Day 1

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

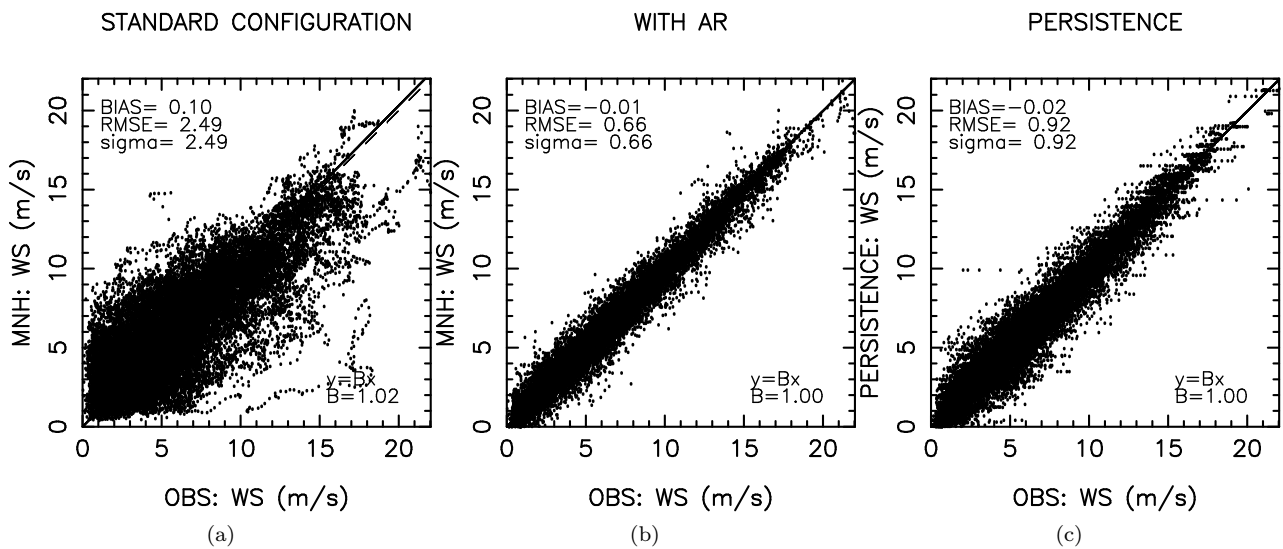


Figure 8: wind speed (ms^{-1}): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

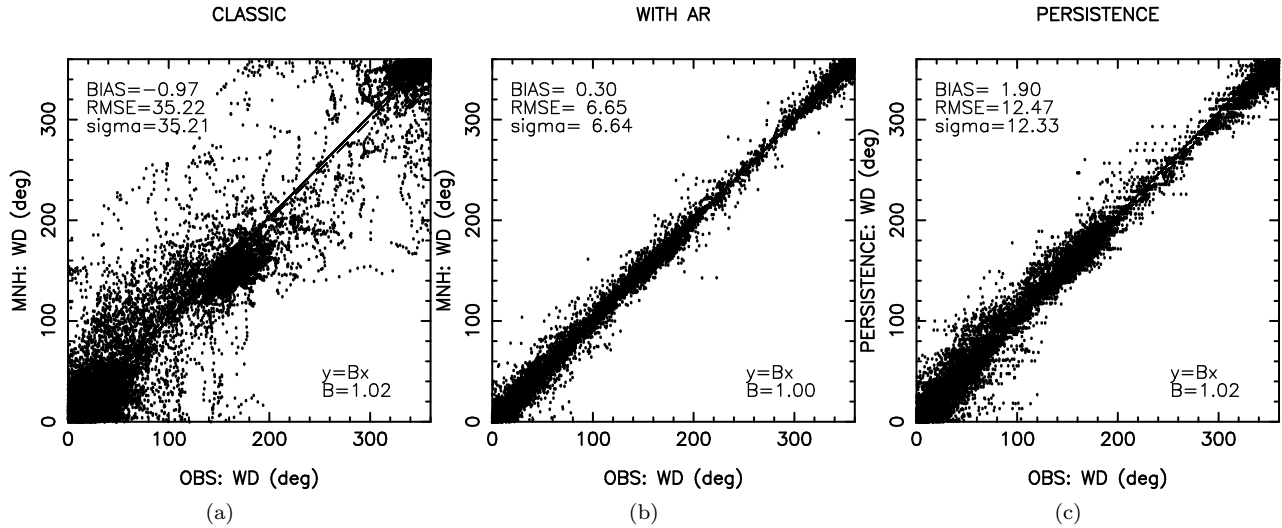


Figure 9: wind direction (degree): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

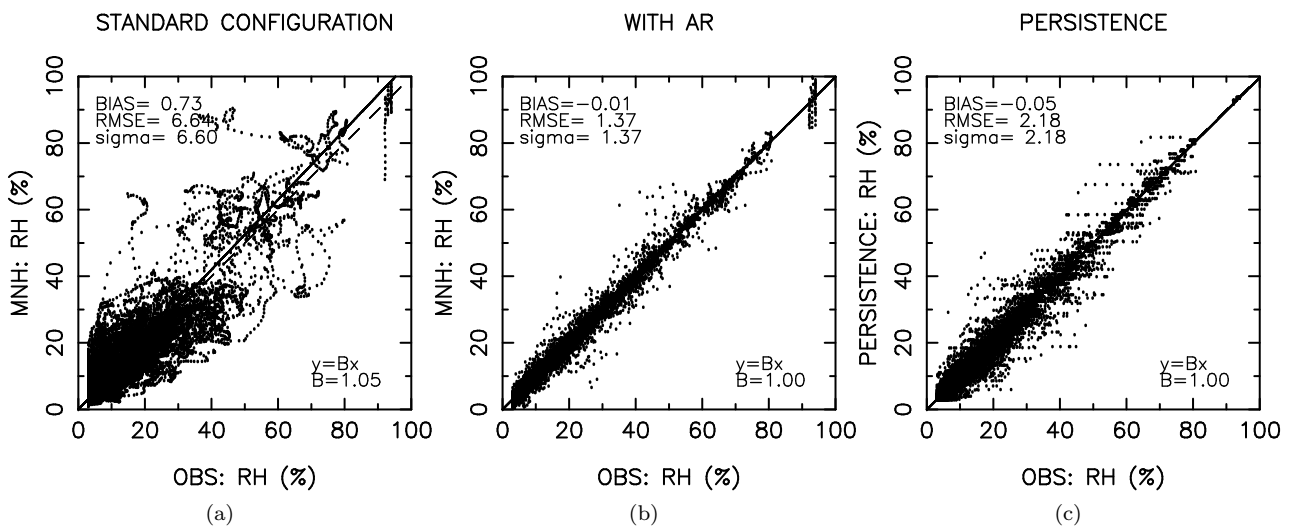


Figure 10: relative humidity (percent): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

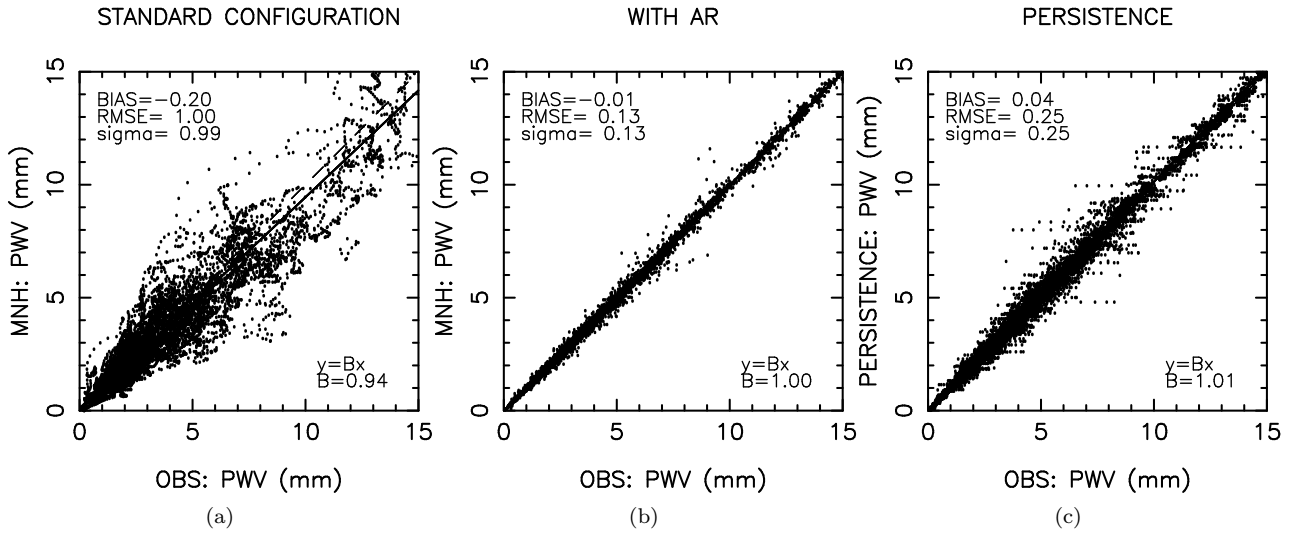


Figure 11: precipitable water vapor (mm): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

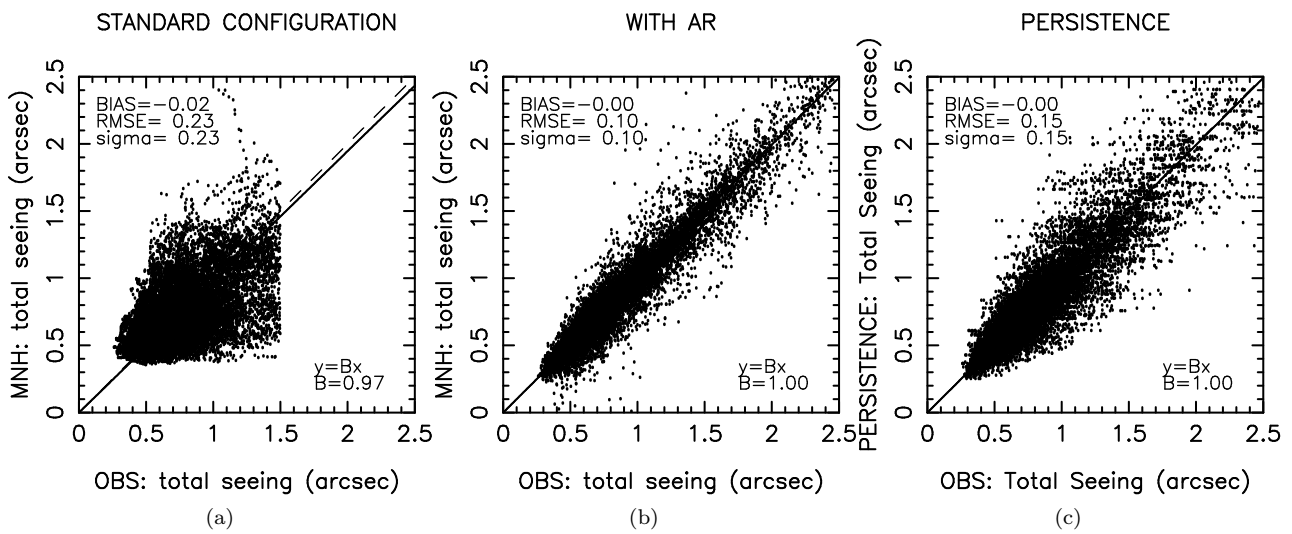


Figure 12: total seeing (arcsec): (a) STANDARD CONFIGURATION ($< 1.5''$), (b) WITH AR (1H), (c) PERSISTENCE (1H).

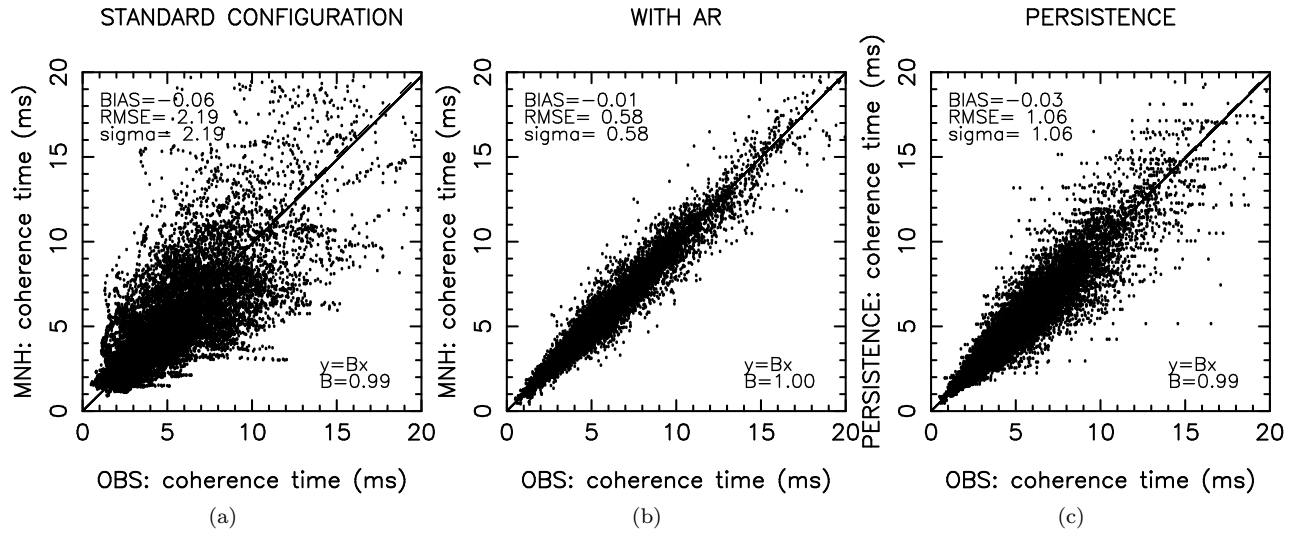


Figure 13: coherence time (ms): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

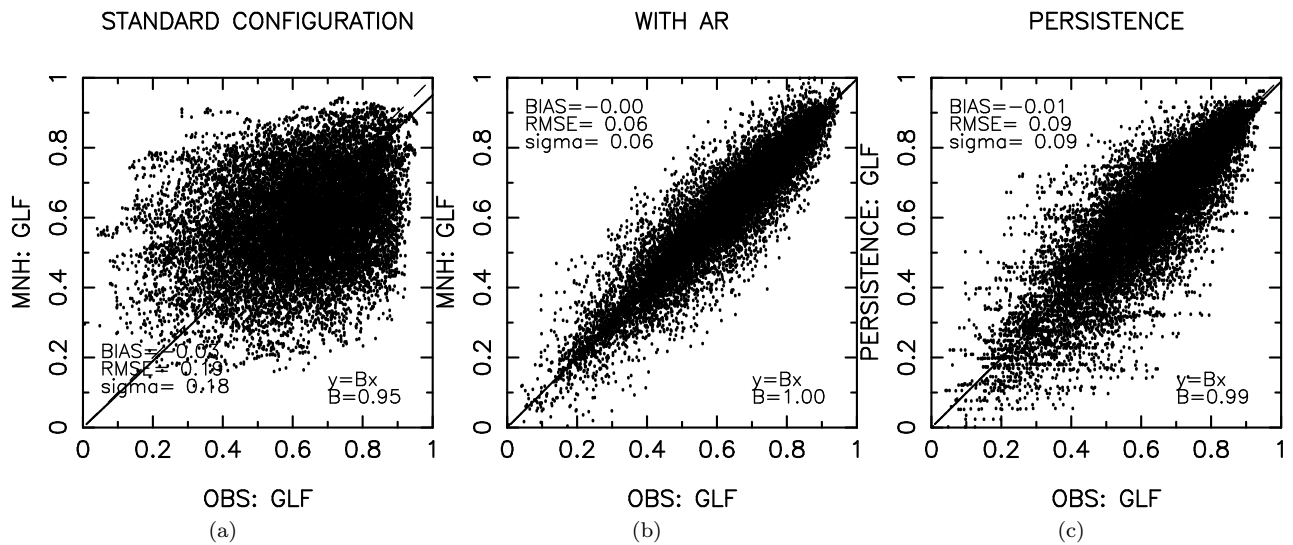


Figure 14: ground layer fraction (dimensionless): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H)

2.2 Title for Statistics of Day 1

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

VARIABLE	BIAS (inc. month)	RMSE (inc. month)	SD (inc. month)	BIAS (last month)	RMSE (last month)	SD (last month)
WS ($\text{m}\cdot\text{s}^{-1}$)	0.10	2.49	2.49	-0.61	2.60	2.53
WD (degree)	-0.97	35.22	35.21	1.64	33.85	33.81
RH (percent)	0.73	6.64	6.60	0.76	6.84	6.79
PWV (mm)	-0.20	1.00	0.99	-0.35	1.00	0.94
SEE (arcsec)	-0.02	0.23	0.23	-0.02	0.22	0.21
TAU (ms)	-0.06	2.19	2.19	-0.63	2.32	2.24
GLF (dimensionless)	-0.03	0.19	0.18	-0.01	0.16	0.16

Table 34: Statistics for variables in standard configuration: incremental month (i.e., since the beginning of service) *vs* last month (July-2023)

2.3 Title for Contingency tables of Day 1

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

wind speed ms^{-1}		Observations		
		ws < 4.2	4.2 < ws < 7.5	ws > 7.5
Model data	ws < 4.2	4541	2127	249
	4.2 < ws < 7.5	3034	3970	1347
	ws > 7.5	430	1908	6408
Sample size: 38880; PC=62.1%; EBD=2.8%; POD1=56.7%; POD2=49.6%; POD3=80.1%				

Table 35: Contingency table for wind speed (ms^{-1}) in standard configuration

wind direction		Observations			
degree		North	East	South	West
Model data	North	9401	1028	107	229
	East	1002	1832	560	0
	South	99	508	3567	195
	West	202	89	63	199
Sample size: 38880; PC=78.6%; EBD=1.5%; POD1=87.8%; POD2=53.0%; POD3=83.0%; POD4=31.9%					

Table 36: Contingency table for wind direction (degree) in standard configuration

relative humidity percent	Observations		
	rh < 7.1	7.1 < rh < 15.3	rh > 15.3
Model data	rh < 7.1	4755	1095
	7.1 < rh < 15.3	2696	5193
	rh > 15.3	379	1539
Sample size: 38232; PC=69.8%; EBD=1.7%; POD1=60.7%; POD2=66.3%; POD3=82.3%			

Table 37: Contingency table for variable relative humidity (percent) in standard configuration

precipitable water vapor mm	Observations		
	pwv < 1.9	1.9 < pwv < 3.5	pwv > 3.5
Model data	pwv < 1.9	3402	854
	1.9 < pwv < 3.5	443	2596
	pwv > 3.5	5	400
Sample size: 18900; PC=80.3%; EBD=0.1%; POD1=88.4%; POD2=67.4%; POD3=85.0%			

Table 38: Contingency table for variable precipitable water vapor (mm) in standard configuration

2.4 Title for PODs tables of Day 1

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

PARAMETER	STANDARD	WITH AR (1H)
POD1	56.7	92.2
POD2	49.6	86.8
POD3	80.1	95.2
PC	62.1	91.4
EBD	2.8	0.0

Table 39: PODs for wind speed (ms^{-1})

PARAMETER	STANDARD	WITH AR (1H)
POD1	87.8	97.7
POD2	53.0	91.1
POD3	83.0	98.6
POD4	31.9	89.6
PC	78.6	96.4
EBD	1.5	0.0

Table 40: PODs for wind direction (degree)

FATE - Monthly Report

PARAMETER	STANDARD	WITH AR (1H)
POD1	60.7	94.6
POD2	66.3	93.2
POD3	82.3	96.8
PC	69.8	94.9
EBD	1.7	0.0

Table 41: PODs for relative humidity (percent)

PARAMETER	STANDARD	WITH AR (1H)
POD1	88.4	98.3
POD2	67.4	97.0
POD3	85.0	99.0
PC	80.3	98.1
EBD	0.1	0.0

Table 42: PODs for precipitable water vapor (mm)

3 Title for Night 2

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

3.1 Title for Figures of Night 2

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

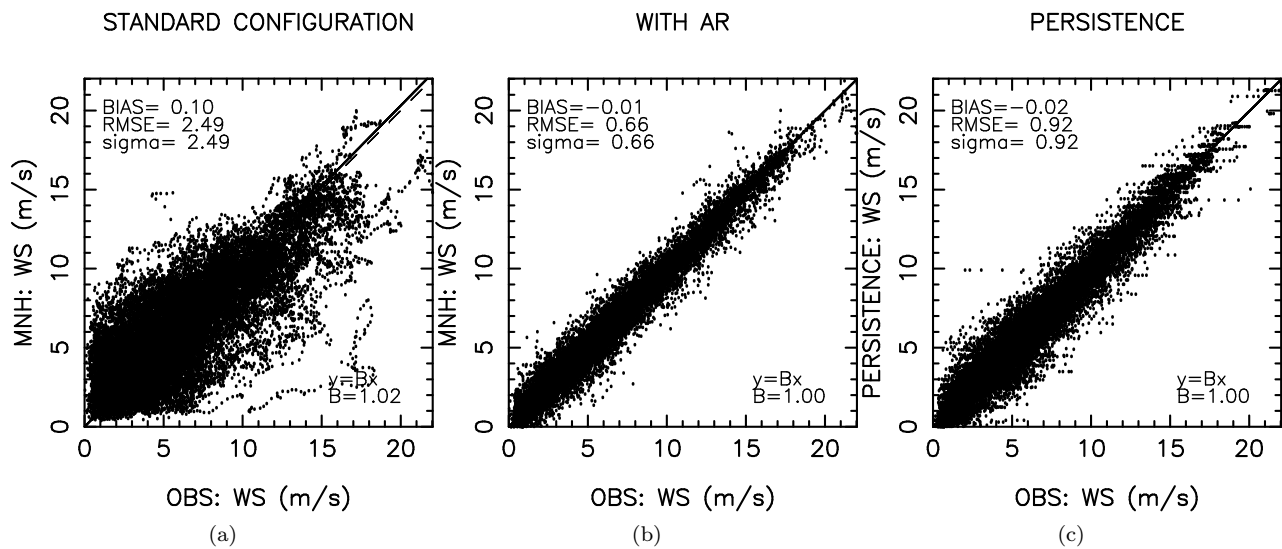


Figure 15: wind speed (ms^{-1}): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

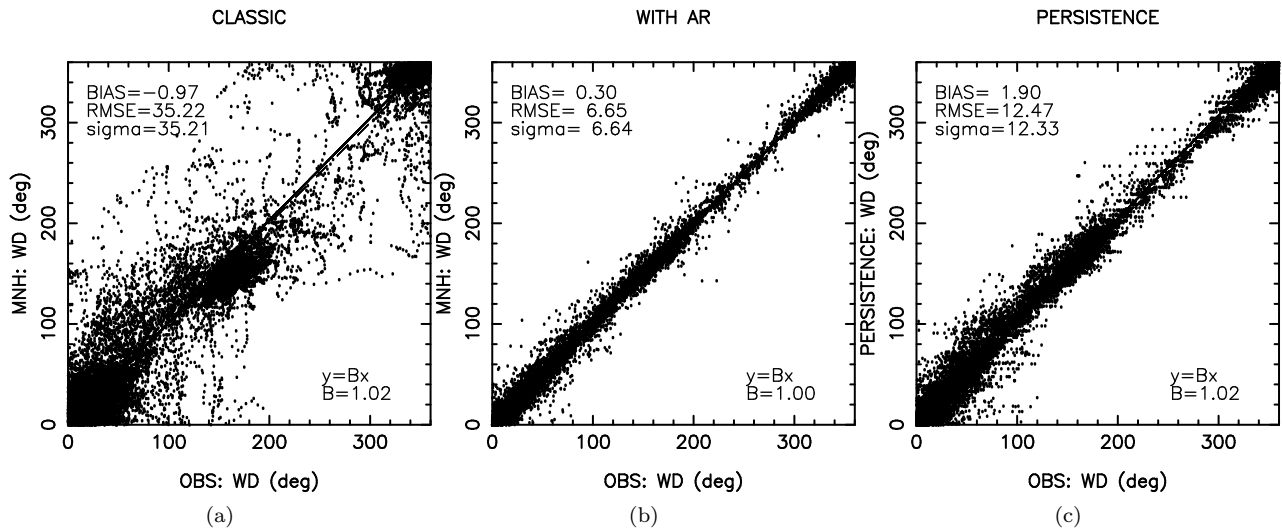


Figure 16: wind direction (degree): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

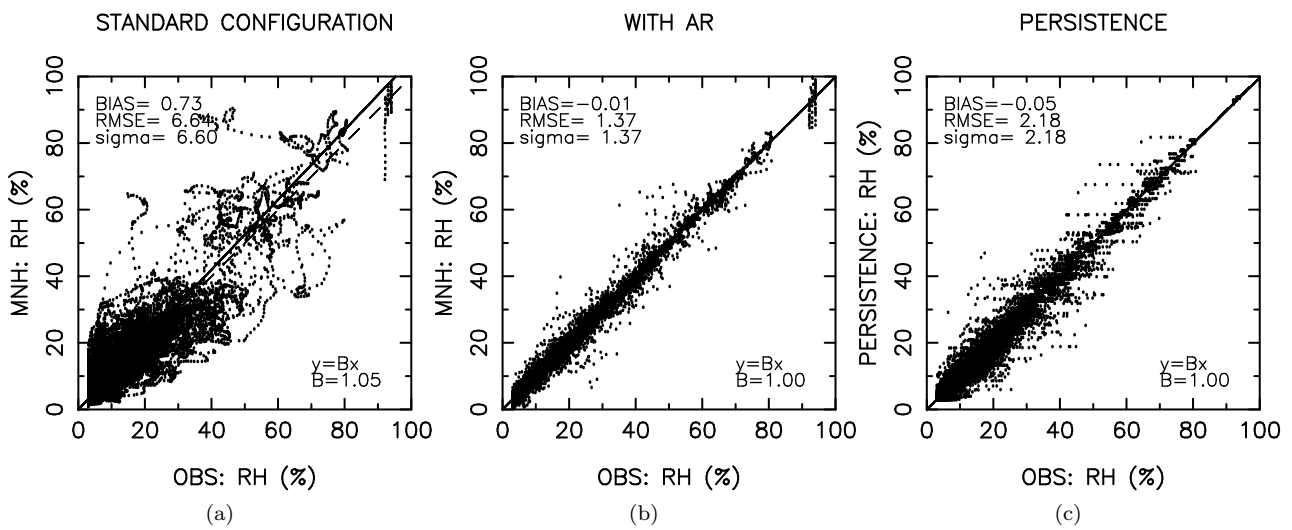


Figure 17: relative humidity (percent): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

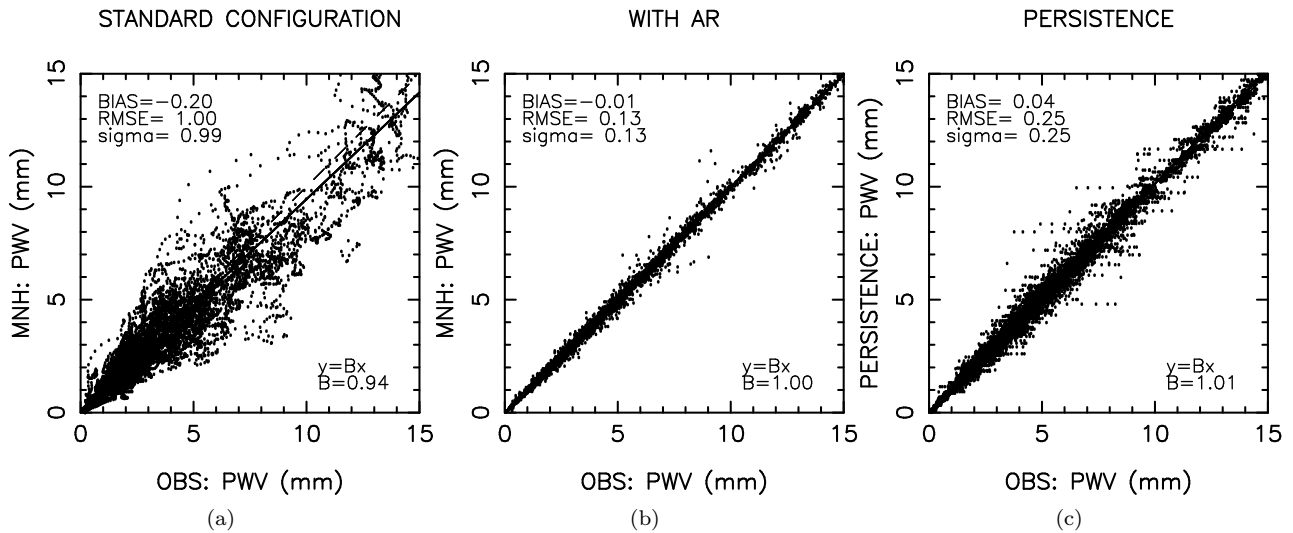


Figure 18: precipitable water vapor (mm): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

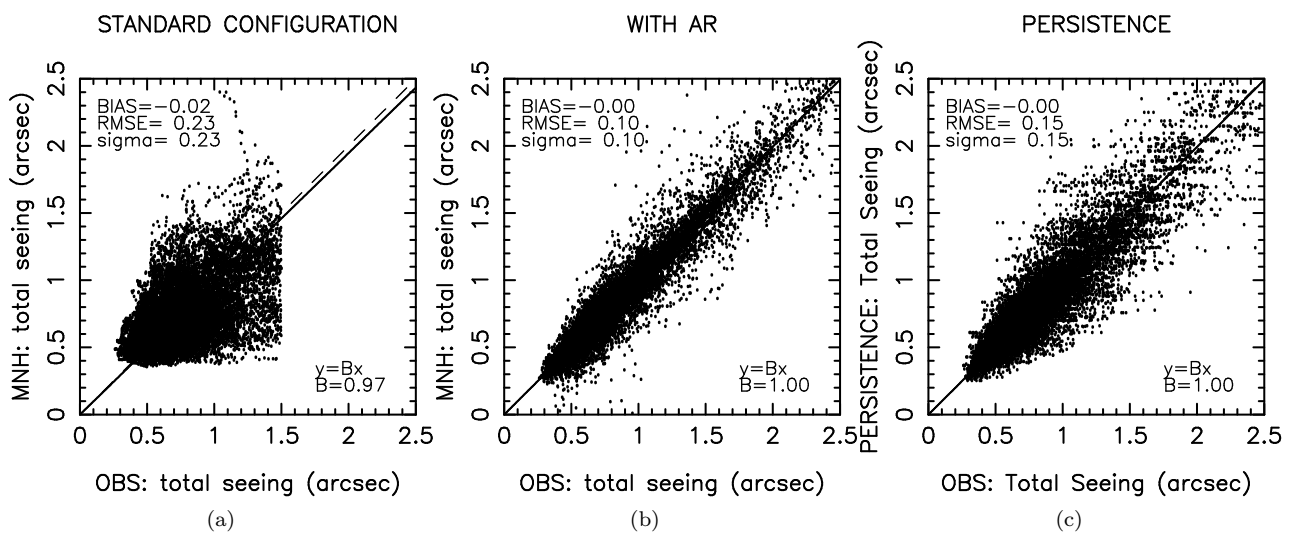


Figure 19: total seeing (arcsec): (a) STANDARD CONFIGURATION (< 1.5"), (b) WITH AR (1H), (c) PERSISTENCE (1H).

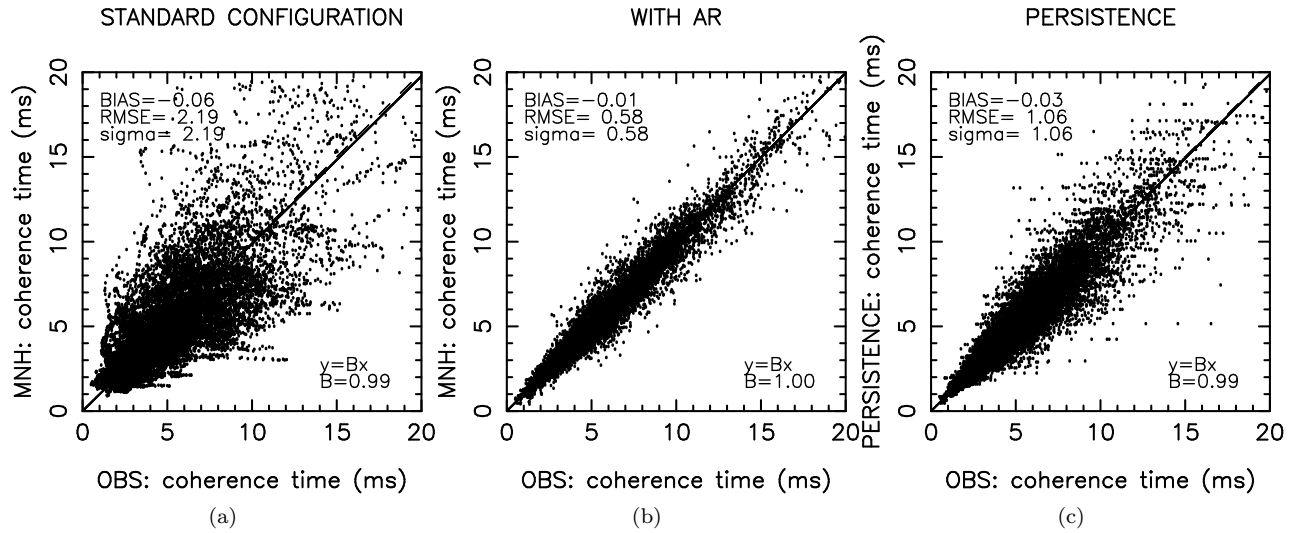


Figure 20: coherence time (ms): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

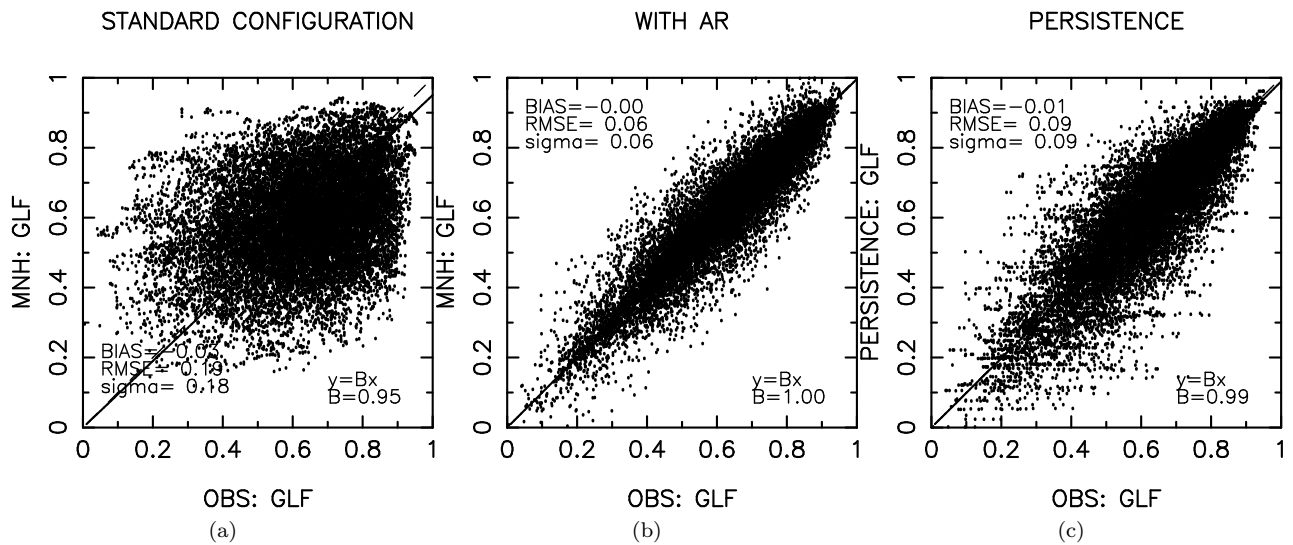


Figure 21: ground layer fraction (dimensionless): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H)

3.2 Title for Statistics of Night 2

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

VARIABLE	BIAS (inc. month)	RMSE (inc. month)	SD (inc. month)	BIAS (last month)	RMSE (last month)	SD (last month)
WS ($\text{m}\cdot\text{s}^{-1}$)	0.10	2.49	2.49	-0.61	2.60	2.53
WD (degree)	-0.97	35.22	35.21	1.64	33.85	33.81
RH (percent)	0.73	6.64	6.60	0.76	6.84	6.79
PWV (mm)	-0.20	1.00	0.99	-0.35	1.00	0.94
SEE (arcsec)	-0.02	0.23	0.23	-0.02	0.22	0.21
TAU (ms)	-0.06	2.19	2.19	-0.63	2.32	2.24
GLF (dimensionless)	-0.03	0.19	0.18	-0.01	0.16	0.16

Table 43: Statistics for variables in standard configuration: incremental month (i.e., since the beginning of service) *vs* last month (July-2023)

3.3 Title for Contingency tables of Night 2

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

wind speed ms^{-1}	Observations		
	ws < 4.2	4.2 < ws < 7.5	ws > 7.5
Model data	ws < 4.2	4541	2127
	4.2 < ws < 7.5	3034	3970
	ws > 7.5	430	1908
Sample size: 38880; PC=62.1%; EBD=2.8%; POD1=56.7%; POD2=49.6%; POD3=80.1%			

Table 44: Contingency table for wind speed (ms^{-1}) in standard configuration

wind direction degree	Observations			
	North	East	South	West
Model data	North	9401	1028	107
	East	1002	1832	560
	South	99	508	3567
	West	202	89	63
Sample size: 38880; PC=78.6%; EBD=1.5%; POD1=87.8%; POD2=53.0%; POD3=83.0%; POD4=31.9%				

Table 45: Contingency table for wind direction (degree) in standard configuration

relative humidity percent	Observations		
	rh < 7.1	7.1 < rh < 15.3	rh > 15.3
Model data	rh < 7.1	4755	1095
	7.1 < rh < 15.3	2696	5193
	rh > 15.3	379	1539
Sample size: 38232; PC=69.8%; EBD=1.7%; POD1=60.7%; POD2=66.3%; POD3=82.3%			

Table 46: Contingency table for variable relative humidity (percent) in standard configuration

precipitable water vapor mm	Observations		
	pwv < 1.9	1.9 < pwv < 3.5	pwv > 3.5
Model data	pwv < 1.9	3402	854
	1.9 < pwv < 3.5	443	2596
	pwv > 3.5	5	400
Sample size: 18900; PC=80.3%; EBD=0.1%; POD1=88.4%; POD2=67.4%; POD3=85.0%			

Table 47: Contingency table for variable precipitable water vapor (mm) in standard configuration

FATE - Monthly Report

total seeing arcsec		Observations		
		see < 0.6	0.6 < see < 0.8	see > 0.8
Model data	see < 0.6	3678	2340	841
	0.6 < see < 0.8	1828	2382	1886
	see > 0.8	520	1303	3298
Sample size: 37584; PC=51.8%; EBD=7.5%; POD1=61.0%; POD2=39.5%; POD3=54.7%				

Table 48: Contingency table for variable total seeing (arcsec) in standard configuration and accuracy 0.0

total seeing arcsec		Observations		
		see < 0.6	0.6 < see < 0.8	see > 0.8
Model data	see < 0.6	5603	0	597
	0.6 < see < 0.8	0	5649	597
	see > 0.8	423	376	5428
Sample size: 37584; PC=92.3%; EBD=5.6%; POD1=93.0%; POD2=93.8%; POD3=82.0%				

Table 49: Contingency table for variable total seeing (arcsec) in standard configuration and accuracy 0.24

coherence time ms		Observations		
		tau < 3.4	3.4 < tau < 5.8	tau > 5.8
Model data	tau < 3.4	4336	1463	107
	3.4 < tau < 5.8	1221	3060	1597
	tau > 5.8	196	1230	4049
Sample size: 37476; PC=66.3%; EBD=1.8%; POD1=75.4%; POD2=53.2%; POD3=70.4%				

Table 50: Contingency table for variable coherence time (ms) in standard configuration and accuracy 0.0

coherence time ms		Observations		
		tau < 3.4	3.4 < tau < 5.8	tau > 5.8
Model data	tau < 3.4	5229	149	639
	3.4 < tau < 5.8	328	4937	635
	tau > 5.8	196	667	5114
Sample size: 37476; PC=88.5%; EBD=4.8%; POD1=90.9%; POD2=85.8%; POD3=80.1%				

Table 51: Contingency table for variable coherence time (ms) in standard configuration and accuracy 1.22

ground layer fraction dimensionless		Observations		
		glf < 0.6	0.6 < glf < 0.7	glf > 0.7
Model data	glf < 0.6	3194	2361	1636
	0.6 < glf < 0.7	1856	2275	2456
	glf > 0.7	707	1121	1665
Sample size: 37476; PC=41.3%; EBD=13.6%; POD1=55.5%; POD2=39.5%; POD3=28.9%				

Table 52: Contingency table for variable ground layer fraction (dimensionless) in standard configuration and accuracy 0.0

ground layer fraction dimensionless		Observations		
		glf < 0.6	0.6 < glf < 0.7	glf > 0.7
Model data	glf < 0.6	4964	566	1758
	0.6 < glf < 0.7	86	5104	1493
	glf > 0.7	707	87	3999
Sample size: 37476; PC=81.4%; EBD=14.3%; POD1=86.2%; POD2=88.7%; POD3=55.2%				

Table 53: Contingency table for variable ground layer fraction (dimensionless) in standard configuration and accuracy 0.14

3.4 Title for PODs tables of Night 2

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

PARAMETER	STANDARD	WITH AR (1H)
POD1	56.7	92.2
POD2	49.6	86.8
POD3	80.1	95.2
PC	62.1	91.4
EBD	2.8	0.0

Table 54: PODs for wind speed (ms^{-1})

PARAMETER	STANDARD	WITH AR (1H)
POD1	87.8	97.7
POD2	53.0	91.1
POD3	83.0	98.6
POD4	31.9	89.6
PC	78.6	96.4
EBD	1.5	0.0

Table 55: PODs for wind direction (degree)

FATE - Monthly Report

PARAMETER	STANDARD	WITH AR (1H)
POD1	60.7	94.6
POD2	66.3	93.2
POD3	82.3	96.8
PC	69.8	94.9
EBD	1.7	0.0

Table 56: PODs for relative humidity (percent)

PARAMETER	STANDARD	WITH AR (1H)
POD1	88.4	98.3
POD2	67.4	97.0
POD3	85.0	99.0
PC	80.3	98.1
EBD	0.1	0.0

Table 57: PODs for precipitable water vapor (mm)

PARAMETER	STANDARD	WITH AR (1H)
POD1	61.0	88.5
POD2	39.5	76.7
POD3	54.7	91.2
PC	51.8	85.5
EBD	7.5	0.2

Table 58: PODs for total seeing (arcsec) and accuray 0.0

PARAMETER	STANDARD	WITH AR (1H)
POD1	93.0	99.8
POD2	93.8	99.3
POD3	82.0	99.4
PC	92.3	99.6
EBD	5.6	0.2

Table 59: PODs for total seeing (arcsec) and accuray 0.24

PARAMETER	STANDARD	WITH AR (1H)
POD1	75.4	93.6
POD2	53.2	87.1
POD3	70.4	93.0
PC	66.3	91.2
EBD	1.8	0.0

Table 60: PODs for coherence time (ms) and accuray 0.0

FATE - Monthly Report

PARAMETER	STANDARD	WITH AR (1H)
POD1	90.9	99.9
POD2	85.8	99.5
POD3	80.1	98.9
PC	88.5	99.6
EBD	4.8	0.2

Table 61: PODs for coherence time (ms) and accuray 1.22

PARAMETER	STANDARD	WITH AR (1H)
POD1	55.5	86.7
POD2	39.5	72.6
POD3	28.9	84.9
PC	41.3	81.4
EBD	13.6	0.4

Table 62: PODs for ground layer fraction (dimensionless) and accuray 0.0

PARAMETER	STANDARD	WITH AR (1H)
POD1	86.2	99.1
POD2	88.7	98.9
POD3	55.2	98.8
PC	81.4	99.1
EBD	14.3	0.4

Table 63: PODs for ground layer fraction (dimensionless) and accuray 0.14

4 Title for Day 2

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

4.1 Title for Figures of Day 2

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

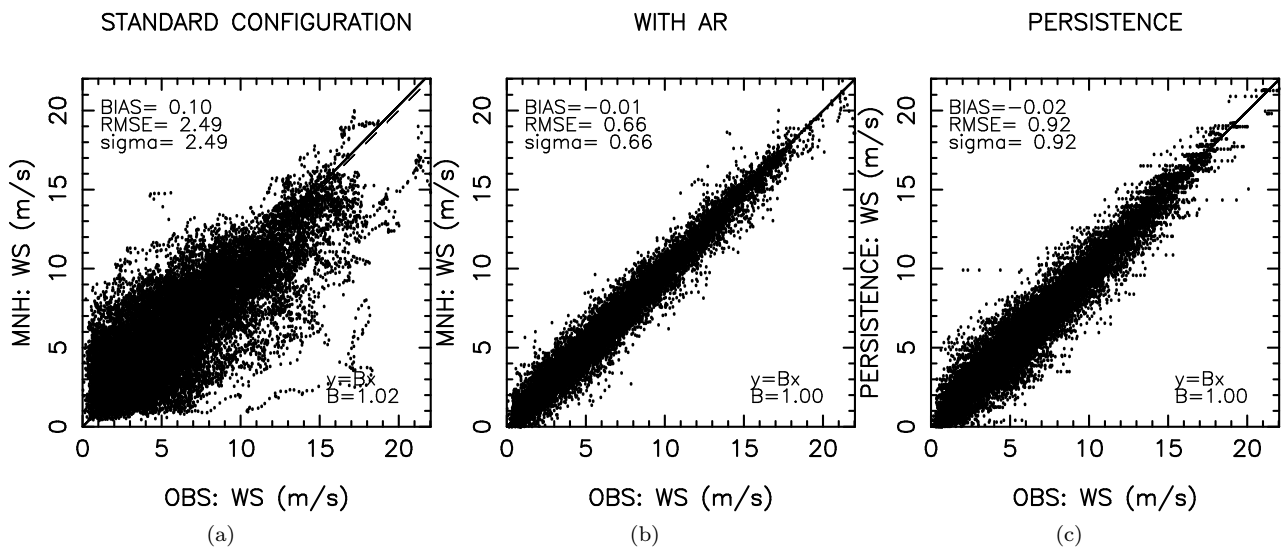


Figure 22: wind speed (ms^{-1}): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

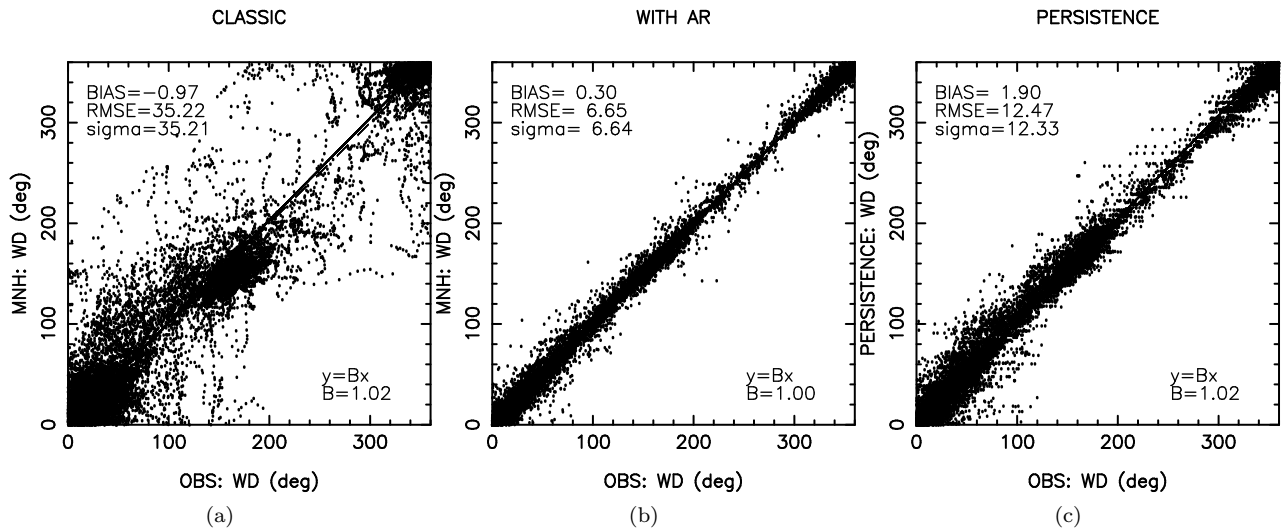


Figure 23: wind direction (degree): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

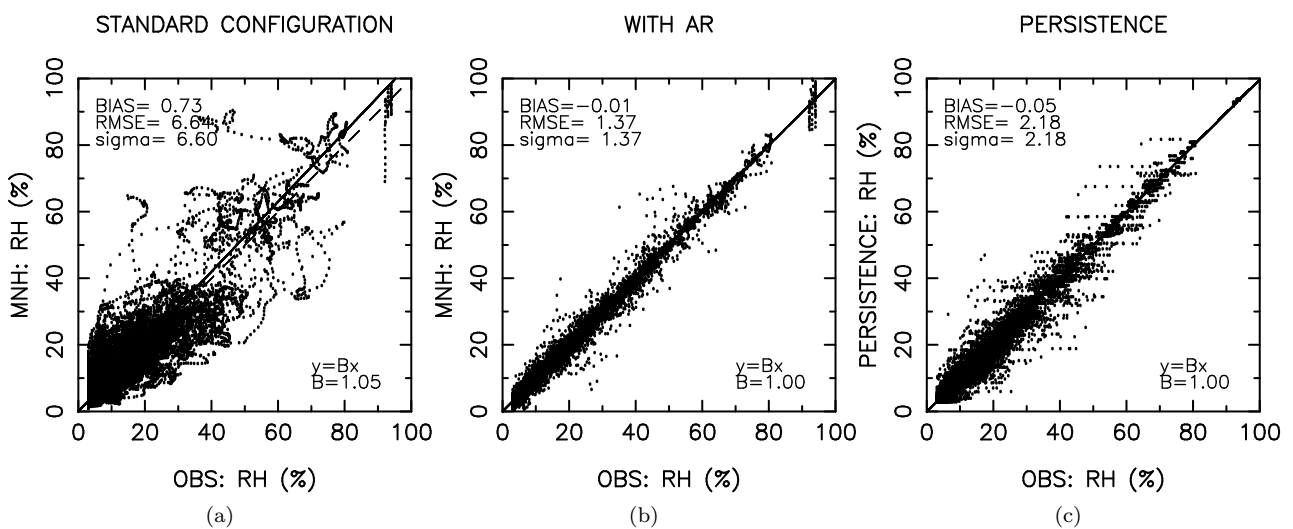


Figure 24: relative humidity (percent): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

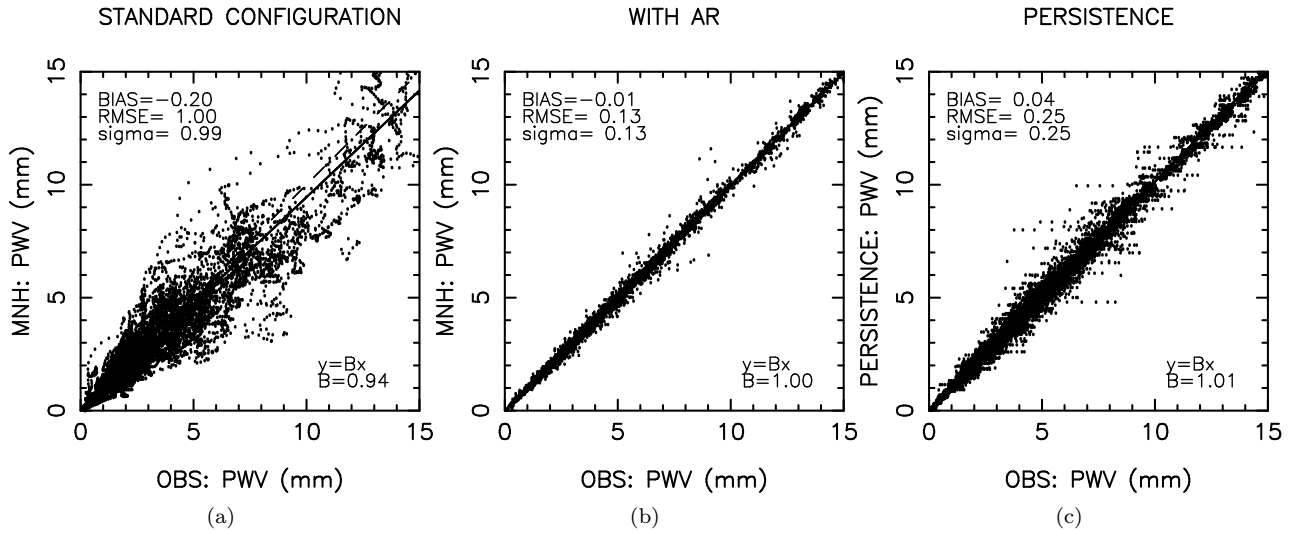


Figure 25: precipitable water vapor (mm): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

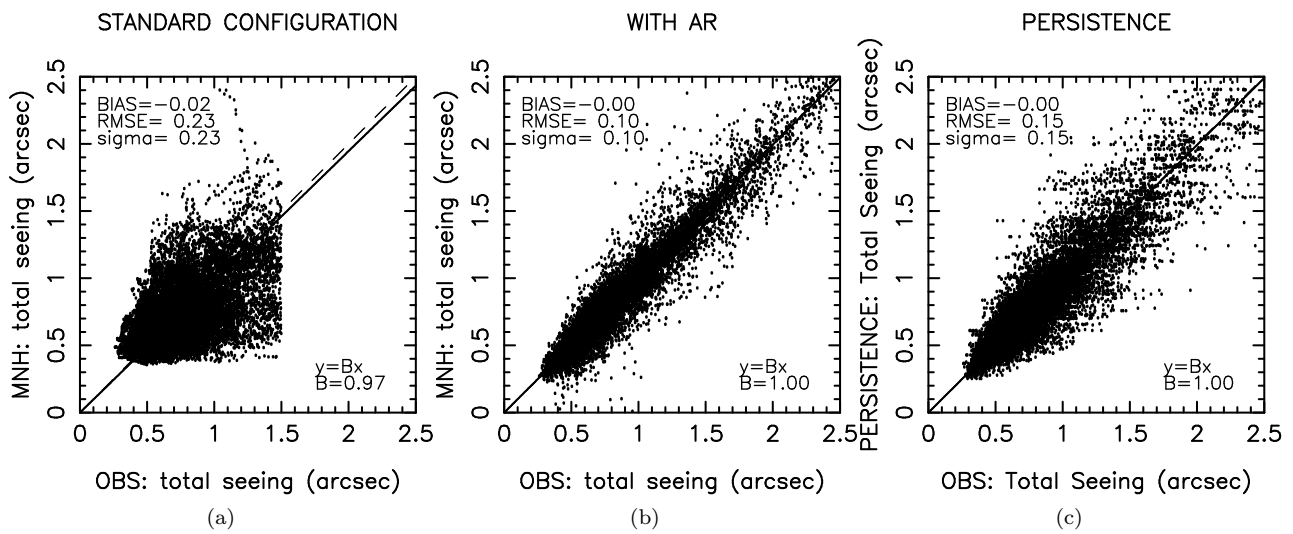


Figure 26: total seeing (arcsec): (a) STANDARD CONFIGURATION ($< 1.5''$), (b) WITH AR (1H), (c) PERSISTENCE (1H).

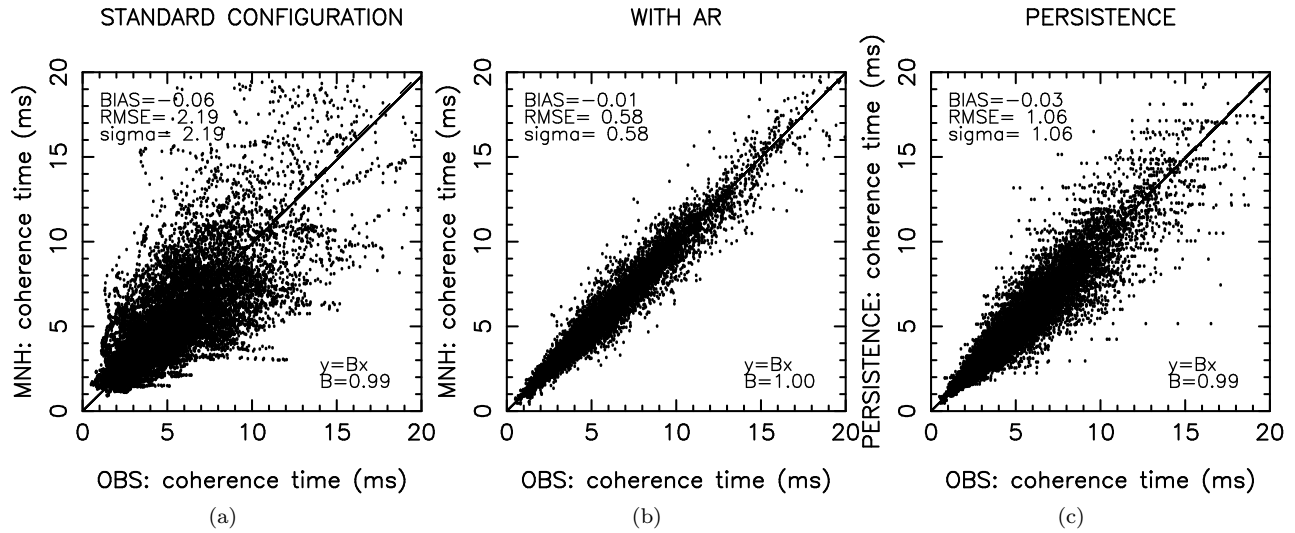


Figure 27: coherence time (ms): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

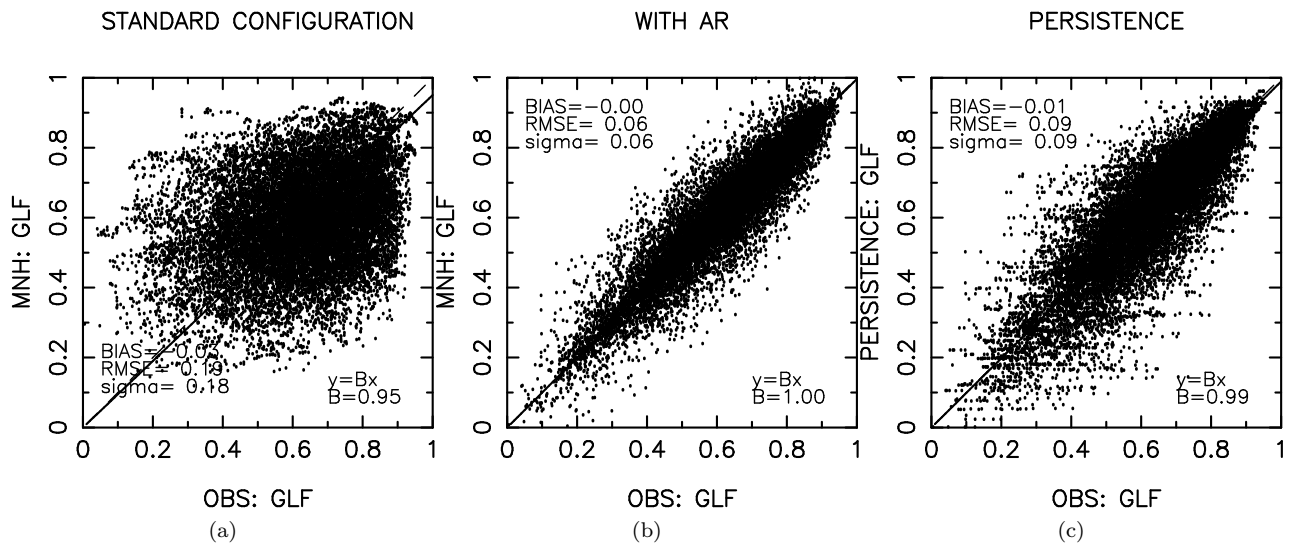


Figure 28: ground layer fraction (dimensionless): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H)

4.2 Title for Statistics of Day 2

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

VARIABLE	BIAS (inc. month)	RMSE (inc. month)	SD (inc. month)	BIAS (last month)	RMSE (last month)	SD (last month)
WS ($\text{m}\cdot\text{s}^{-1}$)	0.10	2.49	2.49	-0.61	2.60	2.53
WD (degree)	-0.97	35.22	35.21	1.64	33.85	33.81
RH (percent)	0.73	6.64	6.60	0.76	6.84	6.79
PWV (mm)	-0.20	1.00	0.99	-0.35	1.00	0.94
SEE (arcsec)	-0.02	0.23	0.23	-0.02	0.22	0.21
TAU (ms)	-0.06	2.19	2.19	-0.63	2.32	2.24
GLF (dimensionless)	-0.03	0.19	0.18	-0.01	0.16	0.16

Table 64: Statistics for variables in standard configuration: incremental month (i.e., since the beginning of service) *vs* last month (July-2023)

4.3 Title for Contingency tables of Day 2

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

wind speed ms^{-1}	Observations		
	ws < 4.2	4.2 < ws < 7.5	ws > 7.5
Model data	ws < 4.2	4541	2127
	4.2 < ws < 7.5	3034	3970
	ws > 7.5	430	1908
Sample size: 38880; PC=62.1%; EBD=2.8%; POD1=56.7%; POD2=49.6%; POD3=80.1%			

Table 65: Contingency table for wind speed (ms^{-1}) in standard configuration

wind direction degree	Observations			
	North	East	South	West
Model data	North	9401	1028	107
	East	1002	1832	560
	South	99	508	3567
	West	202	89	63
Sample size: 38880; PC=78.6%; EBD=1.5%; POD1=87.8%; POD2=53.0%; POD3=83.0%; POD4=31.9%				

Table 66: Contingency table for wind direction (degree) in standard configuration

relative humidity percent	Observations		
	rh < 7.1	7.1 < rh < 15.3	rh > 15.3
Model data	rh < 7.1	4755	1095
	7.1 < rh < 15.3	2696	5193
	rh > 15.3	379	1539
Sample size: 38232; PC=69.8%; EBD=1.7%; POD1=60.7%; POD2=66.3%; POD3=82.3%			

Table 67: Contingency table for variable relative humidity (percent) in standard configuration

precipitable water vapor mm	Observations		
	pwv < 1.9	1.9 < pwv < 3.5	pwv > 3.5
Model data	pwv < 1.9	3402	854
	1.9 < pwv < 3.5	443	2596
	pwv > 3.5	5	400
Sample size: 18900; PC=80.3%; EBD=0.1%; POD1=88.4%; POD2=67.4%; POD3=85.0%			

Table 68: Contingency table for variable precipitable water vapor (mm) in standard configuration

4.4 Title for PODs tables of Day 2

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

PARAMETER	STANDARD	WITH AR (1H)
POD1	56.7	92.2
POD2	49.6	86.8
POD3	80.1	95.2
PC	62.1	91.4
EBD	2.8	0.0

Table 69: PODs for wind speed (ms^{-1})

PARAMETER	STANDARD	WITH AR (1H)
POD1	87.8	97.7
POD2	53.0	91.1
POD3	83.0	98.6
POD4	31.9	89.6
PC	78.6	96.4
EBD	1.5	0.0

Table 70: PODs for wind direction (degree)

FATE - Monthly Report

PARAMETER	STANDARD	WITH AR (1H)
POD1	60.7	94.6
POD2	66.3	93.2
POD3	82.3	96.8
PC	69.8	94.9
EBD	1.7	0.0

Table 71: PODs for relative humidity (percent)

PARAMETER	STANDARD	WITH AR (1H)
POD1	88.4	98.3
POD2	67.4	97.0
POD3	85.0	99.0
PC	80.3	98.1
EBD	0.1	0.0

Table 72: PODs for precipitable water vapor (mm)

5 Title for Night 3

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

5.1 Title for Figures of Night 3

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

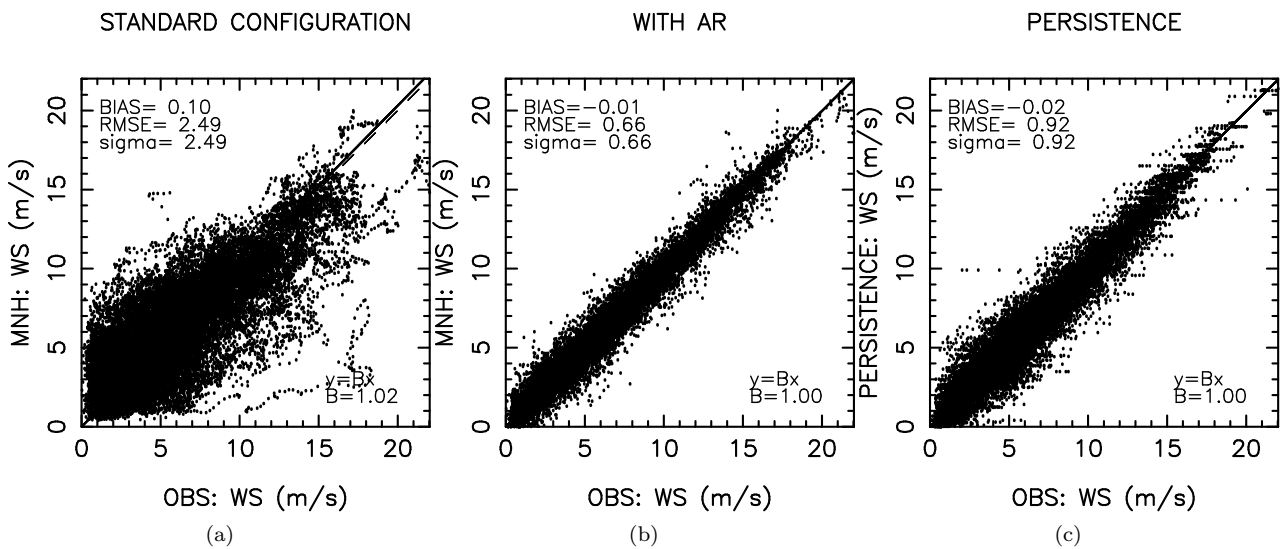


Figure 29: wind speed (ms^{-1}): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

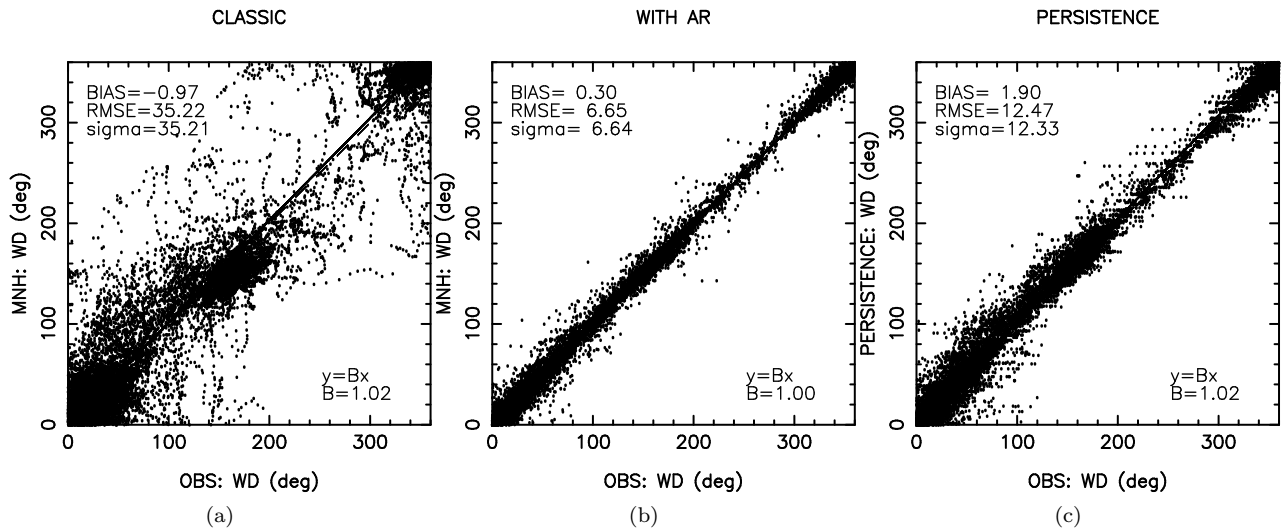


Figure 30: wind direction (degree): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

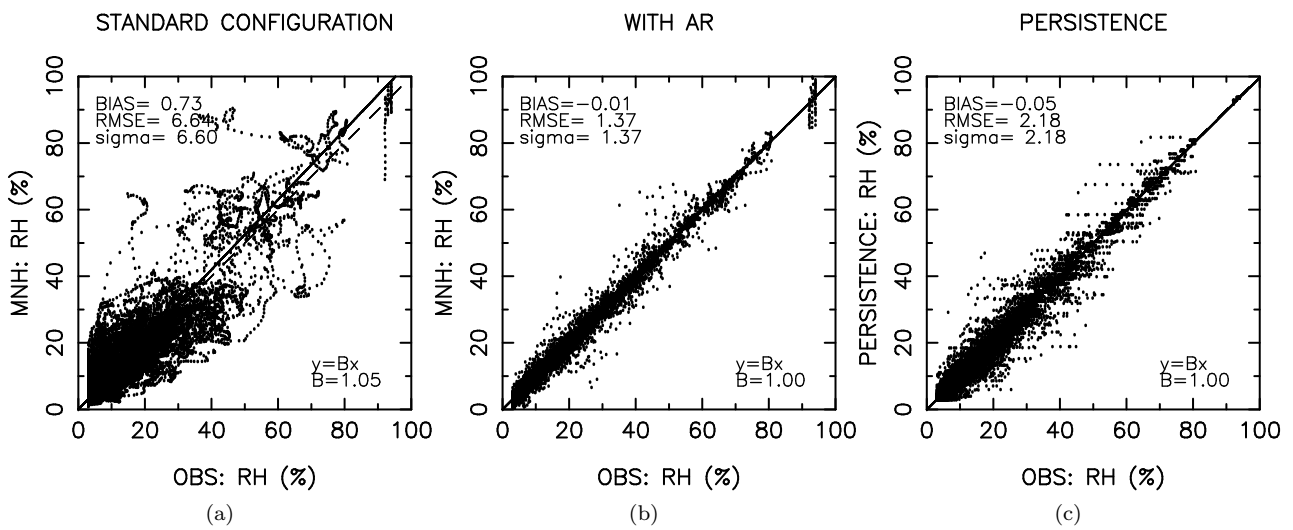


Figure 31: relative humidity (percent): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

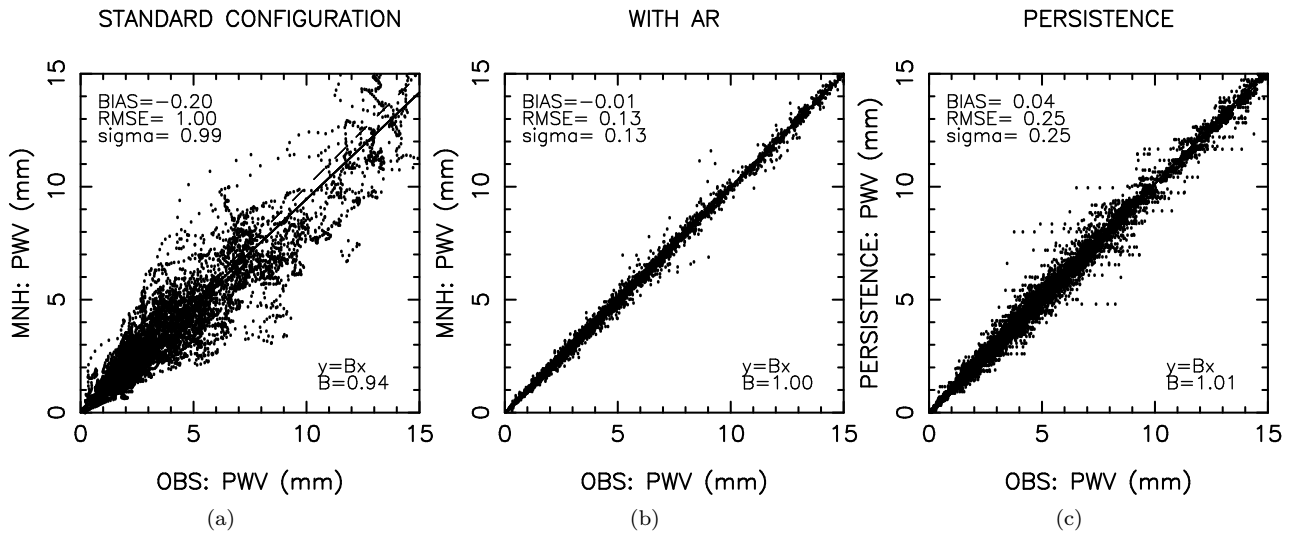


Figure 32: precipitable water vapor (mm): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

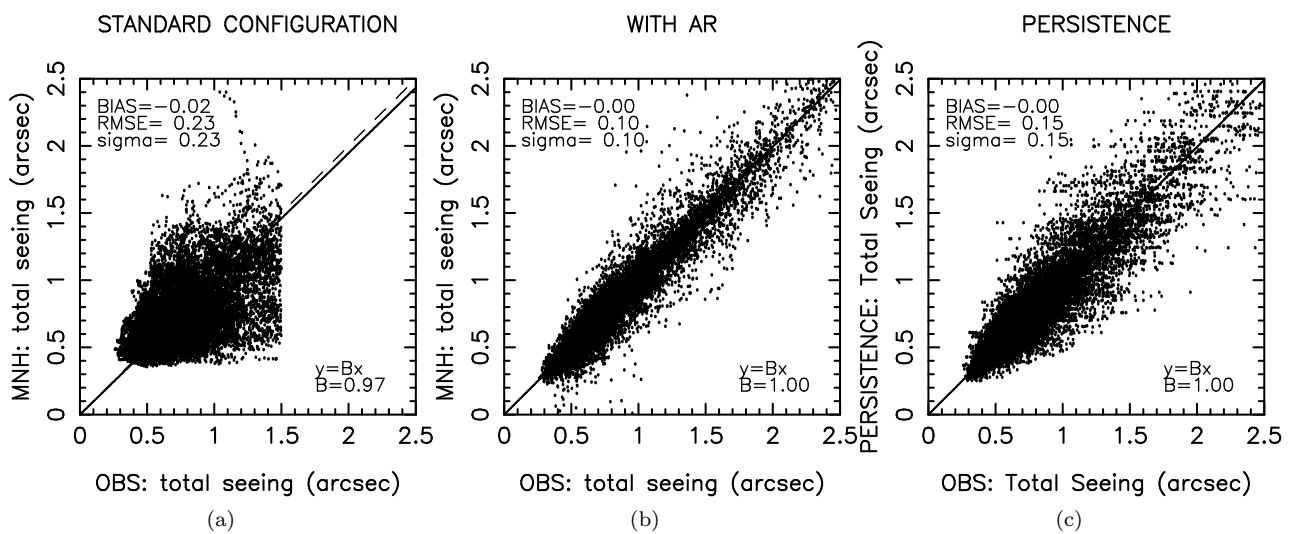


Figure 33: total seeing (arcsec): (a) STANDARD CONFIGURATION ($< 1.5''$), (b) WITH AR (1H), (c) PERSISTENCE (1H).

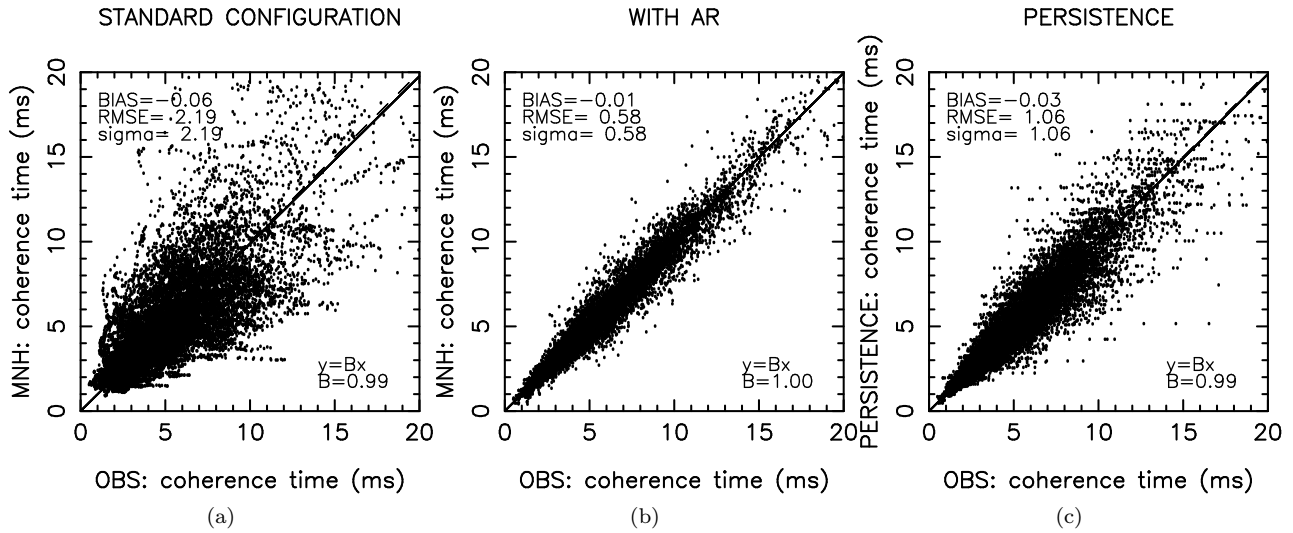


Figure 34: coherence time (ms): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

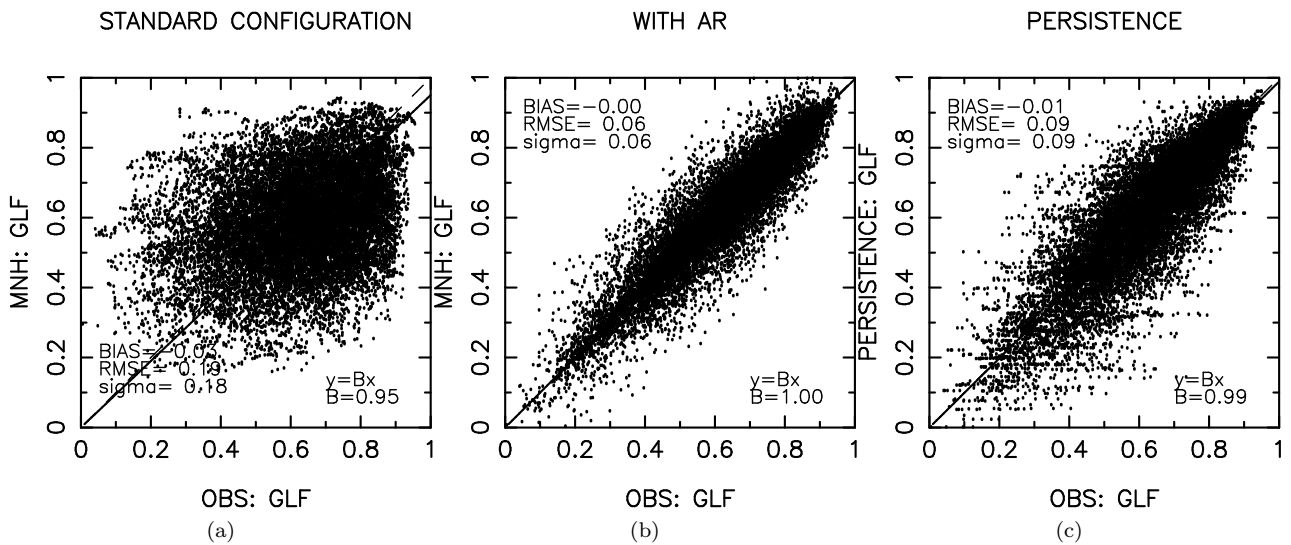


Figure 35: ground layer fraction (dimensionless): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H)

5.2 Title for Statistics of Night 3

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

VARIABLE	BIAS (inc. month)	RMSE (inc. month)	SD (inc. month)	BIAS (last month)	RMSE (last month)	SD (last month)
WS ($\text{m}\cdot\text{s}^{-1}$)	0.10	2.49	2.49	-0.61	2.60	2.53
WD (degree)	-0.97	35.22	35.21	1.64	33.85	33.81
RH (percent)	0.73	6.64	6.60	0.76	6.84	6.79
PWV (mm)	-0.20	1.00	0.99	-0.35	1.00	0.94
SEE (arcsec)	-0.02	0.23	0.23	-0.02	0.22	0.21
TAU (ms)	-0.06	2.19	2.19	-0.63	2.32	2.24
GLF (dimensionless)	-0.03	0.19	0.18	-0.01	0.16	0.16

Table 73: Statistics for variables in standard configuration: incremental month (i.e., since the beginning of service) *vs* last month (July-2023)

5.3 Title for Contingency tables of Night 3

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

wind speed ms^{-1}		Observations		
		ws < 4.2	4.2 < ws < 7.5	ws > 7.5
Model data	ws < 4.2	4541	2127	249
	4.2 < ws < 7.5	3034	3970	1347
	ws > 7.5	430	1908	6408
Sample size: 38880; PC=62.1%; EBD=2.8%; POD1=56.7%; POD2=49.6%; POD3=80.1%				

Table 74: Contingency table for wind speed (ms^{-1}) in standard configuration

wind direction degree		Observations			
		North	East	South	West
Model data	North	9401	1028	107	229
	East	1002	1832	560	0
	South	99	508	3567	195
	West	202	89	63	199
Sample size: 38880; PC=78.6%; EBD=1.5%; POD1=87.8%; POD2=53.0%; POD3=83.0%; POD4=31.9%					

Table 75: Contingency table for wind direction (degree) in standard configuration

relative humidity percent	Observations		
	rh < 7.1	7.1 < rh < 15.3	rh > 15.3
Model data	rh < 7.1	4755	1095
	7.1 < rh < 15.3	2696	5193
	rh > 15.3	379	1539
Sample size: 38232; PC=69.8%; EBD=1.7%; POD1=60.7%; POD2=66.3%; POD3=82.3%			

Table 76: Contingency table for variable relative humidity (percent) in standard configuration

precipitable water vapor mm	Observations		
	pwv < 1.9	1.9 < pwv < 3.5	pwv > 3.5
Model data	pwv < 1.9	3402	854
	1.9 < pwv < 3.5	443	2596
	pwv > 3.5	5	400
Sample size: 18900; PC=80.3%; EBD=0.1%; POD1=88.4%; POD2=67.4%; POD3=85.0%			

Table 77: Contingency table for variable precipitable water vapor (mm) in standard configuration

FATE - Monthly Report

total seeing arcsec		Observations		
		see < 0.6	0.6 < see < 0.8	see > 0.8
Model data	see < 0.6	3678	2340	841
	0.6 < see < 0.8	1828	2382	1886
	see > 0.8	520	1303	3298
Sample size: 37584; PC=51.8%; EBD=7.5%; POD1=61.0%; POD2=39.5%; POD3=54.7%				

Table 78: Contingency table for variable total seeing (arcsec) in standard configuration and accuracy 0.0

total seeing arcsec		Observations		
		see < 0.6	0.6 < see < 0.8	see > 0.8
Model data	see < 0.6	5603	0	597
	0.6 < see < 0.8	0	5649	597
	see > 0.8	423	376	5428
Sample size: 37584; PC=92.3%; EBD=5.6%; POD1=93.0%; POD2=93.8%; POD3=82.0%				

Table 79: Contingency table for variable total seeing (arcsec) in standard configuration and accuracy 0.24

coherence time ms		Observations		
		tau < 3.4	3.4 < tau < 5.8	tau > 5.8
Model data	tau < 3.4	4336	1463	107
	3.4 < tau < 5.8	1221	3060	1597
	tau > 5.8	196	1230	4049
Sample size: 37476; PC=66.3%; EBD=1.8%; POD1=75.4%; POD2=53.2%; POD3=70.4%				

Table 80: Contingency table for variable coherence time (ms) in standard configuration and accuracy 0.0

coherence time ms		Observations		
		tau < 3.4	3.4 < tau < 5.8	tau > 5.8
Model data	tau < 3.4	5229	149	639
	3.4 < tau < 5.8	328	4937	635
	tau > 5.8	196	667	5114
Sample size: 37476; PC=88.5%; EBD=4.8%; POD1=90.9%; POD2=85.8%; POD3=80.1%				

Table 81: Contingency table for variable coherence time (ms) in standard configuration and accuracy 1.22

ground layer fraction dimensionless		Observations		
		glf < 0.6	0.6 < glf < 0.7	glf > 0.7
Model data	glf < 0.6	3194	2361	1636
	0.6 < glf < 0.7	1856	2275	2456
	glf > 0.7	707	1121	1665
Sample size: 37476; PC=41.3%; EBD=13.6%; POD1=55.5%; POD2=39.5%; POD3=28.9%				

Table 82: Contingency table for variable ground layer fraction (dimensionless) in standard configuration and accuracy 0.0

ground layer fraction dimensionless		Observations		
		glf < 0.6	0.6 < glf < 0.7	glf > 0.7
Model data	glf < 0.6	4964	566	1758
	0.6 < glf < 0.7	86	5104	1493
	glf > 0.7	707	87	3999
Sample size: 37476; PC=81.4%; EBD=14.3%; POD1=86.2%; POD2=88.7%; POD3=55.2%				

Table 83: Contingency table for variable ground layer fraction (dimensionless) in standard configuration and accuracy 0.14

5.4 Title for PODs tables of Night 3

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

PARAMETER	STANDARD	WITH AR (1H)
POD1	56.7	92.2
POD2	49.6	86.8
POD3	80.1	95.2
PC	62.1	91.4
EBD	2.8	0.0

Table 84: PODs for wind speed (ms^{-1})

PARAMETER	STANDARD	WITH AR (1H)
POD1	87.8	97.7
POD2	53.0	91.1
POD3	83.0	98.6
POD4	31.9	89.6
PC	78.6	96.4
EBD	1.5	0.0

Table 85: PODs for wind direction (degree)

FATE - Monthly Report

PARAMETER	STANDARD	WITH AR (1H)
POD1	60.7	94.6
POD2	66.3	93.2
POD3	82.3	96.8
PC	69.8	94.9
EBD	1.7	0.0

Table 86: PODs for relative humidity (percent)

PARAMETER	STANDARD	WITH AR (1H)
POD1	88.4	98.3
POD2	67.4	97.0
POD3	85.0	99.0
PC	80.3	98.1
EBD	0.1	0.0

Table 87: PODs for precipitable water vapor (mm)

PARAMETER	STANDARD	WITH AR (1H)
POD1	61.0	88.5
POD2	39.5	76.7
POD3	54.7	91.2
PC	51.8	85.5
EBD	7.5	0.2

Table 88: PODs for total seeing (arcsec) and accuray 0.0

PARAMETER	STANDARD	WITH AR (1H)
POD1	93.0	99.8
POD2	93.8	99.3
POD3	82.0	99.4
PC	92.3	99.6
EBD	5.6	0.2

Table 89: PODs for total seeing (arcsec) and accuray 0.24

PARAMETER	STANDARD	WITH AR (1H)
POD1	75.4	93.6
POD2	53.2	87.1
POD3	70.4	93.0
PC	66.3	91.2
EBD	1.8	0.0

Table 90: PODs for coherence time (ms) and accuray 0.0

FATE - Monthly Report

PARAMETER	STANDARD	WITH AR (1H)
POD1	90.9	99.9
POD2	85.8	99.5
POD3	80.1	98.9
PC	88.5	99.6
EBD	4.8	0.2

Table 91: PODs for coherence time (ms) and accuray 1.22

PARAMETER	STANDARD	WITH AR (1H)
POD1	55.5	86.7
POD2	39.5	72.6
POD3	28.9	84.9
PC	41.3	81.4
EBD	13.6	0.4

Table 92: PODs for ground layer fraction (dimensionless) and accuray 0.0

PARAMETER	STANDARD	WITH AR (1H)
POD1	86.2	99.1
POD2	88.7	98.9
POD3	55.2	98.8
PC	81.4	99.1
EBD	14.3	0.4

Table 93: PODs for ground layer fraction (dimensionless) and accuray 0.14

6 Title for Day 3

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

6.1 Title for Figures of Day 3

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

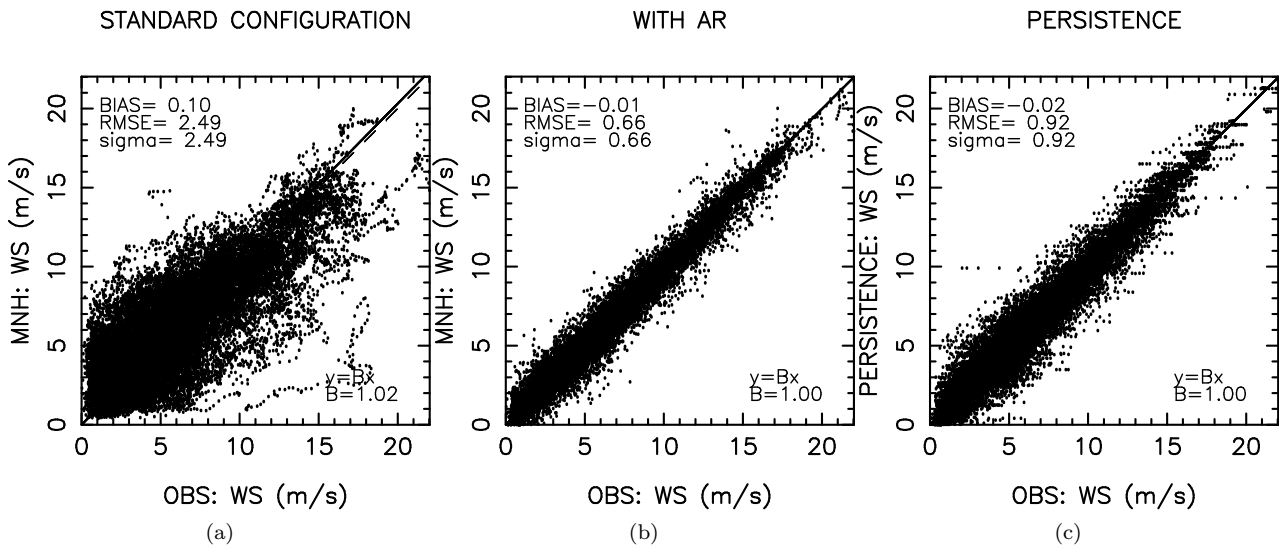


Figure 36: wind speed (ms^{-1}): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

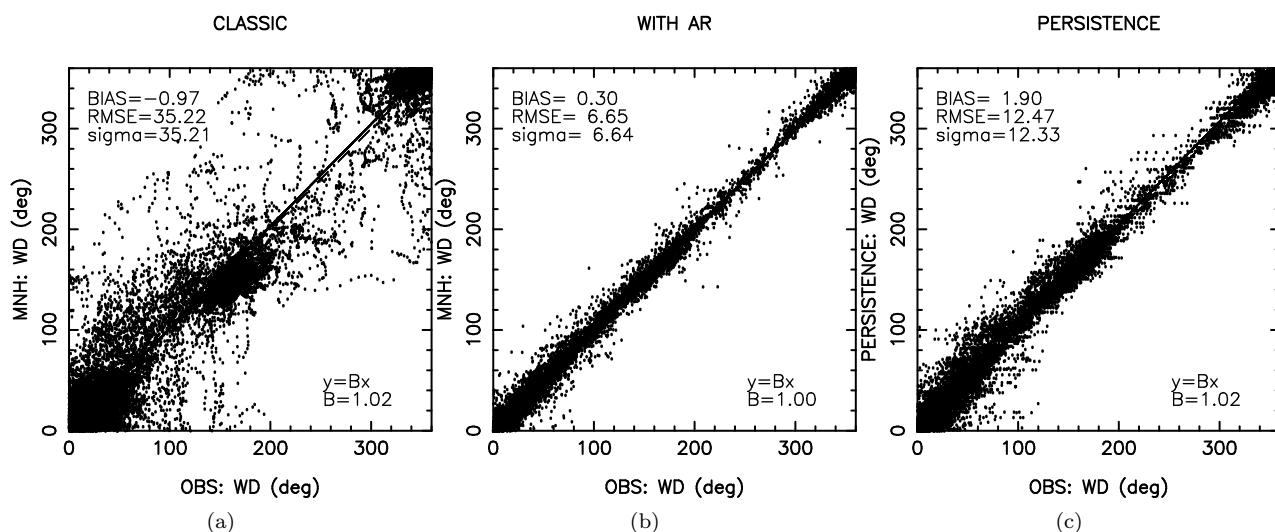


Figure 37: wind direction (degree): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

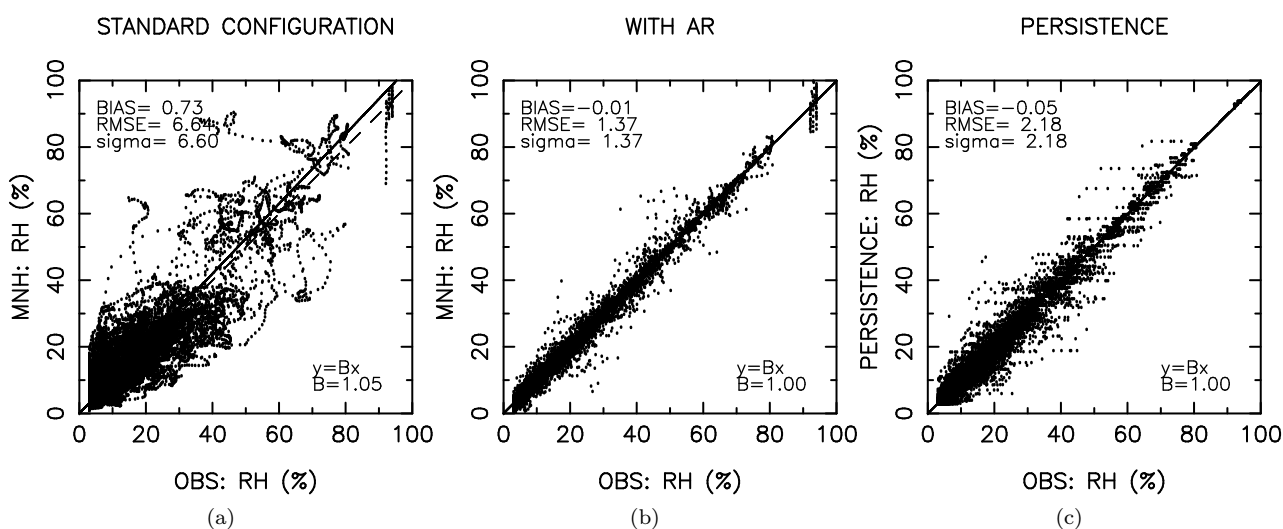


Figure 38: relative humidity (percent): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

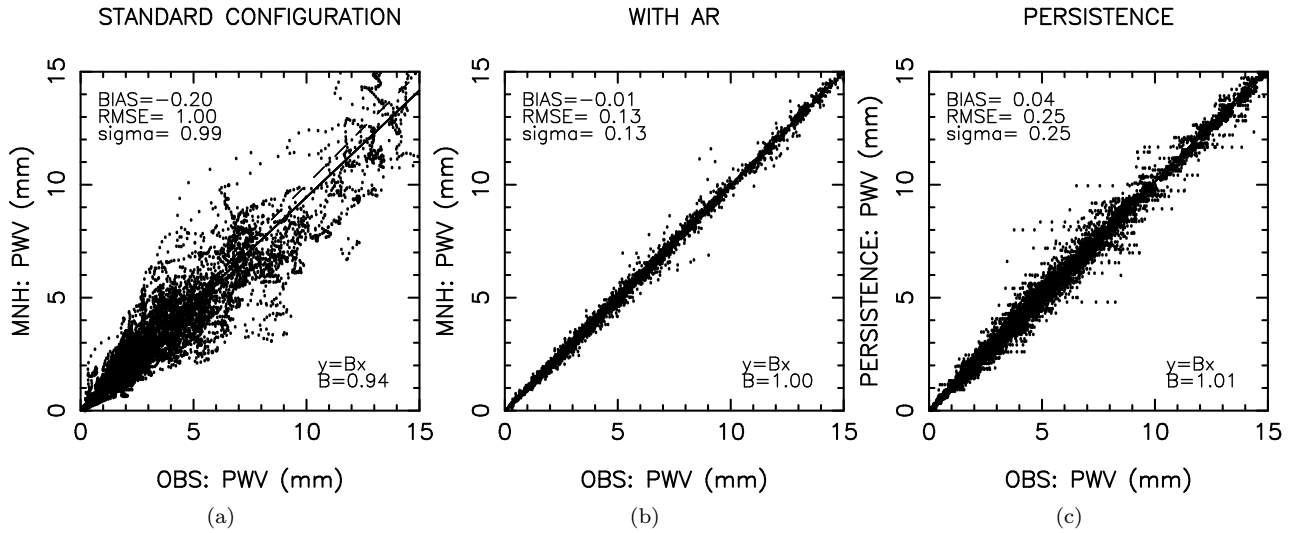


Figure 39: precipitable water vapor (mm): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

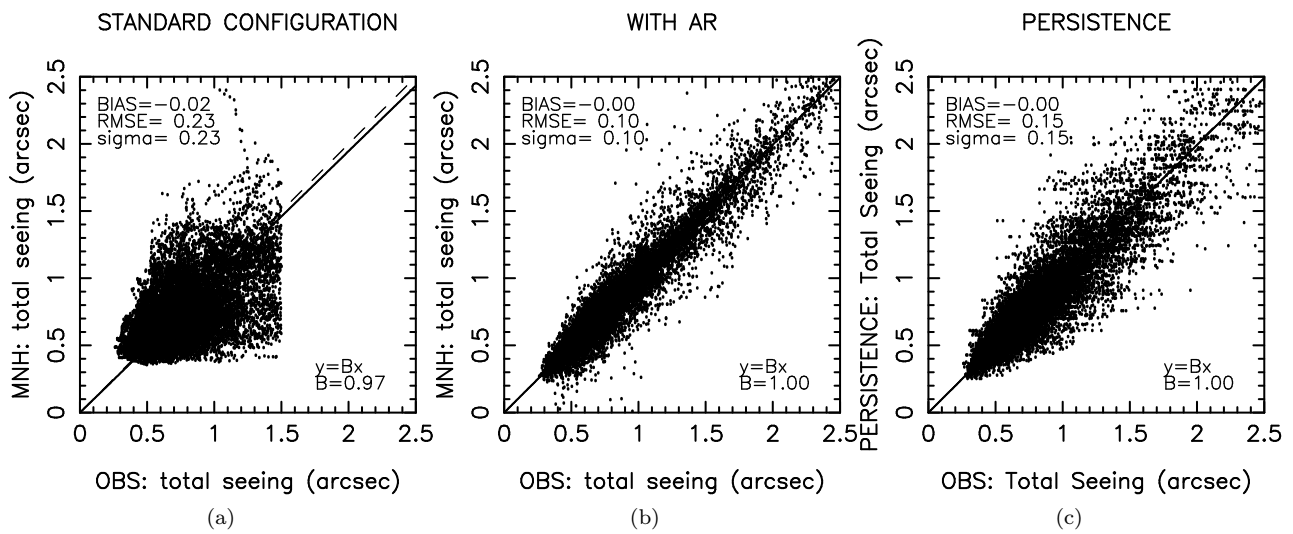


Figure 40: total seeing (arcsec): (a) STANDARD CONFIGURATION ($< 1.5''$), (b) WITH AR (1H), (c) PERSISTENCE (1H).

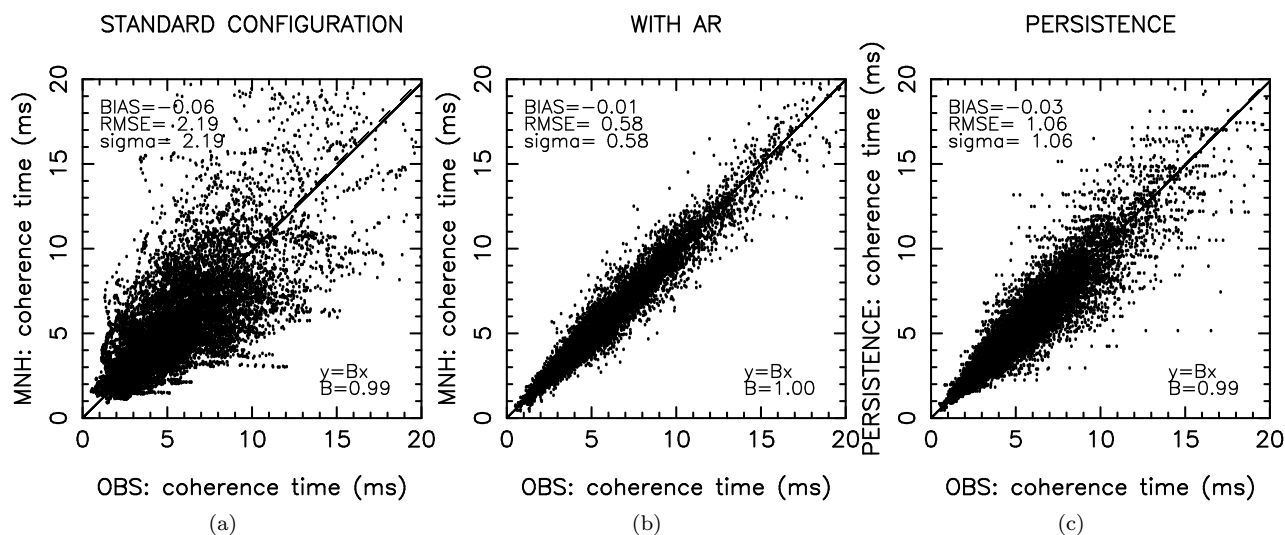


Figure 41: coherence time (ms): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

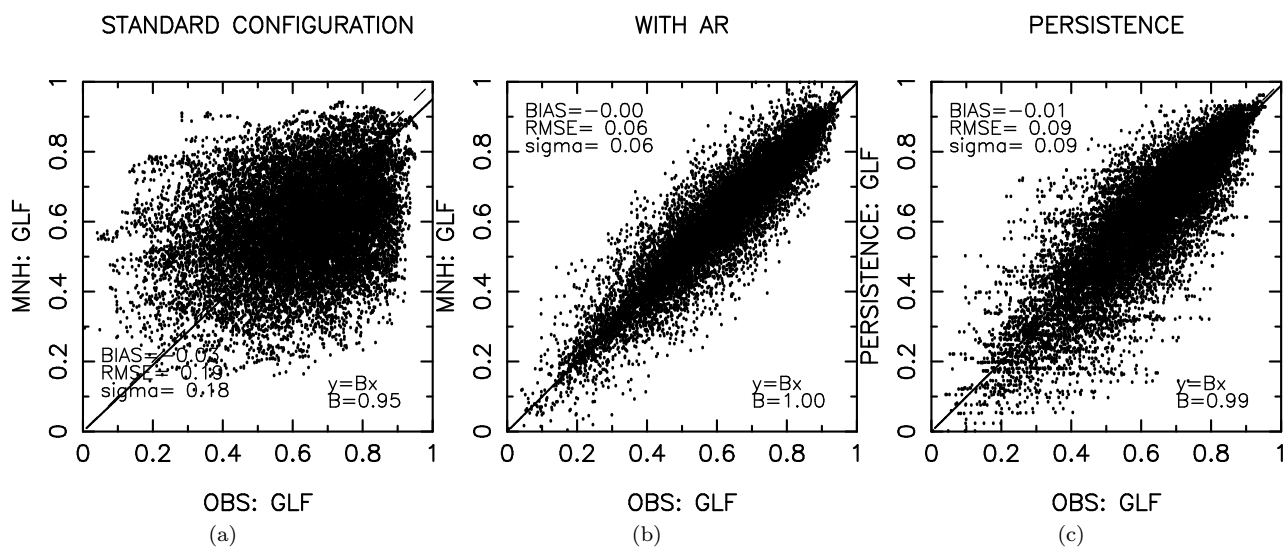


Figure 42: ground layer fraction (dimensionless): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H)

6.2 Title for Statistics of Day 3

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

VARIABLE	BIAS (inc. month)	RMSE (inc. month)	SD (inc. month)	BIAS (last month)	RMSE (last month)	SD (last month)
WS ($\text{m}\cdot\text{s}^{-1}$)	0.10	2.49	2.49	-0.61	2.60	2.53
WD (degree)	-0.97	35.22	35.21	1.64	33.85	33.81
RH (percent)	0.73	6.64	6.60	0.76	6.84	6.79
PWV (mm)	-0.20	1.00	0.99	-0.35	1.00	0.94
SEE (arcsec)	-0.02	0.23	0.23	-0.02	0.22	0.21
TAU (ms)	-0.06	2.19	2.19	-0.63	2.32	2.24
GLF (dimensionless)	-0.03	0.19	0.18	-0.01	0.16	0.16

Table 94: Statistics for variables in standard configuration: incremental month (i.e., since the beginning of service) *vs* last month (July-2023)

6.3 Title for Contingency tables of Day 3

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

wind speed ms^{-1}		Observations		
		ws < 4.2	4.2 < ws < 7.5	ws > 7.5
Model data	ws < 4.2	4541	2127	249
	4.2 < ws < 7.5	3034	3970	1347
	ws > 7.5	430	1908	6408
Sample size: 38880; PC=62.1%; EBD=2.8%; POD1=56.7%; POD2=49.6%; POD3=80.1%				

Table 95: Contingency table for wind speed (ms^{-1}) in standard configuration

wind direction		Observations			
degree		North	East	South	West
Model data	North	9401	1028	107	229
	East	1002	1832	560	0
	South	99	508	3567	195
	West	202	89	63	199
Sample size: 38880; PC=78.6%; EBD=1.5%; POD1=87.8%; POD2=53.0%; POD3=83.0%; POD4=31.9%					

Table 96: Contingency table for wind direction (degree) in standard configuration

relative humidity percent	Observations		
	rh < 7.1	7.1 < rh < 15.3	rh > 15.3
Model data	rh < 7.1	4755	1095
	7.1 < rh < 15.3	2696	5193
	rh > 15.3	379	1539
Sample size: 38232; PC=69.8%; EBD=1.7%; POD1=60.7%; POD2=66.3%; POD3=82.3%			

Table 97: Contingency table for variable relative humidity (percent) in standard configuration

precipitable water vapor mm	Observations		
	pwv < 1.9	1.9 < pwv < 3.5	pwv > 3.5
Model data	pwv < 1.9	3402	854
	1.9 < pwv < 3.5	443	2596
	pwv > 3.5	5	400
Sample size: 18900; PC=80.3%; EBD=0.1%; POD1=88.4%; POD2=67.4%; POD3=85.0%			

Table 98: Contingency table for variable precipitable water vapor (mm) in standard configuration

6.4 Title for PODs tables of Day 3

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

PARAMETER	STANDARD	WITH AR (1H)
POD1	56.7	92.2
POD2	49.6	86.8
POD3	80.1	95.2
PC	62.1	91.4
EBD	2.8	0.0

Table 99: PODs for wind speed (ms^{-1})

PARAMETER	STANDARD	WITH AR (1H)
POD1	87.8	97.7
POD2	53.0	91.1
POD3	83.0	98.6
POD4	31.9	89.6
PC	78.6	96.4
EBD	1.5	0.0

Table 100: PODs for wind direction (degree)

FATE - Monthly Report

PARAMETER	STANDARD	WITH AR (1H)
POD1	60.7	94.6
POD2	66.3	93.2
POD3	82.3	96.8
PC	69.8	94.9
EBD	1.7	0.0

Table 101: PODs for relative humidity (percent)

PARAMETER	STANDARD	WITH AR (1H)
POD1	88.4	98.3
POD2	67.4	97.0
POD3	85.0	99.0
PC	80.3	98.1
EBD	0.1	0.0

Table 102: PODs for precipitable water vapor (mm)