



FATE MONTHLY REPORT

Doc.No : FATE-001
Version : 1.0
Date : 12-10-2023



FORECAST SYSTEM FOR ATMOSPHERE AND TURBULENCE at the VERY LARGE TELESCOPE

Performance assessment
October 2023



PO102958/ESO/20/95952/FLAB

Contents

1	Title for Night 1	2
1.1	Title for Figures of Night 1	3
1.2	Title for Statistics of Night 1	7
1.3	Title for Contingency tables of Night 1	9
1.4	Title for PODs tables of Night 1	18
2	Title for Day 1	21
2.1	Title for Figures of Day 1	22
2.2	Title for Statistics of Day 1	25
2.3	Title for Contingency tables of Day 1	26
2.4	Title for PODs tables of Day 1	28

1 Title for Night 1

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

1.1 Title for Figures of Night 1

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

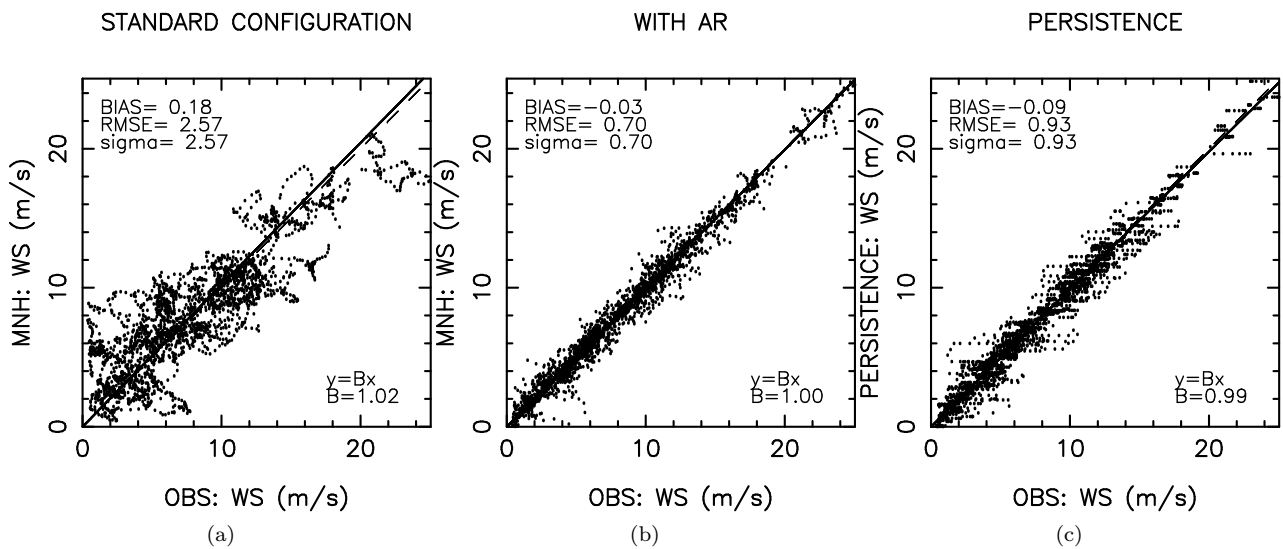


Figure 1: wind speed (ms^{-1}): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

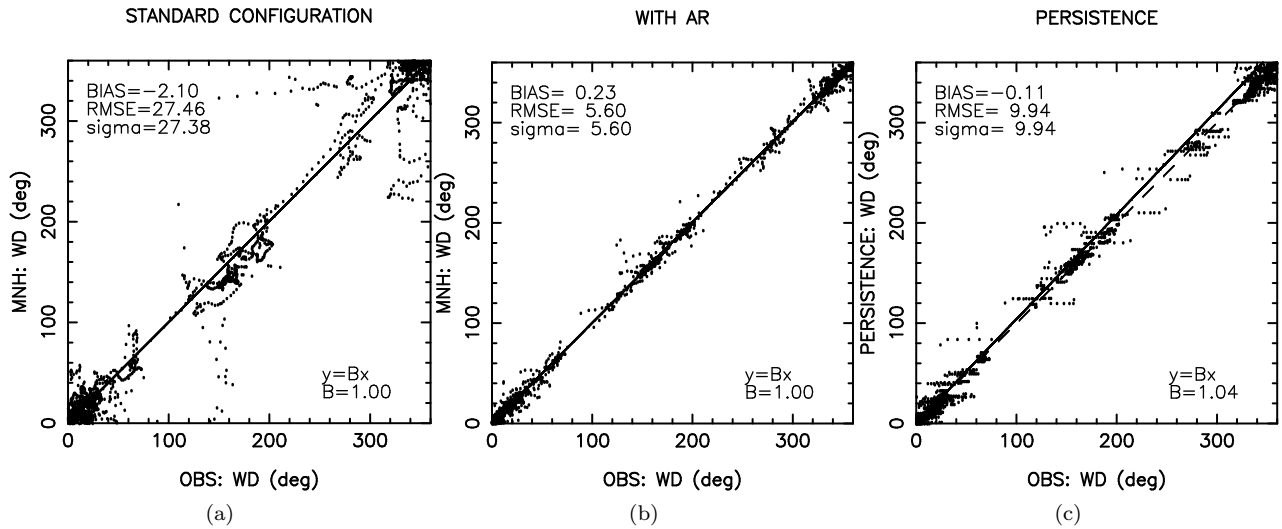


Figure 2: wind direction (degree): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

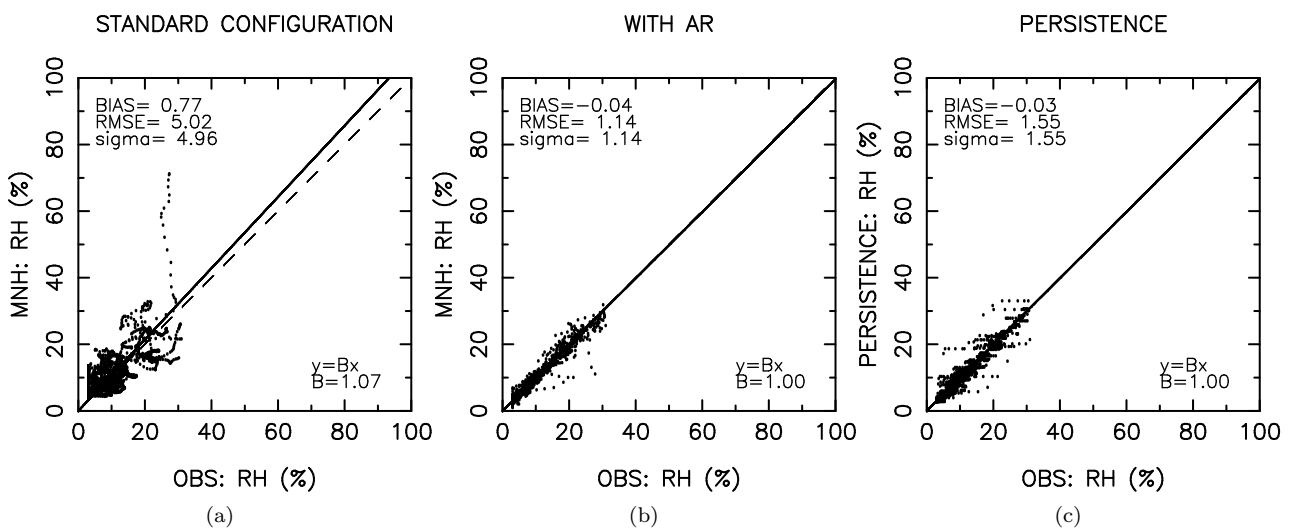


Figure 3: relative humidity (percent): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

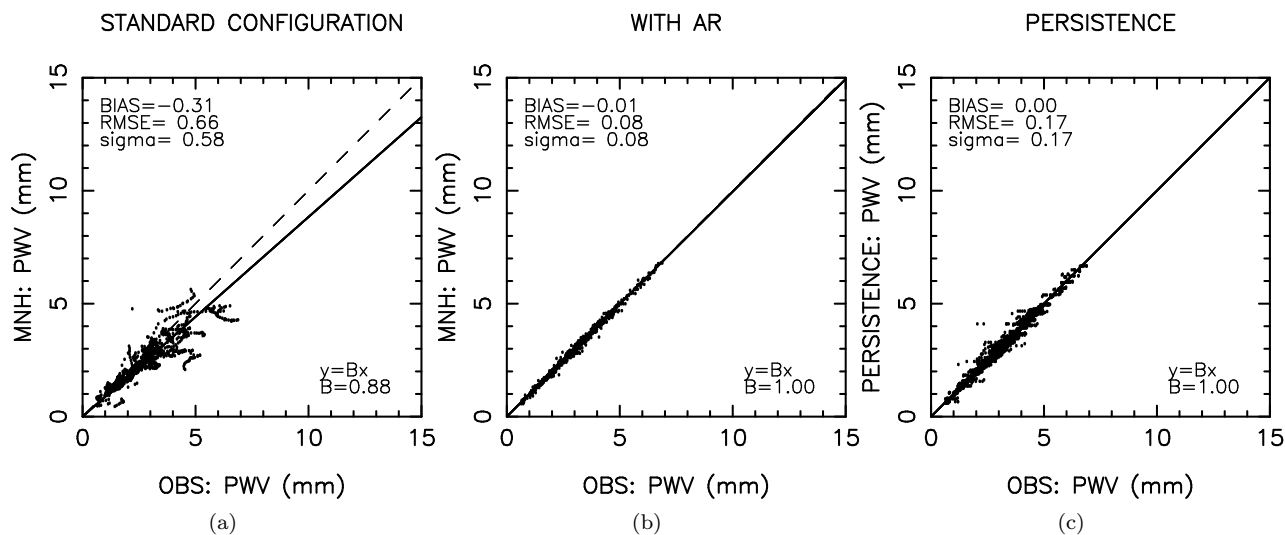


Figure 4: precipitable water vapor (mm): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

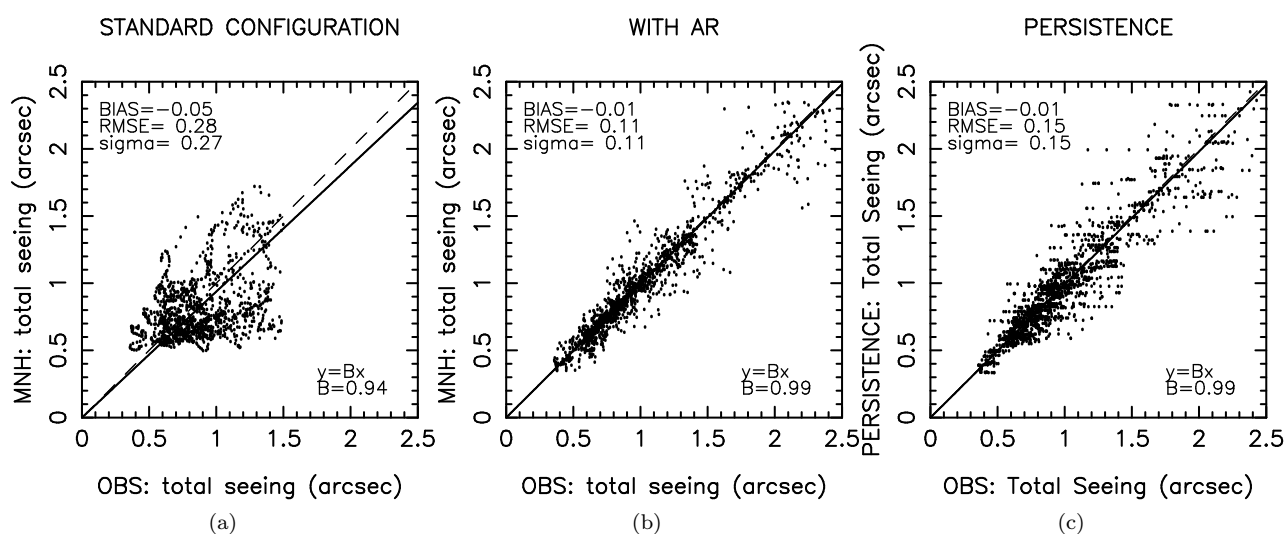


Figure 5: total seeing (arcsec): (a) STANDARD CONFIGURATION (< 1.5"), (b) WITH AR (1H), (c) PERSISTENCE (1H).

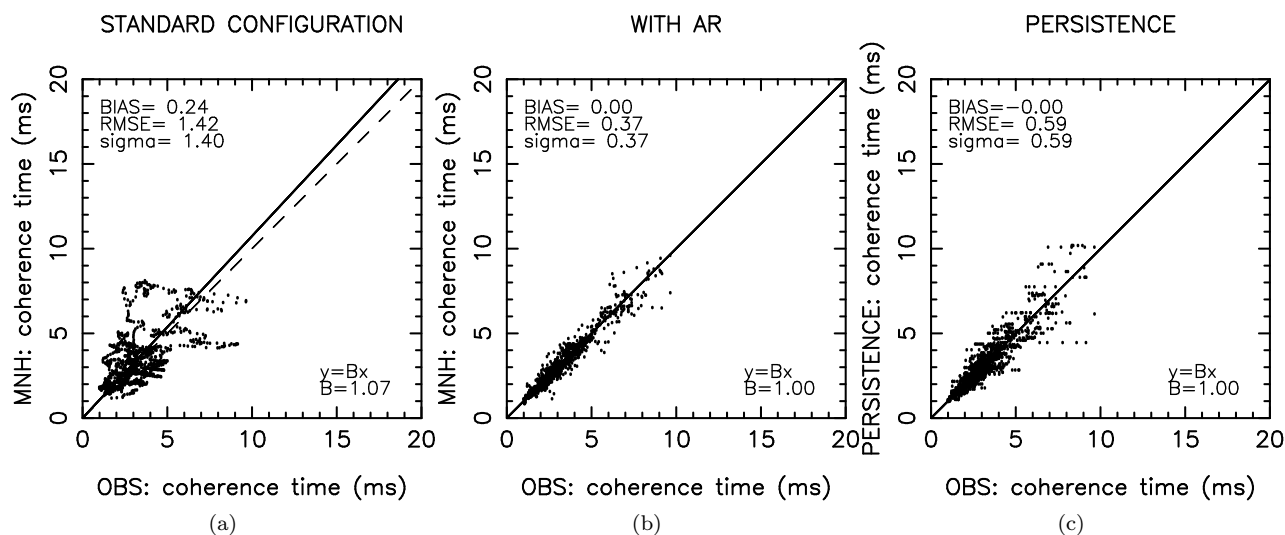


Figure 6: coherence time (ms): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

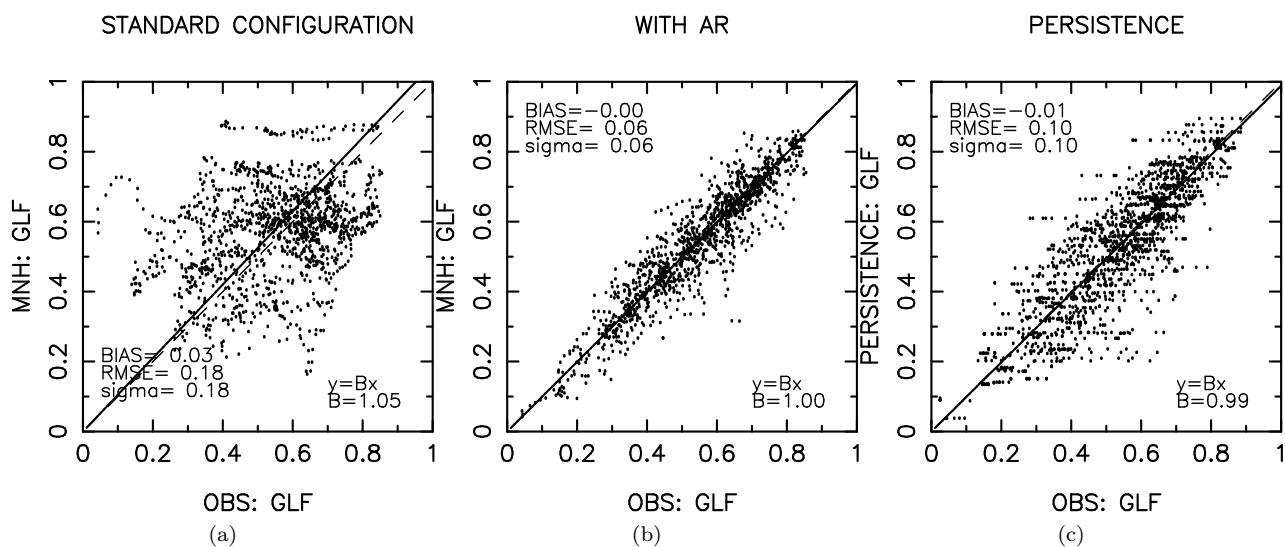


Figure 7: ground layer fraction (dimensionless): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H)

1.2 Title for Statistics of Night 1

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

VARIABLE	BIAS (inc. month)	RMSE (inc. month)	SD (inc. month)	BIAS (last month)	RMSE (last month)	SD (last month)
WS (m·s ⁻¹)	0.18	2.57	2.57	0.53	2.60	2.55
WD (degree)	-2.10	27.46	27.38	-4.47	30.39	30.06
RH (percent)	0.77	5.02	4.96	0.82	4.94	4.87
PWV (mm)	-0.31	0.66	0.58	-0.28	0.59	0.52
SEE (arcsec)	-0.05	0.28	0.27	-0.10	0.27	0.25
TAU (ms)	0.24	1.42	1.40	0.41	1.51	1.45
GLF (dimensionless)	0.03	0.18	0.18	0.04	0.19	0.18

Table 1: Statistics for variables in standard configuration: incremental month (i.e., since the beginning of service) *vs* last month (September-2023)

FATE - Monthly Report

VARIABLE	BIAS AR (1H)	RMSE AR (1H)	SD AR (1H)		RMSE persistence (1H)	SD persistence (1H)
WS ($m \cdot s^{-1}$)	-0.01	0.72	0.72		0.96	0.95
WD (degree)	0.35	6.18	6.17		10.88	10.88
RH (percent)	-0.03	1.09	1.09		1.54	1.54
PWV (mm)	-0.01	0.08	0.08		0.17	0.17
SEE (arcsec)	-0.01	0.12	0.12		0.15	0.15
TAU (ms)	0.01	0.39	0.39		0.63	0.63
GLF (dimensionless)	-0.00	0.06	0.06		0.10	0.10

Table 2: Last month (September-2023): statistics for variables with AR (1H) *vs* persistence (1H)

VARIABLE	BIAS AR (1H)	RMSE AR (1H)	SD AR (1H)		RMSE persistence (1H)	SD persistence (1H)
WS ($m \cdot s^{-1}$)	-0.03	0.70	0.70		0.93	0.93
WD (degree)	0.23	5.60	5.60		9.94	9.94
RH (percent)	-0.04	1.14	1.14		1.55	1.55
PWV (mm)	-0.01	0.08	0.08		0.17	0.17
SEE (arcsec)	-0.01	0.11	0.11		0.15	0.15
TAU (ms)	0.00	0.37	0.37		0.59	0.59
GLF (dimensionless)	-0.00	0.06	0.06		0.10	0.10

Table 3: Incremental month (i.e., since the beginning of service): statistics for variables with AR (1H) *vs* persistence (1H)

1.3 Title for Contingency tables of Night 1

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

wind speed ms^{-1}	Observations		
	ws < 5.3	5.3 < ws < 10.1	ws > 10.1
Model data	ws < 5.3	501	80
	5.3 < ws < 10.1	319	617
	ws > 10.1	6	129
Sample size: 3996; PC=69.8%; EBD=0.2%; POD1=60.7%; POD2=74.7%; POD3=74.1%			

Table 4: Contingency table for wind speed (ms^{-1}) in standard configuration

wind speed ms^{-1}	Observations		
	ws < 5.3	5.3 < ws < 10.1	ws > 10.1
Model data	ws < 5.3	778	45
	5.3 < ws < 10.1	48	743
	ws > 10.1	0	38
Sample size: 3996; PC=92.7%; EBD=0.0%; POD1=94.2%; POD2=90.0%; POD3=93.9%			

Table 5: Contingency table for variable wind speed (ms^{-1}) processed with AR (1H)

FATE - Monthly Report

wind direction degree		North	East	South	Observations	West
Model data	North	1371	35	14		45
	East	25	90	34		0
	South	5	15	345		0
	West	45	2	1		60

Sample size: 3996; PC=89.4%; EBD=1.0%; POD1=94.8%; POD2=63.4%; POD3=87.6%; POD4=57.1%

Table 6: Contingency table for wind direction (degree) in standard configuration

wind direction degree		North	East	South	Observations	West
Model data	North	1437	17	0		3
	East	5	116	3		0
	South	0	9	389		0
	West	4	0	2		102

Sample size: 3996; PC=97.9%; EBD=0.0%; POD1=99.4%; POD2=81.7%; POD3=98.7%; POD4=97.1%

Table 7: Contingency table for wind direction (degree) in standard configuration

FATE - Monthly Report

relative humidity percent		Observations		
		rh < 7.9	7.9 < rh < 11.2	rh > 11.2
Model data	rh < 7.9	466	286	49
	7.9 < rh < 11.2	198	330	171
	rh > 11.2	148	196	592
Sample size: 3996; PC=57.0%; EBD=8.1%; POD1=57.4%; POD2=40.6%; POD3=72.9%				

Table 8: Contingency table for variable relative humidity (percent) in standard configuration

relative humidity percent		Observations		
		rh < 7.9	7.9 < rh < 11.2	rh > 11.2
Model data	rh < 7.9	774	40	2
	7.9 < rh < 11.2	38	728	43
	rh > 11.2	0	44	767
Sample size: 3996; PC=93.1%; EBD=0.1%; POD1=95.3%; POD2=89.7%; POD3=94.5%				

Table 9: Contingency table for variable relative humidity (percent) processed with AR (1H)

precipitable water vapor mm		Observations		
		pwv < 1.9	1.9 < pwv < 3.1	pwv > 3.1
Model data	pwv < 1.9	379	66	0
	1.9 < pwv < 3.1	10	306	141
	pwv > 3.1	0	17	248
Sample size: 1998; PC=79.9%; EBD=0.0%; POD1=97.4%; POD2=78.7%; POD3=63.8%				

Table 10: Contingency table for variable precipitable water vapor (mm) in standard configuration

precipitable water vapor mm		Observations		
		pwv < 1.9	1.9 < pwv < 3.1	pwv > 3.1
Model data	pwv < 1.9	386	11	0
	1.9 < pwv < 3.1	3	371	14
	pwv > 3.1	0	7	375
Sample size: 1998; PC=97.0%; EBD=0.0%; POD1=99.2%; POD2=95.4%; POD3=96.4%				

Table 11: Contingency table for variable precipitable water vapor (mm) processed with AR (1H)

FATE - Monthly Report

total seeing arcsec		Observations		
		see < 0.7	0.7 < see < 1.0	see > 1.0
Model data	see < 0.7	221	203	98
	0.7 < see < 1.0	137	141	151
	see > 1.0	42	56	151
Sample size: 3024; PC=42.8%; EBD=11.7%; POD1=55.2%; POD2=35.2%; POD3=37.8%				

Table 12: Contingency table for variable total seeing (arcsec) in standard configuration and accuracy 0.0

total seeing arcsec		Observations		
		see < 0.7	0.7 < see < 1.0	see > 1.0
Model data	see < 0.7	425	44	1
	0.7 < see < 1.0	35	374	37
	see > 1.0	1	43	422
Sample size: 3024; PC=88.4%; EBD=0.1%; POD1=92.2%; POD2=81.1%; POD3=91.7%				

Table 13: Contingency table for variable total seeing (arcsec) processed with AR (1H) and accuracy 0.0

total seeing		Observations		
arcsec		see < 0.7	0.7 < see < 1.0	see > 1.0
Model data	see < 0.7	425	44	1
	0.7 < see < 1.0	35	374	37
	see > 1.0	1	43	422
Sample size: 3024; PC=88.4%; EBD=0.1%; POD1=92.2%; POD2=81.1%; POD3=91.7%				

Table 14: Contingency table for variable total seeing (arcsec) processed with AR (1H) and accuracy 0.0

total seeing arcsec		Observations		
		see < 0.7	0.7 < see < 1.0	see > 1.0
Model data	see < 0.7	362	0	92
	0.7 < see < 1.0	0	391	92
	see > 1.0	38	9	308
Sample size: 3024; PC=88.4%; EBD=10.8%; POD1=90.5%; POD2=97.8%; POD3=62.6%				

Table 15: Contingency table for variable total seeing (arcsec) in standard configuration and accuracy 0.24

total seeing		Observations		
arcsec		see < 0.7	0.7 < see < 1.0	see > 1.0
Model data	see < 0.7	459	0	3
	0.7 < see < 1.0	1	456	3
	see > 1.0	1	5	457
Sample size: 3024; PC=99.3%; EBD=0.3%; POD1=99.6%; POD2=98.9%; POD3=98.7%				

Table 16: Contingency table for variable total seeing (arcsec) processed with AR (1H) and accuracy 0.24

total seeing		Observations		
arcsec		see < 0.7	0.7 < see < 1.0	see > 1.0
Model data	see < 0.7	459	0	3
	0.7 < see < 1.0	1	456	3
	see > 1.0	1	5	457
Sample size: 3024; PC=99.3%; EBD=0.3%; POD1=99.6%; POD2=98.9%; POD3=98.7%				

Table 17: Contingency table for variable total seeing (arcsec) processed with AR (1H) and accuracy 0.24

FATE - Monthly Report

coherence time		Observations		
ms		$\tau < 2.4$	$2.4 < \tau < 3.5$	$\tau > 3.5$
Model data	$\tau < 2.4$	266	88	12
	$2.4 < \tau < 3.5$	94	185	132
	$\tau > 3.5$	66	153	282
Sample size: 3024; PC=57.4%; EBD=6.1%; POD1=62.4%; POD2=43.4%; POD3=66.2%				

Table 18: Contingency table for variable coherence time (ms) in standard configuration and accuracy 0.0

coherence time		Observations		
ms		$\tau < 2.4$	$2.4 < \tau < 3.5$	$\tau > 3.5$
Model data	$\tau < 2.4$	392	28	0
	$2.4 < \tau < 3.5$	33	375	28
	$\tau > 3.5$	1	23	398
Sample size: 3024; PC=91.2%; EBD=0.1%; POD1=92.0%; POD2=88.0%; POD3=93.4%				

Table 19: Contingency table for variable coherence time (ms) processed with AR (1H) and accuracy 0.0

coherence time		Observations		
ms		$\tau < 2.4$	$2.4 < \tau < 3.5$	$\tau > 3.5$
Model data	$\tau < 2.4$	392	28	0
	$2.4 < \tau < 3.5$	33	375	28
	$\tau > 3.5$	1	23	398
Sample size: 3024; PC=91.2%; EBD=0.1%; POD1=92.0%; POD2=88.0%; POD3=93.4%				

Table 20: Contingency table for variable coherence time (ms) processed with AR (1H) and accuracy 0.0

coherence time		Observations		
ms		$\tau < 2.4$	$2.4 < \tau < 3.5$	$\tau > 3.5$
Model data	$\tau < 2.4$	370	0	12
	$2.4 < \tau < 3.5$	0	378	12
	$\tau > 3.5$	56	48	414
Sample size: 3024; PC=90.9%; EBD=5.3%; POD1=86.9%; POD2=88.7%; POD3=94.5%				

Table 21: Contingency table for variable coherence time (ms) in standard configuration and accuracy 1.22

coherence time		Observations		
ms		$\tau < 2.4$	$2.4 < \tau < 3.5$	$\tau > 3.5$
Model data	$\tau < 2.4$	425	0	0
	$2.4 < \tau < 3.5$	0	426	0
	$\tau > 3.5$	1	0	426
Sample size: 3024; PC=99.9%; EBD=0.1%; POD1=99.8%; POD2=100.0%; POD3=100.0%				

Table 22: Contingency table for variable coherence time (ms) processed with AR (1H) and accuracy 1.22

FATE - Monthly Report

coherence time		Observations		
ms		$\tau < 2.4$	$2.4 < \tau < 3.5$	$\tau > 3.5$
Model data	$\tau < 2.4$	425	0	0
	$2.4 < \tau < 3.5$	0	426	0
	$\tau > 3.5$	1	0	426
Sample size: 3024; PC=99.9%; EBD=0.1%; POD1=99.8%; POD2=100.0%; POD3=100.0%				

Table 23: Contingency table for variable coherence time (ms) processed with AR (1H) and accuracy 1.22

FATE - Monthly Report

ground layer fraction dimensionless		Observations		
		glf < 0.5	0.5 < glf < 0.6	glf > 0.6
Model data	glf < 0.5	182	76	48
	0.5 < glf < 0.6	157	209	234
	glf > 0.6	92	146	149
Sample size: 3024; PC=41.8%; EBD=10.8%; POD1=42.2%; POD2=48.5%; POD3=34.6%				

Table 24: Contingency table for variable ground layer fraction (dimensionless) in standard configuration and accuracy 0.0

ground layer fraction dimensionless		Observations		
		glf < 0.5	0.5 < glf < 0.6	glf > 0.6
Model data	glf < 0.5	375	55	3
	0.5 < glf < 0.6	55	309	69
	glf > 0.6	1	67	359
Sample size: 3024; PC=80.7%; EBD=0.3%; POD1=87.0%; POD2=71.7%; POD3=83.3%				

Table 25: Contingency table for variable ground layer fraction (dimensionless) processed with AR (1H) and accuracy 0.0

ground layer fraction dimensionless		Observations		
		glf < 0.5	0.5 < glf < 0.6	glf > 0.6
Model data	glf < 0.5	375	55	3
	0.5 < glf < 0.6	55	309	69
	glf > 0.6	1	67	359
Sample size: 3024; PC=80.7%; EBD=0.3%; POD1=87.0%; POD2=71.7%; POD3=83.3%				

Table 26: Contingency table for variable ground layer fraction (dimensionless) processed with AR (1H) and accuracy 0.0

ground layer fraction dimensionless		Observations		
		glf < 0.5	0.5 < glf < 0.6	glf > 0.6
Model data	glf < 0.5	319	17	67
	0.5 < glf < 0.6	20	393	54
	glf > 0.6	92	21	364
Sample size: 3024; PC=83.2%; EBD=12.3%; POD1=74.0%; POD2=91.2%; POD3=75.1%				

Table 27: Contingency table for variable ground layer fraction (dimensionless) in standard configuration and accuracy 0.14

ground layer fraction dimensionless		Observations		
		glf < 0.5	0.5 < glf < 0.6	glf > 0.6
Model data	glf < 0.5	427	3	5
	0.5 < glf < 0.6	3	427	3
	glf > 0.6	1	1	426
Sample size: 3024; PC=99.0%; EBD=0.5%; POD1=99.1%; POD2=99.1%; POD3=98.2%				

Table 28: Contingency table for variable ground layer fraction (dimensionless) processed with AR (1H) and accuracy 0.14

FATE - Monthly Report

ground layer fraction dimensionless	Observations		
	glf < 0.5	0.5 < glf < 0.6	glf > 0.6
Model data	glf < 0.5	427	3
	0.5 < glf < 0.6	3	427
	glf > 0.6	1	1
Sample size: 3024; PC=99.0%; EBD=0.5%; POD1=99.1%; POD2=99.1%; POD3=98.2%			

Table 29: Contingency table for variable ground layer fraction (dimensionless) processed with AR (1H) and accuracy 0.14

1.4 Title for PODs tables of Night 1

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

PARAMETER	STANDARD	WITH AR (1H)
POD1	60.7	94.2
POD2	74.7	90.0
POD3	74.1	93.9
PC	69.8	92.7
EBD	0.2	0.0

Table 30: PODs for wind speed (ms^{-1})

PARAMETER	STANDARD	WITH AR (1H)
POD1	94.8	99.4
POD2	63.4	81.7
POD3	87.6	98.7
POD4	57.1	97.1
PC	89.4	97.9
EBD	1.0	0.0

Table 31: PODs for wind direction (degree)

FATE - Monthly Report

PARAMETER	STANDARD	WITH AR (1H)
POD1	57.4	95.3
POD2	40.6	89.7
POD3	72.9	94.5
PC	57.0	93.1
EBD	8.1	0.1

Table 32: PODs for relative humidity (percent)

PARAMETER	STANDARD	WITH AR (1H)
POD1	97.4	99.2
POD2	78.7	95.4
POD3	63.8	96.4
PC	79.9	97.0
EBD	0.0	0.0

Table 33: PODs for precipitable water vapor (mm)

PARAMETER	STANDARD	WITH AR (1H)
POD1	55.2	92.2
POD2	35.2	81.1
POD3	37.8	91.7
PC	42.8	88.4
EBD	11.7	0.1

Table 34: PODs for total seeing (arcsec) and accuray 0.0

PARAMETER	STANDARD	WITH AR (1H)
POD1	90.5	99.6
POD2	97.8	98.9
POD3	62.6	98.7
PC	88.4	99.3
EBD	10.8	0.3

Table 35: PODs for total seeing (arcsec) and accuray 0.24

PARAMETER	STANDARD	WITH AR (1H)
POD1	62.4	92.0
POD2	43.4	88.0
POD3	66.2	93.4
PC	57.4	91.2
EBD	6.1	0.1

Table 36: PODs for coherence time (ms) and accuray 0.0

FATE - Monthly Report

PARAMETER	STANDARD	WITH AR (1H)
POD1	86.9	99.8
POD2	88.7	100.0
POD3	94.5	100.0
PC	90.9	99.9
EBD	5.3	0.1

Table 37: PODs for coherence time (ms) and accuray 1.22

PARAMETER	STANDARD	WITH AR (1H)
POD1	42.2	87.0
POD2	48.5	71.7
POD3	34.6	83.3
PC	41.8	80.7
EBD	10.8	0.3

Table 38: PODs for ground layer fraction (dimensionless) and accuray 0.0

PARAMETER	STANDARD	WITH AR (1H)
POD1	74.0	99.1
POD2	91.2	99.1
POD3	75.1	98.2
PC	83.2	99.0
EBD	12.3	0.5

Table 39: PODs for ground layer fraction (dimensionless) and accuray 0.14

2 Title for Day 1

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

2.1 Title for Figures of Day 1

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

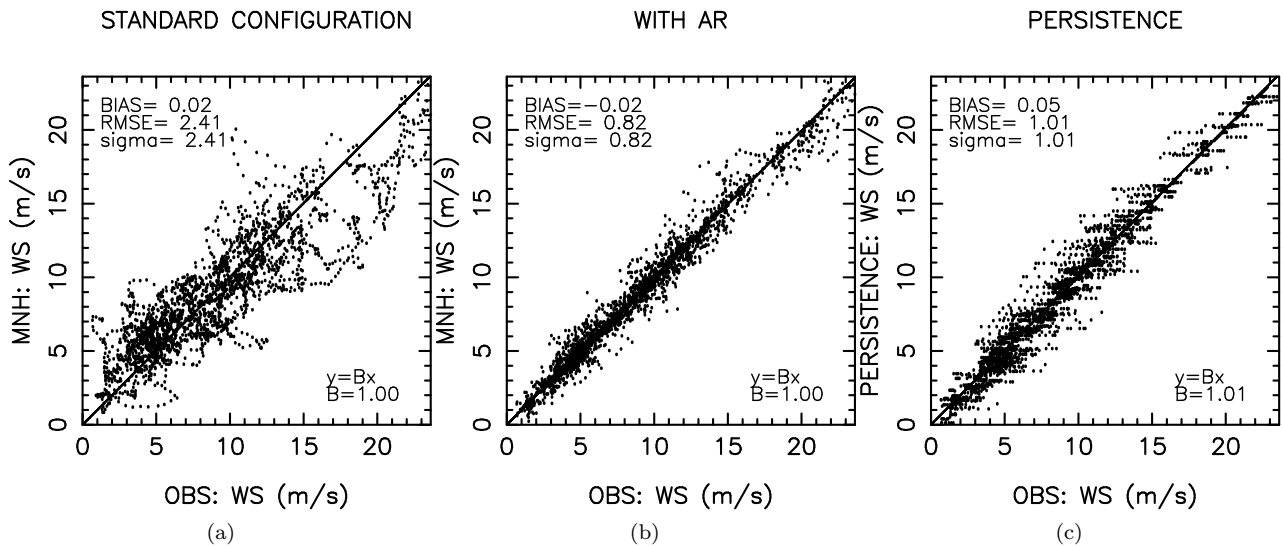


Figure 8: wind speed (ms^{-1}): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

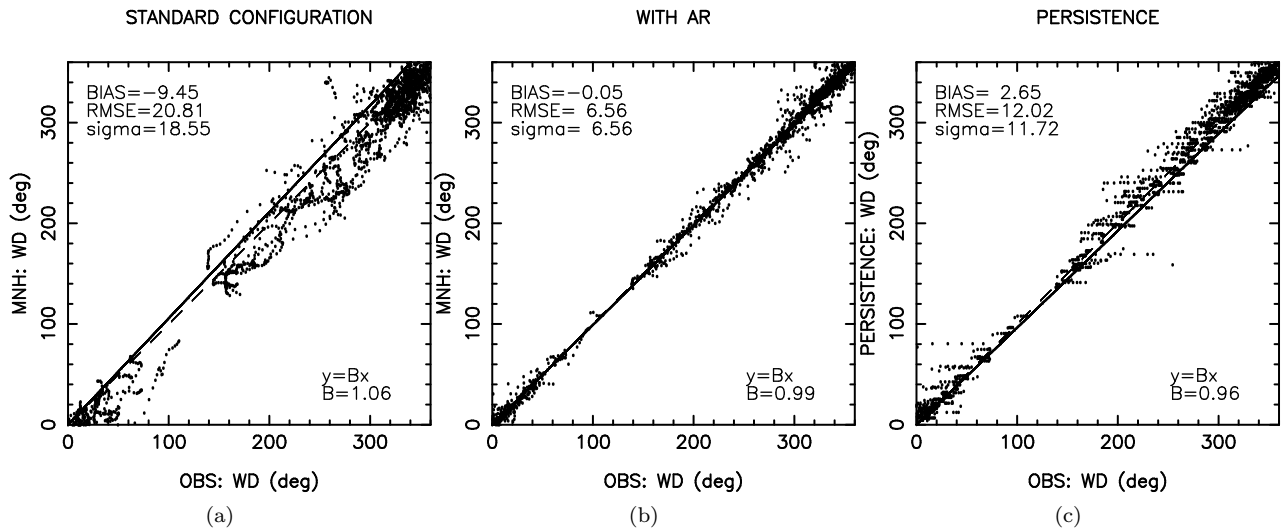


Figure 9: wind direction (degree): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

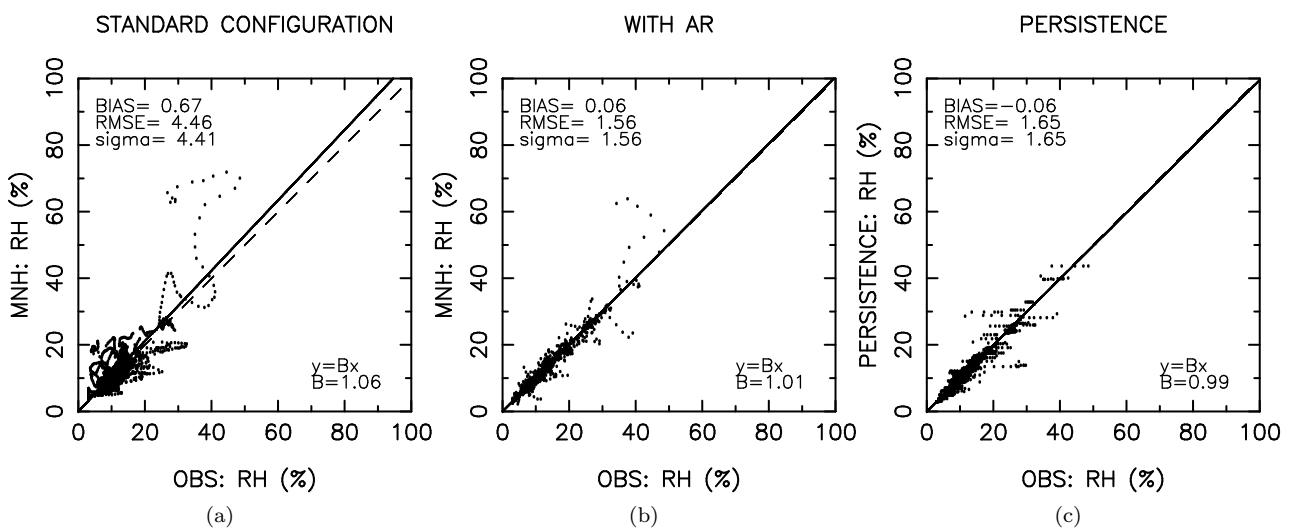


Figure 10: relative humidity (percent): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

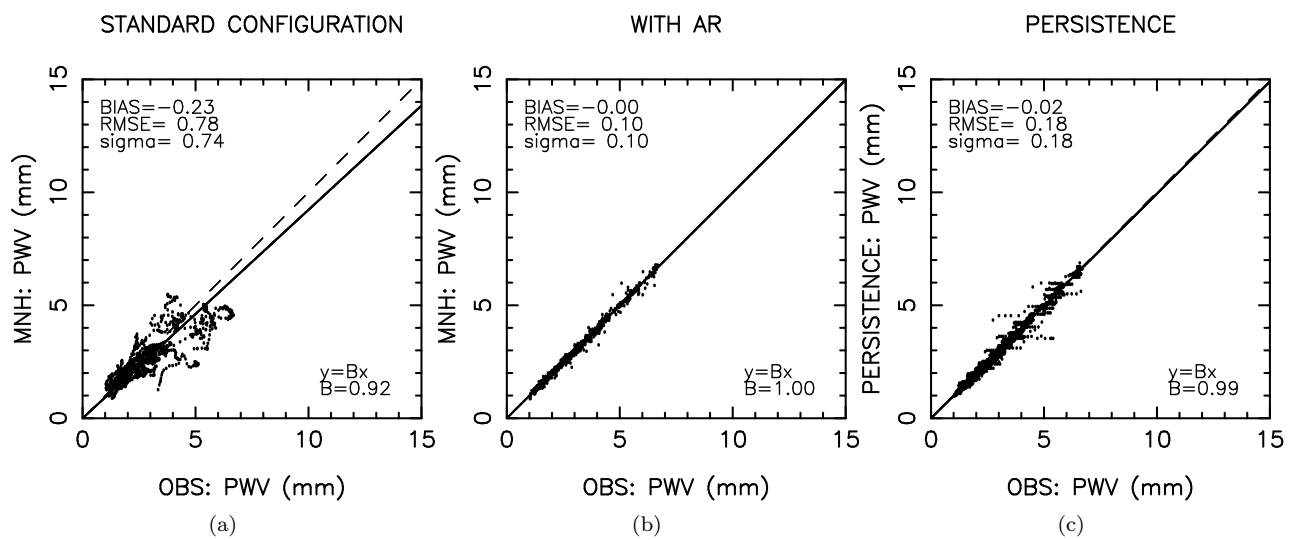


Figure 11: precipitable water vapor (mm): (a) STANDARD CONFIGURATION, (b) WITH AR (1H), (c) PERSISTENCE (1H).

2.2 Title for Statistics of Day 1

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

VARIABLE	BIAS (inc. month)	RMSE (inc. month)	SD (inc. month)	BIAS (last month)	RMSE (last month)	SD (last month)
WS ($\text{m}\cdot\text{s}^{-1}$)	0.02	2.41	2.41	0.27	2.34	2.33
WD (degree)	-9.45	20.81	18.55	-11.26	22.69	19.71
RH (percent)	0.67	4.46	4.41	0.65	4.33	4.28
PWV (mm)	-0.23	0.78	0.74	-0.17	0.63	0.61
SEE (arcsec)	SEEBIAS	SEERMSE	SEESD	SEEbiasLM	SEErmsLM	SEEsdlm
TAU (ms)	TAUBIAS	TAURMSE	TAUSD	TAUbiasLM	TAUrmseLM	TAUsdlm
GLF (dimensionless)	GLFBIAS	GLFRMSE	GLFSD	GLFbiasLM	GLFrmseLM	GLFsdlm

Table 40: Statistics for variables in standard configuration: incremental month (i.e., since the beginning of service) *vs* last month (September-2023)

2.3 Title for Contingency tables of Day 1

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

wind speed ms^{-1}	Observations		
	ws < 5.7	5.7 < ws < 10.5	ws > 10.5
Model data	ws < 5.7	430	63
	5.7 < ws < 10.5	370	638
	ws > 10.5	0	98
Sample size: 3996; PC=70.5%; EBD=0.3%; POD1=53.8%; POD2=79.8%; POD3=77.8%			

Table 41: Contingency table for wind speed (ms^{-1}) in standard configuration

wind direction degree	Observations			
	North	East	South	West
Model data	North	1202	38	0
	East	1	42	8
	South	0	0	251
	West	196	0	10
Sample size: 3996; PC=83.4%; EBD=0.0%; POD1=85.9%; POD2=52.5%; POD3=93.3%; POD4=75.6%				

Table 42: Contingency table for wind direction (degree) in standard configuration

relative humidity percent	Observations		
	rh < 8.9	8.9 < rh < 12.0	rh > 12.0
Model data	rh < 8.9	479	255
	8.9 < rh < 12.0	223	333
	rh > 12.0	97	210
Sample size: 3996; PC=59.1%; EBD=4.5%; POD1=59.9%; POD2=41.7%; POD3=75.7%			

Table 43: Contingency table for variable relative humidity (percent) in standard configuration

precipitable water vapor mm	Observations		
	pwv < 2.1	2.1 < pwv < 3.2	pwv > 3.2
Model data	pwv < 2.1	330	61
	2.1 < pwv < 3.2	51	278
	pwv > 3.2	0	42
Sample size: 1998; PC=76.4%; EBD=0.7%; POD1=86.6%; POD2=73.0%; POD3=69.5%			

Table 44: Contingency table for variable precipitable water vapor (mm) in standard configuration

2.4 Title for PODs tables of Day 1

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

Lorem ipsum dolor sit amet, consectetur adipiscing elit. Etiam lobortis facilisis sem. Nullam nec mi et neque pharetra sollicitudin. Praesent imperdiet mi nec ante. Donec ullamcorper, felis non sodales commodo, lectus velit ultrices augue, a dignissim nibh lectus placerat pede. Vivamus nunc nunc, molestie ut, ultricies vel, semper in, velit. Ut porttitor. Praesent in sapien. Lorem ipsum dolor sit amet, consectetur adipiscing elit. Duis fringilla tristique neque. Sed interdum libero ut metus. Pellentesque placerat. Nam rutrum augue a leo. Morbi sed elit sit amet ante lobortis sollicitudin. Praesent blandit blandit mauris. Praesent lectus tellus, aliquet aliquam, luctus a, egestas a, turpis. Mauris lacinia lorem sit amet ipsum. Nunc quis urna dictum turpis accumsan semper.

PARAMETER	STANDARD	WITH AR (1H)
POD1	53.8	91.9
POD2	79.8	90.4
POD3	77.8	93.0
PC	70.5	91.7
EBD	0.3	0.0

Table 45: PODs for wind speed (ms^{-1})

PARAMETER	STANDARD	WITH AR (1H)
POD1	85.9	96.2
POD2	52.5	92.5
POD3	93.3	97.8
POD4	75.6	91.1
PC	83.4	95.2
EBD	0.0	0.0

Table 46: PODs for wind direction (degree)

FATE - Monthly Report

PARAMETER	STANDARD	WITH AR (1H)
POD1	59.9	91.0
POD2	41.7	88.8
POD3	75.7	95.5
PC	59.1	91.8
EBD	4.5	0.0

Table 47: PODs for relative humidity (percent)

PARAMETER	STANDARD	WITH AR (1H)
POD1	86.6	96.3
POD2	73.0	95.3
POD3	69.5	96.6
PC	76.4	96.1
EBD	0.7	0.0

Table 48: PODs for precipitable water vapor (mm)