
Town of Ladysmith - Arbutus Water treatment Plant

December 2025 - Monthly Report

Date	Daily Flow			Chlorine Residual				CT*	External Lab Testing					
	Stocking Lake	Holland Creek	Combined Flow	Free Min	Free Max	Free Avg	Total		HPC	E.coli	Total Coliforms	Aluminum	THM	HAA
	m³	m³	m³	mg/l	mg/l	mg/l	mg/l	Minutes·mg/l	CFU	MPN	MPN	mg/l	mg/l	mg/l
01-Dec	3594	0	3594	0.94	0.97	0.96	1.04	145						
02-Dec	3352	0	3352	0.94	0.96	0.95	1.10	142						
03-Dec	3299	0	3299	0.94	0.96	0.94	1.06	137	< 1	< 1	< 1			
04-Dec	3349	0	3349	0.96	0.98	0.96	1.18	143						
05-Dec	3176	0	3176	0.96	0.98	0.97	1.05	141						
06-Dec	3264	0	3264	0.95	0.97	0.96	1.02	139						
07-Dec	3280	0	3280	0.94	0.97	0.96	1.04	138						
08-Dec	3287	0	3287	0.94	0.96	0.95	1.06	139						
09-Dec	3468	0	3468	0.94	0.96	0.96	1.13	134						
10-Dec	3241	0	3241	0.93	0.96	0.94	1.04	138	< 1	< 1	< 1	0.0092	0.0158	0.0097
11-Dec	3649	0	3649	0.91	1.02	1.02	1.04	170						
12-Dec	3162	0	3162	1.01	1.03	1.02	1.13	140						
13-Dec	3211	0	3211	1.00	1.02	1.00	1.17	134						
14-Dec	3275	0	3275	0.97	1.00	0.97	1.06	128						
15-Dec	3223	0	3223	0.95	0.97	0.96	1.10	138						
16-Dec	3193	0	3193	0.94	0.96	0.95	1.04	134	< 1	< 1	< 1			
17-Dec	3228	0	3228	0.93	0.96	0.95	1.05	140						
18-Dec	3179	0	3179	0.93	0.96	0.95	1.05	131						
19-Dec	3214	0	3214	0.94	0.96	0.95	1.07	128						
20-Dec	3232	0	3232	0.94	0.96	0.95	1.08	125						
21-Dec	3241	0	3241	0.94	0.96	0.95	1.08	155						
22-Dec	3521	0	3521	0.94	0.96	0.96	1.07	124						
23-Dec	3574	0	3574	0.95	0.97	0.96	1.08	124	< 1	< 1	< 1			
24-Dec	3350	0	3350	0.95	0.97	0.96	1.07	129						
25-Dec	3156	0	3156	0.94	0.96	0.95	1.09	122						
26-Dec	3202	0	3202	0.93	0.95	0.95	1.07	131						
27-Dec	3261	0	3261	0.92	0.95	0.94	1.09	122						
28-Dec	3264	0	3264	0.93	0.95	0.94	1.05	116						
29-Dec	3266	0	3266	0.93	0.95	0.94	1.01	117						
30-Dec	3235	0	3235	0.92	0.94	0.93	1.07	160						
31-Dec	3250	0	3250	0.93	0.96	0.95	1.04	163						
Total	102196	0	102196											
Average	3297	0	3297	0.94	0.97	0.96	1.07	136	< 1	< 1	< 1	0.0092	0.0158	0.00968

*CT - Recorded as the minimum value at the highest daily flow ** Manual Residual were not taken

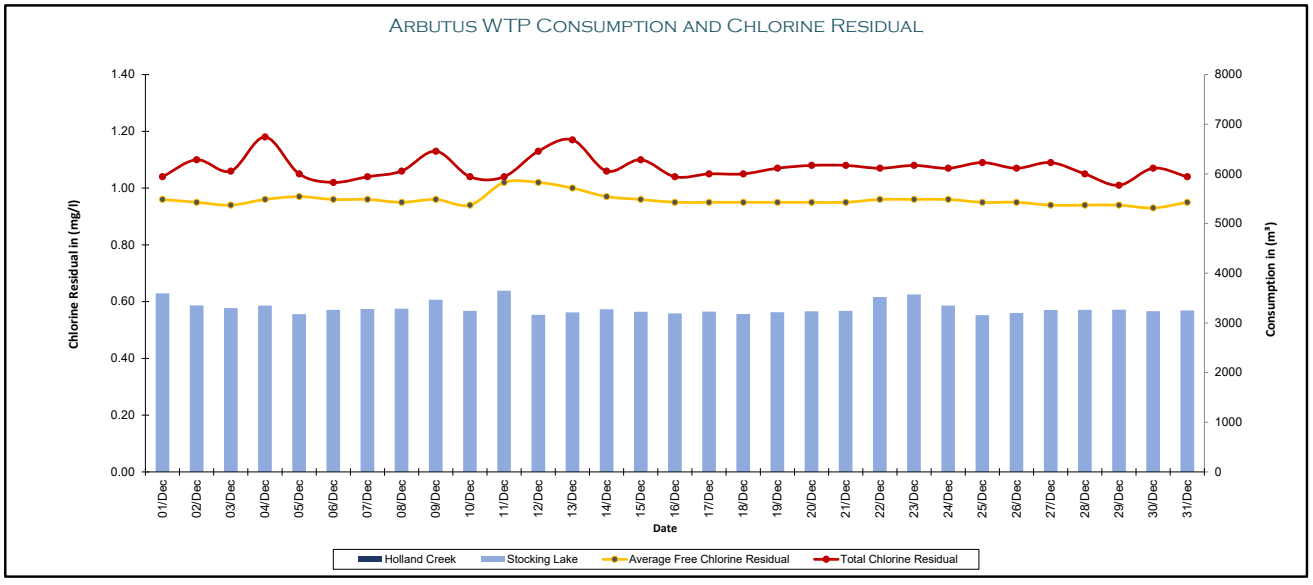

VEOLIA

InSight

Town of Ladysmith Arbutus DWTP

Monthly LRV and Turbidity Report

12/01/2025 - 01/01/2026

LRV Monthly Average

Asset	Parameter	Health	Avg	Std. Dev	Points	LL	L	%In	% between L and LL	% < LL	Unit
UF 1	LRV		5.0	0.0	32	4.25	4.5	100 %	0 %	0 %	#
UF 2	LRV		5.0	0.0	34	4.25	4.5	100 %	0 %	0 %	#
UF 3	LRV		5.0	0.0	33	4.25	4.5	100 %	0 %	0 %	#

LRV Daily Values


Asset	Parameter	Dec 01	Dec 02	Dec 03	Dec 04	Dec 05	Dec 06	Dec 07	Dec 08	Dec 09	Dec 10	Dec 11	Dec 12
UF 1	LRV	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0
UF 2	LRV	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0
UF 3	LRV	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0

Asset	Dec 13	Dec 14	Dec 15	Dec 16	Dec 17	Dec 18	Dec 19	Dec 20	Dec 21	Dec 22	Dec 23	Dec 24	Dec 25	Dec 26	Dec 27	Dec 28
UF 1	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0
UF 2	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0
UF 3	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0


Asset	Dec 29	Dec 30	Dec 31	Jan 01
UF 1	5.0	5.0	5.0	5.0
UF 2	5.0	5.0	5.0	5.0
UF 3	5.0	5.0	5.0	5.0

LRV Raw Data


UF 1 - LRV (#)

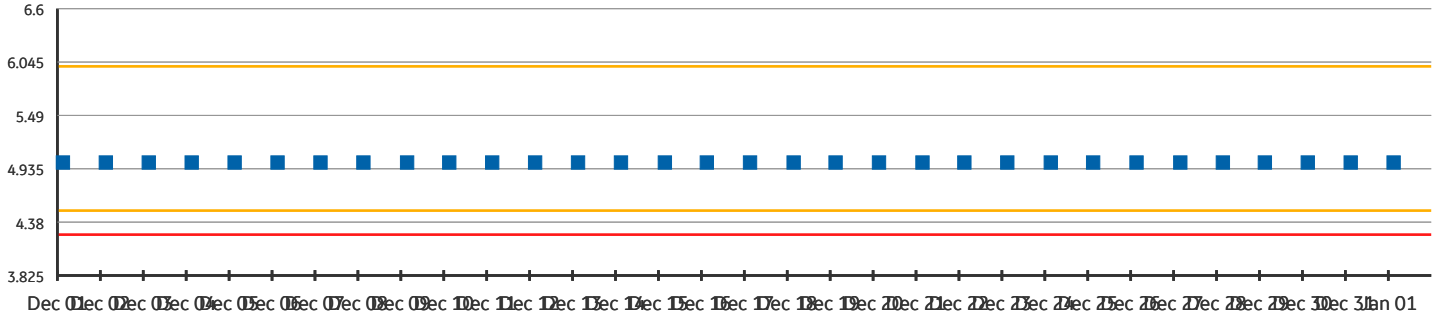

UF 2 - LRV (#)

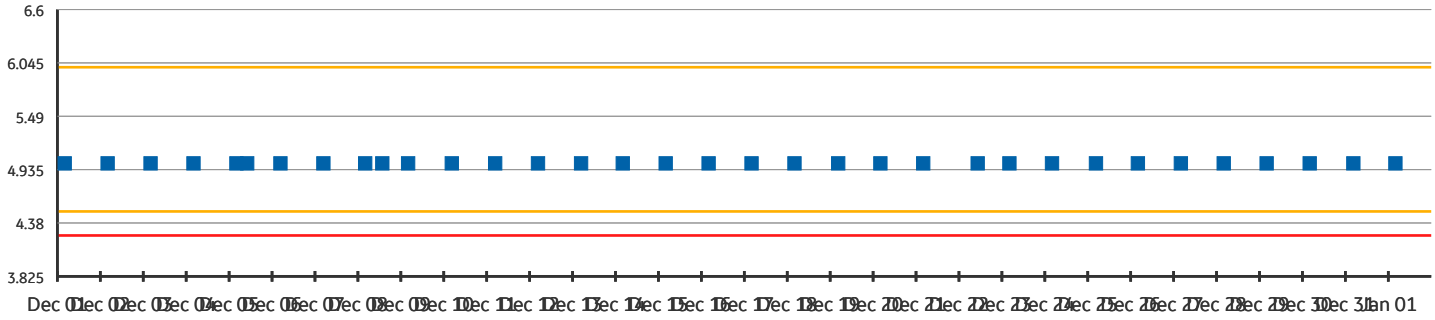

UF 3 - LRV (#)

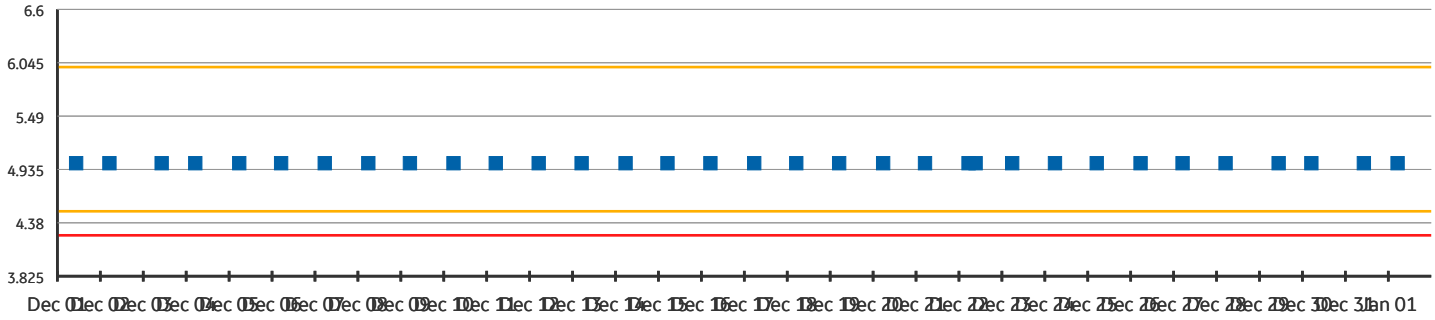

Turbidity Monthly Average

Asset	Parameter	Health	Avg	Std. Dev	Points	H	HH	%In	% between H and HH	% > HH	Unit
UF 1	PermeateTurbidity		0.012	0.0	45221	--	--	100 %	0 %	0 %	NTU
UF 2	PermeateTurbidity		0.013	0.0	45221	--	--	100 %	0 %	0 %	NTU
UF 3	PermeateTurbidity		0.013	0.0	45221	--	--	100 %	0 %	0 %	NTU
UF 1	PermeateTurbidityAfterBP	●	0.013	0.0	368	0.1	0.3	100 %	0 %	0 %	NTU
UF 2	PermeateTurbidityAfterBP	●	0.013	0.0	379	0.1	0.3	100 %	0 %	0 %	NTU
UF 3	PermeateTurbidityAfterBP	●	0.013	0.0	359	0.1	0.3	100 %	0 %	0 %	NTU

Turbidity Daily Averages


Asset	Parameter	Dec 01	Dec 02	Dec 03	Dec 04	Dec 05	Dec 06	Dec 07	Dec 08	Dec 09	Dec 10	Dec 11
UF 1	PermeateTurbidity	0.012	0.011	0.012	0.012	0.011	0.011	0.012	0.012	0.012	0.012	0.012
UF 2	PermeateTurbidity	0.015	0.014	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013
UF 3	PermeateTurbidity	0.012	0.011	0.012	0.011	0.012	0.012	0.012	0.012	0.012	0.012	0.013
UF 1	PermeateTurbidityAfterBP	0.011	0.011	0.012	0.011	0.011	0.012	0.012	0.012	0.012	0.012	0.012
UF 2	PermeateTurbidityAfterBP	0.015	0.014	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013
UF 3	PermeateTurbidityAfterBP	0.012	0.011	0.012	0.011	0.011	0.011	0.011	0.011	0.011	0.012	0.013

Asset	Dec 12	Dec 13	Dec 14	Dec 15	Dec 16	Dec 17	Dec 18	Dec 19	Dec 20	Dec 21	Dec 22	Dec 23	Dec 24	Dec 25	Dec 26
UF 1	0.012	0.012	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013
UF 2	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013
UF 3	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013
UF 1	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013
UF 2	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013
UF 3	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013


Asset	Dec 27	Dec 28	Dec 29	Dec 30	Dec 31	Jan 01
UF 1	0.013	0.013	0.013	0.013	0.013	0.014
UF 2	0.013	0.013	0.013	0.013	0.013	0.013
UF 3	0.013	0.013	0.013	0.013	0.014	0.013
UF 1	0.013	0.013	0.013	0.013	0.013	0.014
UF 2	0.013	0.013	0.013	0.013	0.013	0.013
UF 3	0.013	0.013	0.013	0.013	0.013	0.013

Turbidity Raw Data


UF 1 - PermeateTurbidityAfterBP (NTU)

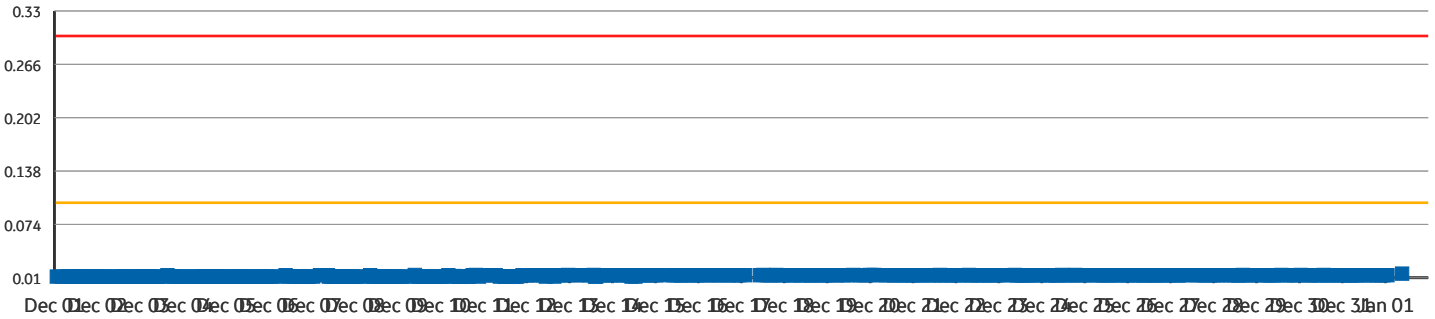

UF 2 - PermeateTurbidityAfterBP (NTU)

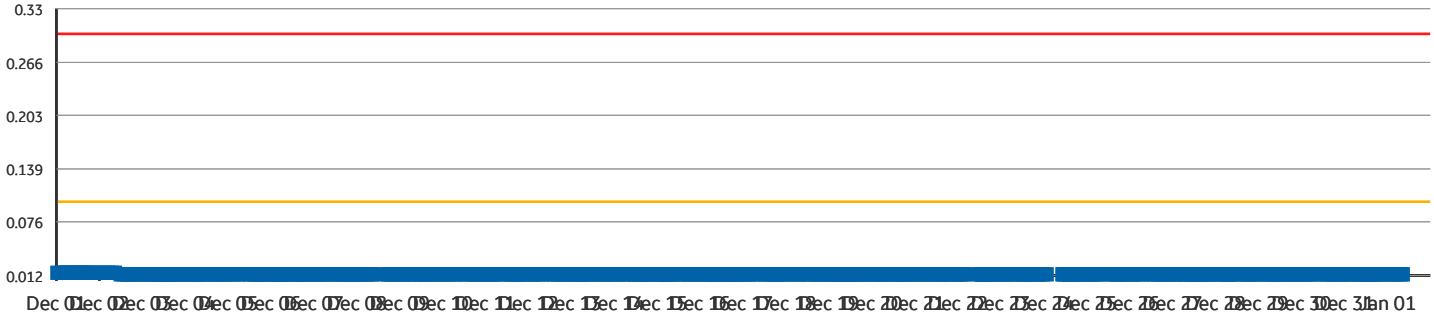

UF 3 - PermeateTurbidityAfterBP (NTU)

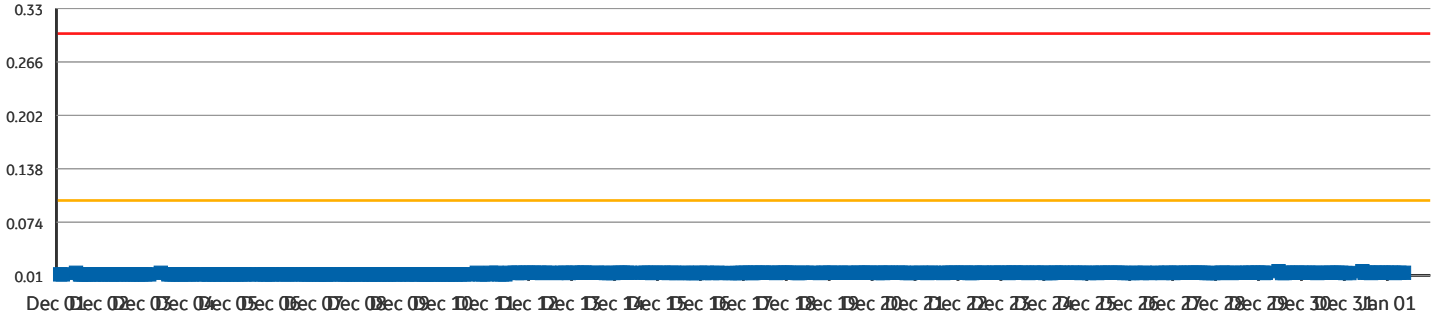

CERTIFICATE OF ANALYSIS

Work Order	:	**VA25D2590**			
Client	:	**Town of Ladysmith**	Laboratory	:	ALS Environmental - Vancouver
Contact	:	Shawn Baker	Account Manager	:	Kevin Bhikadia
Address	:	410 Esplanade PO Box 220 Ladysmith British Columbia Canada V9G 1A2	Address	:	8081 Lougheed Highway Burnaby BC Canada V5A 1W9
Telephone	:	----	E-mail	:	Kevin.Bhikadia@alsglobal.com
Project	:	Arbutus Water Treatment Plant - Weekly Sampling	Telephone	:	+1 604 253 4188
PO	:	10940	Date Samples Received	:	05-Dec-2025 11:05
C-O-C number	:	----	Date Analysis Commenced	:	05-Dec-2025
Sampler	:	----	Issue Date	:	08-Dec-2025 16:07
Site	:	Town of Ladysmith			
Quote number	:	Town of Ladysmith Standing Offer			
No. of samples received	:	4			
No. of samples analysed	:	4			

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

Signatories	*Position*	*Laboratory Department*
Claire Yang	Lab Assistant	Inorganics, Burnaby, British Columbia
Miles Gropen	Department Manager - Inorganics	Inorganics, Burnaby, British Columbia
Miles Gropen	Department Manager - Inorganics	Microbiology, Burnaby, British Columbia

General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key: CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances.
LOR: Limit of Reporting (detection limit).

Unit	*Description*
-	no units
CFU/mL	colony forming units per millilitre
CU	colour units (1 cu = 1 mg/l pt)
mg/L	milligrams per litre
MPN/100mL	most probable number per hundred millilitres
NTU	nephelometric turbidity units
pH units	pH units
µS/cm	microsiemens per centimetre

<: less than.
>: greater than.
Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.
UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

Workorder Comments

Sample(s) 004: Exceeded Recommended Holding Time prior to receipt at the lab for Microbiology analysis.

Analytical Results

Sub-Matrix: Water
(Matrix: Water)

Analyte	CAS Number	Method/Lab	LOR	Unit	Client sample ID: Raw Water ----	DAF Effluent ----	UF Effluent ----	Treated Water (post reservoir) ----	----
					Client sampling date / time: 03-Dec-2025 10:30	03-Dec-2025 10:30	03-Dec-2025 10:30	03-Dec-2025 10:30	----
					VA25D2590-001	VA25D2590-002	VA25D2590-003	VA25D2590-004	----
					Result	Result	Result	Result	----
Sample Preparation									
Dissolved carbon filtration location	----	EP358/VA	-	-	lab	lab	lab	----	----
Physical Tests									
Alkalinity, total (as CaCO3)	----	E290/VA	1.0	mg/L	----	----	----	15.6	----
Colour, true	----	E329/VA	5.0	CU	----	----	----	<5.0	----
Conductivity	----	E100/VA	2.0	µS/cm	----	----	----	63.1	----
pH	----	E108/VA	0.10	pH units	----	----	----	7.25	----
Turbidity	----	E121/VA	0.10	NTU	----	----	----	1.25	----
Organic / Inorganic Carbon									
Carbon, dissolved organic [DOC]	----	E358-L/VA	0.50	mg/L	3.10	1.19	1.39	----	----
Carbon, total organic [TOC]	----	E355-L/VA	0.50	mg/L	3.02	1.43	1.33	----	----
Microbiological Tests									
Heterotrophic plate count [HPC]	----	E020/VA	1	CFU/mL	----	----	----	<1	----
Coliforms, Escherichia coli [E. coli]	----	E010/VA	1	MPN/100 mL	----	----	----	<1	----
Coliforms, total	----	E010/VA	1	MPN/100 mL	----	----	----	<1	----

Please refer to the General Comments section for an explanation of any qualifiers detected.

ALS Canada Ltd.

right solutions.
right partner.

QUALITY CONTROL INTERPRETIVE REPORT

Work Order	: **VA25D2590**	Page	: 1 of 7
Client	: **Town of Ladysmith**	Laboratory	: ALS Environmental - Vancouver
Contact	: Shawn Baker	Account Manager	: Kevin Bhikadia
Address	: 410 Esplanade PO Box 220 Ladysmith BC Canada V9G 1A2	Address	: 8081 Lougheed Highway Burnaby, British Columbia Canada V5A 1W9
Telephone	: ----	Telephone	: +1 604 253 4188
Project	: Arbutus Water Treatment Plant - Weekly Sampling	Date Samples Received	: 05-Dec-2025 11:05
PO	: 10940	Issue Date	: 08-Dec-2025 15:59
C-O-C number	: ----		
Sampler	: ----		
Site	: Town of Ladysmith		
Quote number	: Town of Ladysmith Standing Offer_V2		
No. of samples received	: 4		
No. of samples analysed	: 4		

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

Key

Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
CAS Number: Chemical Abstracts Service number is a unique identifier assigned to discrete substances.
DQO: Data Quality Objective.
LOR: Limit of Reporting (detection limit).
RPD: Relative Percent Difference.

Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

Summary of Outliers

Outliers : Quality Control Samples

- No Method Blank value outliers occur.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Matrix Spike outliers occur.
- No Test sample Surrogate recovery outliers exist.

Outliers: Reference Material (RM) Samples

- No Reference Material (RM) Sample outliers occur.

Outliers : Analysis Holding Time Compliance (Breaches)

- Analysis Holding Time Outliers exist - please see following pages for full details.

Outliers : Frequency of Quality Control Samples

- No Quality Control Sample Frequency Outliers occur.

CERTIFICATE OF ANALYSIS

Work Order	:	**VA25D3103**		
Client	:	**Town of Ladysmith**	Laboratory	: ALS Environmental - Vancouver
Contact	:	Shawn Baker	Account Manager	: Kevin Bhikadia
Address	:	410 Esplanade PO Box 220 Ladysmith British Columbia Canada V9G 1A2	Address	: 8081 Lougheed Highway Burnaby BC Canada V5A 1W9
Telephone	:	----	E-mail	: Kevin.Bhikadia@alsglobal.com
Project	:	Arbutus Water Treatment Plant-Monthly Sampling	Telephone	: +1 604 253 4188
PO	:	10940	Date Samples Received	: 11-Dec-2025 11:00
C-O-C number	:	----	Date Analysis Commenced	: 12-Dec-2025
Sampler	:	----	Issue Date	: 23-Dec-2025 15:40
Site	:	Town of Ladysmith		
Quote number	:	Town of Ladysmith Standing Offer		
No. of samples received	:	1		
No. of samples analysed	:	1		

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results
- Surrogate Control Limits

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

Signatories	*Position*	*Laboratory Department*
Kevin Duarte	Supervisor - Metals ICP Instrumentation	Metals, Burnaby, British Columbia
Robin Weeks	Supervisor - Organics Extractions	Organics, Burnaby, British Columbia
Sanja Risticevic	Department Manager - LCMS	LCMS, Waterloo, Ontario

General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key: CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances.
LOR: Limit of Reporting (detection limit).

Unit	*Description*
mg/L	milligrams per litre
µg/L	micrograms per litre

<: less than.
>: greater than.
Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.
UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

Analytical Results

Sub-Matrix: Water
(Matrix: Water)

Analyte	CAS Number	Method/Lab	LOR	Unit	Client sample ID: Treated Water (post reservoir) ----	----	----	----	----
					Client sampling date / time: 10-Dec-2025 10:30	----	----	----	----
					VA25D3103-001	----	----	----	----
					Result	----	----	----	----
Total Metals									
Aluminum, total	7429-90-5	E420/VA	0.0030	mg/L	0.0092	----	----	----	----
Volatile Organic Compounds [THMs]									
Bromodichloromethane	75-27-4	E611B/VA	1.0	µg/L	1.5	----	----	----	----
Bromoform	75-25-2	E611B/VA	1.0	µg/L	<1.0	----	----	----	----
Chloroform	67-66-3	E611B/VA	1.0	µg/L	14.3	----	----	----	----
Dibromochloromethane	124-48-1	E611B/VA	1.0	µg/L	<1.0	----	----	----	----
Trihalomethanes [THMs], total	----	E611B/VA	2.0	µg/L	15.8	----	----	----	----
Volatile Organic Compounds [THMs] Surrogates									
Bromofluorobenzene, 4-	460-00-4	E611B/VA	1.0	%	90.9	----	----	----	----
Difluorobenzene, 1,4-	540-36-3	E611B/VA	1.0	%	98.6	----	----	----	----
Haloacetic Acids									
Bromochloroacetic acid	5589-96-8	E750/WT	1.00	µg/L	<1.00	----	----	----	----
Dibromoacetic acid	631-64-1	E750/WT	1.00	µg/L	<1.00	----	----	----	----
Dichloroacetic acid	79-43-6	E750/WT	1.00	µg/L	5.05	----	----	----	----
Monobromoacetic acid	79-08-3	E750/WT	1.00	µg/L	<1.00	----	----	----	----
Monochloroacetic acid	79-11-8	E750/WT	1.00	µg/L	<1.00	----	----	----	----
Trichloroacetic acid	76-03-9	E750/WT	1.00	µg/L	4.63	----	----	----	----
Haloacetic acids, total [HAA5]	n/a	E750/WT	5.00	µg/L	9.68	----	----	----	----

Please refer to the General Comments section for an explanation of any qualifiers detected.

Quality Control Interpretive Report

Work Order	:	**VA25D3103**			
Client	:	Town of Ladysmith	Laboratory	:	ALS Environmental - Vancouver
Contact	:	Shawn Baker	Account Manager	:	Kevin Bhikadia
Address	:	410 Esplanade PO Box 220 Ladysmith BC Canada V9G 1A2	Address	:	8081 Lougheed Highway Burnaby British Columbia Canada V5A 1W9
Telephone	:	----	Telephone	:	+1 604 253 4188
Project	:	Arbutus Water Treatment Plant-Monthly Sampling	Date Samples Received	:	11-Dec-2025 11:00
PO	:	10940	Issue Date	:	23-Dec-2025 15:40
C-O-C number	:	----			
Sampler	:	----			
Site	:	Town of Ladysmith			
Quote number	:	Town of Ladysmith Standing Offer			
No. of samples received	:	1			
No. of samples analysed	:	1			

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

Key

Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances.
DQO: Data Quality Objective.
LOR: Limit of Reporting (detection limit).
RPD: Relative Percent Difference.

Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

Summary of Outliers

Outliers : Quality Control Samples

- No Method Blank value outliers occur.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Laboratory Control Sample Duplicate (LCSD) outliers occur
- No Matrix Spike outliers occur.
- No Matrix Spike Duplicate (MSD) outliers occur.
- No Test sample Surrogate recovery outliers exist.

Outliers: Reference Material (RM) Samples

- No Reference Material (RM) Sample outliers occur.

Outliers : Analysis Holding Time Compliance (Breaches)

- No Analysis Holding Time Outliers exist.

Outliers : Frequency of Quality Control Samples

- No Quality Control Sample Frequency Outliers occur.

CERTIFICATE OF ANALYSIS

Work Order	:	**VA25D3095**			
Client	:	**Town of Ladysmith**	Laboratory	:	ALS Environmental - Vancouver
Contact	:	Shawn Baker	Account Manager	:	Kevin Bhikadia
Address	:	410 Esplanade PO Box 220 Ladysmith British Columbia Canada V9G 1A2	Address	:	8081 Lougheed Highway Burnaby BC Canada V5A 1W9
Telephone	:	----	E-mail	:	Kevin.Bhikadia@alsglobal.com
Project	:	Arbutus Water Treatment Plant-Weekly Sampling	Telephone	:	+1 604 253 4188
PO	:	10940	Date Samples Received	:	11-Dec-2025 11:00
C-O-C number	:	----	Date Analysis Commenced	:	11-Dec-2025
Sampler	:	----	Issue Date	:	15-Dec-2025 15:48
Site	:	Town of Ladysmith			
Quote number	:	Town of Ladysmith Standing Offer			
No. of samples received	:	4			
No. of samples analysed	:	4			

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

Signatories	*Position*	*Laboratory Department*
Anita Chuang	Lab Assistant	Inorganics, Burnaby, British Columbia
Miles Gropen	Department Manager - Inorganics	Inorganics, Burnaby, British Columbia
Miles Gropen	Department Manager - Inorganics	Microbiology, Burnaby, British Columbia

General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key: CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances.
LOR: Limit of Reporting (detection limit).

Unit	*Description*
-	no units
CFU/mL	colony forming units per millilitre
CU	colour units (1 cu = 1 mg/l pt)
mg/L	milligrams per litre
MPN/100mL	most probable number per hundred millilitres
NTU	nephelometric turbidity units
pH units	pH units
µS/cm	microsiemens per centimetre

<: less than.
>: greater than.
Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.
UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

Workorder Comments

Sample(s) "Treated water":Exceeded Recommended Holding Time prior to receipt at the lab for HPC analysis.HPC analysis will be carried out from the provided expired sample.

Qualifiers

Qualifier	Description
SFP	Sample was filtered and preserved at the laboratory.

Analytical Results

Sub-Matrix: Water
(Matrix: Water)

Analyte	CAS Number	Method/Lab	LOR	Unit	Client sample ID: Raw Water ----	DAF Effluent ----	UF Effluent ----	Treated Water (post reservoir) ----	----
					Client sampling date / time: 10-Dec-2025 10:30	10-Dec-2025 10:30	10-Dec-2025 10:30	10-Dec-2025 10:30	----
					VA25D3095-001	VA25D3095-002	VA25D3095-003	VA25D3095-004	----
					Result	Result	Result	Result	----
Sample Preparation									
Dissolved carbon filtration location	----	EP358/VA	-	-	lab	lab	lab	----	----
Physical Tests									
Alkalinity, total (as CaCO3)	----	E290/VA	1.0	mg/L	----	----	----	17.6	----
Colour, true	----	E329/VA	5.0	CU	----	----	----	<5.0	----
Conductivity	----	E100/VA	2.0	µS/cm	----	----	----	68.1	----
pH	----	E108/VA	0.10	pH units	----	----	----	7.44	----
Turbidity	----	E121/VA	0.10	NTU	----	----	----	<0.10	----
Organic / Inorganic Carbon									
Carbon, dissolved organic [DOC]	----	E358-L/VA	0.50	mg/L	2.56 SFP	1.26 SFP	1.18 SFP	----	----
Carbon, total organic [TOC]	----	E355-L/VA	0.50	mg/L	2.50	1.17	1.52	----	----
Microbiological Tests									
Heterotrophic plate count [HPC]	----	E020/VA	1	CFU/mL	----	----	----	<1	----
Coliforms, Escherichia coli [E. coli]	----	E010/VA	1	MPN/100 mL	----	----	----	<1	----
Coliforms, total	----	E010/VA	1	MPN/100 mL	----	----	----	<1	----

Please refer to the General Comments section for an explanation of any qualifiers detected.

alsglobal.com

Quality Control Interpretive Report

Work Order	:	**VA25D3095**			
Client	:	Town of Ladysmith	Laboratory	:	ALS Environmental - Vancouver
Contact	:	Shawn Baker	Account Manager	:	Kevin Bhikadia
Address	:	410 Esplanade PO Box 220 Ladysmith BC Canada V9G 1A2	Address	:	8081 Lougheed Highway Burnaby British Columbia Canada V5A 1W9
Telephone	:	----	Telephone	:	+1 604 253 4188
Project	:	Arbutus Water Treatment Plant-Weekly Sampling	Date Samples Received	:	11-Dec-2025 11:00
PO	:	10940	Issue Date	:	15-Dec-2025 15:48
C-O-C number	:	----			
Sampler	:	----			
Site	:	Town of Ladysmith			
Quote number	:	Town of Ladysmith Standing Offer			
No. of samples received	:	4			
No. of samples analysed	:	4			

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

Key

Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances.
DQO: Data Quality Objective.
LOR: Limit of Reporting (detection limit).
RPD: Relative Percent Difference.

Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

Summary of Outliers

Outliers : Quality Control Samples

- Method Blank value outliers occur - please see following pages for full details.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Laboratory Control Sample Duplicate (LCSD) outliers occur
- No Matrix Spike outliers occur.
- No Matrix Spike Duplicate (MSD) outliers occur.
- No Test sample Surrogate recovery outliers exist.

Outliers: Reference Material (RM) Samples

- No Reference Material (RM) Sample outliers occur.

Outliers : Analysis Holding Time Compliance (Breaches)

- Analysis Holding Time Outliers exist.

Outliers : Frequency of Quality Control Samples

- No Quality Control Sample Frequency Outliers occur.

CERTIFICATE OF ANALYSIS

Work Order	:	**VA25D3573**			
Client	:	**Town of Ladysmith**	Laboratory	:	ALS Environmental - Vancouver
Contact	:	Shawn Baker	Account Manager	:	Kevin Bhikadia
Address	:	410 Esplanade PO Box 220 Ladysmith British Columbia Canada V9G 1A2	Address	:	8081 Lougheed Highway Burnaby BC Canada V5A 1W9
Telephone	:	----	E-mail	:	Kevin.Bhikadia@alsglobal.com
Project	:	Arbutus Water Treatment Plant-Weekly Sampling	Telephone	:	+1 604 253 4188
PO	:	10940	Date Samples Received	:	17-Dec-2025 10:22
C-O-C number	:	----	Date Analysis Commenced	:	17-Dec-2025
Sampler	:	----	Issue Date	:	22-Dec-2025 10:08
Site	:	Town of Ladysmith			
Quote number	:	Town of Ladysmith Standing Offer			
No. of samples received	:	4			
No. of samples analysed	:	4			

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

Signatories	*Position*	*Laboratory Department*
Miles Gropen	Department Manager - Inorganics	Inorganics, Burnaby, British Columbia
Miles Gropen	Department Manager - Inorganics	Microbiology, Burnaby, British Columbia

General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key: CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances.
LOR: Limit of Reporting (detection limit).

Unit	*Description*
-	no units
CFU/mL	colony forming units per millilitre
CU	colour units (1 cu = 1 mg/l pt)
mg/L	milligrams per litre
MPN/100mL	most probable number per hundred millilitres
NTU	nephelometric turbidity units
pH units	pH units
µS/cm	microsiemens per centimetre

<: less than.
>: greater than.
Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.
UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

alsglobal.com

Analytical Results

Sub-Matrix: Water
(Matrix: Water)

Analyte	CAS Number	Method/Lab	LOR	Unit	Raw Water ----	DAF Effluent ----	UF Effluent ----	Treated Water (post reservoir) ----	----
Client sampling date / time					16-Dec-2025 10:30	16-Dec-2025 10:30	16-Dec-2025 10:30	16-Dec-2025 10:30	----
					VA25D3573-001	**VA25D3573-002**	**VA25D3573-003**	**VA25D3573-004**	**----**
					Result	Result	Result	Result	----
Sample Preparation									
Dissolved carbon filtration location	----	EP358/VA	-	-	lab	lab	lab	----	----
Physical Tests									
Alkalinity, total (as CaCO3)	----	E290/VA	1.0	mg/L	----	----	----	18.3	----
Colour, true	----	E329/VA	5.0	CU	----	----	----	<5.0	----
Conductivity	----	E100/VA	2.0	µS/cm	----	----	----	68.1	----
pH	----	E108/VA	0.10	pH units	----	----	----	7.53	----
Turbidity	----	E121/VA	0.10	NTU	----	----	----	<0.10	----
Organic / Inorganic Carbon									
Carbon, dissolved organic [DOC]	----	E358-L/VA	0.50	mg/L	2.39	0.97	1.06	----	----
Carbon, total organic [TOC]	----	E355-L/VA	0.50	mg/L	2.67	1.21	1.13	----	----
Microbiological Tests									
Heterotrophic plate count [HPC]	----	E020/VA	1	CFU/mL	----	----	----	<1	----
Coliforms, Escherichia coli [E. coli]	----	E010/VA	1	MPN/100 mL	----	----	----	<1	----
Coliforms, total	----	E010/VA	1	MPN/100 mL	----	----	----	<1	----

Please refer to the General Comments section for an explanation of any qualifiers detected.

Quality Control Interpretive Report

Work Order	:	**VA25D3573**			
Client	:	Town of Ladysmith	Laboratory	:	ALS Environmental - Vancouver
Contact	:	Shawn Baker	Account Manager	:	Kevin Bhikadia
Address	:	410 Esplanade PO Box 220 Ladysmith BC Canada V9G 1A2	Address	:	8081 Lougheed Highway Burnaby British Columbia Canada V5A 1W9
Telephone	:	----	Telephone	:	+1 604 253 4188
Project	:	Arbutus Water Treatment Plant-Weekly Sampling	Date Samples Received	:	17-Dec-2025 10:22
PO	:	10940	Issue Date	:	22-Dec-2025 10:08
C-O-C number	:	----			
Sampler	:	----			
Site	:	Town of Ladysmith			
Quote number	:	Town of Ladysmith Standing Offer			
No. of samples received	:	4			
No. of samples analysed	:	4			

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

Key

Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances.
DQO: Data Quality Objective.
LOR: Limit of Reporting (detection limit).
RPD: Relative Percent Difference.

Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

Summary of Outliers

Outliers : Quality Control Samples

- No Method Blank value outliers occur.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Laboratory Control Sample Duplicate (LCSD) outliers occur
- No Matrix Spike outliers occur.
- No Matrix Spike Duplicate (MSD) outliers occur.
- No Test sample Surrogate recovery outliers exist.

Outliers: Reference Material (RM) Samples

- No Reference Material (RM) Sample outliers occur.

Outliers : Analysis Holding Time Compliance (Breaches)

- Analysis Holding Time Outliers exist.

Outliers : Frequency of Quality Control Samples

- No Quality Control Sample Frequency Outliers occur.

CERTIFICATE OF ANALYSIS

Work Order	:	**VA25D4158**		
Client	:	**Town of Ladysmith**	Laboratory	: ALS Environmental - Vancouver
Contact	:	Shawn Baker	Account Manager	: Kevin Bhikadia
Address	:	410 Esplanade PO Box 220 Ladysmith British Columbia Canada V9G 1A2	Address	: 8081 Lougheed Highway Burnaby BC Canada V5A 1W9
Telephone	:	----	E-mail	: Kevin.Bhikadia@alsglobal.com
Project	:	Arbutus Water Treatment - Weekly Sampling	Telephone	: +1 604 253 4188
PO	:	10940	Date Samples Received	: 24-Dec-2025 10:00
C-O-C number	:	----	Date Analysis Commenced	: 24-Dec-2025
Sampler	:	----	Issue Date	: 06-Jan-2026 10:03
Site	:	Town of Ladysmith		
Quote number	:	Town of Ladysmith Standing Offer		
No. of samples received	:	4		
No. of samples analysed	:	4		

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

Signatories	*Position*	*Laboratory Department*
Hdeep Kaur	Lab Assistant	Inorganics, Burnaby, British Columbia
Miles Gropen	Department Manager - Inorganics	Microbiology, Burnaby, British Columbia
Miles Gropen	Department Manager - Inorganics	Inorganics, Burnaby, British Columbia
Monica Ko	Supervisor - Inorganic	Inorganics, Burnaby, British Columbia

General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key: CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances.
LOR: Limit of Reporting (detection limit).

Unit	*Description*
-	no units
CFU/mL	colony forming units per millilitre
CU	colour units (1 cu = 1 mg/l pt)
mg/L	milligrams per litre
MPN/100mL	most probable number per hundred millilitres
NTU	nephelometric turbidity units
pH units	pH units
µS/cm	microsiemens per centimetre

<: less than.
>: greater than.
Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.
UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

Analytical Results

Sub-Matrix: Water
(Matrix: Water)

Analyte	CAS Number	Method/Lab	LOR	Unit	Client sample ID: Raw Water ----	DAF Effluent ----	UF Effluent ----	Treated Water (post reservoir) ----	----
					Client sampling date / time: 23-Dec-2025 10:00	23-Dec-2025 10:00	23-Dec-2025 10:00	23-Dec-2025 10:00	----
					VA25D4158-001	VA25D4158-002	VA25D4158-003	VA25D4158-004	----
					Result	Result	Result	Result	----
Sample Preparation									
Dissolved carbon filtration location	----	EP358/VA	-	-	lab	lab	lab	----	----
Physical Tests									
Alkalinity, total (as CaCO3)	----	E290/VA	1.0	mg/L	----	----	----	18.2	----
Colour, true	----	E329/VA	5.0	CU	----	----	----	<5.0	----
Conductivity	----	E100/VA	2.0	µS/cm	----	----	----	68.8	----
pH	----	E108/VA	0.10	pH units	----	----	----	7.45	----
Turbidity	----	E121/VA	0.10	NTU	----	----	----	1.16	----
Organic / Inorganic Carbon									
Carbon, dissolved organic [DOC]	----	E358-L/VA	0.50	mg/L	2.79	1.11	1.22	----	----
Carbon, total organic [TOC]	----	E355-L/VA	0.50	mg/L	2.83	1.13	1.26	----	----
Microbiological Tests									
Heterotrophic plate count [HPC]	----	E020/VA	1	CFU/mL	----	----	----	<1	----
Coliforms, Escherichia coli [E. coli]	----	E010/VA	1	MPN/100 mL	----	----	----	<1	----
Coliforms, total	----	E010/VA	1	MPN/100 mL	----	----	----	<1	----

Please refer to the General Comments section for an explanation of any qualifiers detected.

Quality Control Interpretive Report

Work Order	:	**VA25D4158**			
Client	:	Town of Ladysmith	Laboratory	:	ALS Environmental - Vancouver
Contact	:	Shawn Baker	Account Manager	:	Kevin Bhikadia
Address	:	410 Esplanade PO Box 220 Ladysmith BC Canada V9G 1A2	Address	:	8081 Lougheed Highway Burnaby British Columbia Canada V5A 1W9
Telephone	:	----	Telephone	:	+1 604 253 4188
Project	:	Arbutus Water Treatment - Weekly Sampling	Date Samples Received	:	24-Dec-2025 10:00
PO	:	10940	Issue Date	:	06-Jan-2026 10:03
C-O-C number	:	----			
Sampler	:	----			
Site	:	Town of Ladysmith			
Quote number	:	Town of Ladysmith Standing Offer			
No. of samples received	:	4			
No. of samples analysed	:	4			

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

Key

Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances.
DQO: Data Quality Objective.
LOR: Limit of Reporting (detection limit).
RPD: Relative Percent Difference.

Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

Summary of Outliers

Outliers : Quality Control Samples

- No Method Blank value outliers occur.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Laboratory Control Sample Duplicate (LCSD) outliers occur
- No Matrix Spike outliers occur.
- No Matrix Spike Duplicate (MSD) outliers occur.
- No Test sample Surrogate recovery outliers exist.

Outliers: Reference Material (RM) Samples

- No Reference Material (RM) Sample outliers occur.

Outliers : Analysis Holding Time Compliance (Breaches)

- Analysis Holding Time Outliers exist.

Outliers : Frequency of Quality Control Samples

- No Quality Control Sample Frequency Outliers occur.

CERTIFICATE OF ANALYSIS

Work Order	:	**VA25D4348**			
Client	:	**Town of Ladysmith**	Laboratory	:	ALS Environmental - Vancouver
Contact	:	Shawn Baker	Account Manager	:	Kevin Bhikadia
Address	:	410 Esplanade PO Box 220 Ladysmith British Columbia Canada V9G 1A2	Address	:	8081 Lougheed Highway Burnaby BC Canada V5A 1W9
Telephone	:	----	E-mail	:	Kevin.Bhikadia@alsglobal.com
Project	:	Arbutus Water Treatment Plant - Weekly Sampling	Telephone	:	+1 604 253 4188
PO	:	10940	Date Samples Received	:	31-Dec-2025 09:50
C-O-C number	:	----	Date Analysis Commenced	:	31-Dec-2025
Sampler	:	----	Issue Date	:	06-Jan-2026 11:17
Site	:	Town of Ladysmith			
Quote number	:	Town of Ladysmith Standing Offer			
No. of samples received	:	4			
No. of samples analysed	:	4			

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

Signatories	*Position*	*Laboratory Department*
Hdeep Kaur	Lab Assistant	Inorganics, Burnaby, British Columbia
Monica Ko	Supervisor - Inorganic	Inorganics, Burnaby, British Columbia

General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key: CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances.
LOR: Limit of Reporting (detection limit).

Unit	*Description*
-	no units
CU	colour units (1 cu = 1 mg/l pt)
mg/L	milligrams per litre
NTU	nephelometric turbidity units
pH units	pH units
µS/cm	microsiemens per centimetre

<: less than.
>: greater than.
Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.
UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

Analytical Results

Sub-Matrix: Water
(Matrix: Water)

Analyte	CAS Number	Method/Lab	LOR	Unit	Raw Water ----	DAF Effluent ----	UF Effluent ----	Treated Water (post reservoir) ----	----
Client sampling date / time					30-Dec-2025 10:30	30-Dec-2025 10:30	30-Dec-2025 10:30	30-Dec-2025 10:30	----
					VA25D4348-001	**VA25D4348-002**	**VA25D4348-003**	**VA25D4348-004**	**----**
					Result	Result	Result	Result	----
Sample Preparation									
Dissolved carbon filtration location	----	EP358/VA	-	-	lab	lab	lab	----	----
Physical Tests									
Alkalinity, total (as CaCO3)	----	E290/VA	1.0	mg/L	----	----	----	18.4	----
Colour, true	----	E329/VA	5.0	CU	----	----	----	<5.0	----
Conductivity	----	E100/VA	2.0	µS/cm	----	----	----	69.5	----
pH	----	E108/VA	0.10	pH units	----	----	----	7.56	----
Turbidity	----	E121/VA	0.10	NTU	----	----	----	0.61	----
Organic / Inorganic Carbon									
Carbon, dissolved organic [DOC]	----	E358-L/VA	0.50	mg/L	2.62	1.08	1.05	----	----
Carbon, total organic [TOC]	----	E355-L/VA	0.50	mg/L	3.14	1.44	1.22	----	----

Please refer to the General Comments section for an explanation of any qualifiers detected.

ALS Canada Ltd.

right solutions.
right partner.

Quality Control Interpretive Report

Work Order	:	**VA25D4348**		
Client	:	Town of Ladysmith	Laboratory	: ALS Environmental - Vancouver
Contact	:	Shawn Baker	Account Manager	: Kevin Bhikadia
Address	:	410 Esplanade PO Box 220 Ladysmith BC Canada V9G 1A2	Address	: 8081 Lougheed Highway Burnaby British Columbia Canada V5A 1W9
Telephone	:	----	Telephone	: +1 604 253 4188
Project	:	Arbutus Water Treatment Plant - Weekly Sampling	Date Samples Received	: 31-Dec-2025 09:50
PO	:	10940	Issue Date	: 06-Jan-2026 11:17
C-O-C number	:	----		
Sampler	:	----		
Site	:	Town of Ladysmith		
Quote number	:	Town of Ladysmith Standing Offer		
No. of samples received	:	4		
No. of samples analysed	:	4		

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

Key

Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances.
DQO: Data Quality Objective.
LOR: Limit of Reporting (detection limit).
RPD: Relative Percent Difference.

Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

Summary of Outliers

Outliers : Quality Control Samples

- No Method Blank value outliers occur.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Laboratory Control Sample Duplicate (LCSD) outliers occur
- No Matrix Spike outliers occur.
- No Matrix Spike Duplicate (MSD) outliers occur.
- No Test sample Surrogate recovery outliers exist.

Outliers: Reference Material (RM) Samples

- No Reference Material (RM) Sample outliers occur.

Outliers : Analysis Holding Time Compliance (Breaches)

- Analysis Holding Time Outliers exist.

Outliers : Frequency of Quality Control Samples

- No Quality Control Sample Frequency Outliers occur.