
Town of Ladysmith - Arbutus Water treatment Plant

February 2026 - Monthly Report

Date	Daily Flow			Chlorine Residual				CT*	External Lab Testing					
	Stocking Lake	Holland Creek	Combined Flow	Free Min	Free Max	Free Avg	Total		HPC	E.coli	Total Coliforms	Aluminum	THM	HAA
	m³	m³	m³	mg/l	mg/l	mg/l	mg/l	Minutes·mg/l	CFU	MPN	MPN	mg/l	mg/l	mg/l
01-Feb	3120	0	3120	0.92	0.95	0.95	1.03	156						
02-Feb	4093	0	4093	0.91	0.97	0.97	1.09	156						
03-Feb	5027	509	5536	0.95	1.00	1.00	1.05	99	9	< 1	< 1	0.0084	0.0167	0.0094
04-Feb	4196	117	4313	0.94	1.00	0.94	1.11	112						
05-Feb	3006	1	3007	0.91	0.95	0.95	1.03	136						
06-Feb	3331	0	3331	0.93	0.97	0.96	1.06	152						
07-Feb	3135	0	3135	0.94	0.96	0.96	1.06	165						
08-Feb	3202	0	3202	0.94	0.96	0.96	1.07	127						
09-Feb	3028	0	3028	0.94	0.96	0.95	1.09	110						
10-Feb	3248	0	3248	0.94	0.96	0.96	1.05	135	1	< 1	< 1			
11-Feb	3522	0	3522	0.94	0.96	0.96	1.07	125						
12-Feb	3211	0	3211	0.94	0.97	0.95	1.08	103						
13-Feb	3579	0	3579	0.93	0.96	0.96	1.05	130						
14-Feb	2938	0	2938	0.92	0.96	0.93	1.04	123						
15-Feb	3163	0	3163	0.91	0.94	0.94	1.01	165						
16-Feb	3141	0	3141	0.92	0.96	0.95	1.04	115						
17-Feb	2962	0	2962	0.93	0.96	0.95	1.04	118	< 1	< 1	< 1			
18-Feb	3221	0	3221	0.93	0.96	0.95	0.98	129						
19-Feb	2987	0	2987	0.92	0.95	0.95	0.98	106						
20-Feb	2934	0	2934	0.92	0.95	0.94	1.02	96						
21-Feb	2918	0	2918	0.93	0.95	0.95	1.09	138						
22-Feb	2981	0	2981	0.93	0.96	0.95	1.06	162						
23-Feb	3220	0	3220	0.92	0.97	0.96	1.07	142						
24-Feb	3280	0	3280	0.94	0.98	0.96	1.07	146	1	< 1	< 1			
25-Feb	3066	0	3066	0.91	0.97	0.91	1.06	152						
26-Feb	3225	0	3225	0.86	0.92	0.92	1.01	186						
27-Feb	2969	0	2969	0.92	0.96	0.95	1.05	150						
28-Feb	2944	0	2944	0.94	0.98	0.96	1.06	146						
Total	91647	627	92274											
Average	3273	22	3296	0.93	0.96	0.95	1.05	135	< 3	< 1	< 1	0.0084	0.0167	0.00939

*CT - Recorded as the minimum value at the highest daily flow ** Manual Residual were not taken

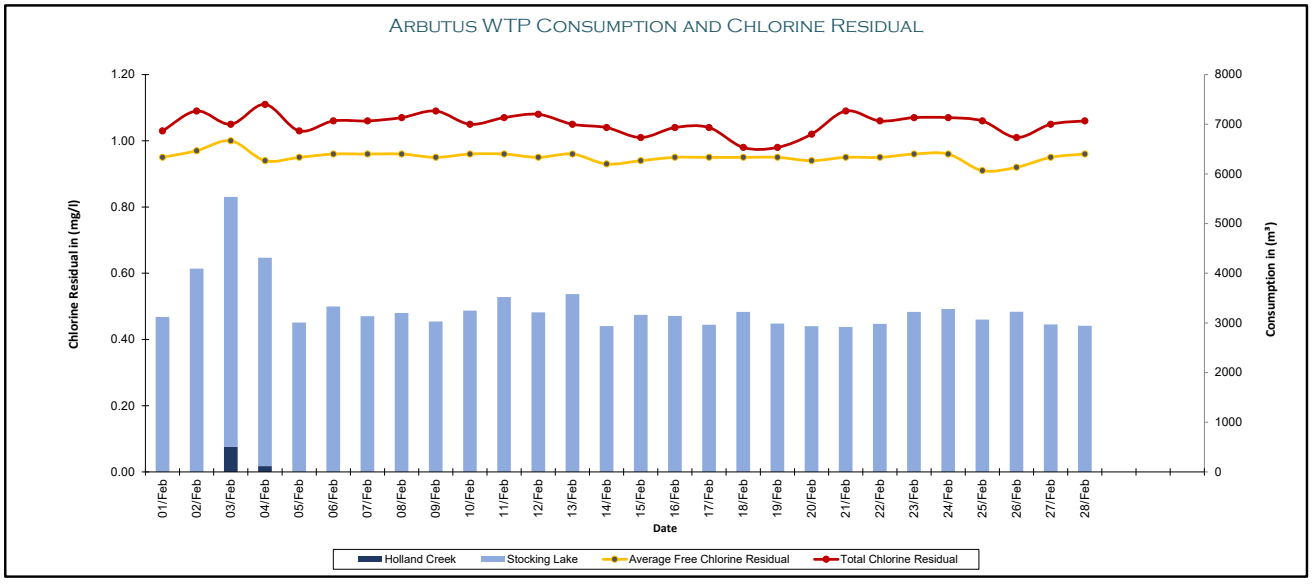

VEOLIA

InSight

Town of Ladysmith Arbutus DWTP

Monthly LRV and Turbidity Report

01/29/2026 - 03/01/2026

LRV Monthly Average

Asset	Parameter	Health	Avg	Std. Dev	Points	LL	L	%In	% between L and LL	% < LL	Unit
UF 1	LRV		5.0	0.0	34	4.25	4.5	100 %	0 %	0 %	#
UF 2	LRV		4.991	0.05	33	4.25	4.5	100 %	0 %	0 %	#
UF 3	LRV		5.0	0.0	33	4.25	4.5	100 %	0 %	0 %	#

LRV Daily Values


Asset	Parameter	Jan 29	Jan 30	Jan 31	Feb 01	Feb 02	Feb 03	Feb 04	Feb 05	Feb 06	Feb 07	Feb 08	Feb 09
UF 1	LRV	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0
UF 2	LRV	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0
UF 3	LRV	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0

Asset	Feb 10	Feb 11	Feb 12	Feb 13	Feb 14	Feb 15	Feb 16	Feb 17	Feb 18	Feb 19	Feb 20	Feb 21	Feb 22	Feb 23	Feb 24	Feb 25
UF 1	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0
UF 2	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	4.85
UF 3	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0


Asset	Feb 26	Feb 27	Feb 28	Mar 01
UF 1	5.0	5.0	5.0	5.0
UF 2	5.0	5.0	5.0	5.0
UF 3	5.0	5.0	5.0	5.0

LRV Raw Data


UF 1 - LRV (#)

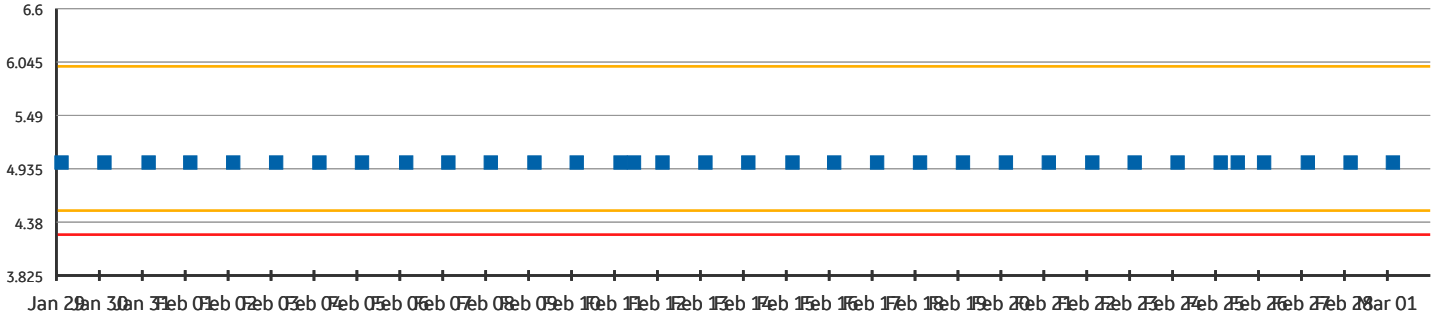

UF 2 - LRV (#)

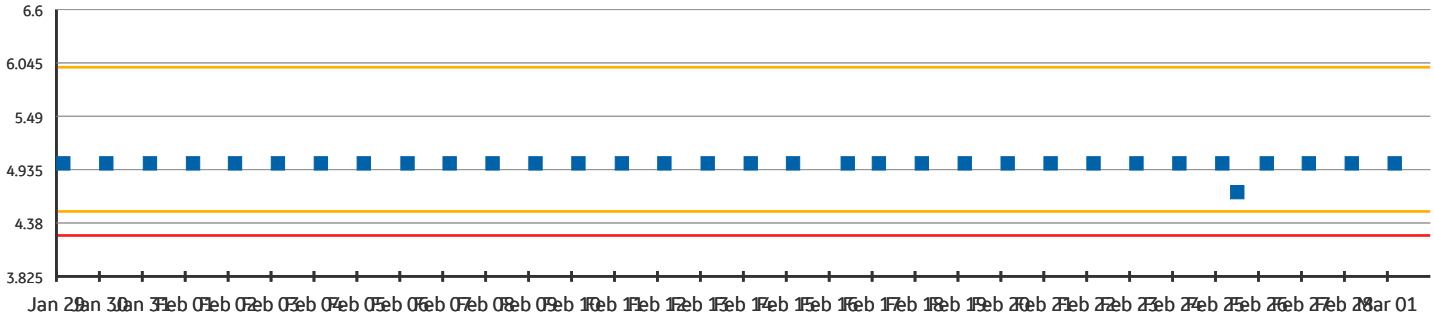

UF 3 - LRV (#)

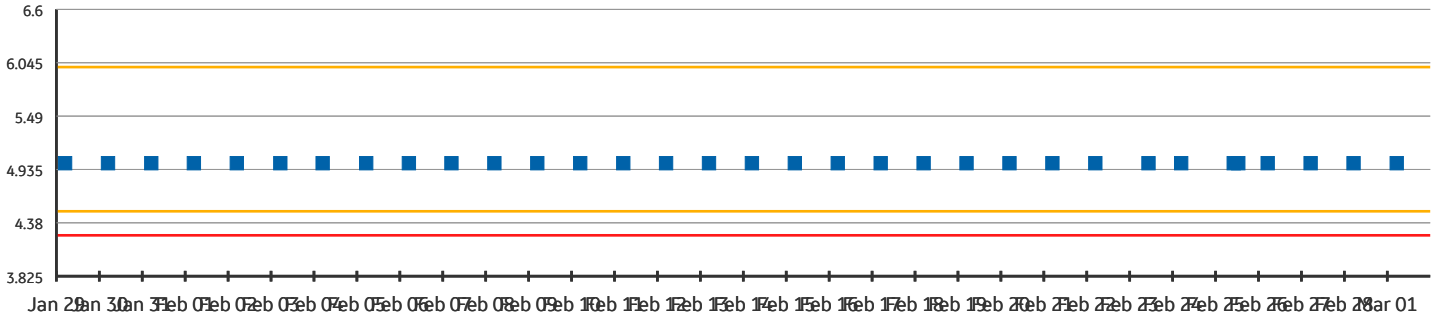

Turbidity Monthly Average

Asset	Parameter	Health	Avg	Std. Dev	Points	H	HH	%In	% between H and HH	% > HH	Unit
UF 1	PermeateTurbidity		0.014	0.01	45207	--	--	100 %	0 %	0 %	NTU
UF 2	PermeateTurbidity		0.013	0.0	45207	--	--	100 %	0 %	0 %	NTU
UF 3	PermeateTurbidity		0.014	0.0	45207	--	--	100 %	0 %	0 %	NTU
UF 1	PermeateTurbidityAfterBP	●	0.014	0.0	381	0.1	0.3	100 %	0 %	0 %	NTU
UF 2	PermeateTurbidityAfterBP	●	0.013	0.0	362	0.1	0.3	100 %	0 %	0 %	NTU
UF 3	PermeateTurbidityAfterBP	●	0.014	0.0	379	0.1	0.3	100 %	0 %	0 %	NTU

Turbidity Daily Averages

Asset	Parameter	Jan 29	Jan 30	Jan 31	Feb 01	Feb 02	Feb 03	Feb 04	Feb 05	Feb 06	Feb 07	Feb 08
UF 1	PermeateTurbidity	0.015	0.015	0.015	0.015	0.015	0.016	0.017	0.017	0.017	0.017	0.017
UF 2	PermeateTurbidity	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013
UF 3	PermeateTurbidity	0.017	0.017	0.017	0.017	0.017	0.017	0.017	0.018	0.019	0.019	0.019


Asset	Parameter	Jan 29	Jan 30	Jan 31	Feb 01	Feb 02	Feb 03	Feb 04	Feb 05	Feb 06	Feb 07	Feb 08
UF 1	PermeateTurbidityAfterBP	0.015	0.015	0.015	0.016	0.016	0.016	0.017	0.017	0.017	0.017	0.017
UF 2	PermeateTurbidityAfterBP	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013
UF 3	PermeateTurbidityAfterBP	0.017	0.017	0.017	0.017	0.017	0.017	0.017	0.018	0.019	0.019	0.019

Asset	Feb 09	Feb 10	Feb 11	Feb 12	Feb 13	Feb 14	Feb 15	Feb 16	Feb 17	Feb 18	Feb 19	Feb 20	Feb 21	Feb 22	Feb 23
UF 1	0.017	0.017	0.018	0.018	0.011	0.011	0.011	0.011	0.011	0.011	0.011	0.011	0.011	0.011	0.011
UF 2	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013
UF 3	0.019	0.019	0.014	0.011	0.011	0.011	0.011	0.011	0.012	0.011	0.011	0.011	0.011	0.011	0.012
UF 1	0.017	0.017	0.017	0.013	0.012	0.011	0.011	0.011	0.011	0.011	0.011	0.011	0.011	0.011	0.011
UF 2	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.014	0.013	0.013	0.013	0.013	0.013	0.013	0.013
UF 3	0.019	0.019	0.014	0.011	0.011	0.011	0.011	0.011	0.011	0.011	0.011	0.011	0.012	0.011	0.012


Asset	Feb 24	Feb 25	Feb 26	Feb 27	Feb 28	Mar 01
UF 1	0.011	0.011	0.012	0.011	0.011	0.011
UF 2	0.013	0.013	0.013	0.013	0.013	0.013
UF 3	0.011	0.012	0.011	0.011	0.012	0.011
UF 1	0.011	0.011	0.012	0.011	0.011	0.012
UF 2	0.013	0.013	0.013	0.013	0.013	0.013
UF 3	0.011	0.012	0.012	0.011	0.012	0.011

Turbidity Raw Data


UF 1 - PermeateTurbidityAfterBP (NTU)

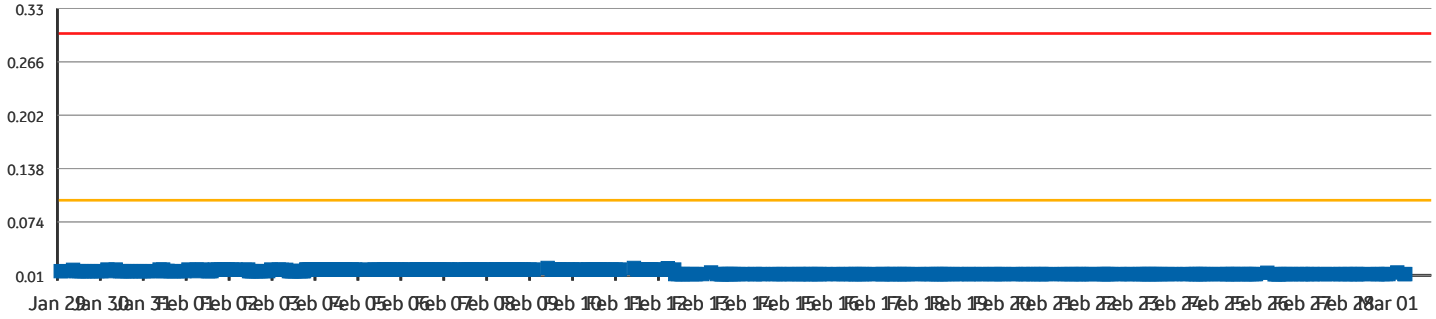

UF 2 - PermeateTurbidityAfterBP (NTU)

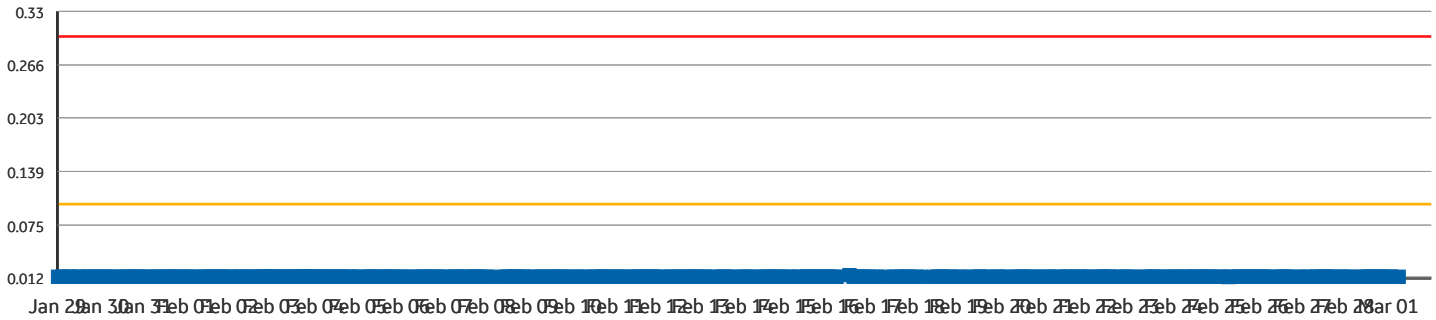

UF 3 - PermeateTurbidityAfterBP (NTU)

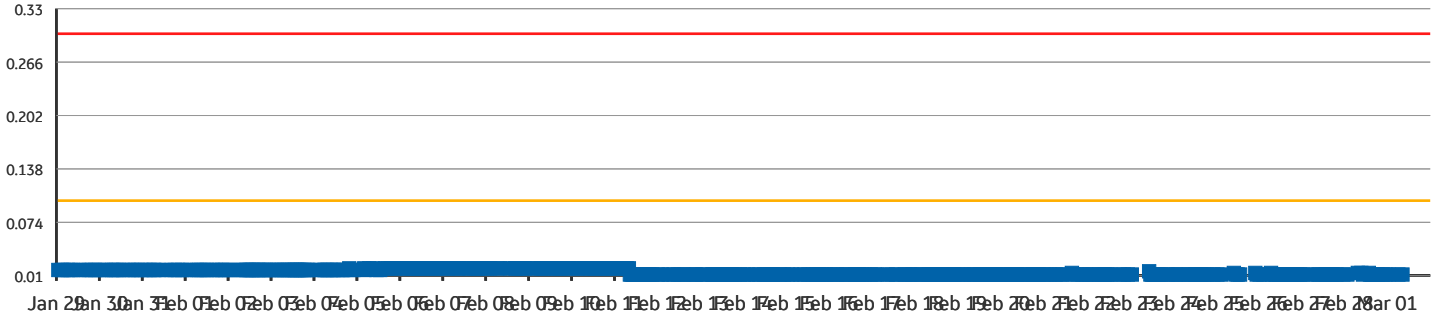

VEOLIA

InSight

Town of Ladysmith Arbutus DWTP

Monthly LRV and Turbidity Report

01/29/2026 - 03/01/2026

LRV Monthly Average

Asset	Parameter	Health	Avg	Std. Dev	Points	LL	L	%In	% between L and LL	% < LL	Unit
UF 1	LRV		5.0	0.0	34	4.25	4.5	100 %	0 %	0 %	#
UF 2	LRV		4.991	0.05	33	4.25	4.5	100 %	0 %	0 %	#
UF 3	LRV		5.0	0.0	33	4.25	4.5	100 %	0 %	0 %	#

LRV Daily Values


Asset	Parameter	Jan 29	Jan 30	Jan 31	Feb 01	Feb 02	Feb 03	Feb 04	Feb 05	Feb 06	Feb 07	Feb 08	Feb 09
UF 1	LRV	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0
UF 2	LRV	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0
UF 3	LRV	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0

Asset	Feb 10	Feb 11	Feb 12	Feb 13	Feb 14	Feb 15	Feb 16	Feb 17	Feb 18	Feb 19	Feb 20	Feb 21	Feb 22	Feb 23	Feb 24	Feb 25
UF 1	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0
UF 2	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	4.85
UF 3	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0	5.0


Asset	Feb 26	Feb 27	Feb 28	Mar 01
UF 1	5.0	5.0	5.0	5.0
UF 2	5.0	5.0	5.0	5.0
UF 3	5.0	5.0	5.0	5.0

LRV Raw Data


UF 1 - LRV (#)

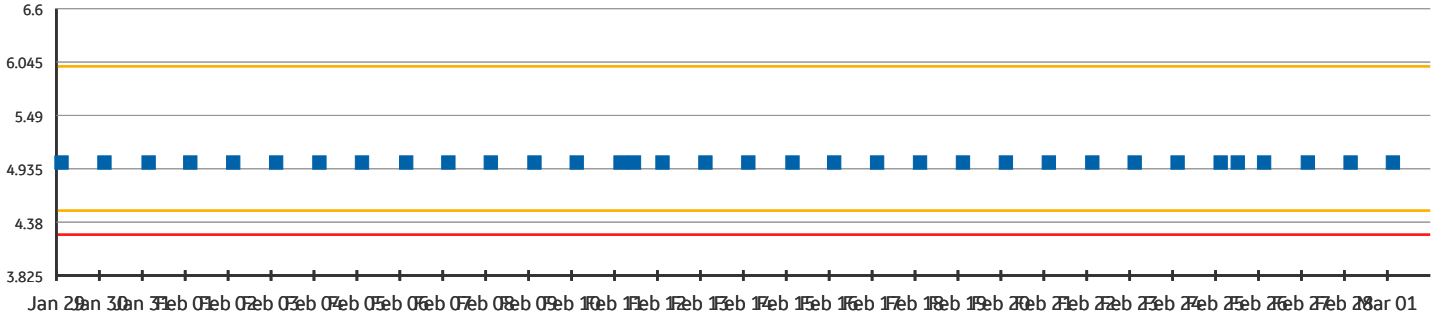

UF 2 - LRV (#)

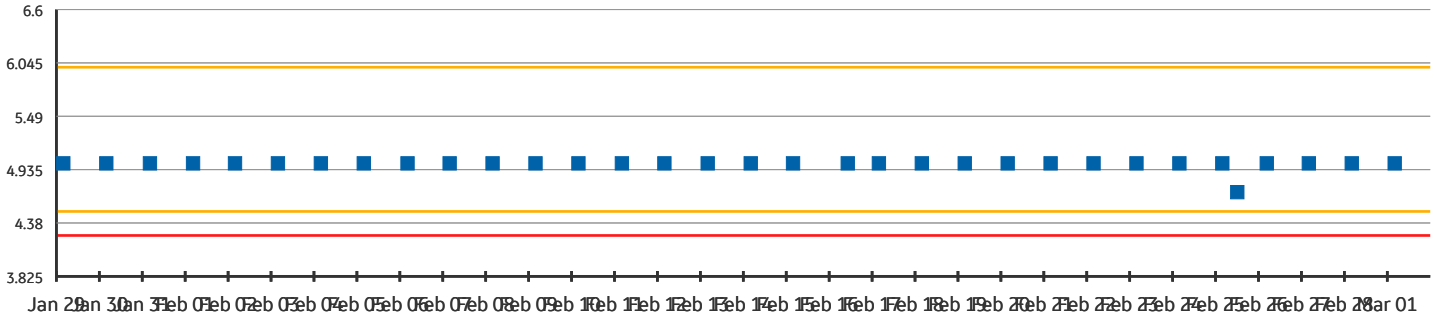

UF 3 - LRV (#)

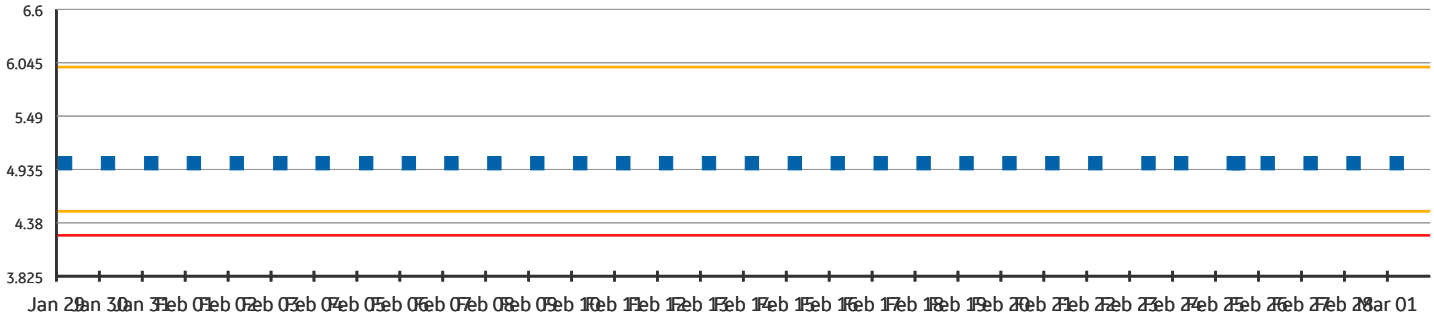

Turbidity Monthly Average

Asset	Parameter	Health	Avg	Std. Dev	Points	H	HH	%In	% between H and HH	% > HH	Unit
UF 1	PermeateTurbidity		0.014	0.01	45207	--	--	100 %	0 %	0 %	NTU
UF 2	PermeateTurbidity		0.013	0.0	45207	--	--	100 %	0 %	0 %	NTU
UF 3	PermeateTurbidity		0.014	0.0	45207	--	--	100 %	0 %	0 %	NTU
UF 1	PermeateTurbidityAfterBP	●	0.014	0.0	381	0.1	0.3	100 %	0 %	0 %	NTU
UF 2	PermeateTurbidityAfterBP	●	0.013	0.0	362	0.1	0.3	100 %	0 %	0 %	NTU
UF 3	PermeateTurbidityAfterBP	●	0.014	0.0	379	0.1	0.3	100 %	0 %	0 %	NTU

Turbidity Daily Averages

Asset	Parameter	Jan 29	Jan 30	Jan 31	Feb 01	Feb 02	Feb 03	Feb 04	Feb 05	Feb 06	Feb 07	Feb 08
UF 1	PermeateTurbidity	0.015	0.015	0.015	0.015	0.015	0.016	0.017	0.017	0.017	0.017	0.017
UF 2	PermeateTurbidity	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013
UF 3	PermeateTurbidity	0.017	0.017	0.017	0.017	0.017	0.017	0.017	0.018	0.019	0.019	0.019


Asset	Parameter	Jan 29	Jan 30	Jan 31	Feb 01	Feb 02	Feb 03	Feb 04	Feb 05	Feb 06	Feb 07	Feb 08
UF 1	PermeateTurbidityAfterBP	0.015	0.015	0.015	0.016	0.016	0.016	0.017	0.017	0.017	0.017	0.017
UF 2	PermeateTurbidityAfterBP	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013
UF 3	PermeateTurbidityAfterBP	0.017	0.017	0.017	0.017	0.017	0.017	0.017	0.018	0.019	0.019	0.019

Asset	Feb 09	Feb 10	Feb 11	Feb 12	Feb 13	Feb 14	Feb 15	Feb 16	Feb 17	Feb 18	Feb 19	Feb 20	Feb 21	Feb 22	Feb 23
UF 1	0.017	0.017	0.018	0.018	0.011	0.011	0.011	0.011	0.011	0.011	0.011	0.011	0.011	0.011	0.011
UF 2	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.013
UF 3	0.019	0.019	0.014	0.011	0.011	0.011	0.011	0.011	0.012	0.011	0.011	0.011	0.011	0.011	0.012
UF 1	0.017	0.017	0.017	0.013	0.012	0.011	0.011	0.011	0.011	0.011	0.011	0.011	0.011	0.011	0.011
UF 2	0.013	0.013	0.013	0.013	0.013	0.013	0.013	0.014	0.013	0.013	0.013	0.013	0.013	0.013	0.013
UF 3	0.019	0.019	0.014	0.011	0.011	0.011	0.011	0.011	0.011	0.011	0.011	0.011	0.012	0.011	0.012


Asset	Feb 24	Feb 25	Feb 26	Feb 27	Feb 28	Mar 01
UF 1	0.011	0.011	0.012	0.011	0.011	0.011
UF 2	0.013	0.013	0.013	0.013	0.013	0.013
UF 3	0.011	0.012	0.011	0.011	0.012	0.011
UF 1	0.011	0.011	0.012	0.011	0.011	0.012
UF 2	0.013	0.013	0.013	0.013	0.013	0.013
UF 3	0.011	0.012	0.012	0.011	0.012	0.011

Turbidity Raw Data


UF 1 - PermeateTurbidityAfterBP (NTU)

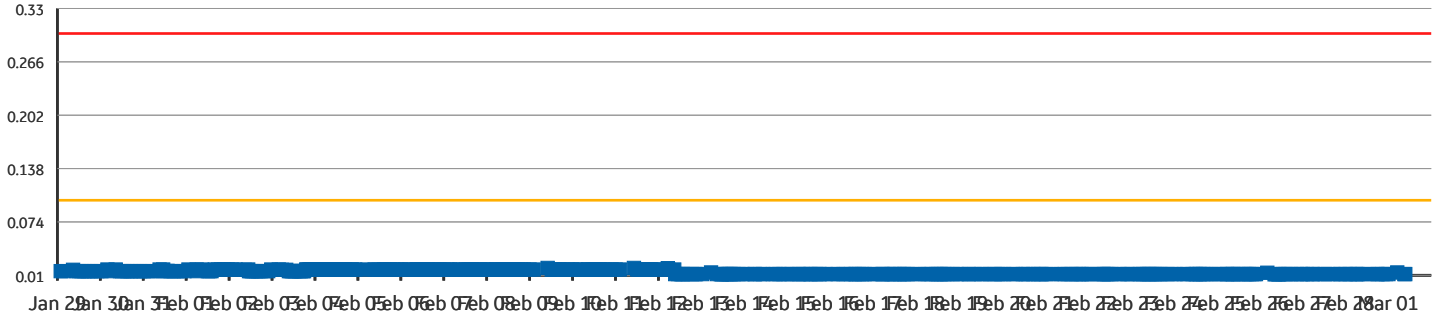

UF 2 - PermeateTurbidityAfterBP (NTU)

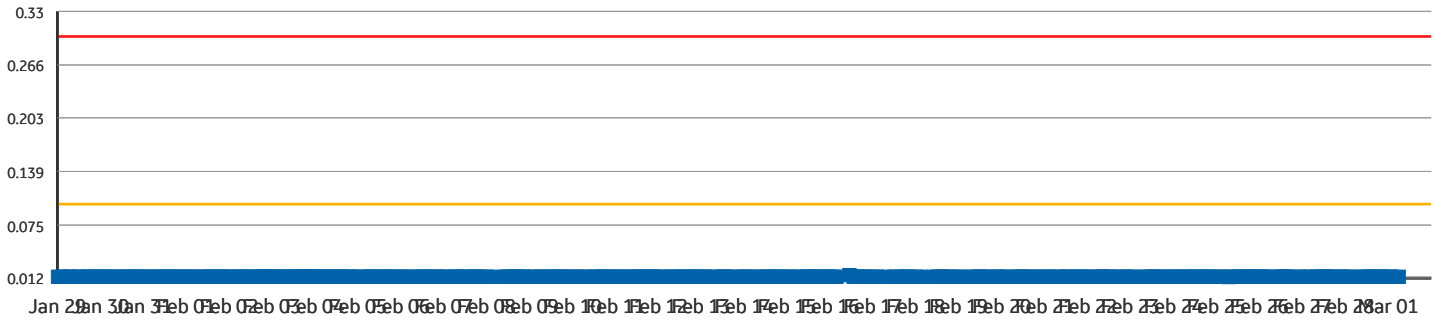

UF 3 - PermeateTurbidityAfterBP (NTU)

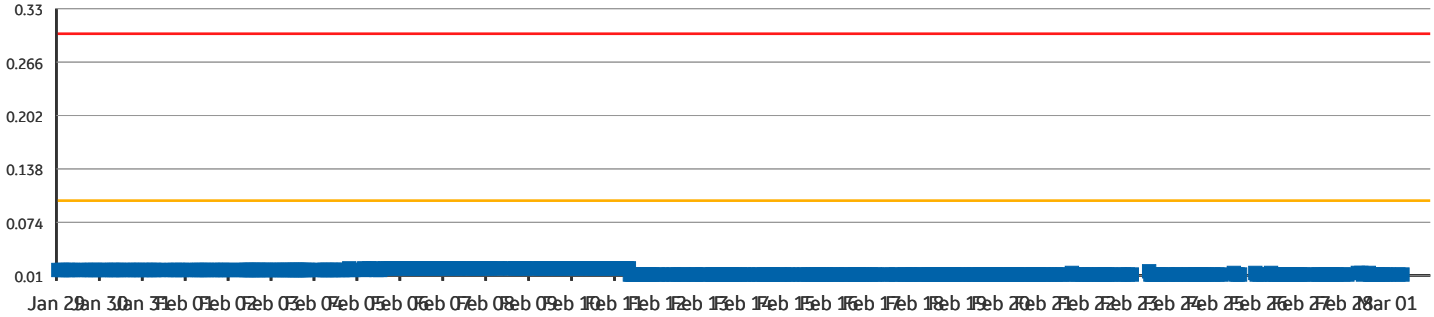

CERTIFICATE OF ANALYSIS

Work Order	:	**VA26A2591**			
Client	:	**Town of Ladysmith**	Laboratory	:	ALS Environmental - Vancouver
Contact	:	Shawn Baker	Account Manager	:	Kevin Bhikadia
Address	:	410 Esplanade PO Box 220 Ladysmith British Columbia Canada V9G 1A2	Address	:	8081 Lougheed Highway Burnaby BC Canada V5A 1W9
Telephone	:	----	E-mail	:	Kevin.Bhikadia@alsglobal.com
Project	:	Arbutus Water Treatment Plant - Monthly Sampling	Telephone	:	+1 604 253 4188
PO	:	10940	Date Samples Received	:	04-Feb-2026 10:35
C-O-C number	:	----	Date Analysis Commenced	:	05-Feb-2026
Sampler	:	----	Issue Date	:	13-Feb-2026 16:26
Site	:	Town of Ladysmith			
Quote number	:	Town of Ladysmith Standing Offer			
No. of samples received	:	1			
No. of samples analysed	:	1			

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results
- Surrogate Control Limits

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

Signatories	*Position*	*Laboratory Department*
Catherine DeMone	Laboratory Analyst	LCMS, Waterloo, Ontario
Dan Gebert	Supervisor - Metals Mercury & Speciation	Metals, Burnaby, British Columbia
Robin Weeks	Supervisor - Organics Extractions	Organics, Burnaby, British Columbia

General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key: CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances.
LOR: Limit of Reporting (detection limit).

Unit	*Description*
mg/L	milligrams per litre
µg/L	micrograms per litre

<: less than.
>: greater than.
Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.
UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

Analytical Results

Sub-Matrix: Water
(Matrix: Water)

Analyte	CAS Number	Method/Lab	LOR	Unit	Treated Water (post reservoir) ----	----	----	----	----
Client sample ID					Treated Water (post reservoir) ----	----	----	----	----
Client sampling date / time					03-Feb-2026 10:30	----	----	----	----
					VA26A2591-001	----	----	----	----
					Result	----	----	----	----
Total Metals									
Aluminum, total	7429-90-5	E420/VA	0.0030	mg/L	0.0084	----	----	----	----
Volatile Organic Compounds [THMs]									
Bromodichloromethane	75-27-4	E611B/VA	1.0	µg/L	1.2	----	----	----	----
Bromoform	75-25-2	E611B/VA	1.0	µg/L	<1.0	----	----	----	----
Chloroform	67-66-3	E611B/VA	1.0	µg/L	15.5	----	----	----	----
Dibromochloromethane	124-48-1	E611B/VA	1.0	µg/L	<1.0	----	----	----	----
Trihalomethanes [THMs], total	----	E611B/VA	2.0	µg/L	16.7	----	----	----	----
Volatile Organic Compounds [THMs] Surrogates									
Bromofluorobenzene, 4-	460-00-4	E611B/VA	1.0	%	101	----	----	----	----
Difluorobenzene, 1,4-	540-36-3	E611B/VA	1.0	%	101	----	----	----	----
Haloacetic Acids									
Bromochloroacetic acid	5589-96-8	E750/WT	1.00	µg/L	<1.00	----	----	----	----
Dibromoacetic acid	631-64-1	E750/WT	1.00	µg/L	<1.00	----	----	----	----
Dichloroacetic acid	79-43-6	E750/WT	1.00	µg/L	4.36	----	----	----	----
Monobromoacetic acid	79-08-3	E750/WT	1.00	µg/L	<1.00	----	----	----	----
Monochloroacetic acid	79-11-8	E750/WT	1.00	µg/L	<1.00	----	----	----	----
Trichloroacetic acid	76-03-9	E750/WT	1.00	µg/L	5.03	----	----	----	----
Haloacetic acids, total [HAA5]	n/a	E750/WT	5.00	µg/L	9.39	----	----	----	----

Please refer to the General Comments section for an explanation of any qualifiers detected.

ALS Canada Ltd.

right solutions.
right partner.

QUALITY CONTROL INTERPRETIVE REPORT

Work Order	: **VA26A2591**	Page	: 1 of 5
Client	: **Town of Ladysmith**	Laboratory	: ALS Environmental - Vancouver
Contact	: Shawn Baker	Account Manager	: Kevin Bhikadia
Address	: 410 Esplanade PO Box 220 Ladysmith BC Canada V9G 1A2	Address	: 8081 Lougheed Highway Burnaby, British Columbia Canada V5A 1W9
Telephone	: ----	Telephone	: +1 604 253 4188
Project	: Arbutus Water Treatment Plant - Monthly Sampling	Date Samples Received	: 04-Feb-2026 10:35
PO	: 10940	Issue Date	: 13-Feb-2026 16:24
C-O-C number	: ----		
Sampler	: ----		
Site	: Town of Ladysmith		
Quote number	: Town of Ladysmith Standing Offer_V3		
No. of samples received	: 1		
No. of samples analysed	: 1		

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

Key

Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
CAS Number: Chemical Abstracts Service number is a unique identifier assigned to discrete substances.
DQO: Data Quality Objective.
LOR: Limit of Reporting (detection limit).
RPD: Relative Percent Difference.

Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

Summary of Outliers

Outliers : Quality Control Samples

- No Method Blank value outliers occur.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Matrix Spike outliers occur.
- No Matrix Spike Duplicate (MSD) outliers occur - please see following pages for full details.
- No Test sample Surrogate recovery outliers exist.

Outliers: Reference Material (RM) Samples

- No Reference Material (RM) Sample outliers occur.

Outliers : Analysis Holding Time Compliance (Breaches)

- No Analysis Holding Time Outliers exist.

Outliers : Frequency of Quality Control Samples

- No Quality Control Sample Frequency Outliers occur.

CERTIFICATE OF ANALYSIS

Work Order	:	**VA26A2600**		
Client	:	**Town of Ladysmith**	Laboratory	: ALS Environmental - Vancouver
Contact	:	Shawn Baker	Account Manager	: Kevin Bhikadia
Address	:	410 Esplanade PO Box 220 Ladysmith British Columbia Canada V9G 1A2	Address	: 8081 Lougheed Highway Burnaby BC Canada V5A 1W9
Telephone	:	----	E-mail	: Kevin.Bhikadia@alsglobal.com
Project	:	Arbutus Water Treatment - Quarterly Lake Sampling	Telephone	: +1 604 253 4188
PO	:	10940	Date Samples Received	: 04-Feb-2026 10:30
C-O-C number	:	----	Date Analysis Commenced	: 04-Feb-2026
Sampler	:	----	Issue Date	: 17-Feb-2026 09:14
Site	:	RFP Tender No. 2022-IS-20 Extension		
Quote number	:	Town of Ladysmith Standing Offer		
No. of samples received	:	2		
No. of samples analysed	:	2		

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results
- Surrogate Control Limits

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

Signatories	*Position*	*Laboratory Department*
Brieanna Allen	Production/Validation Manager	Organics, Burnaby, British Columbia
Kate Dimitrova	Supervisor - Inorganic	Inorganics, Burnaby, British Columbia
Kevin Duarte	Supervisor - Metals ICP Instrumentation	Metals, Burnaby, British Columbia
Lia Xie	Lab Assistant	Inorganics, Burnaby, British Columbia
Miles Gropen	Department Manager - Inorganics	Inorganics, Burnaby, British Columbia
Miles Gropen	Department Manager - Inorganics	Microbiology, Burnaby, British Columbia

General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key: CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances.
LOR: Limit of Reporting (detection limit).

Unit	*Description*
-	no units
% T/cm	% transmittance per centimetre
AU/cm	absorbance units per centimetre
CU	colour units (1 cu = 1 mg/l pt)
mg/L	milligrams per litre
MPN/100mL	most probable number per hundred millilitres
NTU	nephelometric turbidity units
pH units	pH units
µg/L	micrograms per litre

<: less than.
>: greater than.
Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.
UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

Analytical Results

Sub-Matrix: Water
(Matrix: Water)

Analyte	CAS Number	Method/Lab	LOR	Unit	Client sample ID	Stocking Lake ----	Holland Lake ----	----	----	----
					Client sampling date / time	03-Feb-2026 10:40	03-Feb-2026 09:10	----	----	----
						VA26A2600-001	VA26A2600-002	----	----	----
						Result	Result	----	----	----
Sample Preparation										
Dissolved carbon filtration location	----	EP358/VA	-	-		lab	lab	----	----	----
Physical Tests										
Absorbance, UV (@ 254nm)	----	E404/VA	0.0050	AU/cm		0.0830	0.127	----	----	----
Alkalinity, total (as CaCO3)	----	E290/VA	1.0	mg/L		9.1	3.0	----	----	----
Colour, true	----	E329/VA	5.0	CU		11.7	18.3	----	----	----
Hardness (as CaCO3), from total Ca/Mg	----	EC100A/VA	0.60	mg/L		9.98	3.90	----	----	----
pH	----	E108/VA	0.10	pH units		6.90	6.42	----	----	----
Solids, total dissolved [TDS]	----	E162/VA	10	mg/L		33	24	----	----	----
Turbidity	----	E121/VA	0.10	NTU		0.88	0.65	----	----	----
Transmittance, UV (@ 254nm)	----	E404/VA	1.0	% T/cm		82.6	74.6	----	----	----
Anions and Nutrients										
Bromide	24959-67-9	E235.Br-L/VA	0.050	mg/L		<0.050	<0.050	----	----	----
Organic / Inorganic Carbon										
Carbon, dissolved organic [DOC]	----	E358-L/VA	0.50	mg/L		3.02	4.34	----	----	----
Carbon, total organic [TOC]	----	E355-L/VA	0.50	mg/L		4.33	4.37	----	----	----
Microbiological Tests										
Coliforms, Escherichia coli [E. coli]	----	E010/VA	1	MPN/100 mL		2	1	----	----	----
Coliforms, total	----	E010/VA	1	MPN/100 mL		15	83	----	----	----
Total Metals										
Aluminum, total	7429-90-5	E420/VA	0.0030	mg/L		0.0623	0.0938	----	----	----
Antimony, total	7440-36-0	E420/VA	0.00010	mg/L		<0.00010	<0.00010	----	----	----

Analytical Results

Sub-Matrix: Water
(Matrix: Water)

Analyte	CAS Number	Method/Lab	LOR	Unit	Client sample ID	Stocking Lake ----	Holland Lake ----	----	----	----
					Client sampling date / time	03-Feb-2026 10:40	03-Feb-2026 09:10	----	----	----
						VA26A2600-001	VA26A2600-002	----	----	----
						Result	Result	----	----	----
Total Metals										
Arsenic, total	7440-38-2	E420/VA	0.00010	mg/L		0.00013	<0.00010	----	----	----
Barium, total	7440-39-3	E420/VA	0.00010	mg/L		0.00271	0.00361	----	----	----
Beryllium, total	7440-41-7	E420/VA	0.000100	mg/L		<0.000100	<0.000100	----	----	----
Bismuth, total	7440-69-9	E420/VA	0.000050	mg/L		<0.000050	<0.000050	----	----	----
Boron, total	7440-42-8	E420/VA	0.010	mg/L		0.021	<0.010	----	----	----
Cadmium, total	7440-43-9	E420/VA	0.0000050	mg/L		0.0000066	<0.0000050	----	----	----
Calcium, total	7440-70-2	E420/VA	0.050	mg/L		3.17	1.16	----	----	----
Cesium, total	7440-46-2	E420/VA	0.000010	mg/L		<0.000010	<0.000010	----	----	----
Chromium, total	7440-47-3	E420/VA	0.00050	mg/L		<0.00050	<0.00050	----	----	----
Cobalt, total	7440-48-4	E420/VA	0.00010	mg/L		<0.00010	<0.00010	----	----	----
Copper, total	7440-50-8	E420/VA	0.00050	mg/L		0.00057	0.00062	----	----	----
Iron, total	7439-89-6	E420/VA	0.010	mg/L		0.073	0.097	----	----	----
Lead, total	7439-92-1	E420/VA	0.000050	mg/L		<0.000050	<0.000050	----	----	----
Lithium, total	7439-93-2	E420/VA	0.0010	mg/L		<0.0010	<0.0010	----	----	----
Magnesium, total	7439-95-4	E420/VA	0.0050	mg/L		0.502	0.244	----	----	----
Manganese, total	7439-96-5	E420/VA	0.00010	mg/L		0.00613	0.0140	----	----	----
Mercury, total	7439-97-6	E508/VA	0.0000050	mg/L		<0.0000050	<0.0000050	----	----	----
Molybdenum, total	7439-98-7	E420/VA	0.000050	mg/L		0.000216	<0.000050	----	----	----
Nickel, total	7440-02-0	E420/VA	0.00050	mg/L		<0.00050	<0.00050	----	----	----
Phosphorus, total	7723-14-0	E420/VA	0.050	mg/L		<0.050	<0.050	----	----	----
Potassium, total	7440-09-7	E420/VA	0.050	mg/L		0.234	0.112	----	----	----

Analytical Results

Sub-Matrix: Water
(Matrix: Water)

Analyte	CAS Number	Method/Lab	LOR	Unit	Client sample ID	Stocking Lake ----	Holland Lake ----	----	----	----
					Client sampling date / time	03-Feb-2026 10:40	03-Feb-2026 09:10	----	----	----
						VA26A2600-001	VA26A2600-002	----	----	----
						Result	Result	----	----	----
Total Metals										
Rubidium, total	7440-17-7	E420/VA	0.00020	mg/L		0.00051	0.00032	----	----	----
Selenium, total	7782-49-2	E420/VA	0.000050	mg/L		<0.000050	<0.000050	----	----	----
Silicon, total	7440-21-3	E420/VA	0.10	mg/L		1.78	1.26	----	----	----
Silver, total	7440-22-4	E420/VA	0.000010	mg/L		<0.000010	<0.000010	----	----	----
Sodium, total	7440-23-5	E420/VA	0.050	mg/L		1.14	0.793	----	----	----
Strontium, total	7440-24-6	E420/VA	0.00020	mg/L		0.0100	0.00637	----	----	----
Sulfur, total	7704-34-9	E420/VA	0.50	mg/L		<0.50	<0.50	----	----	----
Tellurium, total	13494-80-9	E420/VA	0.00020	mg/L		<0.00020	<0.00020	----	----	----
Thallium, total	7440-28-0	E420/VA	0.000010	mg/L		<0.000010	<0.000010	----	----	----
Thorium, total	7440-29-1	E420/VA	0.00010	mg/L		<0.00010	<0.00010	----	----	----
Tin, total	7440-31-5	E420/VA	0.00010	mg/L		<0.00010	<0.00010	----	----	----
Titanium, total	7440-32-6	E420/VA	0.00030	mg/L		0.00047	0.00073	----	----	----
Tungsten, total	7440-33-7	E420/VA	0.00010	mg/L		<0.00010	<0.00010	----	----	----
Uranium, total	7440-61-1	E420/VA	0.000010	mg/L		0.000026	<0.000010	----	----	----
Vanadium, total	7440-62-2	E420/VA	0.00050	mg/L		<0.00050	<0.00050	----	----	----
Zinc, total	7440-66-6	E420/VA	0.0030	mg/L		<0.0030	<0.0030	----	----	----
Zirconium, total	7440-67-7	E420/VA	0.00020	mg/L		<0.00020	<0.00020	----	----	----
Hydrocarbons										
EPH (C10-C19)	----	E601A/VA	250	µg/L		<250	<250	----	----	----
EPH (C10-C32)	----	E601A/VA	400	µg/L		<400	<400	----	----	----
EPH (C19-C32)	----	E601A/VA	250	µg/L		<250	<250	----	----	----

Analytical Results

Sub-Matrix: Water
(Matrix: Water)

Analyte	CAS Number	Method/Lab	LOR	Unit	Client sample ID: Stocking Lake ----	Holland Lake ----	----	----	----
					Client sampling date / time: 03-Feb-2026 10:40	03-Feb-2026 09:10	----	----	----
					VA26A2600-001	VA26A2600-002	----	----	----
					Result	Result	----	----	----
Hydrocarbons									
TEH (C10-C30), BC	----	E601A/VA	250	µg/L	<250	<250	----	----	----
Hydrocarbons Surrogates									
Bromobenzotrifluoride, 2- (EPH surrogate)	392-83-6	E601A/VA	1.0	%	88.7	93.3	----	----	----
Polycyclic Aromatic Hydrocarbons									
Acenaphthene	83-32-9	E641A/VA	0.010	µg/L	<0.010	<0.010	----	----	----
Acenaphthylene	208-96-8	E641A/VA	0.010	µg/L	<0.010	<0.010	----	----	----
Acridine	260-94-6	E641A/VA	0.010	µg/L	<0.010	<0.010	----	----	----
Anthracene	120-12-7	E641A/VA	0.010	µg/L	<0.010	<0.010	----	----	----
Benz(a)anthracene	56-55-3	E641A/VA	0.010	µg/L	<0.010	<0.010	----	----	----
Benzo(a)pyrene	50-32-8	E641A/VA	0.0050	µg/L	<0.0050	<0.0050	----	----	----
Benzo(b+j)fluoranthene	n/a	E641A/VA	0.010	µg/L	<0.010	<0.010	----	----	----
Benzo(b+j+k)fluoranthene	n/a	E641A/VA	0.015	µg/L	<0.015	<0.015	----	----	----
Benzo(g,h,i)perylene	191-24-2	E641A/VA	0.010	µg/L	<0.010	<0.010	----	----	----
Benzo(k)fluoranthene	207-08-9	E641A/VA	0.010	µg/L	<0.010	<0.010	----	----	----
Chrysene	218-01-9	E641A/VA	0.010	µg/L	<0.010	<0.010	----	----	----
Dibenz(a,h)anthracene	53-70-3	E641A/VA	0.0050	µg/L	<0.0050	<0.0050	----	----	----
Fluoranthene	206-44-0	E641A/VA	0.010	µg/L	<0.010	<0.010	----	----	----
Fluorene	86-73-7	E641A/VA	0.010	µg/L	<0.010	<0.010	----	----	----
Indeno(1,2,3-cd)pyrene	193-39-5	E641A/VA	0.010	µg/L	<0.010	<0.010	----	----	----
Methylnaphthalene, 1-	90-12-0	E641A/VA	0.010	µg/L	<0.010	<0.010	----	----	----
Methylnaphthalene, 1+2-	----	E641A/VA	0.015	µg/L	<0.015	<0.015	----	----	----

Analytical Results

Sub-Matrix: Water
(Matrix: Water)

Analyte	CAS Number	Method/Lab	LOR	Unit	Client sample ID: Stocking Lake ----	Holland Lake ----	----	----	----
					Client sampling date / time: 03-Feb-2026 10:40	03-Feb-2026 09:10	----	----	----
					VA26A2600-001	VA26A2600-002	----	----	----
					Result	Result	----	----	----
Polycyclic Aromatic Hydrocarbons									
Methylnaphthalene, 2-	91-57-6	E641A/VA	0.010	µg/L	<0.010	<0.010	----	----	----
Naphthalene	91-20-3	E641A/VA	0.050	µg/L	<0.050	<0.050	----	----	----
Phenanthrene	85-01-8	E641A/VA	0.020	µg/L	<0.020	<0.020	----	----	----
Pyrene	129-00-0	E641A/VA	0.010	µg/L	<0.010	<0.010	----	----	----
Quinoline	91-22-5	E641A/VA	0.050	µg/L	<0.050	<0.050	----	----	----
B(a)P total potency equivalents [B(a)P TPE]	----	E641A/VA	0.010	µg/L	<0.010	<0.010	----	----	----
PAHs, high molecular weight (BC AWQ)	n/a	E641A/VA	0.030	µg/L	<0.030	<0.030	----	----	----
PAHs, low molecular weight (BC AWQ)	n/a	E641A/VA	0.060	µg/L	<0.060	<0.060	----	----	----
PAHs, total (CCME sewer 18)	n/a	E641A/VA	0.070	µg/L	<0.070	<0.070	----	----	----
PAHs, total (EPA 16)	n/a	E641A/VA	0.065	µg/L	<0.065	<0.065	----	----	----
Polycyclic Aromatic Hydrocarbons Surrogates									
Chrysene-d12	1719-03-5	E641A/VA	0.1	%	97.5	89.3	----	----	----
Naphthalene-d8	1146-65-2	E641A/VA	0.1	%	103	91.3	----	----	----
Phenanthrene-d10	1517-22-2	E641A/VA	0.1	%	107	95.5	----	----	----

Please refer to the General Comments section for an explanation of any qualifiers detected.

ALS Canada Ltd.

right solutions.
right partner.

QUALITY CONTROL INTERPRETIVE REPORT

Work Order	: **VA26A2600**	Page	: 1 of 11
Client	: **Town of Ladysmith**	Laboratory	: ALS Environmental - Vancouver
Contact	: Shawn Baker	Account Manager	: Kevin Bhikadia
Address	: 410 Esplanade PO Box 220 Ladysmith BC Canada V9G 1A2	Address	: 8081 Lougheed Highway Burnaby, British Columbia Canada V5A 1W9
Telephone	: ----	Telephone	: +1 604 253 4188
Project	: Arbutus Water Treatment - Quarterly Lake Sampling	Date Samples Received	: 04-Feb-2026 10:30
PO	: 10940	Issue Date	: 17-Feb-2026 09:13
C-O-C number	: ----		
Sampler	: ----		
Site	: RFP Tender No. 2022-IS-20 Extension		
Quote number	: Town of Ladysmith Standing Offer_V3		
No. of samples received	: 2		
No. of samples analysed	: 2		

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

Key

Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
CAS Number: Chemical Abstracts Service number is a unique identifier assigned to discrete substances.
DQO: Data Quality Objective.
LOR: Limit of Reporting (detection limit).
RPD: Relative Percent Difference.

Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

Summary of Outliers

Outliers : Quality Control Samples

- No Method Blank value outliers occur.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Matrix Spike outliers occur.
- No Test sample Surrogate recovery outliers exist.

Outliers: Reference Material (RM) Samples

- No Reference Material (RM) Sample outliers occur.

Outliers : Analysis Holding Time Compliance (Breaches)

- Analysis Holding Time Outliers exist - please see following pages for full details.

Outliers : Frequency of Quality Control Samples

- No Quality Control Sample Frequency Outliers occur.

CERTIFICATE OF ANALYSIS

Work Order	:	**VA26A2589**			
Client	:	**Town of Ladysmith**	Laboratory	:	ALS Environmental - Vancouver
Contact	:	Shawn Baker	Account Manager	:	Kevin Bhikadia
Address	:	410 Esplanade PO Box 220 Ladysmith British Columbia Canada V9G 1A2	Address	:	8081 Lougheed Highway Burnaby BC Canada V5A 1W9
Telephone	:	----	E-mail	:	Kevin.Bhikadia@alsglobal.com
Project	:	Arbutus Water Treatment Plant- Weekly Sampling	Telephone	:	+1 604 253 4188
PO	:	10977	Date Samples Received	:	04-Feb-2026 10:35
C-O-C number	:	----	Date Analysis Commenced	:	04-Feb-2026
Sampler	:	----	Issue Date	:	10-Feb-2026 09:26
Site	:	Town of Ladysmith			
Quote number	:	Town of Ladysmith Standing Offer			
No. of samples received	:	4			
No. of samples analysed	:	4			

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

Signatories	*Position*	*Laboratory Department*
Lia Xie	Lab Assistant	Inorganics, Burnaby, British Columbia
Miles Gropen	Department Manager - Inorganics	Inorganics, Burnaby, British Columbia
Miles Gropen	Department Manager - Inorganics	Microbiology, Burnaby, British Columbia

General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key: CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances.
LOR: Limit of Reporting (detection limit).

Unit	*Description*
-	no units
CFU/mL	colony forming units per millilitre
CU	colour units (1 cu = 1 mg/l pt)
mg/L	milligrams per litre
MPN/100mL	most probable number per hundred millilitres
NTU	nephelometric turbidity units
pH units	pH units
µS/cm	microsiemens per centimetre

<: less than.
>: greater than.
Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.
UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

Workorder Comments

sample 004 "Treated Water (post reservoir)" Exceeded Recommended Holding Time prior to receipt at the lab for Microbiology analysis. Please check the PM to clarify the test.

Analytical Results

Sub-Matrix: Water
(Matrix: Water)

Analyte	CAS Number	Method/Lab	LOR	Unit	Raw Water ----	DAF Effluent ----	UF Effluent ----	Treated Water (post reservoir) ----	----
Client sampling date / time					03-Feb-2026 10:30	03-Feb-2026 10:30	03-Feb-2026 10:30	03-Feb-2026 10:30	----
					VA26A2589-001	**VA26A2589-002**	**VA26A2589-003**	**VA26A2589-004**	**----**
					Result	Result	Result	Result	----
Sample Preparation									
Dissolved carbon filtration location	----	EP358/VA	-	-	lab	lab	lab	----	----
Physical Tests									
Alkalinity, total (as CaCO3)	----	E290/VA	1.0	mg/L	----	----	----	22.8	----
Colour, true	----	E329/VA	5.0	CU	----	----	----	<5.0	----
Conductivity	----	E100/VA	2.0	µS/cm	----	----	----	74.9	----
pH	----	E108/VA	0.10	pH units	----	----	----	7.55	----
Turbidity	----	E121/VA	0.10	NTU	----	----	----	<0.10	----
Organic / Inorganic Carbon									
Carbon, dissolved organic [DOC]	----	E358-L/VA	0.50	mg/L	2.97	1.40	1.42	----	----
Carbon, total organic [TOC]	----	E355-L/VA	0.50	mg/L	2.93	1.43	1.26	----	----
Microbiological Tests									
Heterotrophic plate count [HPC]	----	E020/VA	1	CFU/mL	----	----	----	9	----
Coliforms, Escherichia coli [E. coli]	----	E010/VA	1	MPN/100 mL	----	----	----	<1	----
Coliforms, total	----	E010/VA	1	MPN/100 mL	----	----	----	<1	----

Please refer to the General Comments section for an explanation of any qualifiers detected.

alsglobal.com

ALS Canada Ltd.

right solutions.
right partner.

QUALITY CONTROL INTERPRETIVE REPORT

Work Order	: **VA26A2589**	Page	: 1 of 8
Client	: **Town of Ladysmith**	Laboratory	: ALS Environmental - Vancouver
Contact	: Shawn Baker	Account Manager	: Kevin Bhikadia
Address	: 410 Esplanade PO Box 220 Ladysmith BC Canada V9G 1A2	Address	: 8081 Lougheed Highway Burnaby, British Columbia Canada V5A 1W9
Telephone	: ----	Telephone	: +1 604 253 4188
Project	: Arbutus Water Treatment Plant- Weekly Sampling	Date Samples Received	: 04-Feb-2026 10:35
PO	: 10977	Issue Date	: 10-Feb-2026 09:26
C-O-C number	: ----		
Sampler	: ----		
Site	: Town of Ladysmith		
Quote number	: Town of Ladysmith Standing Offer_V3		
No. of samples received	: 4		
No. of samples analysed	: 4		

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

Key

Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
CAS Number: Chemical Abstracts Service number is a unique identifier assigned to discrete substances.
DQO: Data Quality Objective.
LOR: Limit of Reporting (detection limit).
RPD: Relative Percent Difference.

Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

Summary of Outliers

Outliers : Quality Control Samples

- No Method Blank value outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Matrix Spike outliers occur.
- Duplicate outliers occur - please see following pages for full details.
- No Test sample Surrogate recovery outliers exist.

Outliers: Reference Material (RM) Samples

- No Reference Material (RM) Sample outliers occur.

Outliers : Analysis Holding Time Compliance (Breaches)

- Analysis Holding Time Outliers exist - please see following pages for full details.

Outliers : Frequency of Quality Control Samples

- No Quality Control Sample Frequency Outliers occur.

CERTIFICATE OF ANALYSIS

Work Order	:	**VA26A3265**			
Client	:	**Town of Ladysmith**	Laboratory	:	ALS Environmental - Vancouver
Contact	:	Shawn Baker	Account Manager	:	Kevin Bhikadia
Address	:	410 Esplanade PO Box 220 Ladysmith British Columbia Canada V9G 1A2	Address	:	8081 Lougheed Highway Burnaby BC Canada V5A 1W9
Telephone	:	----	E-mail	:	Kevin.Bhikadia@alsglobal.com
Project	:	Arbutus Water Treatment Plant - Weekly Sampling	Telephone	:	+1 604 253 4188
PO	:	10940	Date Samples Received	:	11-Feb-2026 10:45
C-O-C number	:	----	Date Analysis Commenced	:	11-Feb-2026
Sampler	:	----	Issue Date	:	17-Feb-2026 10:10
Site	:	Town of Ladysmith			
Quote number	:	Town of Ladysmith Standing Offer			
No. of samples received	:	4			
No. of samples analysed	:	4			

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

Signatories	*Position*	*Laboratory Department*
Hdeep Kaur	Lab Assistant	Inorganics, Burnaby, British Columbia
Miles Gropen	Department Manager - Inorganics	Inorganics, Burnaby, British Columbia
Miles Gropen	Department Manager - Inorganics	Microbiology, Burnaby, British Columbia

General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key: CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances.
LOR: Limit of Reporting (detection limit).

Unit	*Description*
-	no units
CFU/mL	colony forming units per millilitre
CU	colour units (1 cu = 1 mg/l pt)
mg/L	milligrams per litre
MPN/100mL	most probable number per hundred millilitres
NTU	nephelometric turbidity units
pH units	pH units
µS/cm	microsiemens per centimetre

<: less than.
>: greater than.
Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.
UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

alsglobal.com

Analytical Results

Sub-Matrix: Water
(Matrix: Water)

Analyte	CAS Number	Method/Lab	LOR	Unit	Client sample ID: Raw Water ----	DAF Effluent ----	UF Effluent ----	Treated Water (post reservoir) ----	----
					Client sampling date / time: 10-Feb-2026 10:30	10-Feb-2026 10:30	10-Feb-2026 10:30	10-Feb-2026 10:30	----
					VA26A3265-001	VA26A3265-002	VA26A3265-003	VA26A3265-004	----
					Result	Result	Result	Result	----
Sample Preparation									
Dissolved carbon filtration location	----	EP358/VA	-	-	lab	lab	lab	----	----
Physical Tests									
Alkalinity, total (as CaCO3)	----	E290/VA	1.0	mg/L	----	----	----	22.7	----
Colour, true	----	E329/VA	5.0	CU	----	----	----	<5.0	----
Conductivity	----	E100/VA	2.0	µS/cm	----	----	----	74.7	----
pH	----	E108/VA	0.10	pH units	----	----	----	7.55	----
Turbidity	----	E121/VA	0.10	NTU	----	----	----	<0.10	----
Organic / Inorganic Carbon									
Carbon, dissolved organic [DOC]	----	E358-L/VA	0.50	mg/L	3.15	1.62	1.45	----	----
Carbon, total organic [TOC]	----	E355-L/VA	0.50	mg/L	2.86	1.50	1.23	----	----
Microbiological Tests									
Heterotrophic plate count [HPC]	----	E020/VA	1	CFU/mL	----	----	----	1	----
Coliforms, Escherichia coli [E. coli]	----	E010/VA	1	MPN/100 mL	----	----	----	<1	----
Coliforms, total	----	E010/VA	1	MPN/100 mL	----	----	----	<1	----

Please refer to the General Comments section for an explanation of any qualifiers detected.

alsglobal.com

ALS Canada Ltd.

right solutions.
right partner.

QUALITY CONTROL INTERPRETIVE REPORT

Work Order	: **VA26A3265**	Page	: 1 of 7
Client	: **Town of Ladysmith**	Laboratory	: ALS Environmental - Vancouver
Contact	: Shawn Baker	Account Manager	: Kevin Bhikadia
Address	: 410 Esplanade PO Box 220 Ladysmith BC Canada V9G 1A2	Address	: 8081 Lougheed Highway Burnaby, British Columbia Canada V5A 1W9
Telephone	: ----	Telephone	: +1 604 253 4188
Project	: Arbutus Water Treatment Plant - Weekly Sampling	Date Samples Received	: 11-Feb-2026 10:45
PO	: 10940	Issue Date	: 17-Feb-2026 10:09
C-O-C number	: ----		
Sampler	: ----		
Site	: Town of Ladysmith		
Quote number	: Town of Ladysmith Standing Offer_V3		
No. of samples received	: 4		
No. of samples analysed	: 4		

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

Key

Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
CAS Number: Chemical Abstracts Service number is a unique identifier assigned to discrete substances.
DQO: Data Quality Objective.
LOR: Limit of Reporting (detection limit).
RPD: Relative Percent Difference.

Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

Summary of Outliers

Outliers : Quality Control Samples

- No Method Blank value outliers occur.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Matrix Spike outliers occur.
- No Test sample Surrogate recovery outliers exist.

Outliers: Reference Material (RM) Samples

- No Reference Material (RM) Sample outliers occur.

Outliers : Analysis Holding Time Compliance (Breaches)

- Analysis Holding Time Outliers exist - please see following pages for full details.

Outliers : Frequency of Quality Control Samples

- No Quality Control Sample Frequency Outliers occur.

CERTIFICATE OF ANALYSIS

Work Order	:	**VA26A3763**		
Client	:	**Town of Ladysmith**	Laboratory	: ALS Environmental - Vancouver
Contact	:	Shawn Baker	Account Manager	: Kevin Bhikadia
Address	:	410 Esplanade PO Box 220 Ladysmith British Columbia Canada V9G 1A2	Address	: 8081 Lougheed Highway Burnaby BC Canada V5A 1W9
Telephone	:	----	E-mail	: Kevin.Bhikadia@alsglobal.com
Project	:	Arbutus Water Treatment Plant - Weekly Sampling	Telephone	: +1 604 253 4188
PO	:	10940	Date Samples Received	: 18-Feb-2026 10:05
C-O-C number	:	----	Date Analysis Commenced	: 18-Feb-2026
Sampler	:	----	Issue Date	: 23-Feb-2026 10:59
Site	:	Town of Ladysmith		
Quote number	:	Town of Ladysmith Standing Offer		
No. of samples received	:	4		
No. of samples analysed	:	4		

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

Signatories	*Position*	*Laboratory Department*
Claire Yang	Lab Assistant	Inorganics, Burnaby, British Columbia
Lindsay Gung	Department Manager - Inorganics	Microbiology, Burnaby, British Columbia
Monica Ko	Supervisor - Inorganic	Inorganics, Burnaby, British Columbia

General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key: CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances.
LOR: Limit of Reporting (detection limit).

Unit	*Description*
-	no units
CFU/mL	colony forming units per millilitre
CU	colour units (1 cu = 1 mg/l pt)
mg/L	milligrams per litre
MPN/100mL	most probable number per hundred millilitres
NTU	nephelometric turbidity units
pH units	pH units
µS/cm	microsiemens per centimetre

<: less than.
>: greater than.
Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.
UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

alsglobal.com

Analytical Results

Sub-Matrix: Water
(Matrix: Water)

Analyte	CAS Number	Method/Lab	LOR	Unit	Client sample ID: Raw Water ----	DAF Effluent ----	UF Effluent ----	Treated Water (post reservoir) ----	----
					Client sampling date / time: 17-Feb-2026 10:30	17-Feb-2026 10:30	17-Feb-2026 10:30	17-Feb-2026 10:30	----
					VA26A3763-001	VA26A3763-002	VA26A3763-003	VA26A3763-004	----
					Result	Result	Result	Result	----
Sample Preparation									
Dissolved carbon filtration location	----	EP358/VA	-	-	lab	lab	lab	----	----
Physical Tests									
Alkalinity, total (as CaCO3)	----	E290/VA	1.0	mg/L	----	----	----	23.4	----
Colour, true	----	E329/VA	5.0	CU	----	----	----	<5.0	----
Conductivity	----	E100/VA	2.0	µS/cm	----	----	----	73.3	----
pH	----	E108/VA	0.10	pH units	----	----	----	7.43	----
Turbidity	----	E121/VA	0.10	NTU	----	----	----	<0.10	----
Organic / Inorganic Carbon									
Carbon, dissolved organic [DOC]	----	E358-L/VA	0.50	mg/L	2.96	1.30	1.51	----	----
Carbon, total organic [TOC]	----	E355-L/VA	0.50	mg/L	3.30	1.58	1.30	----	----
Microbiological Tests									
Heterotrophic plate count [HPC]	----	E020/VA	1	CFU/mL	----	----	----	<1	----
Coliforms, Escherichia coli [E. coli]	----	E010/VA	1	MPN/100 mL	----	----	----	<1	----
Coliforms, total	----	E010/VA	1	MPN/100 mL	----	----	----	<1	----

Please refer to the General Comments section for an explanation of any qualifiers detected.

alsglobal.com

Quality Control Interpretive Report

Work Order	:	**VA26A3763**		
Client	:	Town of Ladysmith	Laboratory	: ALS Environmental - Vancouver
Contact	:	Shawn Baker	Account Manager	: Kevin Bhikadia
Address	:	410 Esplanade PO Box 220 Ladysmith BC Canada V9G 1A2	Address	: 8081 Lougheed Highway Burnaby British Columbia Canada V5A 1W9
Telephone	:	----	Telephone	: +1 604 253 4188
Project	:	Arbutus Water Treatment Plant - Weekly Sampling	Date Samples Received	: 18-Feb-2026 10:05
PO	:	10940	Issue Date	: 23-Feb-2026 10:59
C-O-C number	:	----		
Sampler	:	----		
Site	:	Town of Ladysmith		
Quote number	:	Town of Ladysmith Standing Offer		
No. of samples received	:	4		
No. of samples analysed	:	4		

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

Key

Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances.
DQO: Data Quality Objective.
LOR: Limit of Reporting (detection limit).
RPD: Relative Percent Difference.

Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

Summary of Outliers

Outliers : Quality Control Samples

- No Method Blank value outliers occur.
- No Duplicate outliers occur.
- No Laboratory Control Sample (LCS) outliers occur
- No Laboratory Control Sample Duplicate (LCSD) outliers occur
- No Matrix Spike outliers occur.
- No Matrix Spike Duplicate (MSD) outliers occur.
- No Test sample Surrogate recovery outliers exist.

Outliers: Reference Material (RM) Samples

- No Reference Material (RM) Sample outliers occur.

Outliers : Analysis Holding Time Compliance (Breaches)

- Analysis Holding Time Outliers exist.

Outliers : Frequency of Quality Control Samples

- No Quality Control Sample Frequency Outliers occur.

CERTIFICATE OF ANALYSIS

Work Order	:	**VA26A4344**			
Client	:	**Town of Ladysmith**	Laboratory	:	ALS Environmental - Vancouver
Contact	:	Shawn Baker	Account Manager	:	Kevin Bhikadia
Address	:	410 Esplanade PO Box 220 Ladysmith British Columbia Canada V9G 1A2	Address	:	8081 Lougheed Highway Burnaby BC Canada V5A 1W9
Telephone	:	----	E-mail	:	Kevin.Bhikadia@alsglobal.com
Project	:	Arbutus Water Treatment - Weekly Sampling	Telephone	:	+1 604 253 4188
PO	:	10940	Date Samples Received	:	25-Feb-2026 10:03
C-O-C number	:	----	Date Analysis Commenced	:	25-Feb-2026
Sampler	:	----	Issue Date	:	03-Mar-2026 09:25
Site	:	Town of Ladysmith			
Quote number	:	Town of Ladysmith Standing Offer			
No. of samples received	:	4			
No. of samples analysed	:	4			

This report supersedes any previous report(s) with this reference. Results apply to the sample(s) as submitted. This document shall not be reproduced, except in full.

This Certificate of Analysis contains the following information:

- General Comments
- Analytical Results

Additional information pertinent to this report will be found in the following separate attachments: Quality Control Report, QC Interpretive report to assist with Quality Review and Sample Receipt Notification (SRN).

Signatories

This document has been electronically signed by the authorized signatories below. Electronic signing is conducted in accordance with US FDA 21 CFR Part 11.

Signatories	*Position*	*Laboratory Department*
Dat Ha	Analyst- General	Inorganics, Burnaby, British Columbia
Lindsay Gung	Department Manager - Inorganics	Microbiology, Burnaby, British Columbia
Monica Ko	Supervisor - Inorganic	Inorganics, Burnaby, British Columbia

General Comments

The analytical methods used by ALS are developed using internationally recognized reference methods (where available), such as those published by US EPA, APHA Standard Methods, ASTM, ISO, Environment Canada, BC MOE, and Ontario MOE. Refer to the ALS Quality Control Interpretive report (QCI) for applicable references and methodology summaries. Reference methods may incorporate modifications to improve performance.

Where a reported less than (<) result is higher than the LOR, this may be due to primary sample extract/digestate dilution and/or insufficient sample for analysis.

Where the LOR of a reported result differs from standard LOR, this may be due to high moisture content, insufficient sample (reduced weight employed) or matrix interference.

Please refer to Quality Control Interpretive report (QCI) for information regarding Holding Time compliance.

Key: CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances.
LOR: Limit of Reporting (detection limit).

Unit	*Description*
-	no units
CFU/mL	colony forming units per millilitre
CU	colour units (1 cu = 1 mg/l pt)
mg/L	milligrams per litre
MPN/100mL	most probable number per hundred millilitres
NTU	nephelometric turbidity units
pH units	pH units
µS/cm	microsiemens per centimetre

<: less than.
>: greater than.
Surrogate: An analyte that is similar in behavior to target analyte(s), but that does not occur naturally in environmental samples. For applicable tests, surrogates are added to samples prior to analysis as a check on recovery.

Test results reported relate only to the samples as received by the laboratory.
UNLESS OTHERWISE STATED on SRN or QCI Report, ALL SAMPLES WERE RECEIVED IN ACCEPTABLE CONDITION.

Analytical Results

Sub-Matrix: Water
(Matrix: Water)

Analyte	CAS Number	Method/Lab	LOR	Unit	Client sample ID: Raw Water ----	DAF Effluent ----	UF Effluent ----	Treated Water (post reservoir) ----	----
					Client sampling date / time: 24-Feb-2026 10:30	24-Feb-2026 10:30	24-Feb-2026 10:30	24-Feb-2026 10:30	----
					VA26A4344-001	VA26A4344-002	VA26A4344-003	VA26A4344-004	----
					Result	Result	Result	Result	----
Sample Preparation									
Dissolved carbon filtration location	----	EP358/VA	-	-	lab	lab	lab	----	----
Physical Tests									
Alkalinity, total (as CaCO3)	----	E290/VA	1.0	mg/L	----	----	----	18.4	----
Colour, true	----	E329/VA	5.0	CU	----	----	----	<5.0	----
Conductivity	----	E100/VA	2.0	µS/cm	----	----	----	70.2	----
pH	----	E108/VA	0.10	pH units	----	----	----	7.58	----
Turbidity	----	E121/VA	0.10	NTU	----	----	----	<0.10	----
Organic / Inorganic Carbon									
Carbon, dissolved organic [DOC]	----	E358-L/VA	0.50	mg/L	2.70	1.43	1.32	----	----
Carbon, total organic [TOC]	----	E355-L/VA	0.50	mg/L	3.00	1.34	1.10	----	----
Microbiological Tests									
Heterotrophic plate count [HPC]	----	E020/VA	1	CFU/mL	----	----	----	1	----
Coliforms, Escherichia coli [E. coli]	----	E010/VA	1	MPN/100 mL	----	----	----	<1	----
Coliforms, total	----	E010/VA	1	MPN/100 mL	----	----	----	<1	----

Please refer to the General Comments section for an explanation of any qualifiers detected.

Quality Control Interpretive Report

Work Order	:	**VA26A4344**			
Client	:	Town of Ladysmith	Laboratory	:	ALS Environmental - Vancouver
Contact	:	Shawn Baker	Account Manager	:	Kevin Bhikadia
Address	:	410 Esplanade PO Box 220 Ladysmith BC Canada V9G 1A2	Address	:	8081 Lougheed Highway Burnaby British Columbia Canada V5A 1W9
Telephone	:	----	Telephone	:	+1 604 253 4188
Project	:	Arbutus Water Treatment - Weekly Sampling	Date Samples Received	:	25-Feb-2026 10:03
PO	:	10940	Issue Date	:	03-Mar-2026 09:25
C-O-C number	:	----			
Sampler	:	----			
Site	:	Town of Ladysmith			
Quote number	:	Town of Ladysmith Standing Offer			
No. of samples received	:	4			
No. of samples analysed	:	4			

This report is automatically generated by the ALS LIMS (Laboratory Information Management System) through evaluation of Quality Control (QC) results and other QA parameters associated with this submission, and is intended to facilitate rapid data validation by auditors or reviewers. The report highlights any exceptions and outliers to ALS Data Quality Objectives, provides holding time details and exceptions, summarizes QC sample frequencies, and lists applicable methodology references and summaries.

Key

Anonymous: Refers to samples which are not part of this work order, but which formed part of the QC process lot.
CAS Number: Chemical Abstracts Services number is a unique identifier assigned to discrete substances.
DQO: Data Quality Objective.
LOR: Limit of Reporting (detection limit).
RPD: Relative Percent Difference.

Workorder Comments

Holding times are displayed as "---" if no guidance exists from CCME, Canadian provinces, or broadly recognized international references.

Summary of Outliers

Outliers : Quality Control Samples

- No Method Blank value outliers occur.
- Duplicate outliers occur - please see following pages for full details.
- No Laboratory Control Sample (LCS) outliers occur
- No Laboratory Control Sample Duplicate (LCSD) outliers occur
- No Matrix Spike outliers occur.
- No Matrix Spike Duplicate (MSD) outliers occur.
- No Test sample Surrogate recovery outliers exist.

Outliers: Reference Material (RM) Samples

- No Reference Material (RM) Sample outliers occur.

Outliers : Analysis Holding Time Compliance (Breaches)

- Analysis Holding Time Outliers exist.

Outliers : Frequency of Quality Control Samples

- No Quality Control Sample Frequency Outliers occur.