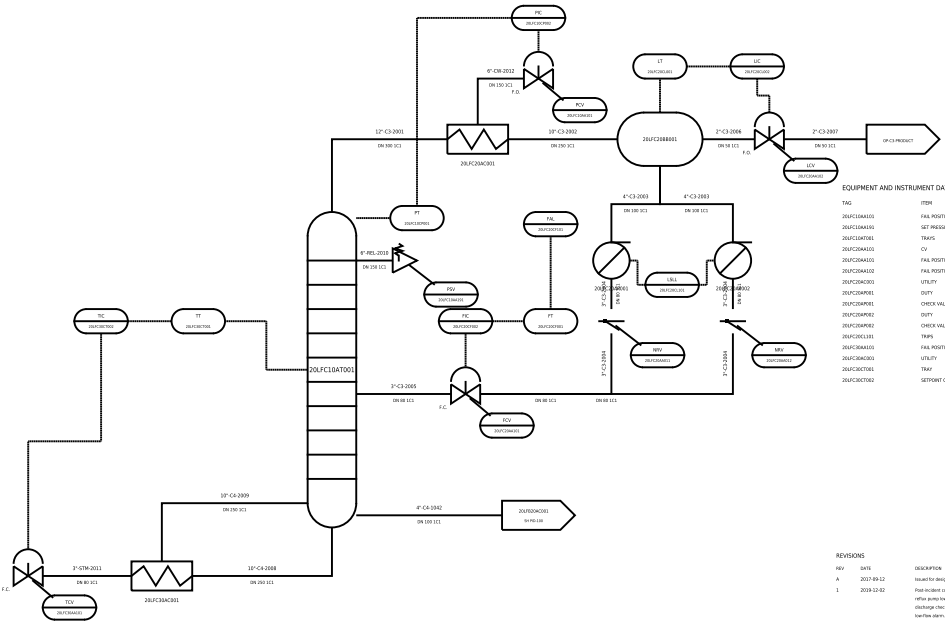


EQUIPMENT AND INSTRUMENT DATA

TAG	ITEM	VALUE
20LFC106A100	FAIL POSITION	FO
20LFC106A100	SET PRESSURE BARG	17.2
20LFC114T001	TRAYS	55
20LFC204A101	CV	45
20LFC204A101	FAIL POSITION	FC
20LFC204A102	FAIL POSITION	FO
20LFC204C001	UTILITY	cooling water
20LFC204P001	DUTY	running
20LFC204P001	CHECK VALVE	20LFC204A011
20LFC204P002	DUTY	standby
20LFC204P002	CHECK VALVE	20LFC204A012
20LFC205C100	TRIPS	20LFC204P001, 20LFC204P002
20LFC306A101	FAIL POSITION	FC
20LFC306C001	UTILITY	steam
20LFC30CT001	TRAY	28
20LFC30CT002	SETPOINT C	78

REVISIONS

REV	DATE	DESCRIPTION	MOC
A	2017-09-12	Issued for design	-
1	2019-12-02	Post-incident corrective actions: reflux pump low-low level trip, discharge check valves, reflux low-flow alarm.	MOC-2019-021

SYNTHETIC DEMO DATA
NOT A REAL PLANT

MERIDIAN GAS PROCESSING - HARBOR TERMINAL
SYNTHETIC DEMO DATA - NOT A REAL PLANT
UNIT 200 C3/C4 SPLITTER

TITLE: Column and Overhead
DWG NO: PID-200
REV: 1
DATE: 2019-12-02
DRAWN: Dana Okafor
MOC: MOC-2019-021