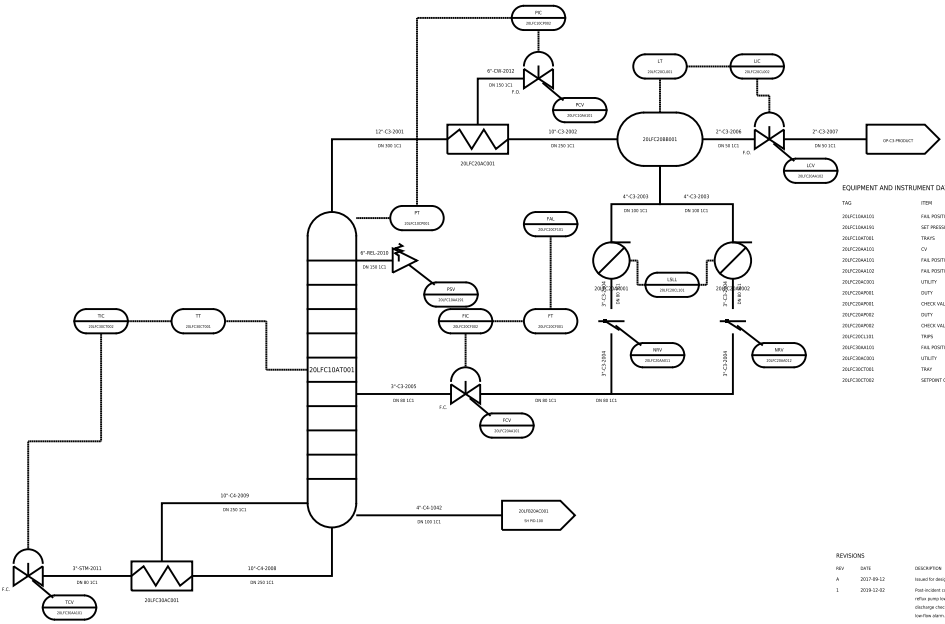


EQUIPMENT AND INSTRUMENT DATA

TAG	ITEM	VALUE
20LFC10AA100	FAIL POSITION	FO
20LFC10AA101	SET PRESSURE BARG	17.2
20LFC10AT001	TRAYS	55
20LFC20AA101	CV	75
20LFC20AA101	FAIL POSITION	FC
20LFC20AA102	FAIL POSITION	FO
20LFC20AC001	UTILITY	cooling water
20LFC20APO01	DUTY	running
20LFC20APO01	CHECK VALVE	20LFC20AA011
20LFC20APO02	DUTY	standby
20LFC20APO02	CHECK VALVE	20LFC20AA012
20LFC20CL101	TRIPS	20LFC20APO01, 20LFC20APO02
20LFC30AA101	FAIL POSITION	FC
20LFC30AC001	UTILITY	steam
20LFC30CT001	TRAY	28
20LFC30CT002	SETPOINT C	78

REVISIONS

REV	DATE	DESCRIPTION	MOC
A	2017-09-12	Issued for design	-
1	2019-12-02	Post-incident corrective actions: reflux pump low-low level trip, discharge check valves, reflux low-flow alarm.	MOC-2019-021
2	2020-08-10	20LFC20AA101 trim upsized for higher feed rate.	MOC-2020-014

SYNTHETIC DEMO DATA
NOT A REAL PLANT

MERIDIAN GAS PROCESSING - HARBOR TERMINAL
SYNTHETIC DEMO DATA - NOT A REAL PLANT
UNIT 200 C3/C4 SPLITTER
TITLE: Column and Overhead
DWG NO: PID-200
REV: 2
DATE: 2020-08-18
DRAWN: Dana Okafor
MOC: MOC-2020-014