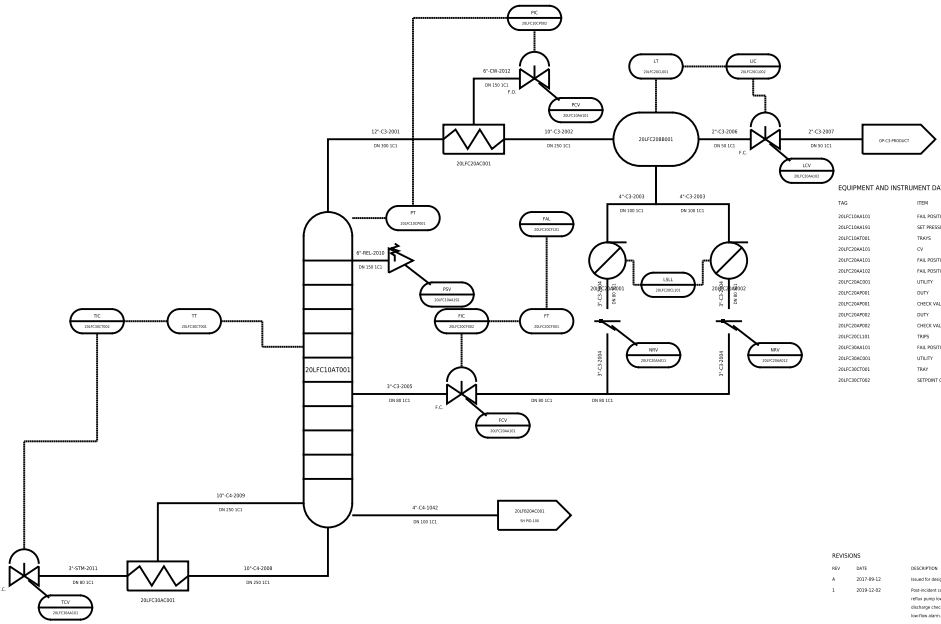


EQUIPMENT AND INSTRUMENT DATA

TAG	ITEM	VALUE
20LFC100A100	FAIL POSITION	FO
20LFC100A101	SET PRESSURE BARG	17.2
20LFC104T001	TRAYS	55
20LFC204A101	CV	75
20LFC204A101	FAIL POSITION	FC
20LFC204A102	FAIL POSITION	FC
20LFC204C001	UTILITY	cooling water
20LFC204P001	DUTY	running
20LFC204P001	CHECK VALVE	20LFC208A011
20LFC204P002	DUTY	standby
20LFC204P002	CHECK VALVE	20LFC208A012
20LFC205C100	TRIPS	20LFC208P001, 20LFC204P002
20LFC304A101	FAIL POSITION	FC
20LFC304C001	UTILITY	steam
20LFC30CT001	TRAY	32
20LFC30CT002	SETPOINT C	81

REVISIONS

REV	DATE	DESCRIPTION	MOC
A	2017-09-12	Issued for design	-
1	2019-12-02	Post-incident corrective actions: reflux pump low-low level trip, discharge check valves, reflux low-flow alarm.	MOC-2019-021
2	2020-08-10	20LFC30AA101 trim updated for higher feed rate.	MOC-2020-014
4	2023-05-22	20LFC30CT001 relocated from tray 28 to tray 32. 20LFC30CT002 setpoint updated.	MOC-2023-008
5	2024-10-14	20LFC304A102 fail position changed from FO to FC after 20LFC208B001 overfill near-miss.	MOC-2024-031

SYNTHETIC DEMO DATA
NOT A REAL PLANT

MERIDIAN GAS PROCESSING - HARBOR TERMINAL
SYNTHETIC DEMO DATA - NOT A REAL PLANT
UNIT 200 C3/C4 SPLITTER
TITLE: Column and Overhead
DWG NO: PID-200
REV: 5
DATE: 2024-10-14
DRAWN: Dana Okafor
MOC: MOC-2024-031