



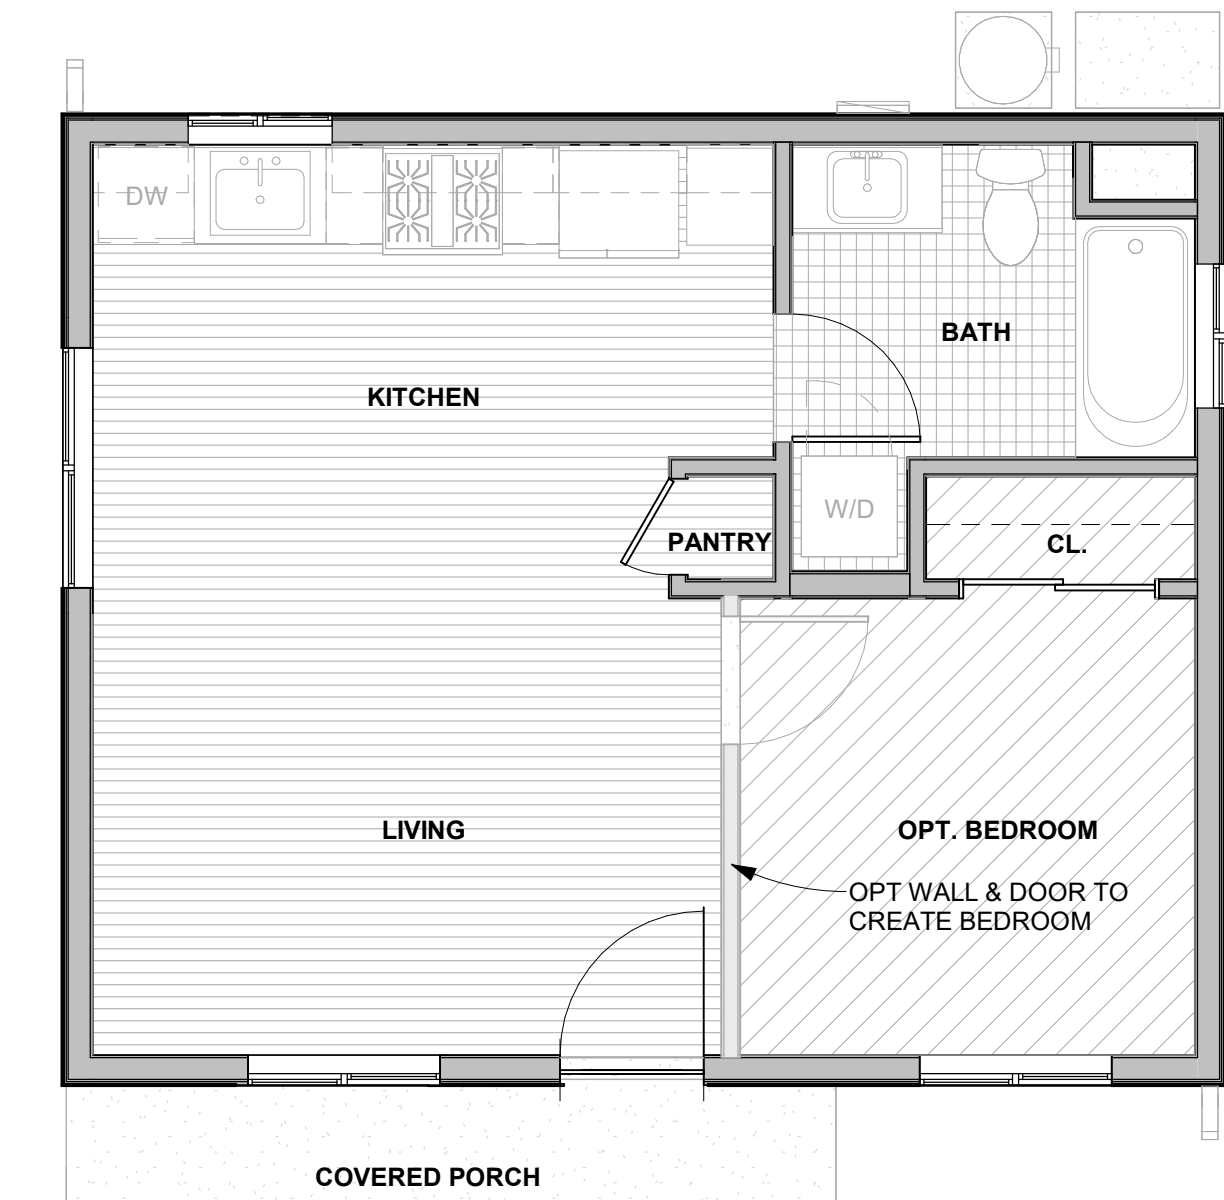

**2 GROUND FLOOR FINISH PLAN**  
A1-201 | A1-101 | SCALE: 1/4" = 1'-0"

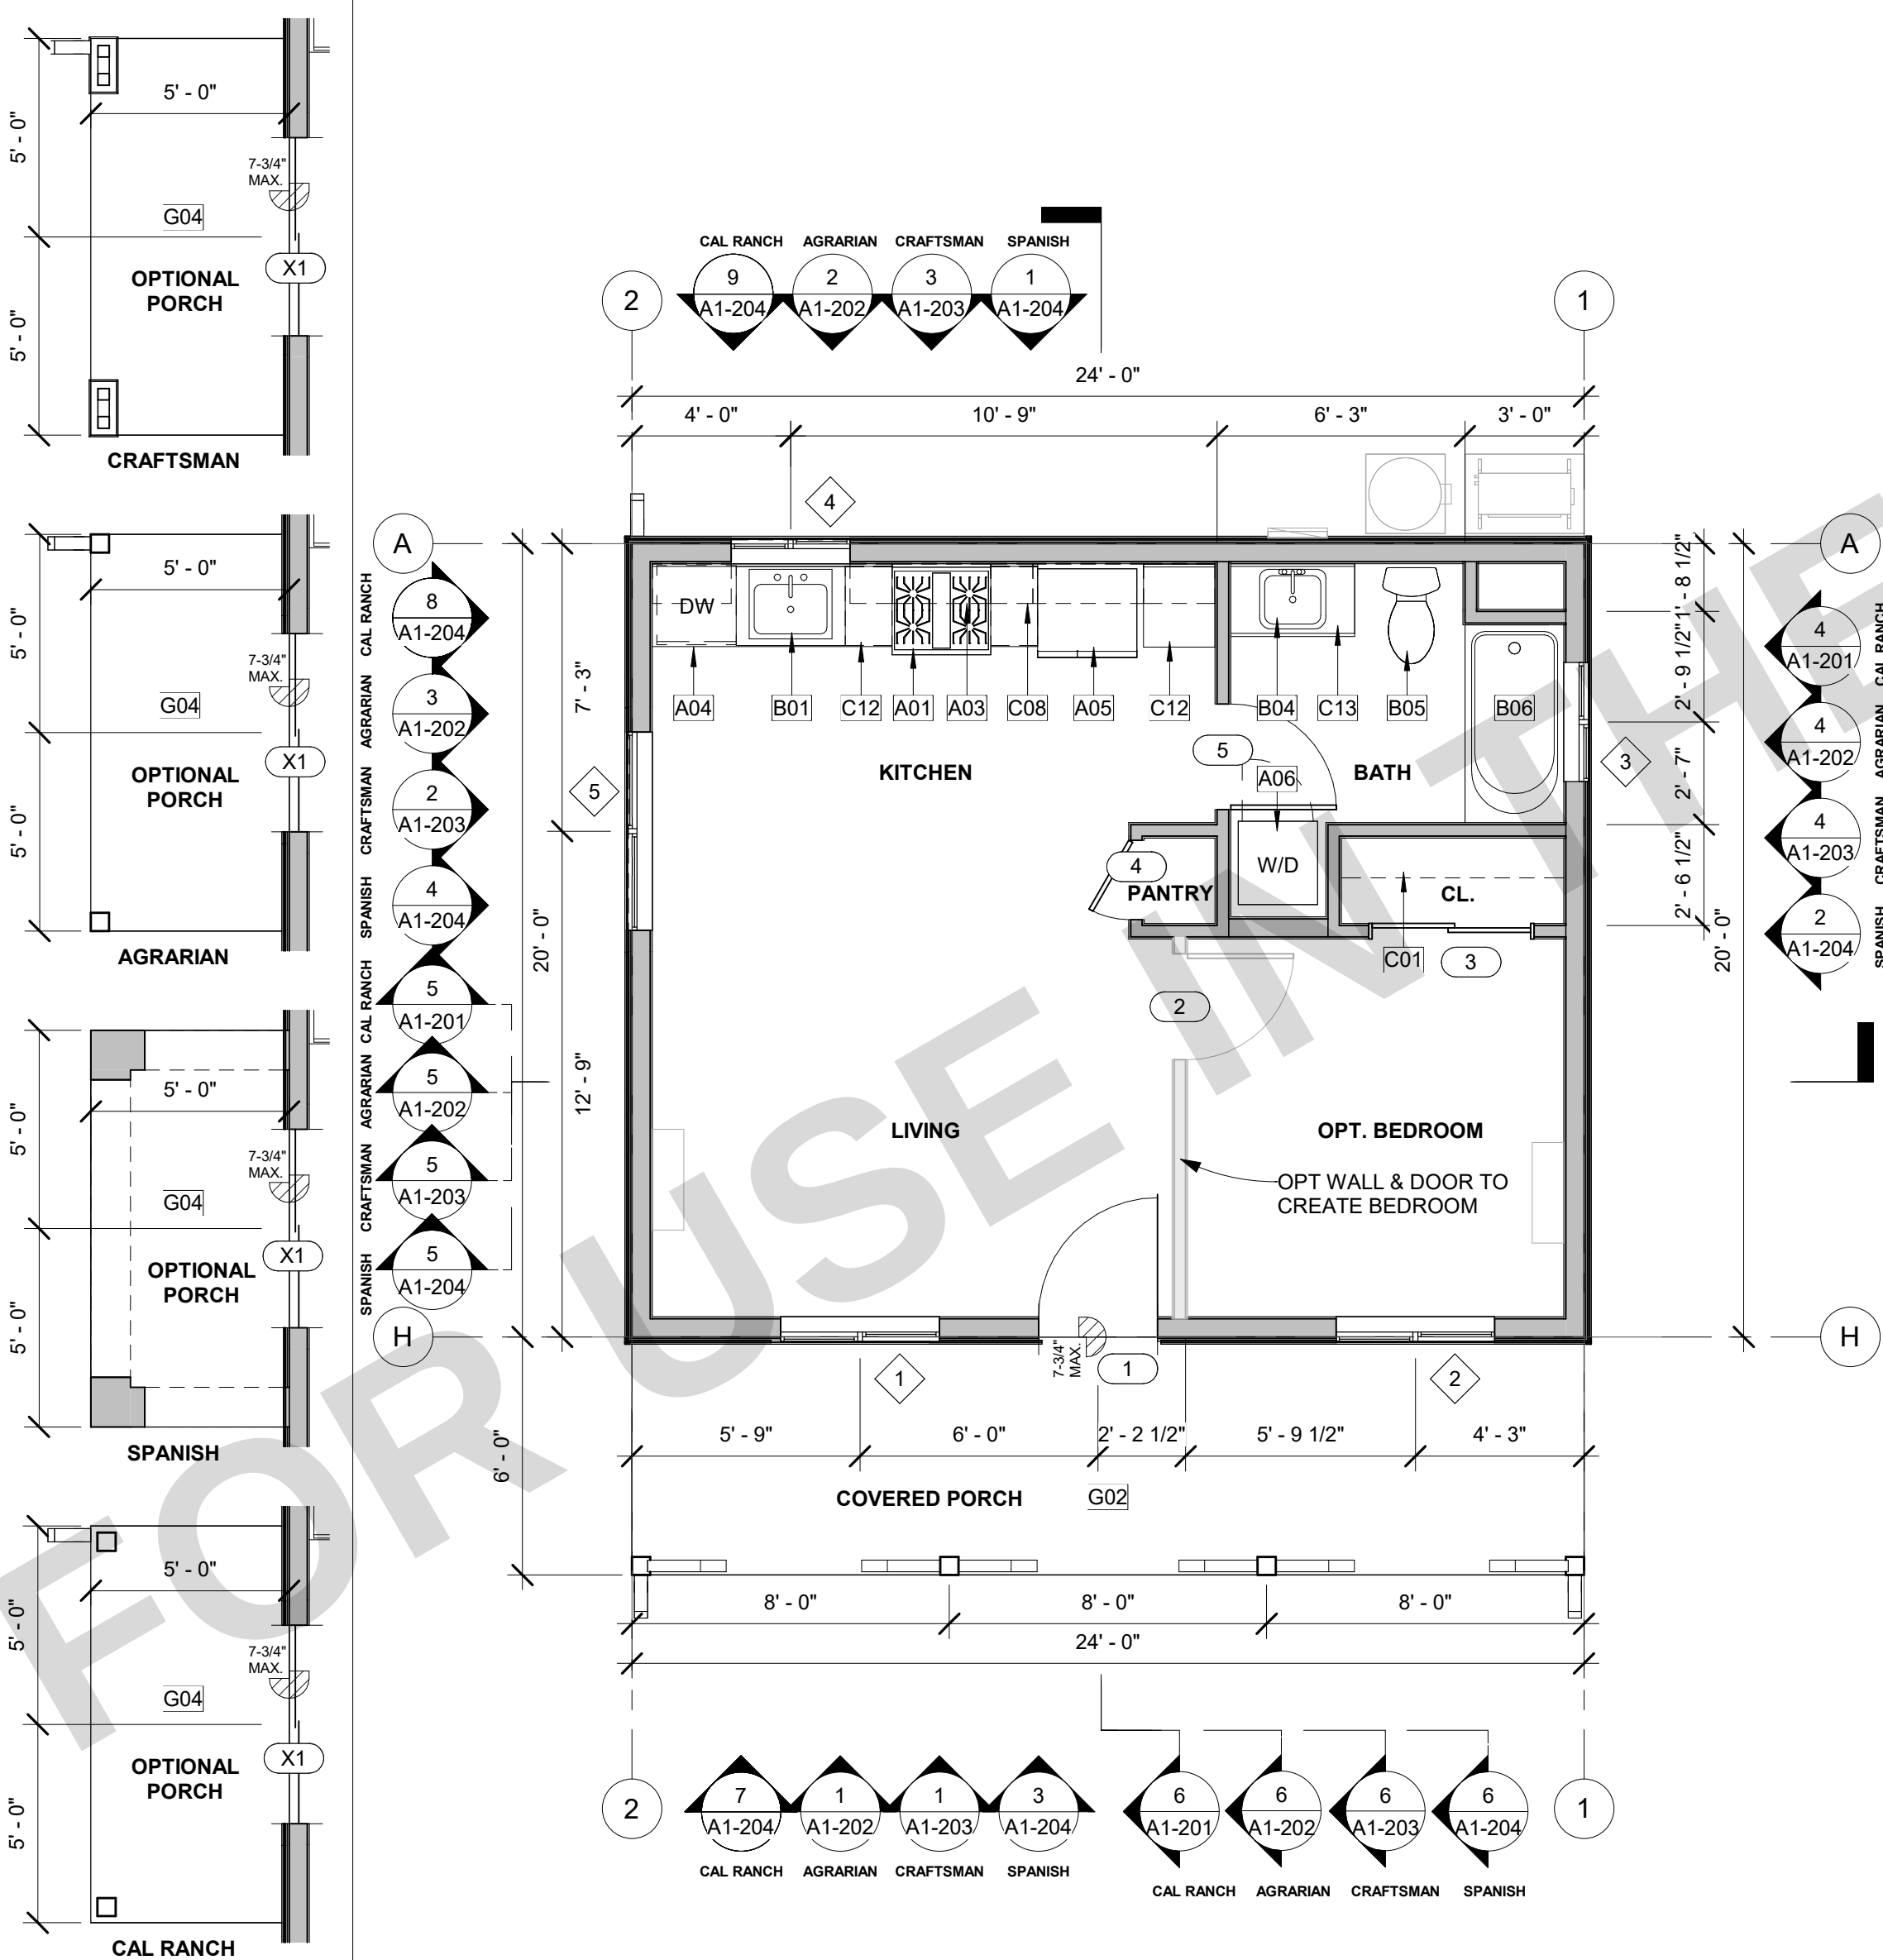

**1 GROUND FLOOR PLAN (CAL RANCH PORCH)**  
A1-201 | A1-101 | SCALE: 1/4" = 1'-0"


## FINISH PLAN GENERAL NOTES

1. REFER TO GENERAL NOTES SHEET G-101 FOR ADDITIONAL REQUIREMENTS.
2. REFER TO DETAILS FOR FLOOR/CEILING ASSEMBLIES AND INTERIOR FINISH DETAILS.
3. ALL HARD SURFACE FLOORING SHALL BE SLIP RESISTANT AND MEET THE **ANSI A326.3** STANDARD FOR MEASURING THE DYNAMIC COEFFICIENT OF FRICTION (DCOF).
4. ALL FLOORING MATERIALS SHALL COMPLY WITH **2022 CBC SEC. 804.1**.
5. ALL WALL AND CEILING FINISHES SHALL COMPLY WITH **2022 CBC TABLE 803.13** FOR MAXIMUM FLAME SPREAD AND SMOKE DENSITY.

## FINISH SCHEDULE

| FINISH SCHEDULE |       |       |         |                                                                                  |  |
|-----------------|-------|-------|---------|----------------------------------------------------------------------------------|--|
| ROOM            | FLOOR | WALL  | CEILING | NOTES                                                                            |  |
| OPT. BEDROOM    | CPT   | GW    | GW      | LVP WHEN BEDROOM NOT PROVIDED.                                                   |  |
| BATH            | CT    | WR GW | WR GW   | AT CERAMIC TILE IN TUB/SHOWER AREAS, PROVIDE BACKER BOARD PER CRC TABLE R702.4.2 |  |
| KITCHEN         | LVP   | GW    | GW      | WR GW BEHIND COUNTER                                                             |  |
| LIVING          | LVP   | GW    | GW      |                                                                                  |  |
| CL.             | CPT   | GW    | GW      | LVP WHEN BEDROOM NOT PROVIDED.                                                   |  |

## FINISH LEGEND

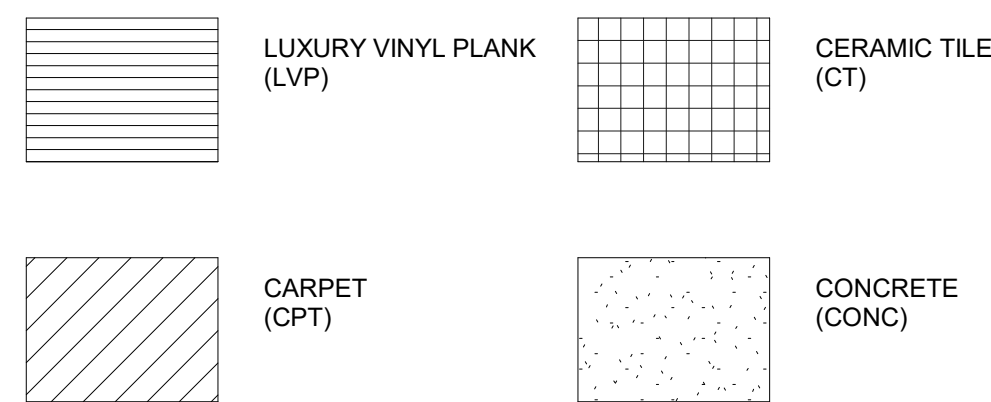

## KEYNOTES

- A01 30" WIDE FREE STANDING ELECTRIC RANGE OVEN. VENT TO EXTERIOR.  
A03 30" WIDE BUILT-IN MICROWAVE WITH RANGE VENT.  
A04 24" WIDE FRONT CONTROL UNDERCOUNTER DISHWASHER.  
A05 REFRIGERATOR LOCATION. PROVIDE 37" SPACE WITH ROUGH PLUMBING FOR ICE MAKER (RECESS IN WALL).  
A06 STACKED WASHER/DRYER MACHINE LOCATION. PROVIDE WASTE AND WATER IN RECESSED WALL BOX. PROVIDE DRYER VENT. VENT TO OUTSIDE AIR THROUGH EXTERIOR WALL. DRYER VENT 4" MIN DIAMETER TO EXTERIOR WITH SCREENED AND ONE DIRECTIONAL VENT GATE. MAX LENGTH TO NOT EXCEED 14' WITH A MAX OF 2 90-DEGREE BENDS. TERMINATION SHALL BE 3' MINIMUM FROM OPERABLE OPENING IN EXTERIOR WALL.  
B01 SINGLE COMPARTMENT UNDER-MOUNT KITCHEN SINK W/ GARBAGE DISPOSAL. REFER TO WATER EFFICIENCY REQUIREMENTS ON CALGREEN CODE NOTES SHEET.  
B04 LAVATORY SINK. REFER TO WATER EFFICIENCY REQUIREMENTS ON CALGREEN CODE NOTES SHEETS.  
B05 WATER CLOSET. REFER TO WATER EFFICIENCY REQUIREMENTS ON CALGREEN CODE NOTES SHEETS.  
B06 32" x 60" x 72" TUB AND SHOWER COMBINATION. MODEL BY BUILDER. WATER RESISTENT FINISH TO EXTEND TO 72" ABOVE FLOOR. SHOWER DOOR IF APPLICABLE TO BE TEMPERED GLASS.  
C01 SINGLE WOOD SHELF AND POLE.  
C08 12" DEEP UPPER CABINET  
C12 34 1/2" HIGH BASE CABINET AND COUNTERTOP.  
C13 30" HIGH BASE CABINET AND COUNTERTOP.  
G02 CONCRETE FLATWORK. 1/4"FT SLOPE AWAY FROM BUILDING.  
G04 SLOPE 1/4" PER FT AWAY FROM BUILDING.

### 4.303.2 STANDARDS FOR PLUMBING FIXTURES AND FITTINGS

PLUMBING FIXTURES AND FITTINGS SHALL BE INSTALLED IN ACCORDANCE WITH THE CALIFORNIA PLUMBING CODE, AND SHALL MEET THE APPLICABLE STANDARDS REFERENCED IN TABLE 1701.1 OF THE CALIFORNIA PLUMBING CODE.

**NOTE:**  
THIS TABLE COMPILES THE DATA IN SECTION 4.303.1 AND IS INCLUDED AS A CONVENIENCE FOR THE USER.

| TABLE - MAXIMUM FIXTURE WATER USE             |                                                |
|-----------------------------------------------|------------------------------------------------|
| FIXTURE TYPE                                  | FLOW RATE                                      |
| SHOWER HEADS (RESIDENTIAL)                    | 1.8 GPM @ 80 PSI                               |
| LAVATORY FAUCETS (RESIDENTIAL)                | MAX. 1.2 GPM @ 60 PSI<br>MIN. 0.8 GPM @ 20 PSI |
| LAVATORY FAUCETS IN COMMON & PUBLIC USE AREAS | 0.5 GPM @ 60 PSI                               |
| KITCHEN FAUCETS                               | 1.8 GPM @ 60 PSI                               |
| METERING FAUCETS                              | 0.25 GAL/CYCLE                                 |
| WATER CLOSET                                  | 1.28 GAL/FLUSH                                 |
| URINALS                                       | 0.125 GAL/FLUSH                                |

## WINDOW GENERAL NOTES

1. REFER TO GENERAL NOTES ON SHEET G-101 FOR ADDITIONAL REQUIREMENTS.
2. REFER TO FLOOR PLANS FOR WINDOW LOCATIONS.
3. CONTRACTOR TO VERIFY EXACT ROUGH OPENING SIZES PRIOR TO FABRICATION OF ROUGH OPENINGS.
4. INSTALL PER MANUFACTURERS WRITTEN INSTRUCTIONS.
5. REFER TO ENERGY COMPLIANCE REPORTS FOR U-FACTOR, SHGC AND ADDITIONAL WINDOW REQUIREMENTS.
6. ALL GLAZING IS DOUBLE PANE.
7. EGRESS WINDOWS SHALL HAVE A CLEAR OPENING WITH A MAX. SILL HEIGHT OF 44" AFF. MIN NET CLEAR OPENING FOR EMERGENCY ESCAPE SHALL BE 5.7 S.F. EXCEPTION: MIN 5.7 S.F. AT GROUND FLOOR. MINIMUM NET CLEAR OPENING DIMENSIONS: HEIGHT: 24". WIDTH: 20".
8. IN A HIGH FIRE SEVERITY / WUI AREA, ALL WINDOWS TO BE WUI COMPLIANT AND HAVE A MIN OF ONE TEMPERED PANE AT EXTERIOR.
9. SAFETY GLAZING / TEMPERED GLASS REQUIRED AT ALL OPERABLE DOORS, WITHIN TUB/SHOWER ENCLOSURES, WITHIN 24" OF TUB/SHOWER, WITHIN OPERATIONAL AREA OF ALL DOORS.


## WINDOW REMARKS

1. REQUIRED EGRESS WINDOW. REFER TO GENERAL NOTE #7 FOR ADDITIONAL INFORMATION.
2. HAZARDOUS LOCATION. WINDOW INCLUDES BOTH PANES TEMPERED GLAZING.
3. MULLED WINDOW ASSEMBLY.
4. OPTIONAL WINDOW.
5. OBSCURE.

## WINDOW SCHEDULE

| NO. | TYPE | SIZE    |         | HEAD HEIGHT | REMARKS |
|-----|------|---------|---------|-------------|---------|
|     |      | WIDTH   | HEIGHT  |             |         |
| 1   | B    | 4' - 0" | 4' - 0" | 6' - 8"     |         |
| 2   | B    | 4' - 0" | 4' - 0" | 6' - 8"     | 1       |
| 3   | B    | 3' - 0" | 2' - 0" | 6' - 8"     | 2       |
| 4   | B    | 3' - 0" | 3' - 0" | 6' - 8"     |         |
| 5   | B    | 5' - 0" | 4' - 0" | 6' - 8"     |         |


## WINDOW LEGEND

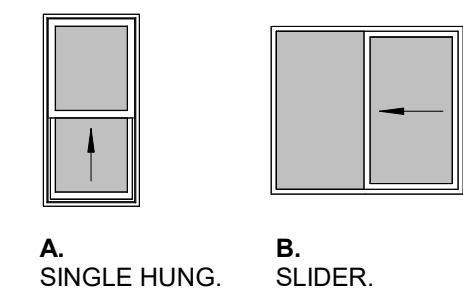

## FLOOR PLAN GENERAL NOTES

1. REFER TO GENERAL NOTES SHEET G-101 FOR ADDITIONAL REQUIREMENTS.
2. REFER TO STRUCTURAL PLANS FOR FURTHER INFORMATION.
3. REFER TO ELECTRICAL PLANS FOR FURTHER INFORMATION IF PROVIDED.
4. ALL FURNITURE AND EQUIPMENT IS BY OWNER AND IS SHOWN FOR COORDINATION PURPOSES ONLY.
5. DIMENSIONS ARE TO FACE OF FRAMING UNLESS SPECIFICALLY NOTED OTHERWISE.
6. PROVIDE ADEQUATE BLOCKING IN WALLS FOR CABINETS AND OTHER WALL MOUNTED ACCESSORIES INCLUDING BUT NOT LIMITED TO HANDRAILS, SHELVING AND BATHROOM FIXTURES.
7. DOOR AND WINDOW DIMENSIONS ARE CENTERED AT OPENINGS.
8. WHERE DOOR IS LOCATED WITHOUT DIMENSION AT THE CORNER OF A ROOM IT SHALL BE 4" FROM FACE OF FRAMING OF ADJACENT WALL TO ROUGH DOOR OPENING.
9. WHERE RECESSED FIXTURES OCCUR IN WALLS OR HORIZONTAL ASSEMBLIES, THE FIRE RATING OF THOSE ASSEMBLIES SHALL BE MAINTAINED.
10. AT ALL PENETRATIONS AND INTERSECTIONS OF FIRE-RATED PARTITIONS, PROVIDE FIRE SEALANT AND/OR FIRE STOPPING TO MAINTAIN CONTINUITY OF PARTITION RATING.
11. PER CRC R311.3 FLOORS OR LANDINGS AT EXTERIOR DOORS SHALL BE AT LEAST AS WIDE AS DOOR SERVED AND SHALL PROVIDE A LENGTH IN THE DIRECTION OF TRAVEL EQUAL TO 36 INCHES MINIMUM. SLOPE OF EXTERIOR LANDINGS SHALL NOT EXCEED 1/4" PER FOOT (2% SLOPE).
12. AT LEAST ONE BATHROOM ON THE ENTRY LEVEL SHALL BE PROVIDED WITH REINFORCEMENT INSTALLED IN ACCORDANCE WITH R327.1.1. REFERENCE A-902 FOR DETAILS.

## FLOOR PLAN LEGEND

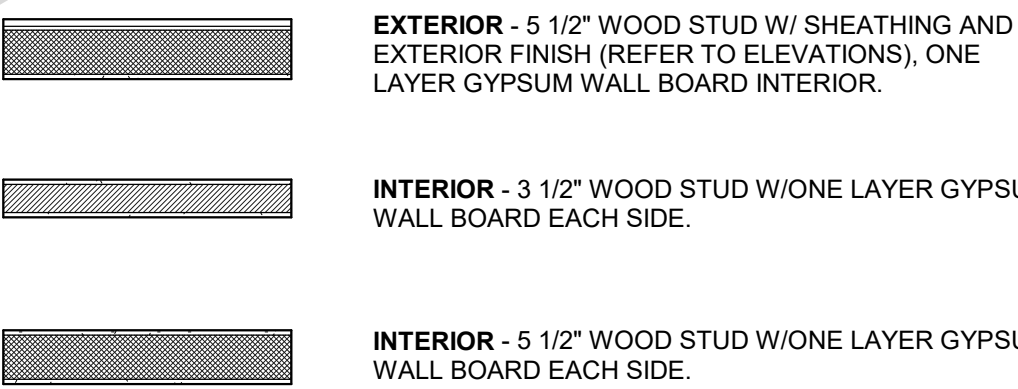

## DOOR GENERAL NOTES

1. REFER TO GENERAL NOTES SHEET G-101 FOR ADDITIONAL REQUIREMENTS.
2. REFER TO PLANS FOR LOCATION OF DOORS.
3. VERIFY ROUGH OPENING SIZE WITH DOOR MANUFACTURER SPECIFICATIONS PRIOR TO CONSTRUCTION.
4. CONTRACTOR TO VERIFY ACTUAL DOOR SIZE TO FIT FINISH OPENING PRIOR TO FABRICATION OF DOOR AND FINISH OPENING.
5. INSTALL PER MANUFACTURERS WRITTEN INSTRUCTIONS.
6. EXTERIOR DOORS SHALL EITHER HAVE A FIRE-RESISTANCE RATING OF NOT LESS THAN 20-MINUTES OR SHALL BE CONSTRUCTED OF SOLID CORE WOOD THAT COMPLIES WITH THE FOLLOWING REQUIREMENTS:
  - A. STILES AND RAILS SHALL NOT BE LESS THAN 1-3/8" THICK.
  - B. PANELS SHALL NOT BE LESS THAN 1-1/4" THICK, EXCEPT FOR THE EXTERIOR PERIMETER OF THE PANEL. SHALL BE PERMITTED TO TAPER TO A TONGUE OF NOT LESS THAN 3/8" THICK.
7. REFER TO DOOR TYPES LEGEND FOR GLAZING.
8. REFER TO T24 REPORT FOR GLAZING ENERGY REQUIREMENTS.
9. GLAZING IN DOORS SHALL BE TEMPERED PER **SECTION R308.4.1**.


## DOOR SCHEDULE

| NO. | TYPE | DOOR    |         | REMARKS |
|-----|------|---------|---------|---------|
|     |      | WIDTH   | HEIGHT  |         |
| 1   | A    | 3' - 0" | 6' - 8" |         |
| 2   | E    | 2' - 8" | 6' - 8" |         |
| 3   | B    | 4' - 0" | 6' - 8" |         |
| 4   | E    | 2' - 0" | 6' - 8" |         |
| 5   | E    | 2' - 8" | 6' - 8" | 2       |
| X1  | C    | 5' - 0" | 6' - 8" | 2, 4    |

## DOOR REMARKS

1. EXTERIOR DOOR. REFER TO GENERAL DOOR NOTE #6
2. GLAZING PER DOOR TYPES. REFER TO GENERAL DOOR NOTE #9
3. PROVIDE 100 SQ INCHES OF VENTING IN DOOR.
4. OPTIONAL DOOR.

## DOOR LEGEND

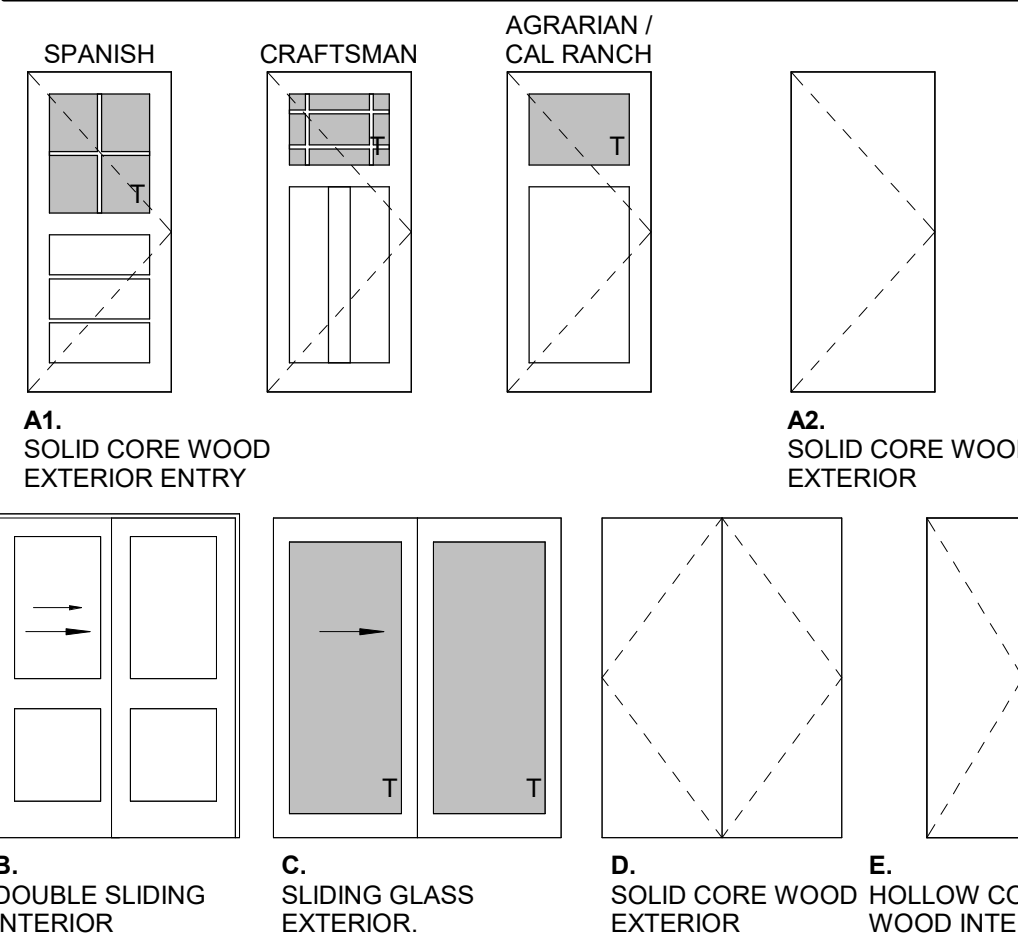

THESE PLANS ARE PROVIDED BY THE CITY OF PORTERVILLE AS PART OF THE PRE-APPROVED ADU PROGRAM AND ARE PUBLIC DOMAIN. THERE CANNOT BE A CHARGE TO PROVIDE THESE PLANS. NO ALTERATIONS TO THESE PLANS ARE ALLOWED. ALL ALTERATIONS MUST BE DONE UNDER A SEPARATE PERMIT ONCE THE BUILDING PERMIT FOR THE ADU HAS BEEN ISSUED AND FINAL INSPECTION COMPLETED IF YOU DO NOT HAVE THE CONSTRUCTION KNOWLEDGE AND EXPERIENCE TO CONSTRUCT THESE PLANS WITHOUT FURTHER DETAILS. IT IS RECOMMENDED YOU HIRE A CONTRACTOR TO DO THE CONSTRUCTION. THE CITY WILL NOT PROVIDE FURTHER INFORMATION OR DETAILS, AND BUILDING INSPECTORS WILL NOT PROVIDE STEP BY STEP INSTRUCTIONS IN THE FIELD.

PORTERVILLE ADU PROTOTYPES

PORTERVILLE, CA

FLOOR PLANS & FINISH PLANS

PUBLIC SET

DATE  
07/05/23  
SHEET

A1-101