

10.47K

Energy Saved (MWh)

1.47M

Annual Savings (\$)


157.08

CO2e reduction (t)


1.31K

CLIMB POINTS AVOIDED


Total Savings (MWh) by Month

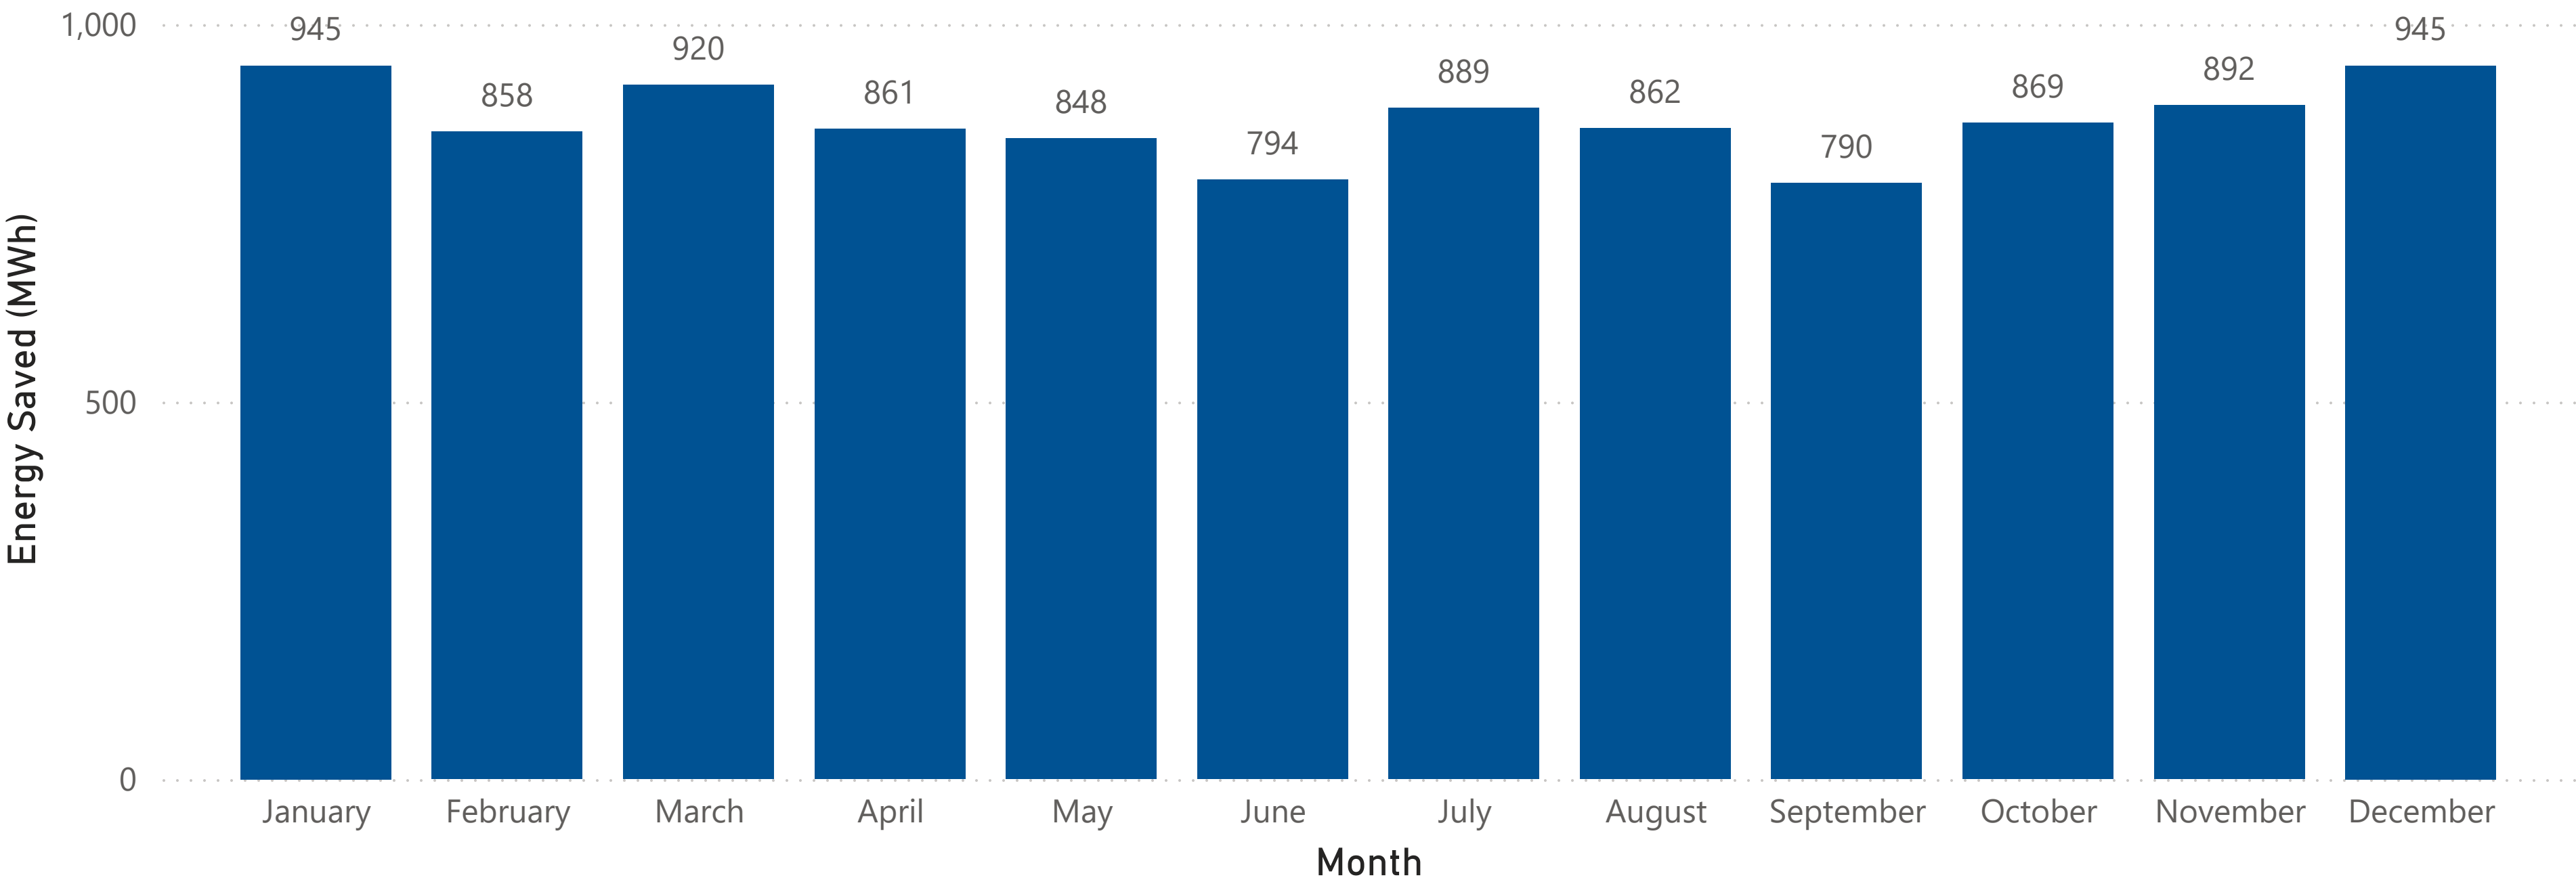


CO2e reduction (t) by Month

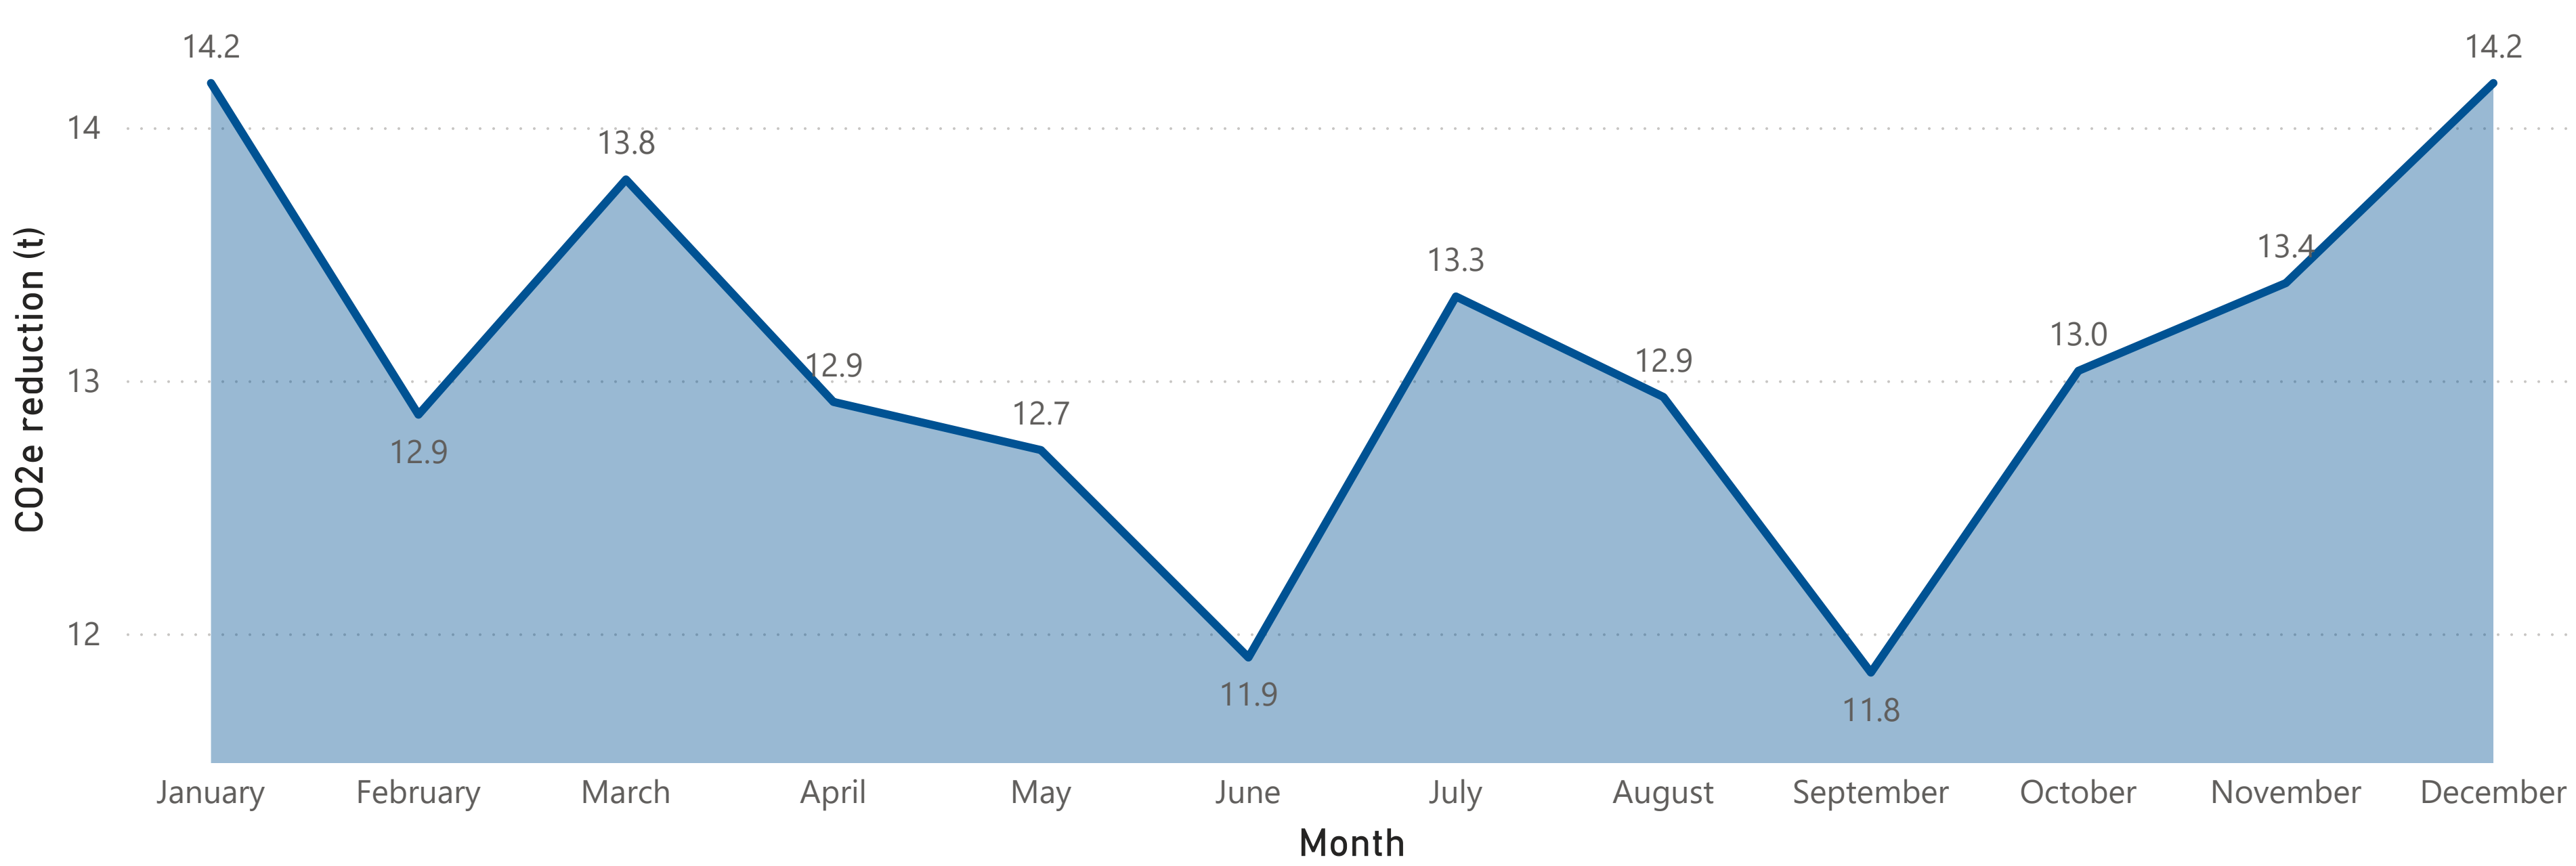

Savings (%) by Month

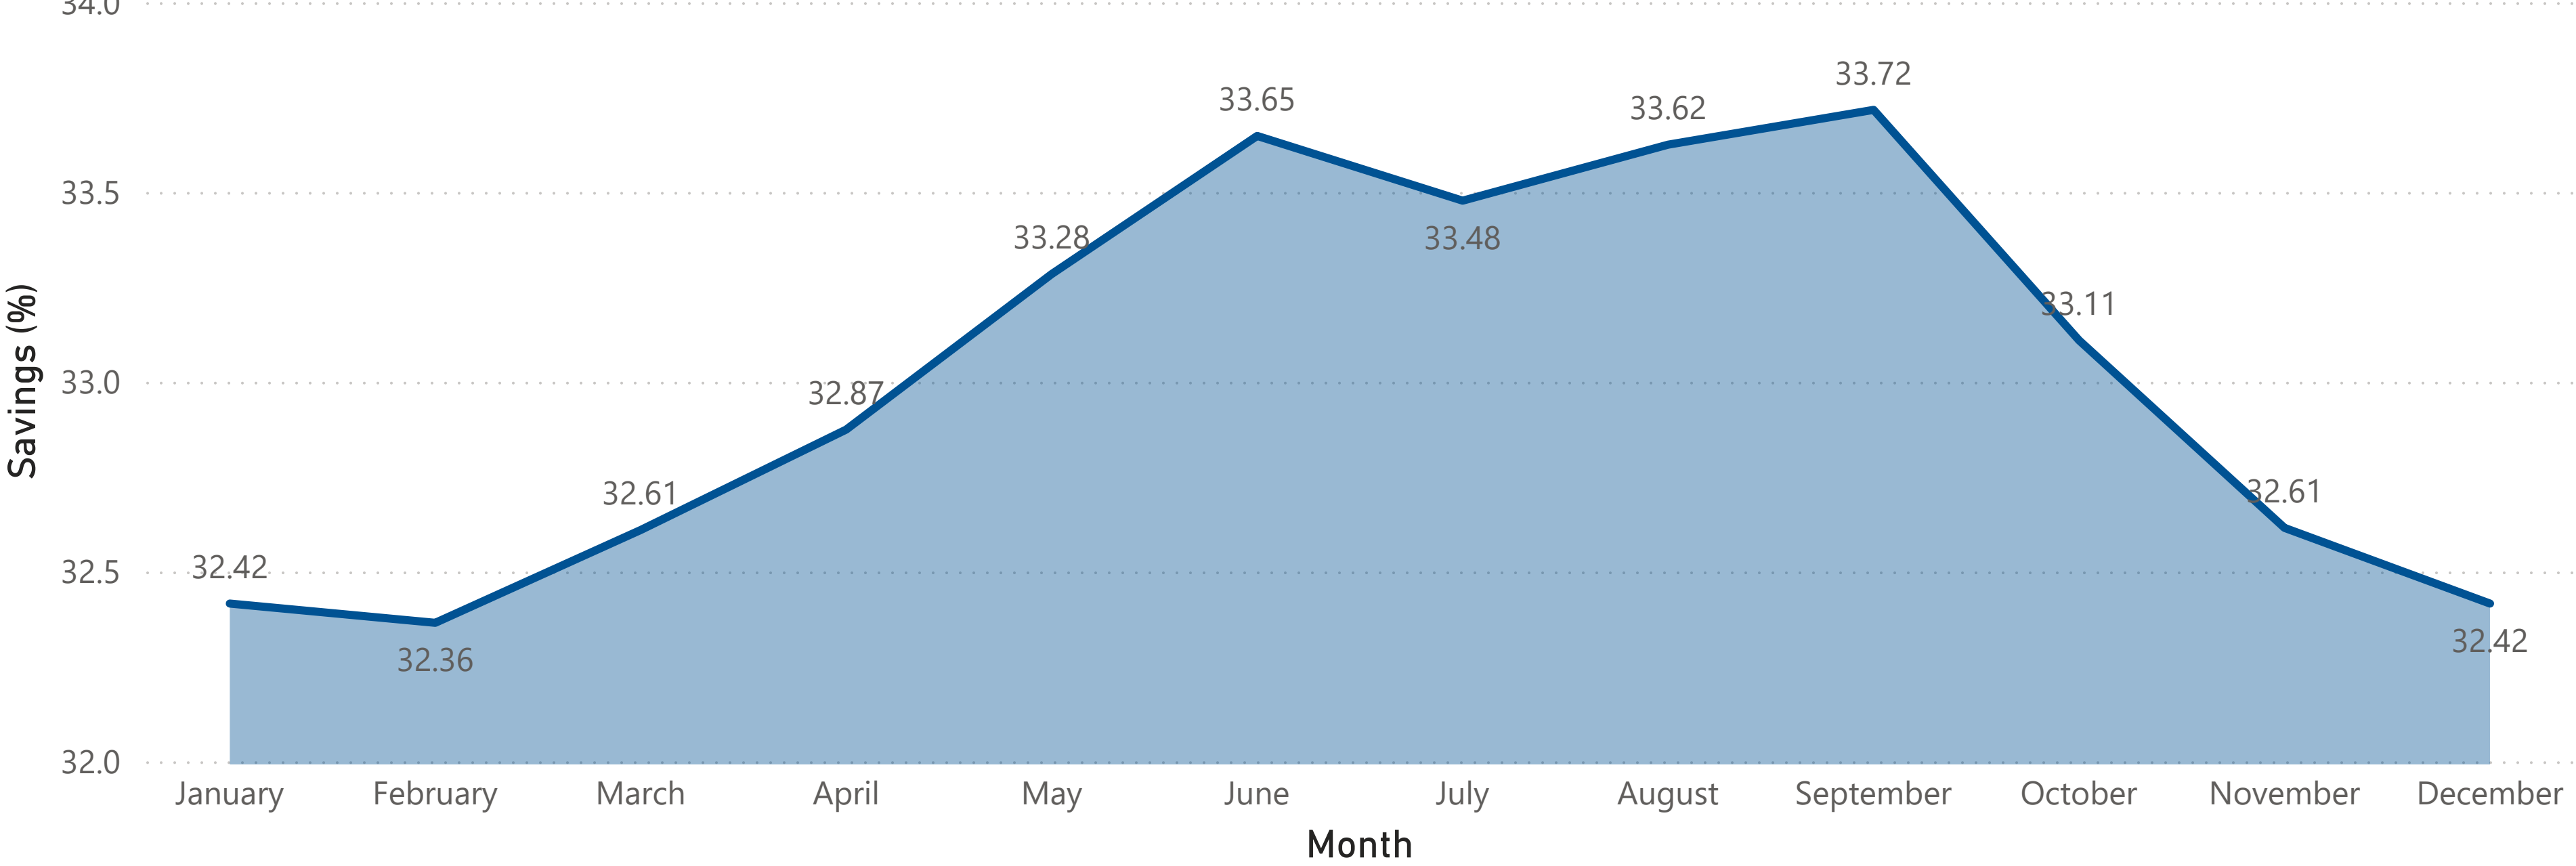

CLIMB Points Avoided by Month

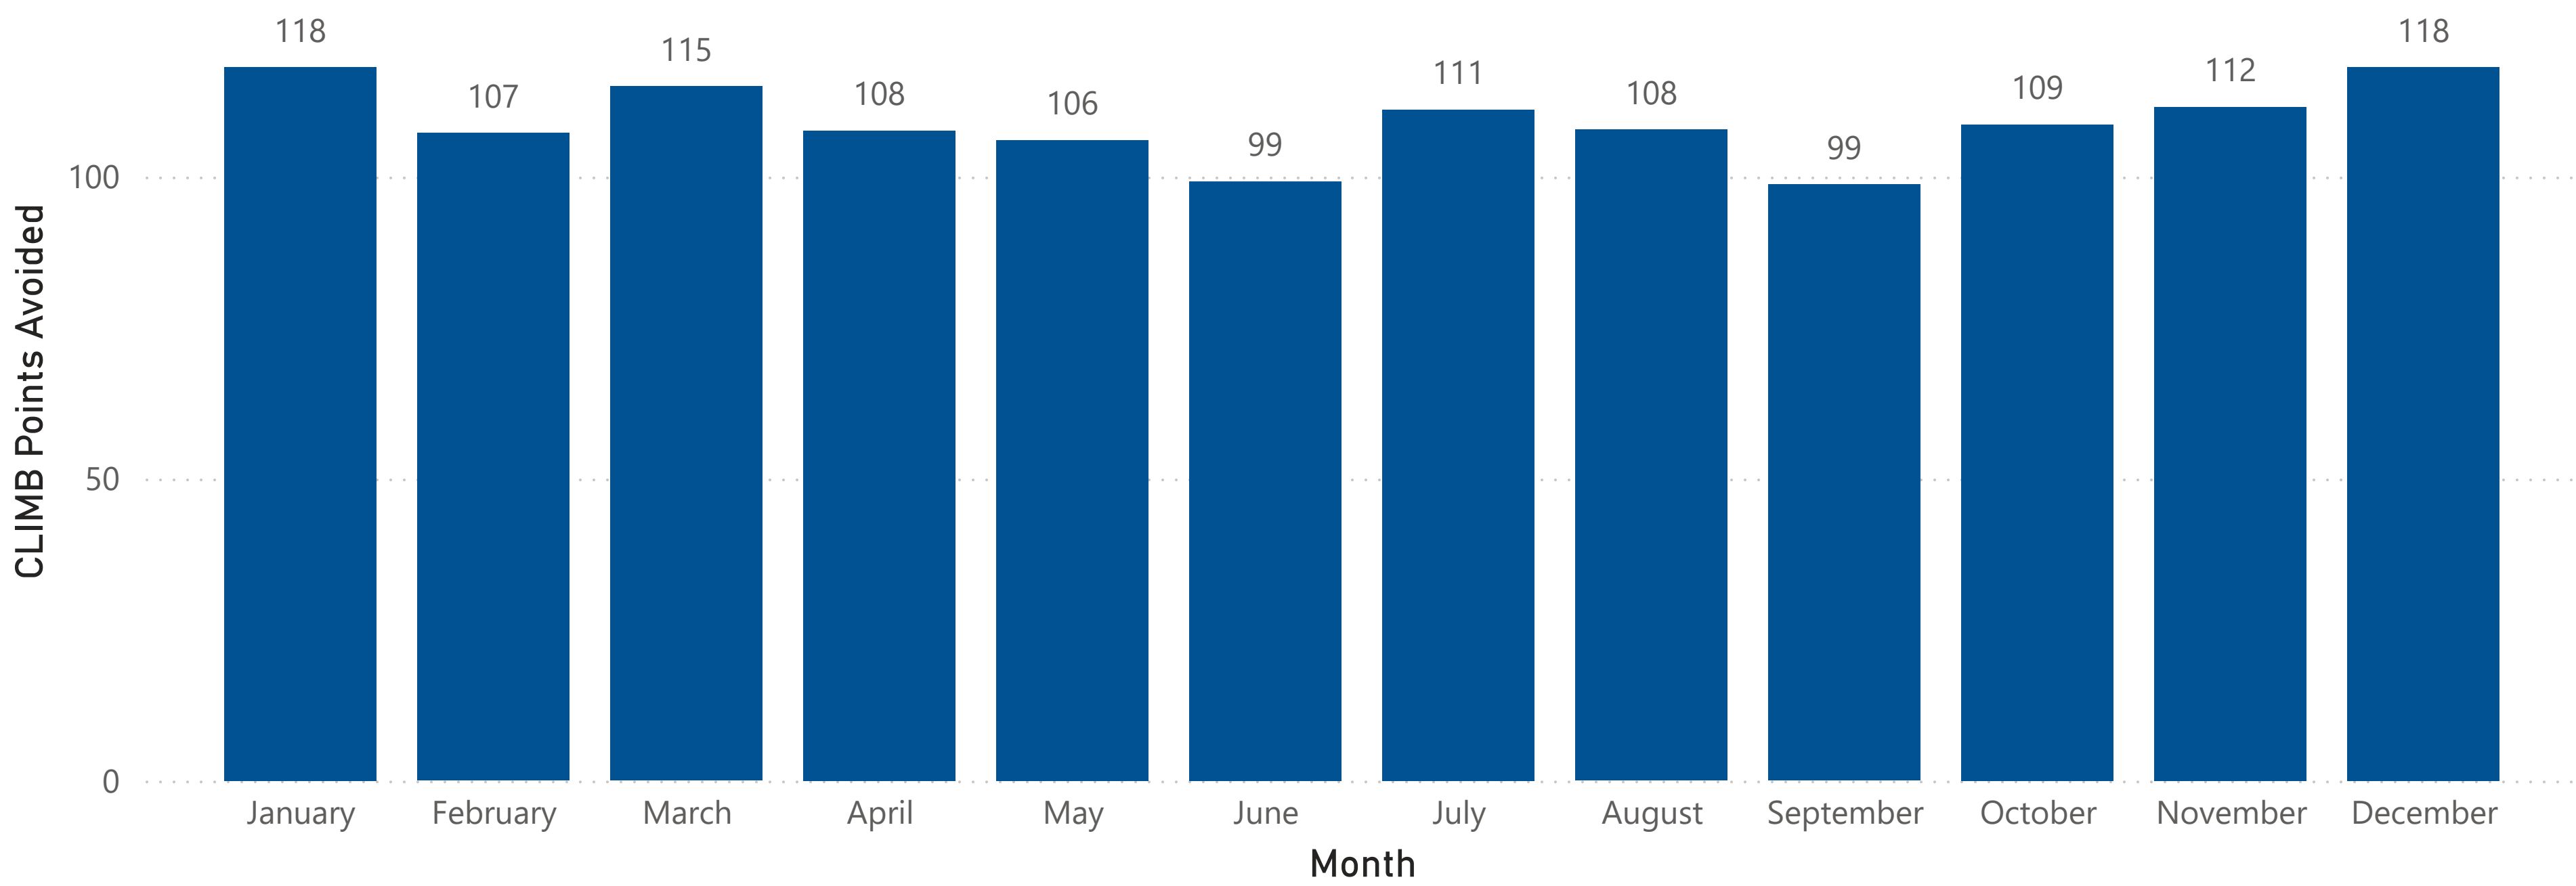

275.68

EUI Baseline (kWh/m²/year)

184.70

EUI Optimized (kWh/m²/year)

33.00

EUI Reduction (%)


5

Override Rate (%)


3

Sensor Failure Rate (%)


Baseline and Optimized by Month

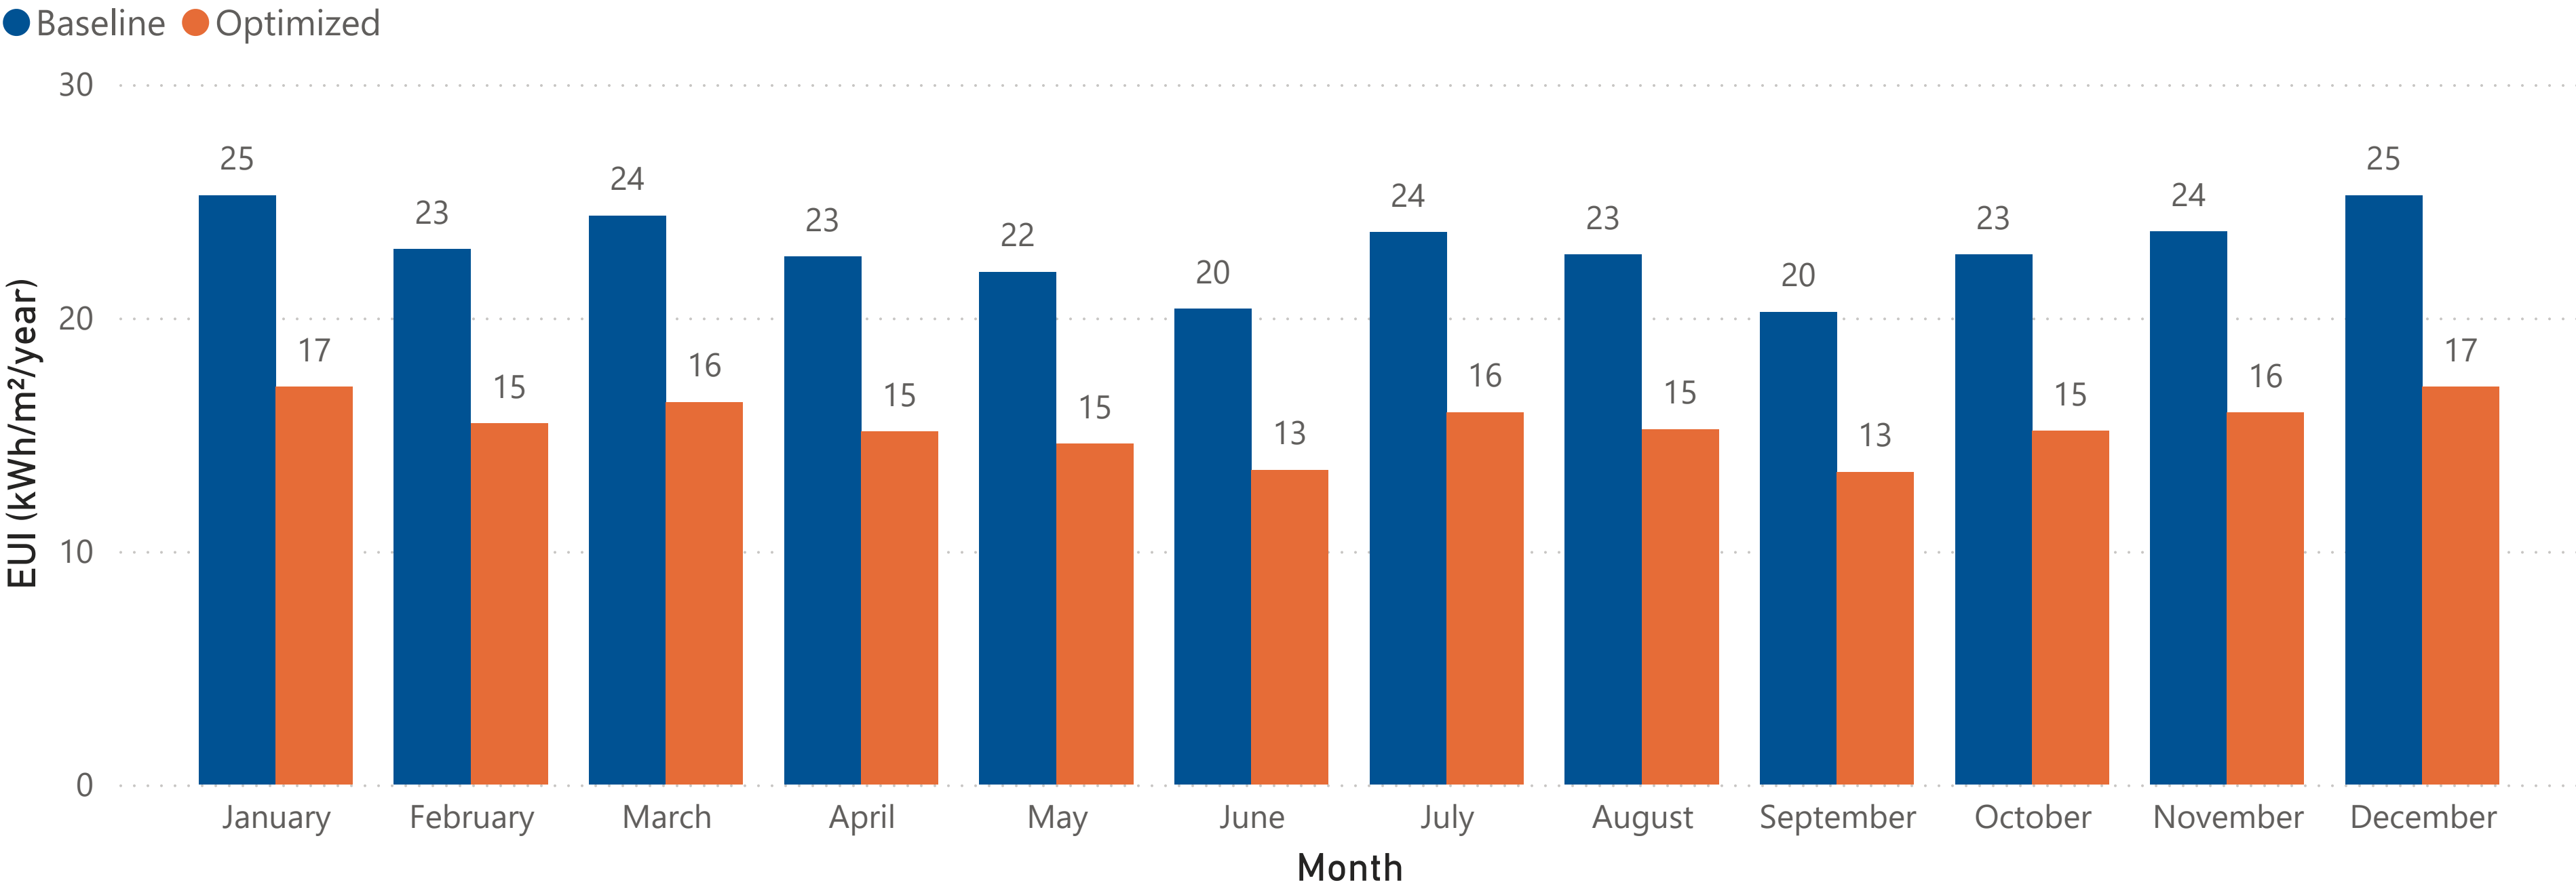


EUI Reduction (%) by Month

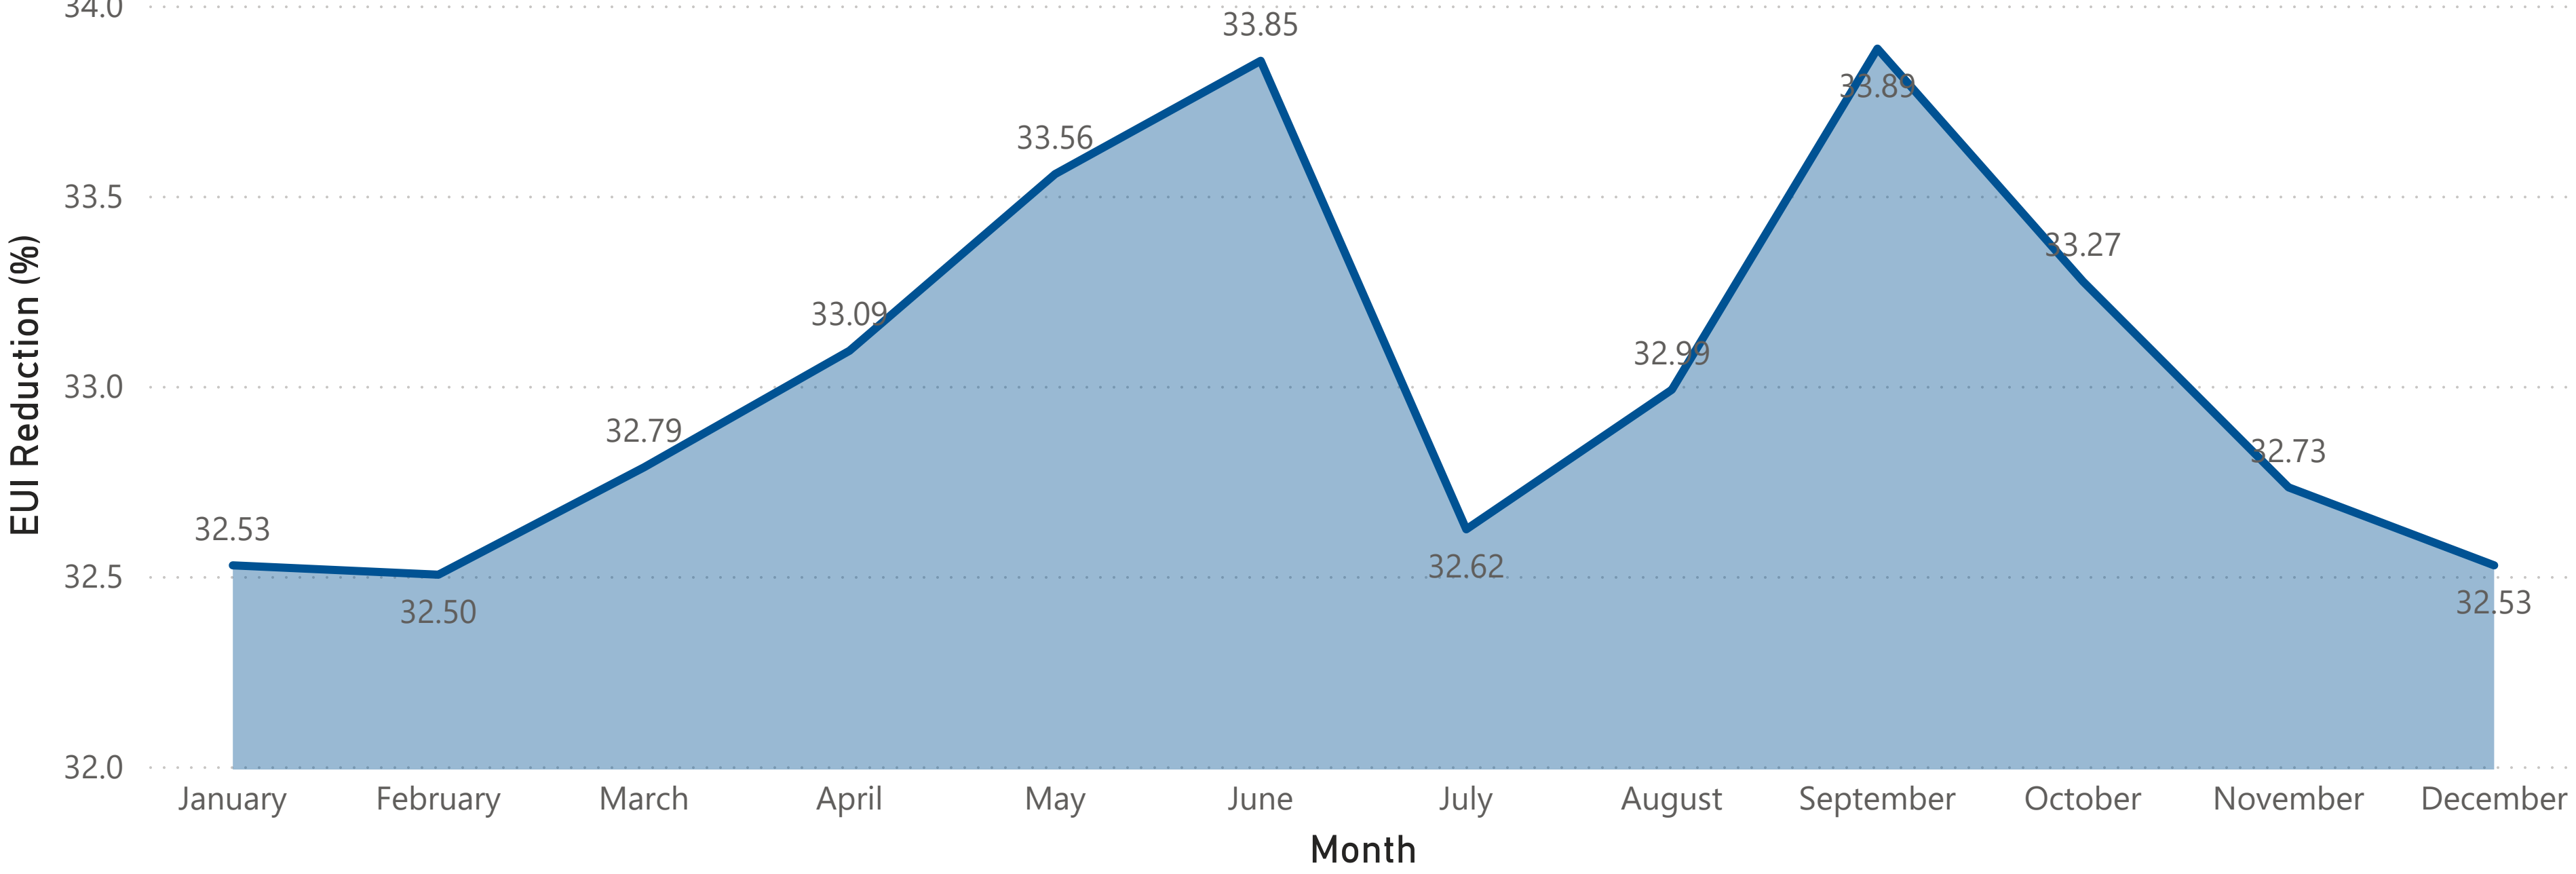

Override Trend by Month

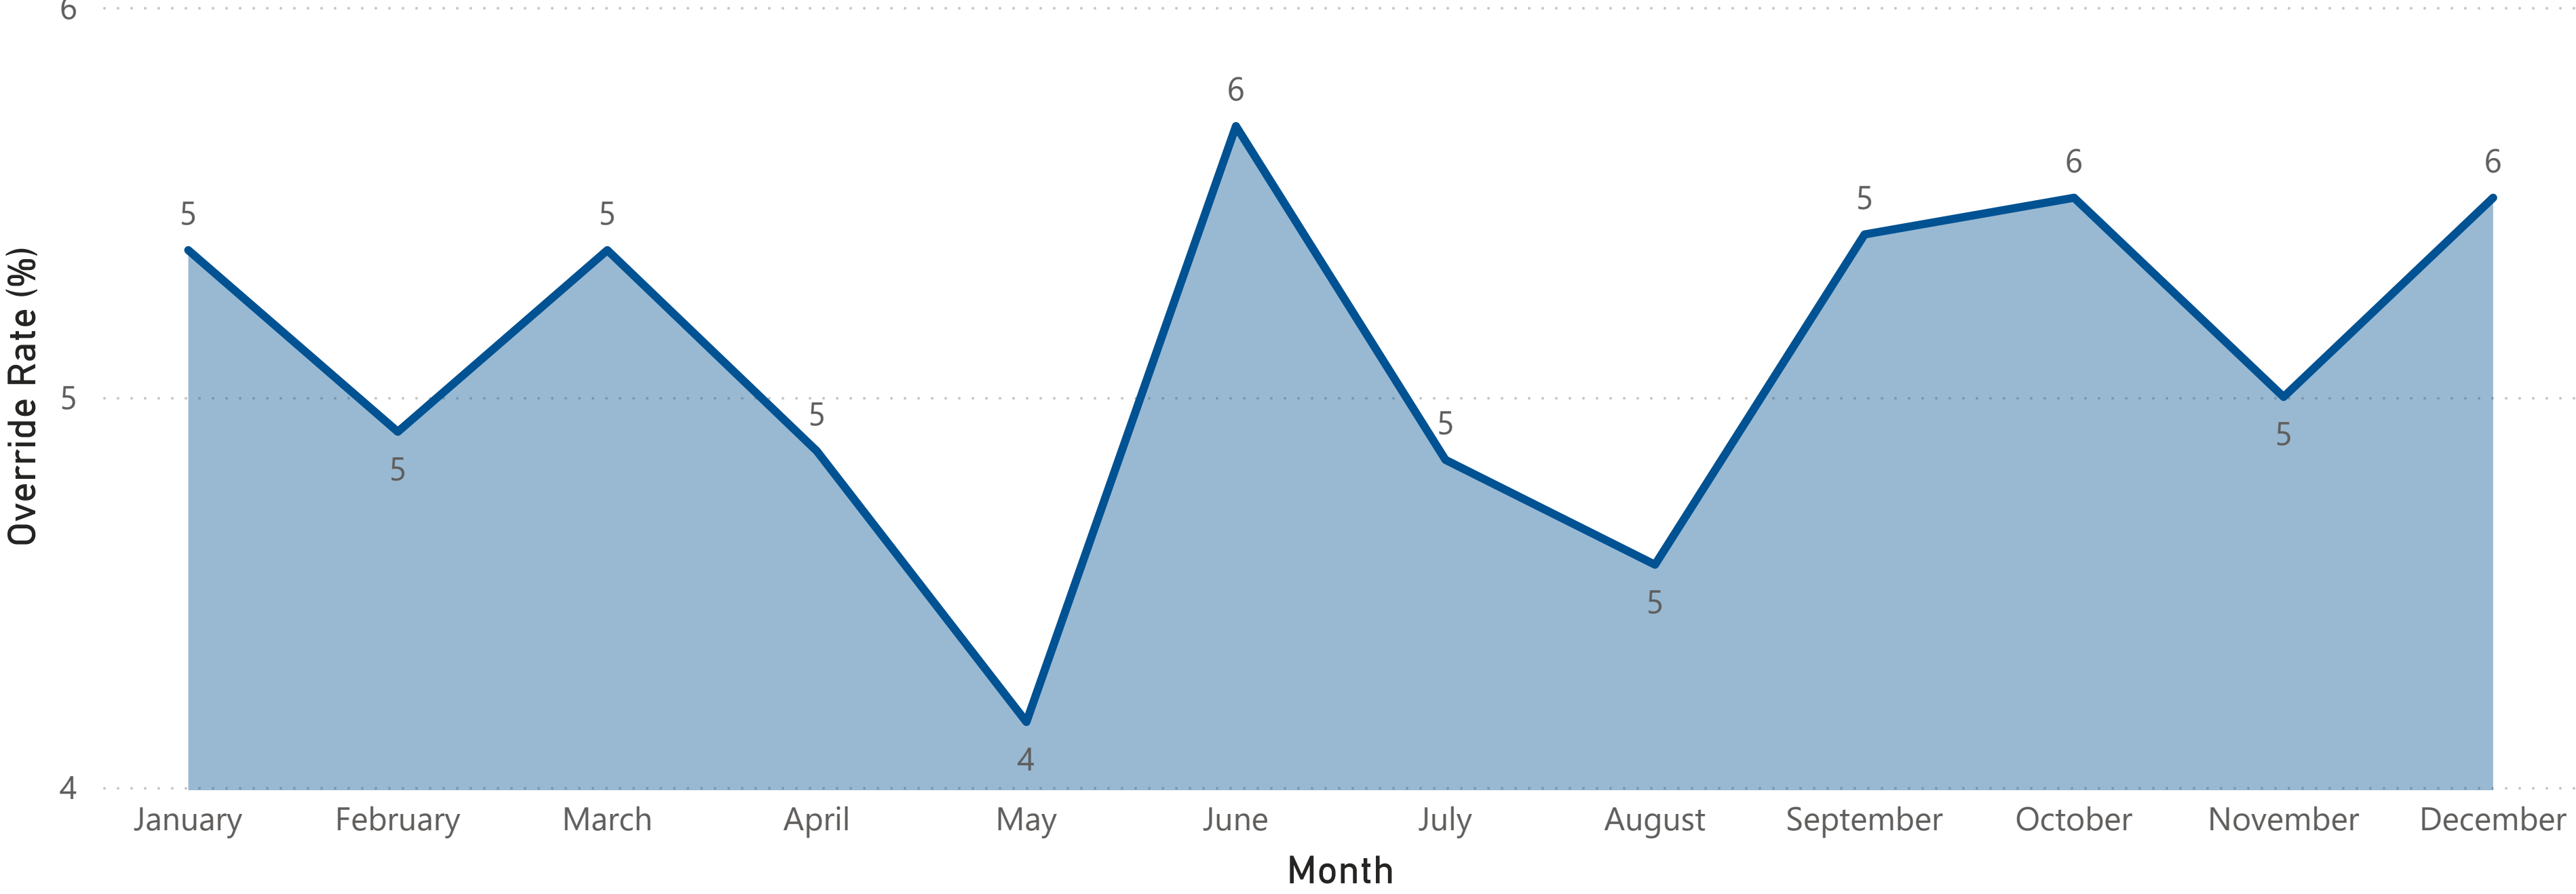

Sensor Failure by Month

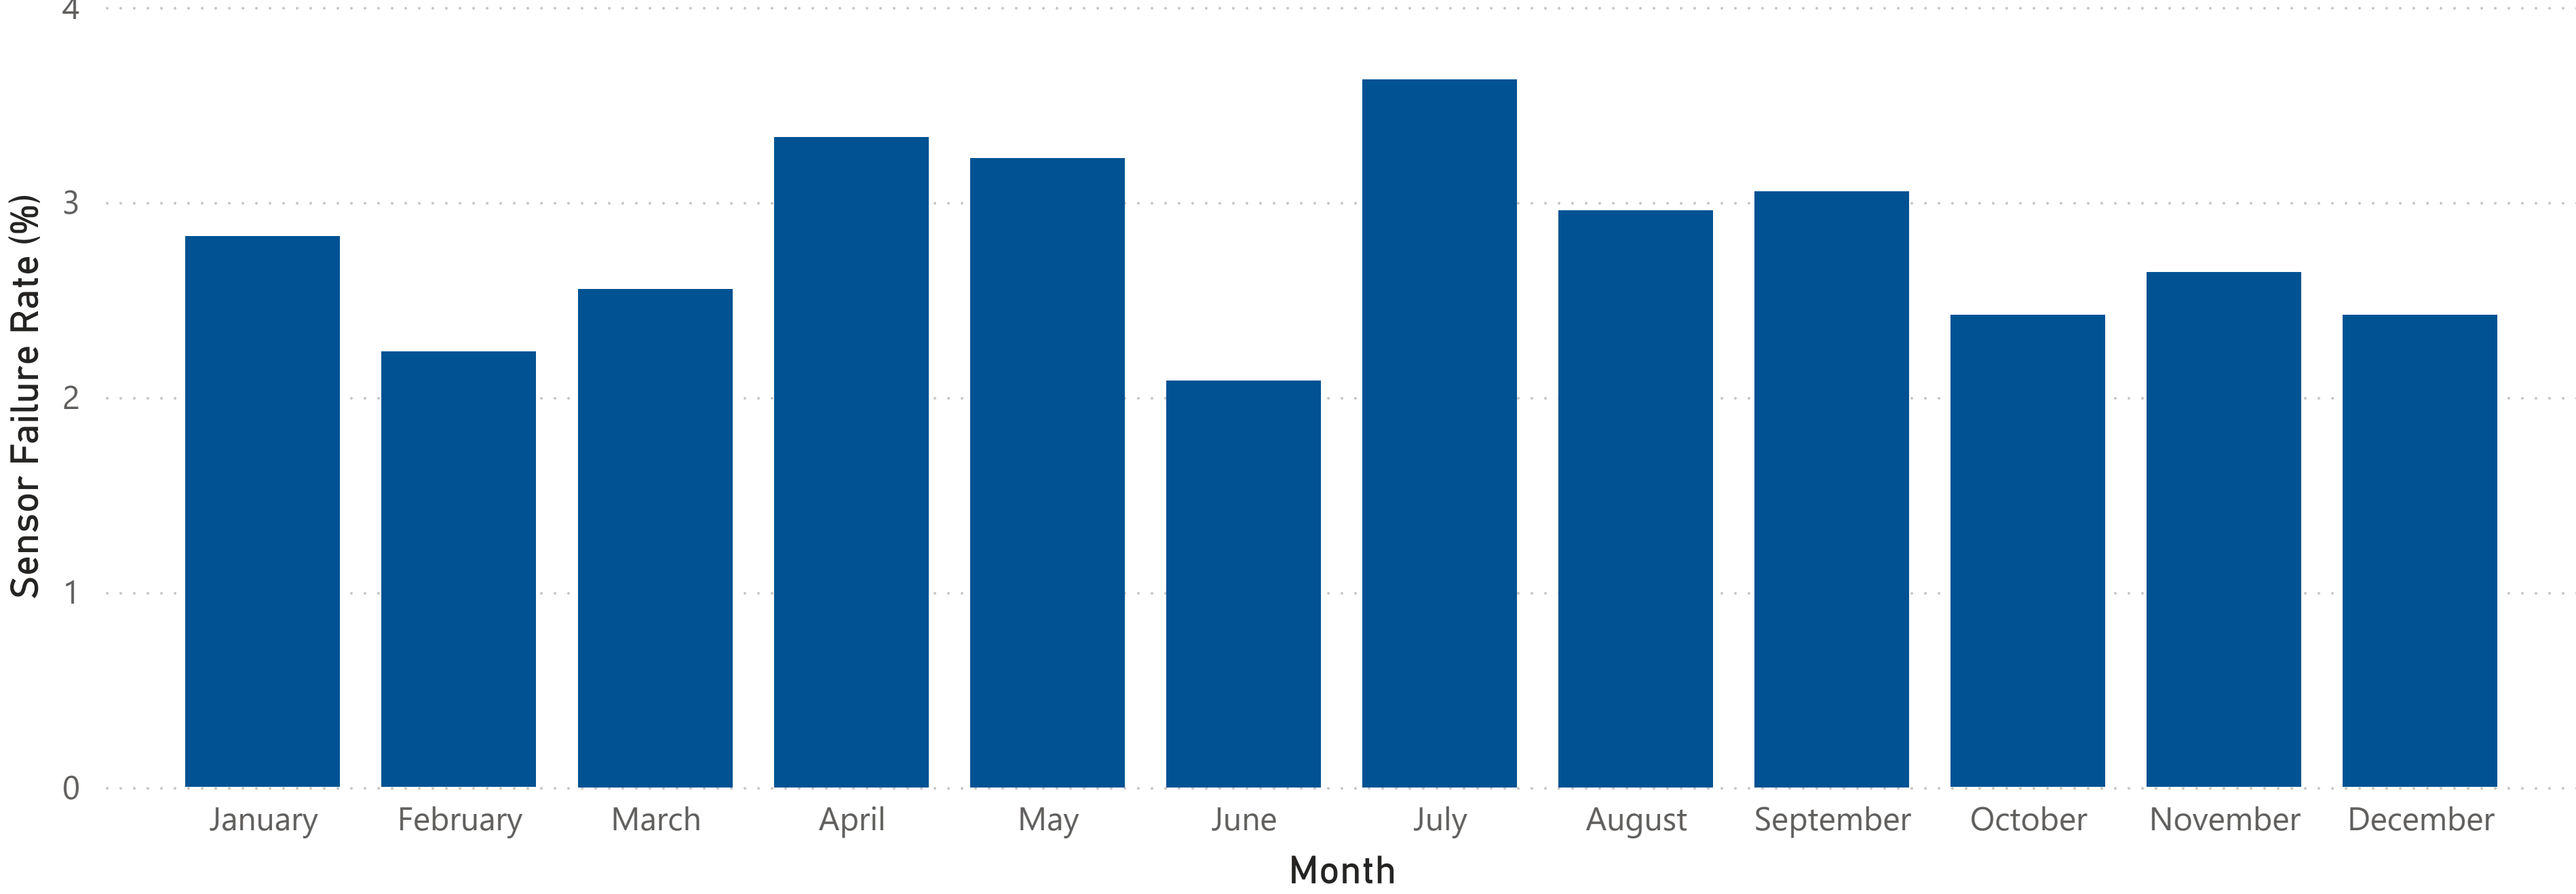

2.50M

Heating Optimized (KWh)

457K

Cooling Optimized (KWh)

11.71M

Fans Optimized (KWh)


6.59M

Lighting Optimized (KWh)


2

Missing Data Rate (%)


Cooling Usage by Month

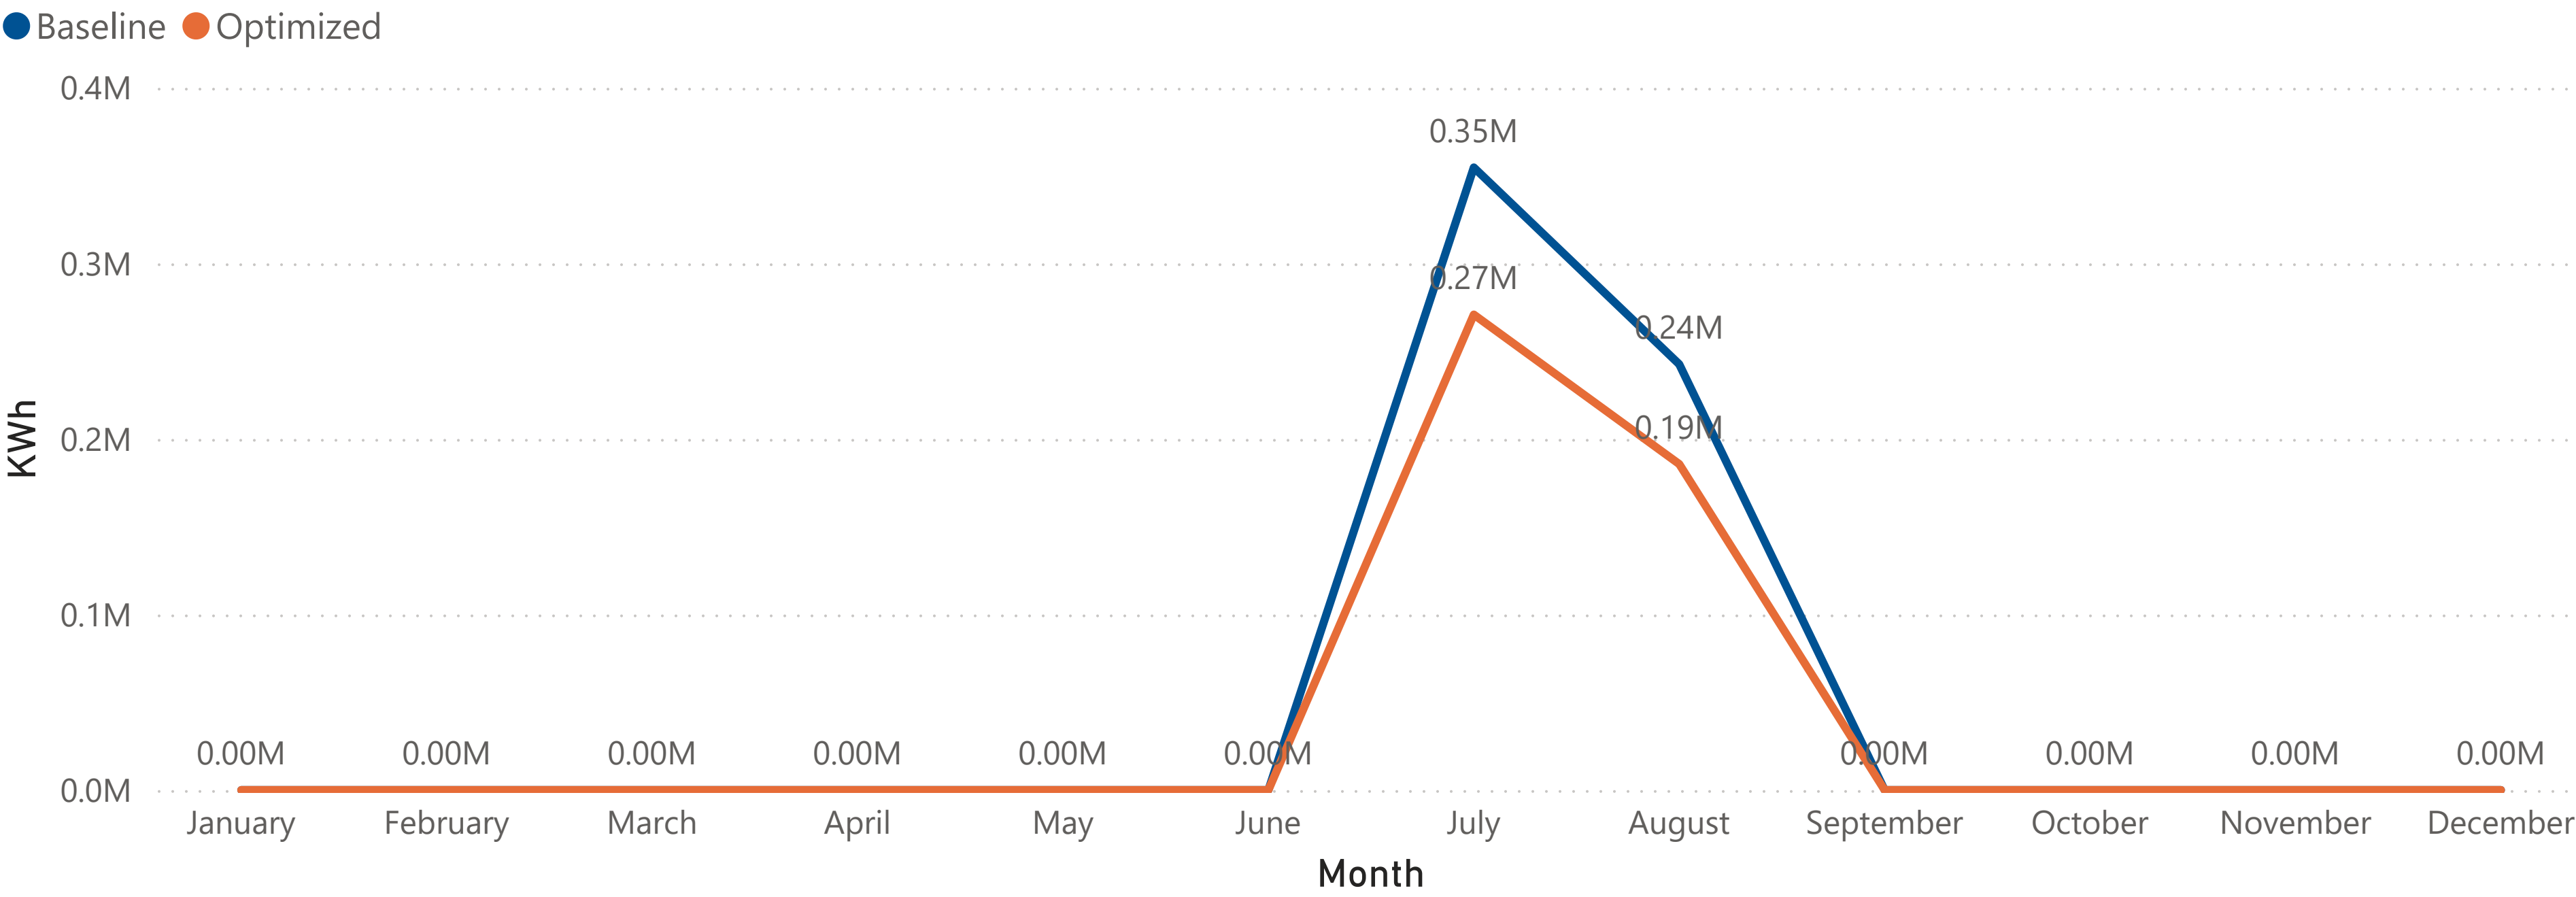

Heating Usage by Month

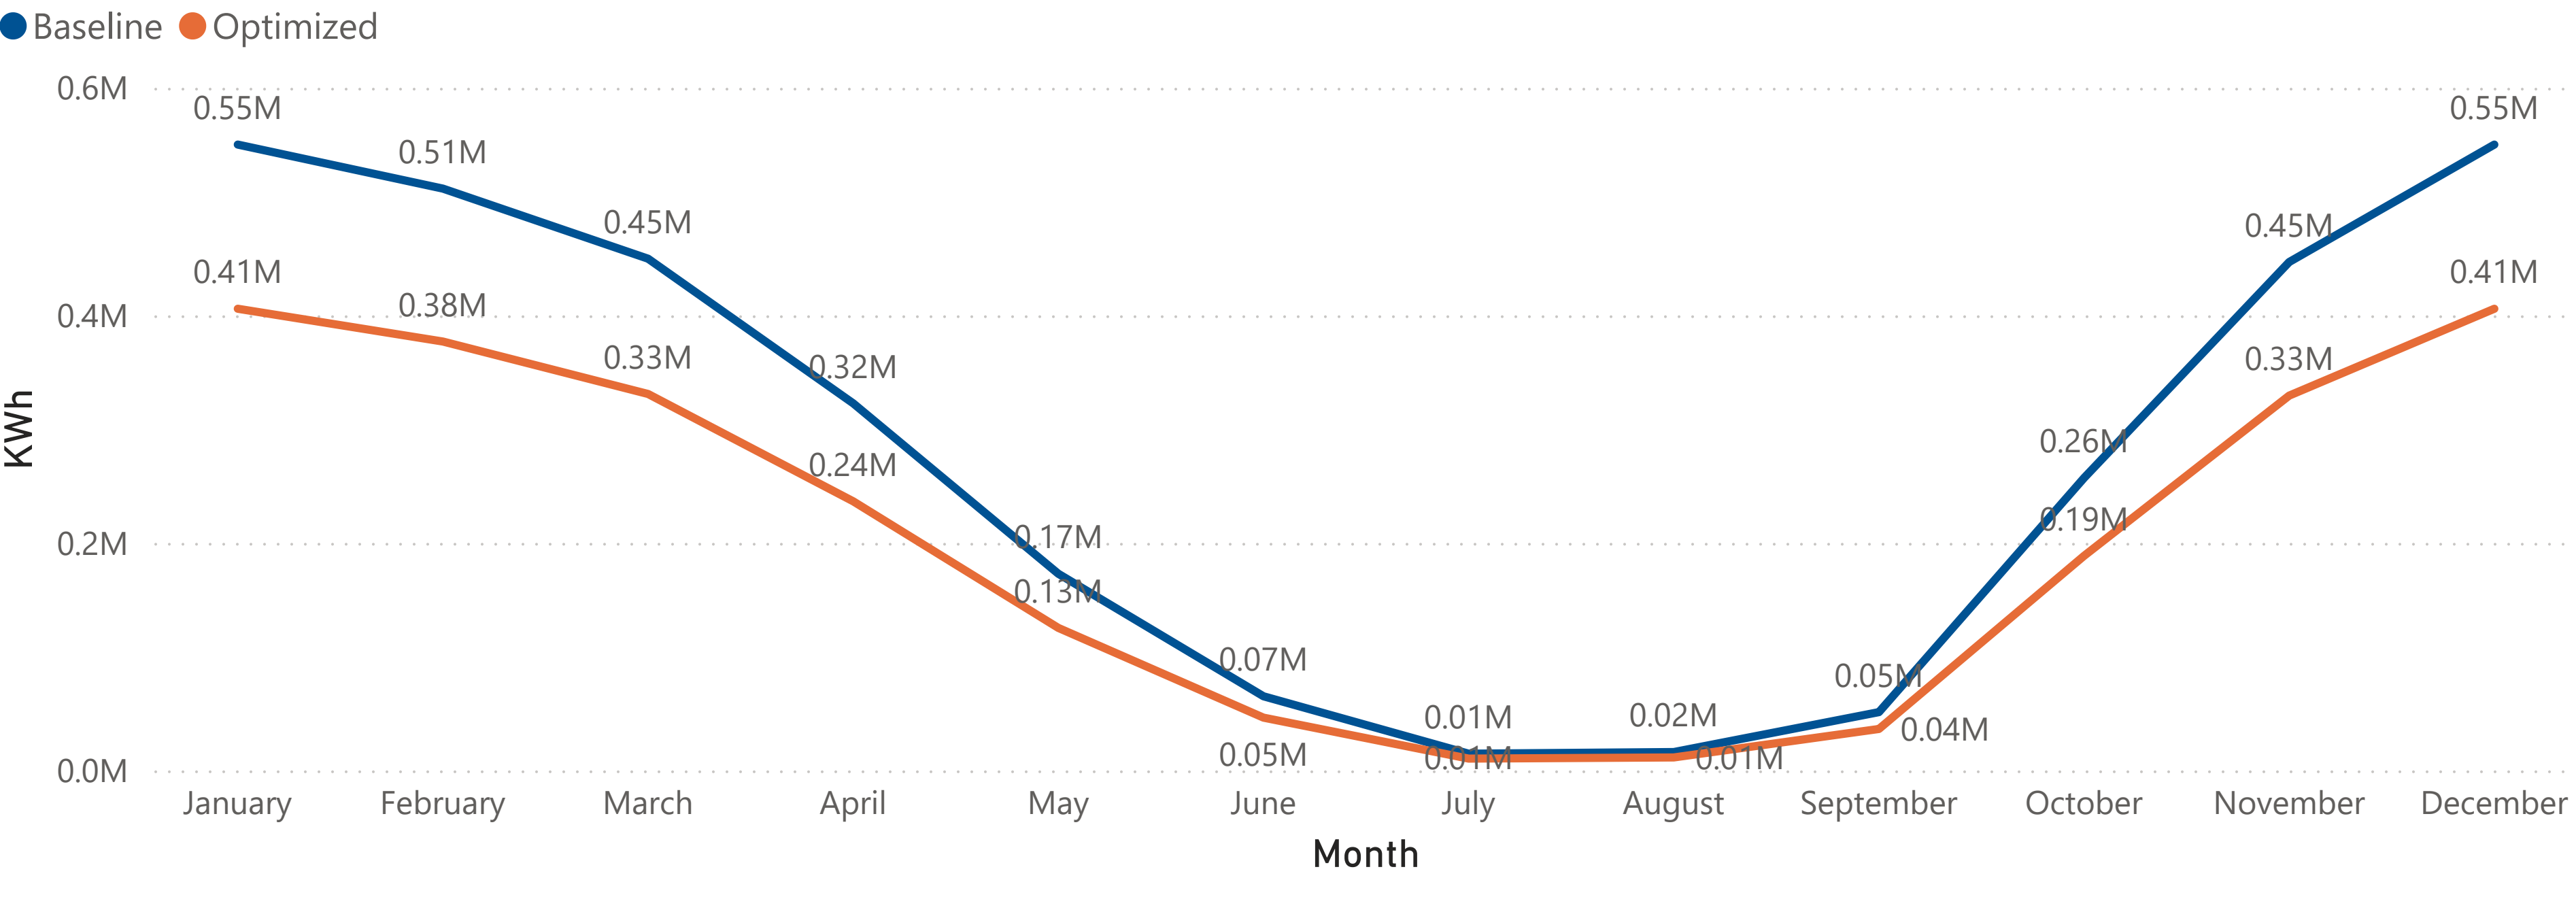

Fans Usage by Month

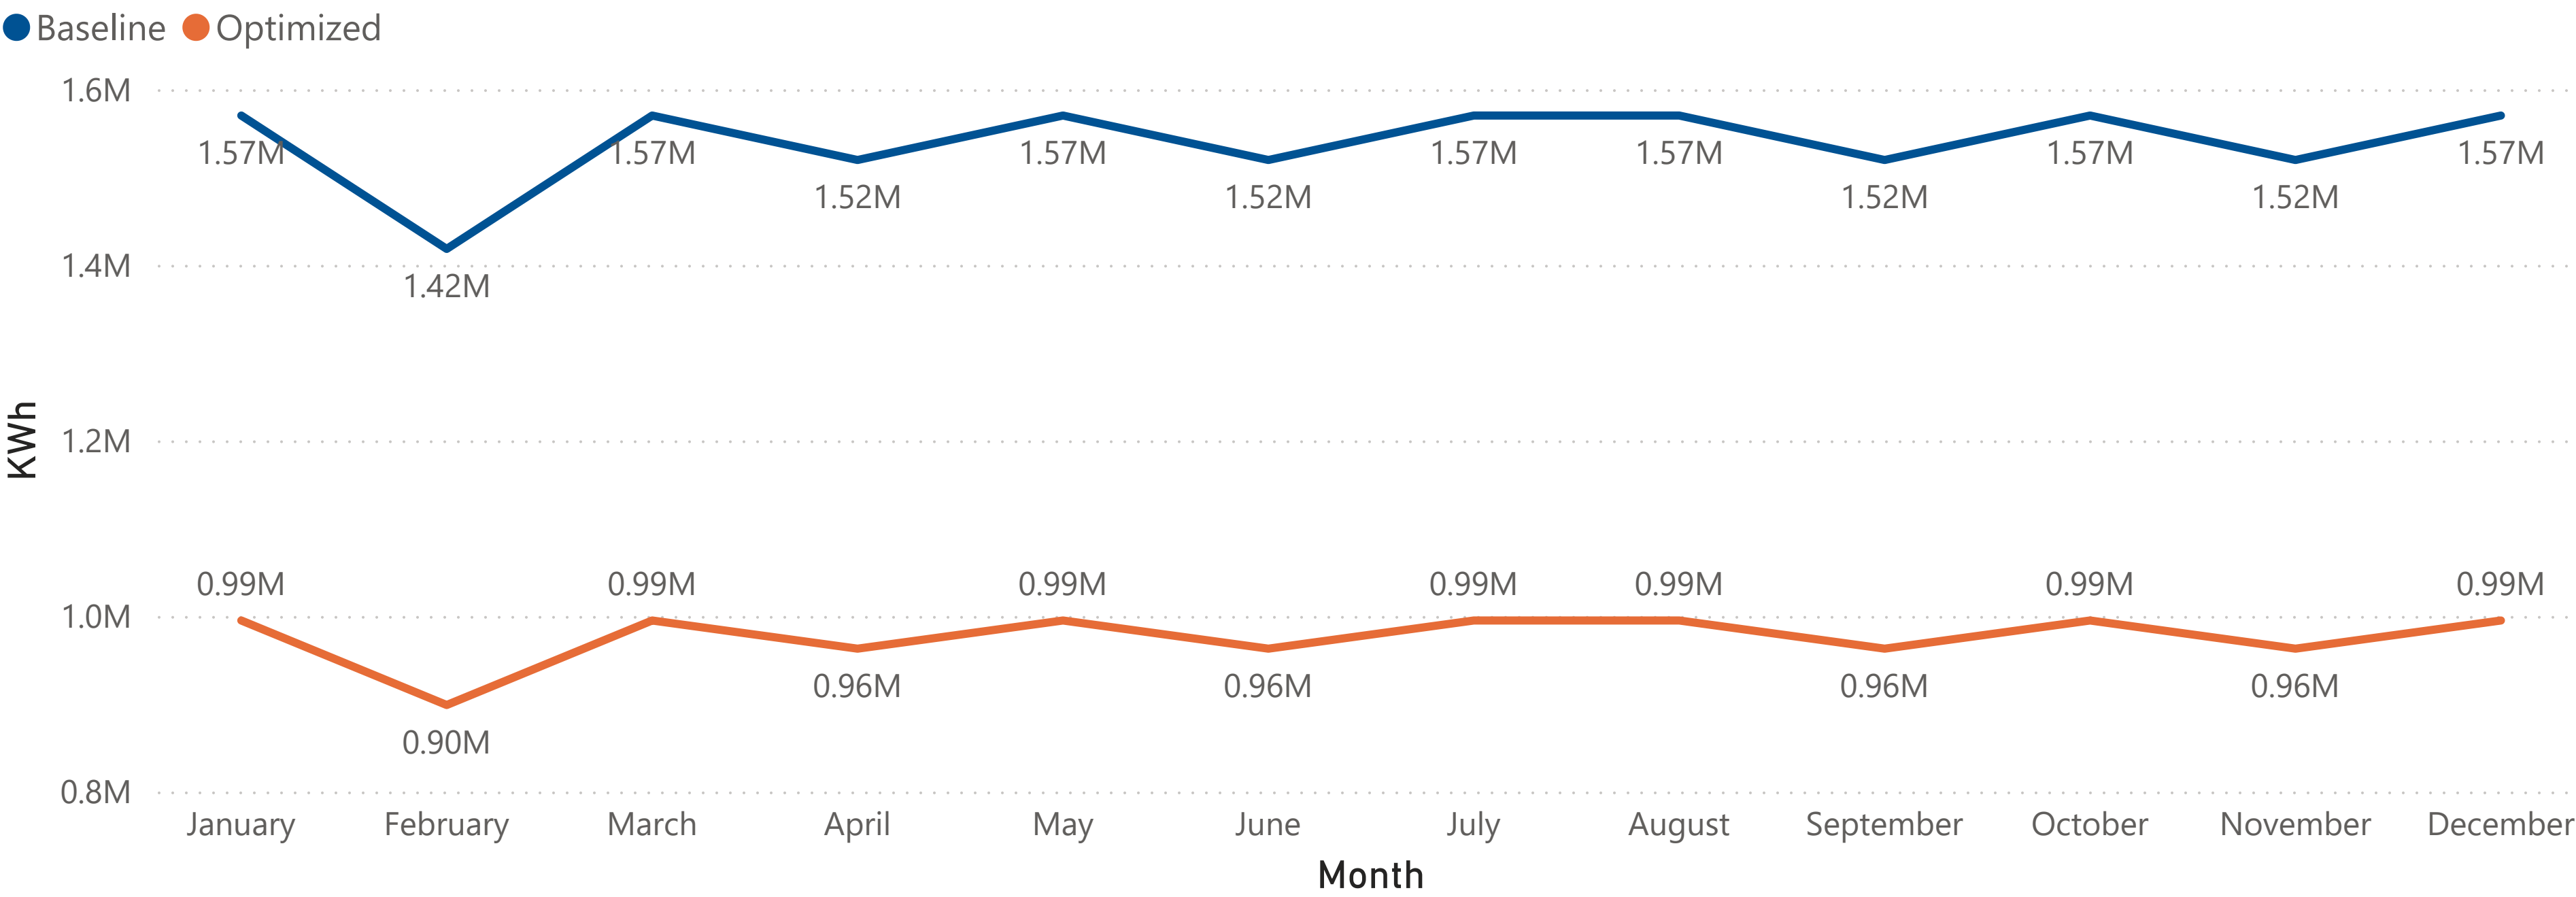

Lighting Usage by Month

