



OoS validation (CHMM-N, K=21)


(a) OoS density fan

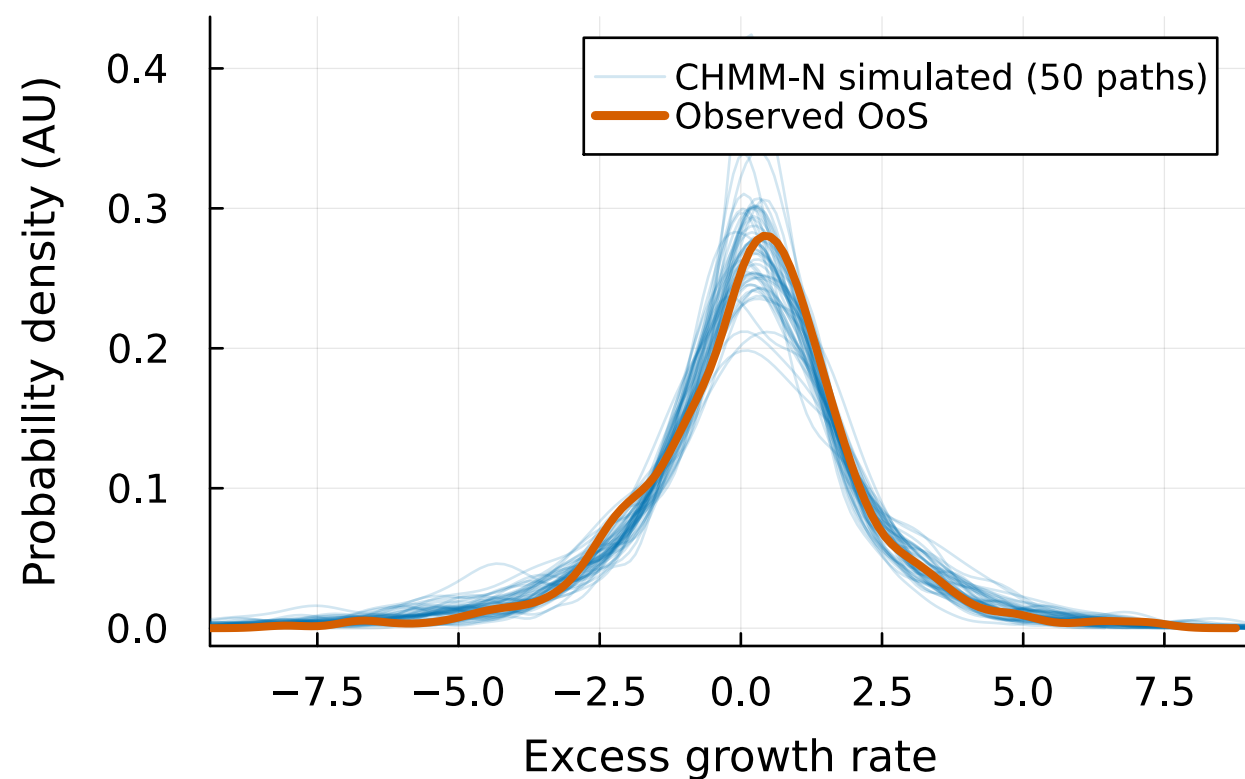

(b) OoS KS p-values (pass: 87.3%)

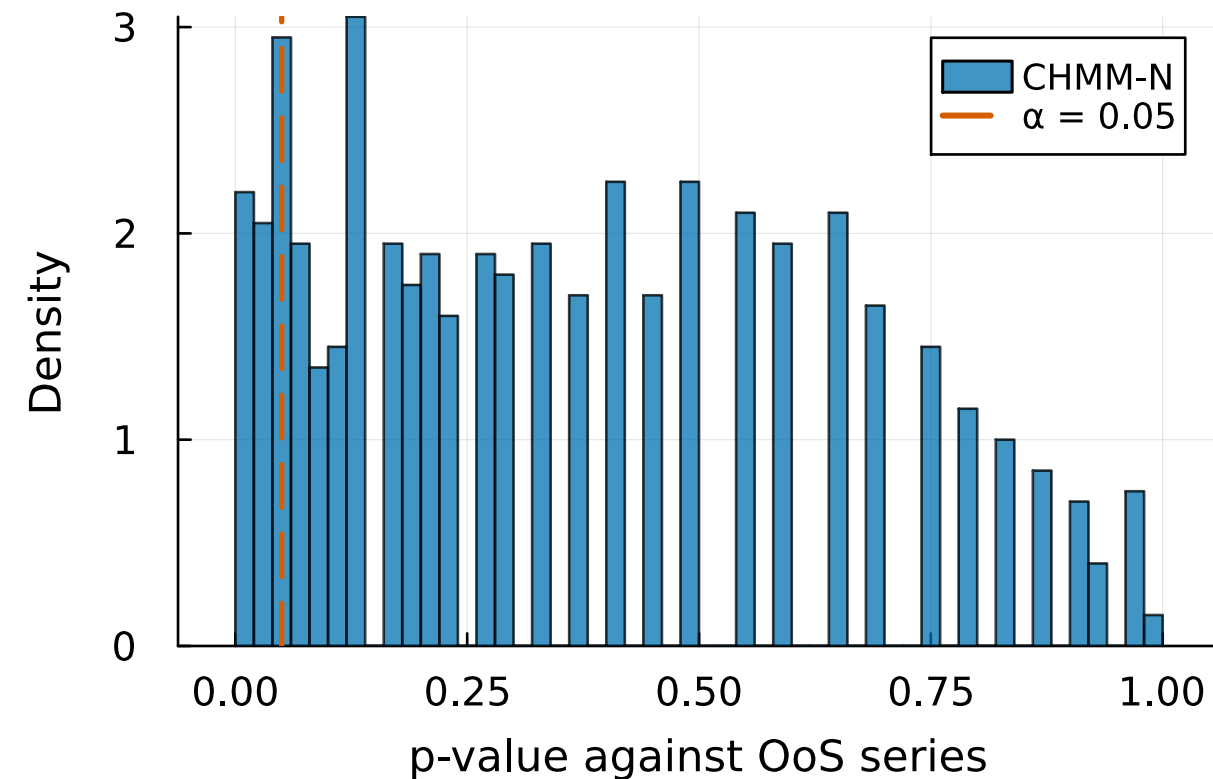

(c) OoS ACF of G_t (raw returns)

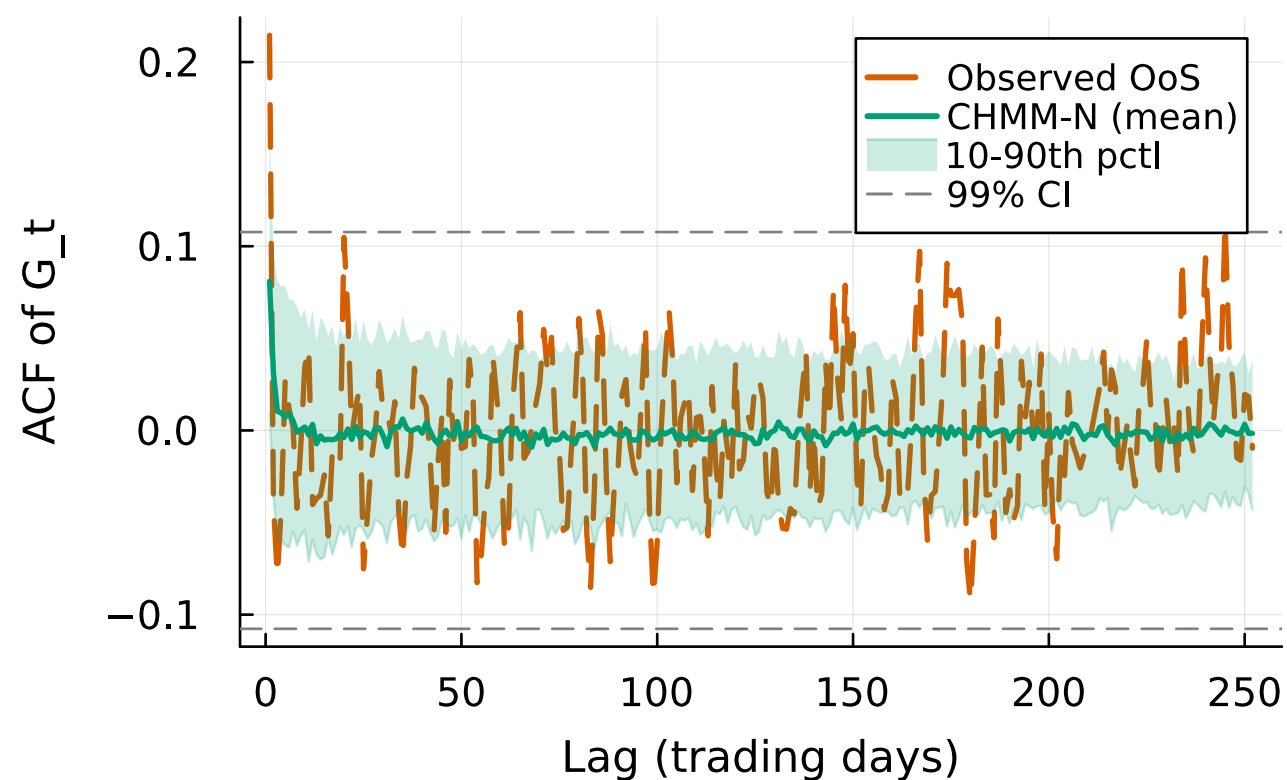

(d) OoS ACF of $|G_t|$

