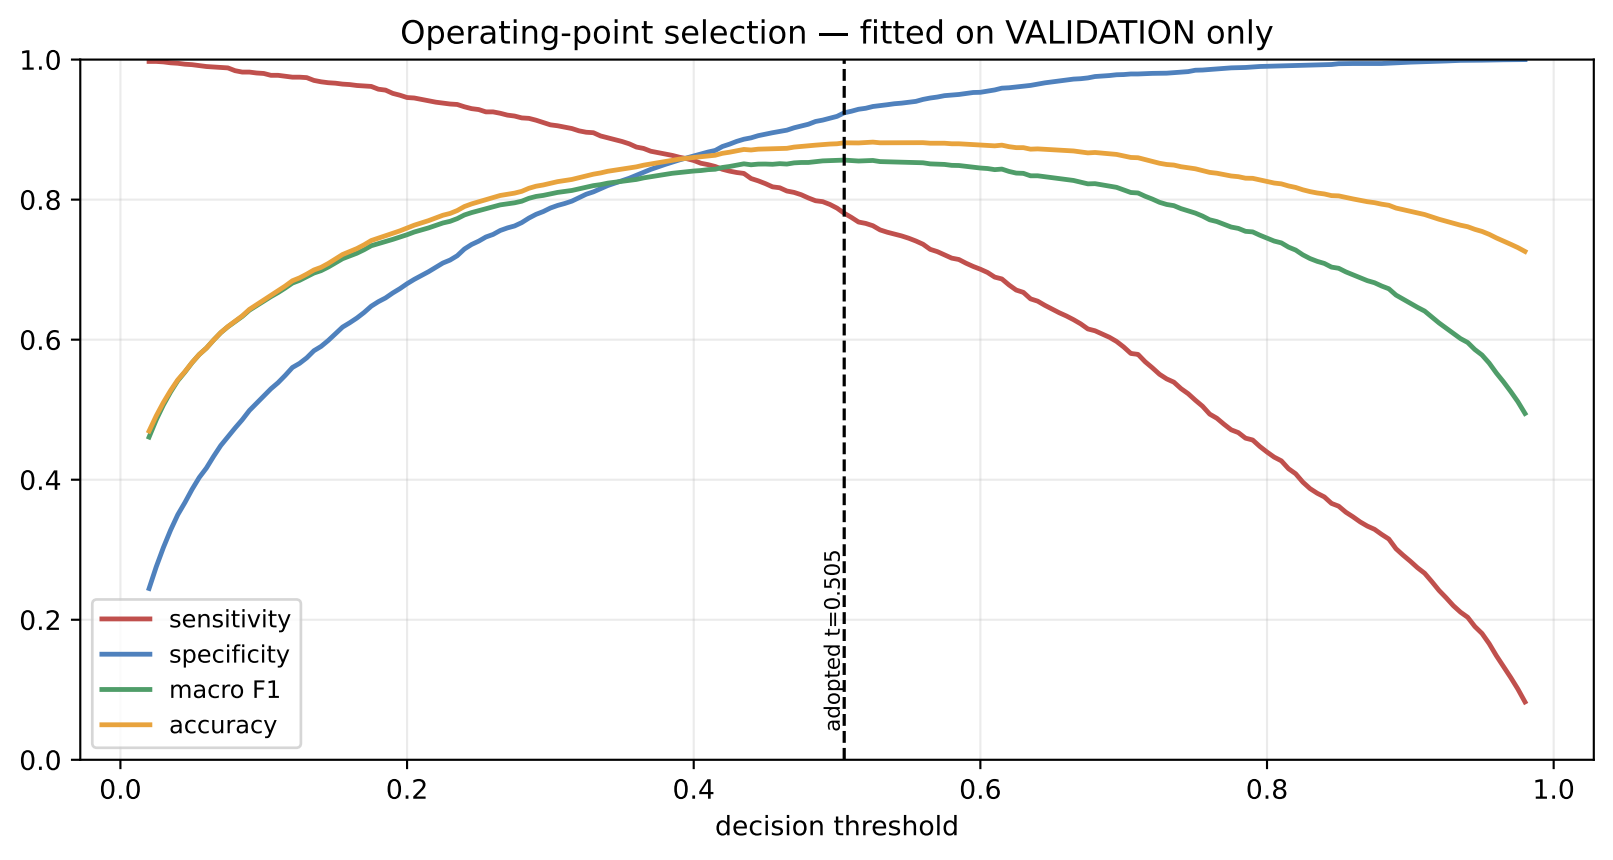
Operating-point selection — fitted on VALIDATION only
1.0
0.8
0.6
0.4
0.2
0.0
0.0
0.2
0.4
0.6
0.8
1.0
decision threshold
adopted t=0.505
sensitivity
specificity
macro F1
accuracy