

DGNB Indoor Climate Report

Indoor climate documentation for DGNB certification

Measurement period: Friday, 19 June 2026 — Thursday, 2 July 2026
Generated: Thursday, 2 July 2026
Standard: DGNB New Construction 2023 · Office building · Mechanical ventilation with cooling · Summer (cooling season)

Measured hours

Week	Mon	Tue	Wed	Thu	Fri	Sat	Sun
25	15.	16.	17.	18.	19. 9h	20.	21.
26	22. 9h	23. 9h	24. 9h	25. 9h	26. 9h	27.	28.
27	29. 9h	30. 9h	1. 9h	2. 9h	3.	4.	5.

= active measurement day | Number after date = measured hours | Week = ISO week number

Sensors / Zones (7)

#	Sensor	Zone / Location	Parameters
1	Møllestien - Entre	Sommerhus	Temperature, Relative humidity (RH%)
2	Ny DT Humidity	Sommerhus	Temperature, Relative humidity (RH%)
3	Entre - SHT45	Sommerhus	Temperature, Relative humidity (RH%)
4	Full+ - Demosensor	Sommerhus	Temperature, Relative humidity (RH%), CO ₂ , VOC
5	Stue - SHT45	Sommerhus	Temperature, Relative humidity (RH%)
6	Møllestien - Stue	Sommerhus	Temperature, Relative humidity (RH%)
7	Zacho - Familiesommerhus	Sommerhus	Temperature, Relative humidity (RH%)

Statistics (all sensors combined)

Parameter	Avg	Min	Max	High	Low	Readings
Temperature	25.6 °C	19.7 °C	29.2 °C	48%	14%	2262
Relative humidity (RH%)	54 %RH	39.5 %RH	93.9 %RH	31%	0%	2262
CO ₂	2549 ppm	0 ppm	2796668 ppm	0%	0%	2262
VOC	148 ppb	0 ppb	9500 ppb	3%	0%	2262

Statistics per sensor and parameter Temperature

Sensor	Avg	Min	Max	High	Low	Readings
Møllestien - Entre	24.3 °C	21.7 °C	27.1 °C	17%	23%	215
Ny DT Humidity	26.8 °C	23.4 °C	29.2 °C	73%	0%	965
Entre - SHT45	23.8 °C	20.5 °C	26.6 °C	10%	32%	182
Full+ - Demosensor	26.9 °C	23.7 °C	29.2 °C	77%	0%	318
Stue - SHT45	23.9 °C	20.5 °C	26.6 °C	11%	31%	176
Møllestien - Stue	24.7 °C	21.1 °C	27.4 °C	30%	17%	206
Zacho - Familiesommerhus	23 °C	19.7 °C	26.6 °C	5%	59%	200

Relative humidity (RH%)

Sensor	Avg	Min	Max	High	Low	Readings
Møllestien - Entre	61.2 %RH	54.2 %RH	71.5 %RH	60%	0%	215
Ny DT Humidity	45.9 %RH	39.5 %RH	61.5 %RH	5%	0%	965
Entre - SHT45	59.6 %RH	52.3 %RH	71.6 %RH	42%	0%	182
Full+ - Demosensor	45.2 %RH	39.7 %RH	58.8 %RH	0%	0%	318
Stue - SHT45	59.7 %RH	52.9 %RH	71.9 %RH	43%	0%	176
Møllestien - Stue	65.6 %RH	57.5 %RH	81.4 %RH	88%	0%	206
Zacho - Familiesommerhus	76.6 %RH	60.4 %RH	93.9 %RH	100%	0%	200


CO₂

Sensor	Avg	Min	Max	High	Low	Readings
Full+ - Demosensor	18067 ppm	421 ppm	2796668 ppm	1%	0%	318

VOC


Sensor	Avg	Min	Max	High	Low	Readings
Full+ - Demosensor	1054 ppb	0 ppb	9500 ppb	18%	0%	318

Temperature

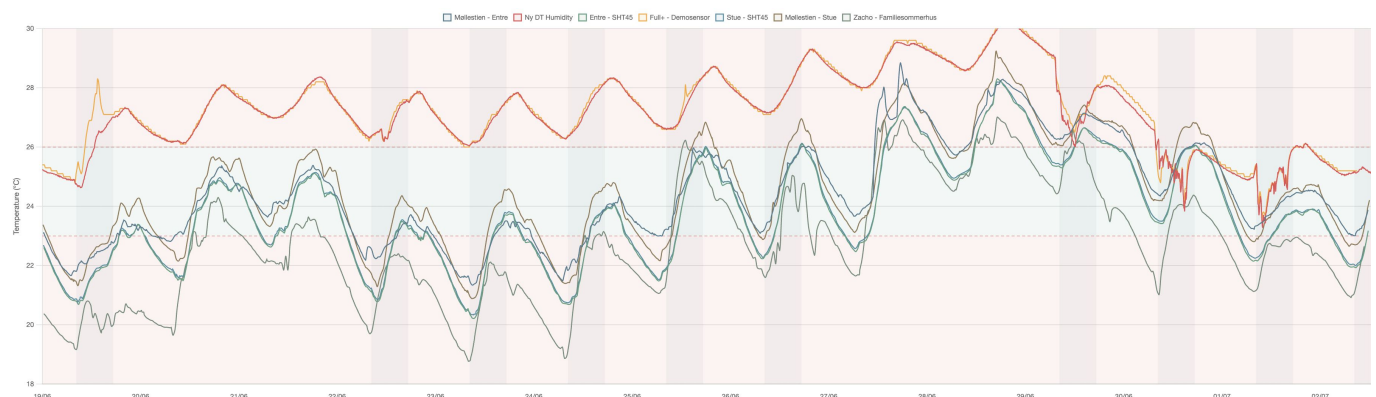


Sensor	Avg	Min	Max	High	Low	Readings
Møllestien - Entre	24.3 °C	21.7 °C	27.1 °C	17%	23%	215
Ny DT Humidity	26.8 °C	23.4 °C	29.2 °C	73%	0%	965
Entre - SHT45	23.8 °C	20.5 °C	26.6 °C	10%	32%	182
Full+ - Demosensor	26.9 °C	23.7 °C	29.2 °C	77%	0%	318
Stue - SHT45	23.9 °C	20.5 °C	26.6 °C	11%	31%	176
Møllestien - Stue	24.7 °C	21.1 °C	27.4 °C	30%	17%	206
Zacho - Familiesommerhus	23 °C	19.7 °C	26.6 °C	5%	59%	200

Relative humidity (RH%)

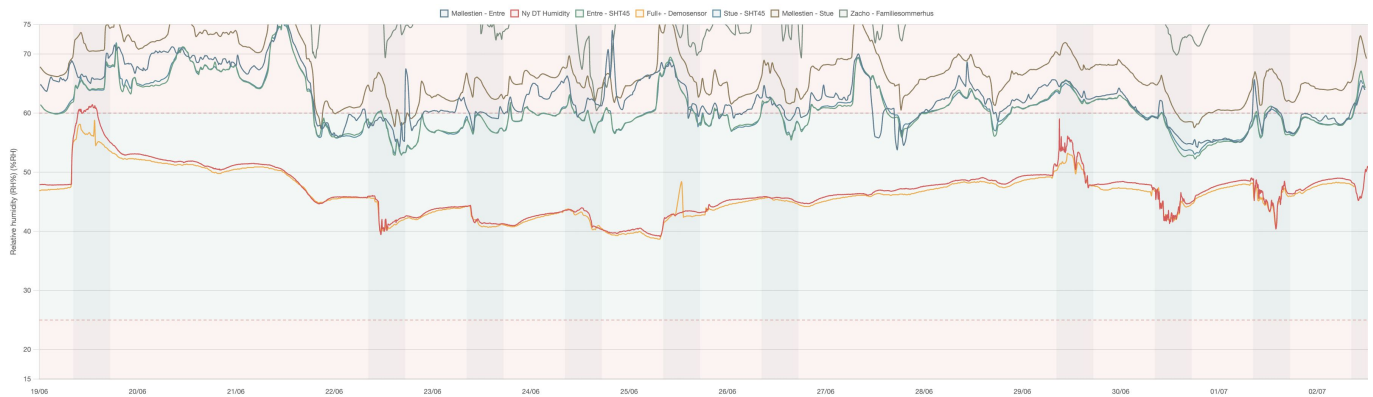


Sensor	Avg	Min	Max	High	Low	Readings
Møllestien - Entre	61.2 %RH	54.2 %RH	71.5 %RH	60%	0%	215
Ny DT Humidity	45.9 %RH	39.5 %RH	61.5 %RH	5%	0%	965
Entre - SHT45	59.6 %RH	52.3 %RH	71.6 %RH	42%	0%	182
Full+ - Demosensor	45.2 %RH	39.7 %RH	58.8 %RH	0%	0%	318
Stue - SHT45	59.7 %RH	52.9 %RH	71.9 %RH	43%	0%	176
Møllestien - Stue	65.6 %RH	57.5 %RH	81.4 %RH	88%	0%	206
Zachø - Familiesommerhus	76.6 %RH	60.4 %RH	93.9 %RH	100%	0%	200

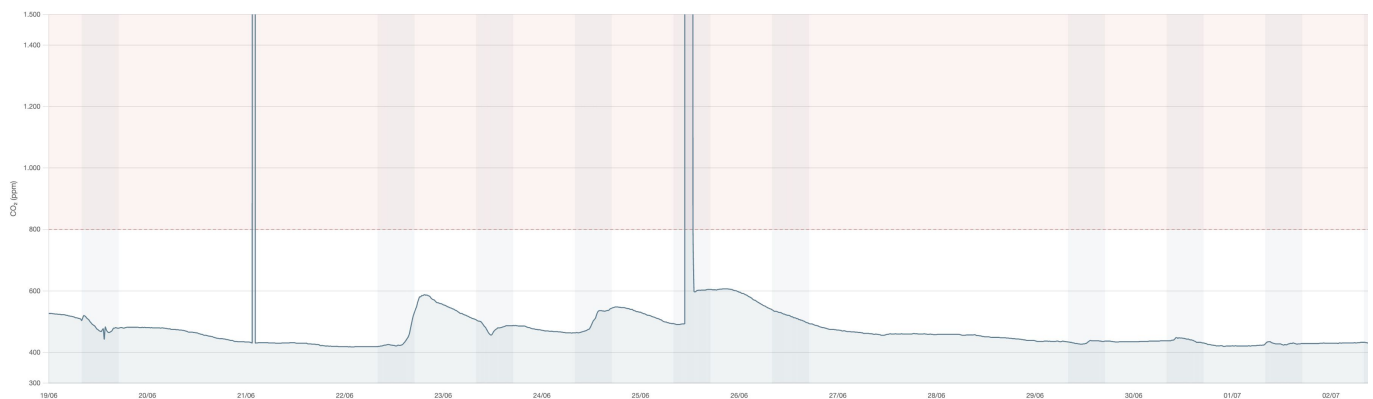CO₂

Sensor	Avg	Min	Max	High	Low	Readings
Full+ - Demosensor	18067 ppm	421 ppm	2796668 ppm	1%	0%	318

VOC

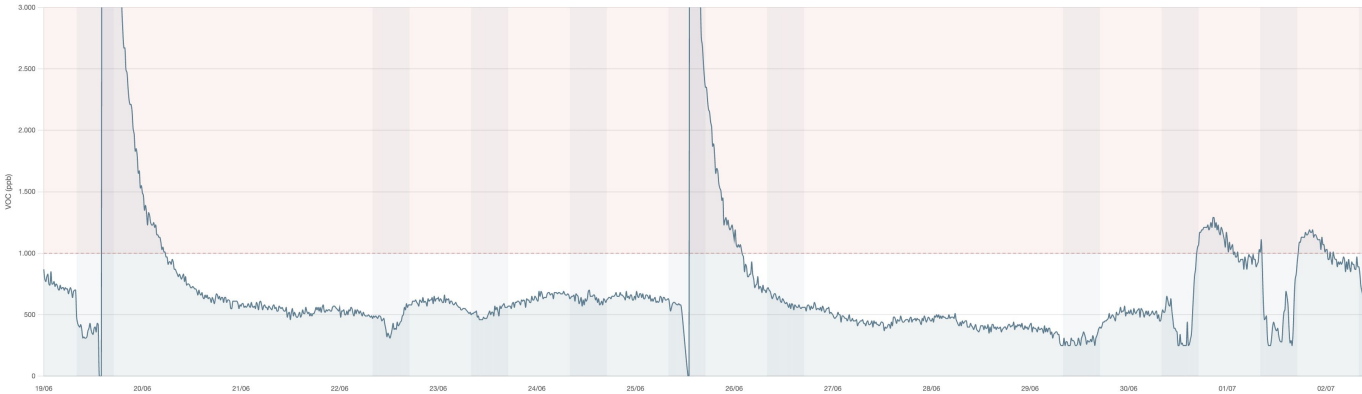


Sensor	Avg	Min	Max	High	Low	Readings
Full+ - Demosensor	1054 ppb	0 ppb	9500 ppb	18%	0%	318

Sensor placement — Floor plans

The floor plans below show the placement of sensors included in this report.

Hovedbygning

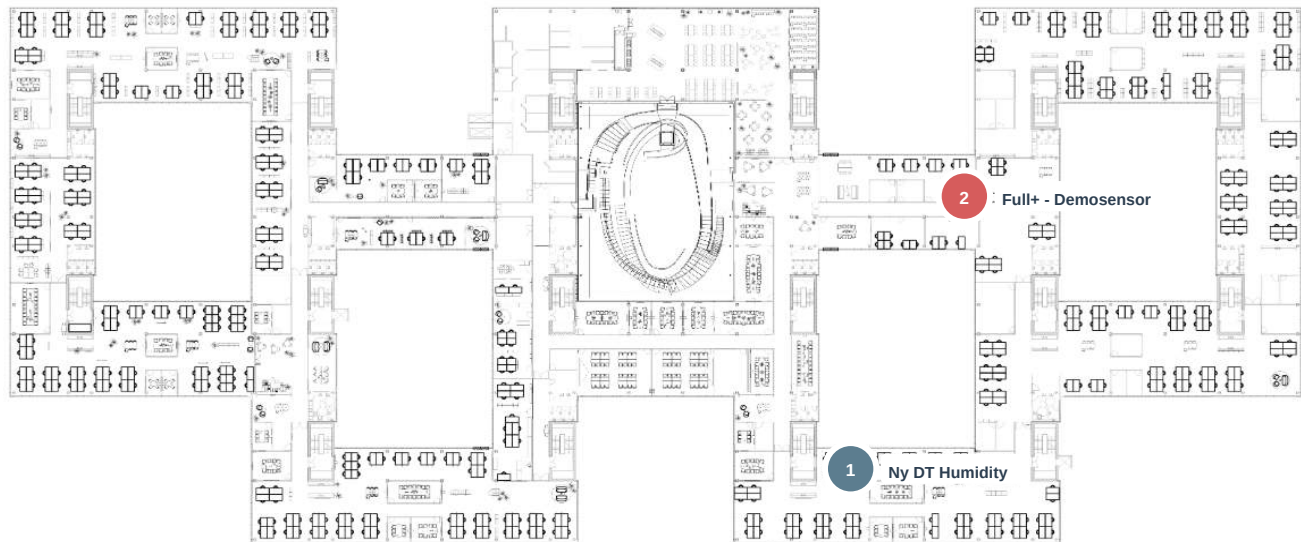

NOTE:
DETTE ER DEN GÆLDENDE INDRETNINGSTEGNING TIL
IMPLEMENTERING - IKKE EN PROJEKTERET TEGNING
TIL OMBYGNINGSARBEJDER.

VISTE PLANER ER FORLØBIGE INDIKATIONER TIL
MÆNGDE OG PLACERING.

INDRETNING		Dato: 2021.11.19.
Sog: 1218_Andel		
FASE: 2 - Work Place Design		
Teknikerbyen 15-45, 2830 Virum		Mål: 1:500 (A3)
Bygning: Ring 1-5		
1. sal - Plantegning		
LAIKA Rumdesign A/S		
Rentemøstervej 62, st		
DK-2400 København NV		
www.laika-rumdesign.dk		

#	Sensor	Zone / Location	Parameters
1	Ny DT Humidity	Sommerhus	Temperature, Relative humidity (RH%)
2	Full+ - Demosensor	Sommerhus	Temperature, Relative humidity (RH%), CO ₂ , VOC

Sensors not placed on any floor plan

#	Sensor	Zone / Location	Parameters
1	Møllestien - Entre	Sommerhus	Temperature, Relative humidity (RH%)
2	Entre - SHT45	Sommerhus	Temperature, Relative humidity (RH%)
3	Stue - SHT45	Sommerhus	Temperature, Relative humidity (RH%)
4	Møllestien - Stue	Sommerhus	Temperature, Relative humidity (RH%)
5	Zacho - Familiesommerhus	Sommerhus	Temperature, Relative humidity (RH%)