

TITLE:

SEWAGE TREATMENT PLANT PROCEDURE MANUAL

Revision No.	Brief Description of Change	Effectivity Date
0	Origination	

	Name	Signature
Originated/ Revised by:	Engr. Roan Paul B. Gallegos Building Maintenance Manager	SEE DCN
Reviewed By:	Engr. Virtron K. Bumal-o QA/QC Manager	SEE DCN
	Engr. Michael D. Corpuz Operations Manager	SEE DCN
	Ms. Richelle D. Eslava HR Manager/QMR	SEE DCN

Approved by:	Ms. Lorraine Ashley Laranang-Josue Finance Director	SEE DCN
Date Approved		

Distribution List

☒ President/CEO
☒ QMR/BOD's

☒ Property Management Office
☒ Building Maintenance Office

☒ Admin (HRD/Fin/ Fac.)
☒ Doc. Con

TITLE:

SEWAGE TREATMENT PLANT PROCEDURE MANUAL**1.0 PURPOSE & SCOPE**

To ensure safe, efficient, and compliant operation of the Sewage Treatment Plant (STP), preventing environmental violations, equipment failure, and health hazards.

2.0 REFERENCES:

- DENR Administrative Orders on wastewater discharge.
- Manufacturer manuals for pumps, blowers, dosing systems.

3.0 DEFINITIONS & ABBREVIATIONS:**3.1 DEFINITIONS**

STP (Sewage Treatment Plant) - Facility designed to treat wastewater from the condominium before discharge.

Influent - Waste water entering the STP system.

Effluent - Treated water discharged from the STP.

Sludge - Semi-solid byproduct of wastewater treatment requiring proper disposal.

Aeration - Process of supplying oxygen to wastewater to support microbial activity.

Clarifier - Tank where solids settle and are separated from treated water.

BOD (Biochemical Oxygen Demand) - Measure of organic matter in wastewater.

COD (Chemical Oxygen Demand) - Measure of chemical pollutants in wastewater.

TSS (Total Suspended Solids) - Solid particles suspended in wastewater.

PPE (Personal Protective Equipment) - Safety gear required during STP operations.

Lock-Out/Tag-Out (LOTO) - Safety procedure to ensure equipment is de-energized before servicing.

3.2 ABBREVIATIONS

DENR - Department of Environmental and Natural Resources

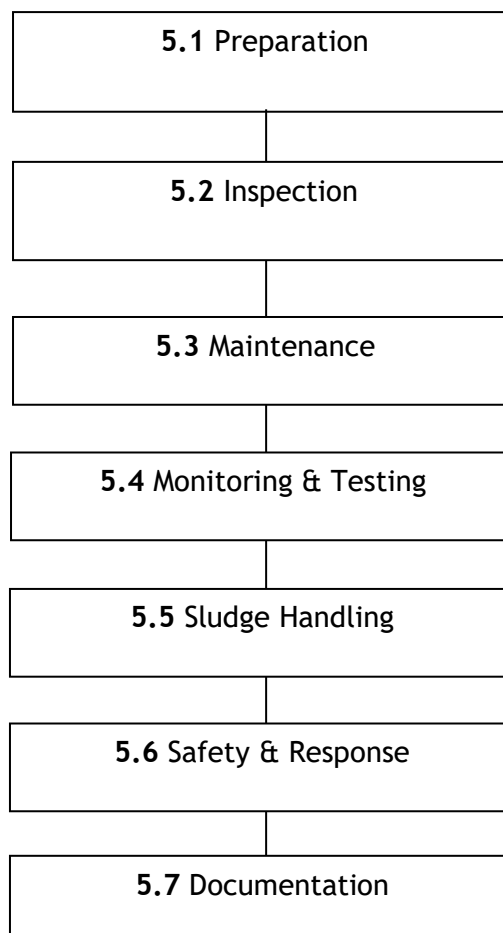
PM - Preventive Maintenance

QA/QC - Quality Assurance / Quality Control

TITLE:

SEWAGE TREATMENT PLANT PROCEDURE MANUAL**O&M** - Operations and Maintenance**4.0 GENERAL REQUIREMENTS:**

The STP must operate in full compliance with DENR and LLDA regulations, maintaining effluent quality within safe limits. Continuous operation must be ensured with backup power available. Personnel shall wear PPE, handle chemicals safely, and record daily readings in logbooks. Preventive maintenance schedules must be strictly followed, reports submitted promptly, and any issues immediately reported to the STP Supervisor and Building Engineer to ensure safety, compliance, and uninterrupted operation.

5.0 PROCEDURE INSTRUCTIONS**PROCEDURE OUTLINE**

TITLE:

SEWAGE TREATMENT PLANT PROCEDURE MANUAL

6.0 PROCEDURE DETAILS

<i>Responsible Person</i>	<i>Activities</i>	<i>Interface Document/ Person</i>
	5.1 Preparation	
STP Technician	Ensure readiness before starting STP task. - Wear PPE (gloves, boots, goggles, mask) - Gather tools, chemicals, and logbook - Check equipment power and safety status	STP Supervisor
	5.2 Inspection	
STP Technician	Identify issues and record system conditions. - Visual check of tanks, pumps, blowers, pipelines - Record influent/effluent readings (flow, pH, odor) - Check for leaks, noise, or abnormal conditions	BM Supervisor
	5.3 Maintenance	
STP Technician	Perform routine upkeep to sustain operations. - Clean inlet screens and strainers. - Refill chemical dosing system. - Lubricate parts and flush pipelines.	BM Supervisor
	5.4 Monitoring and Testing	
STP Technician	Verify treatment quality and equipment accuracy. - Test effluent parameters (pH, BOD, COD, TSS) - Calibrate meters and sensors. - Log results and submit reports.	BM Supervisor
	5.5 Sludge Handling	
STP Technician	Manage sludge and scum safely. - Remove sludge and scum from tanks - Dispose per DENR guidelines - Clean and disinfect equipment	BM Supervisor
	5.6 Safety and Response	
STP Technician/ Safety Officer	Protect personnel and respond to emergencies.	Safety Officer

TITLE:

SEWAGE TREATMENT PLANT PROCEDURE MANUAL

	• Apply lock - out/ tag- out before servicing • Use spill kits for leaks	
	Report incidents immediately	
	5.7 Documentation	
STP Technician/BM Supervisor	Maintain compliance and accountability. • Complete daily log entries with signature • Submit preventive maintenance checklists File compliance reports	BM Supervisor

6.0 APPENDICES

- Daily Logbook
- Preventive Maintenance Checklist
- Incident Report Form
- Purchase Requisition Form